

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 87-121

WASTE DISCHARGE REQUIREMENTS
FOR
GROVELAND COMMUNITY SERVICES DISTRICT
AND PINE MOUNTAIN LAKE ASSOCIATION
WASTEWATER TREATMENT AND DISPOSAL
TUOLUMNE COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Groveland Community Services District and Pine Mountain Lake Association (hereafter Discharger) submitted a Report of Waste Discharge, dated 14 May 1986, and project report, dated 24 November 1986. The treatment facility property is owned by the Discharger.
2. The Board, on 22 July 1977, adopted Order No. 77-216, which prescribed requirements for a discharge from the Groveland wastewater treatment plant, followed by reservoir storage and disposal.
3. The Groveland Community Services District expanded its activated sludge treatment plant capacity to 400,000 gpd in 1986. Present flows average 150,000 gpd. Expansion improvements included upgrading the influent and effluent pumps, sludge pump, sludge decanting and drawing system, air control system, and solids disposal system; increased clarifier and chlorine contact basin capacity; installation of a rotostrainer and modification of the plant headworks. Plant effluent is stored in the system's effluent reservoirs during winter and applied on land by spray irrigation during the summer.
4. Due to the dynamics of growth in this foothill community, continual planning is necessary to assure adequate treatment, storage, and disposal capacity. Projections indicate treatment capacity will be adequate to the year 2005. The District has assured the Board that continual planning for, and implementation of, adequate storage and disposal capacity will take place to conform with the discharge prohibitions of this Order.
5. During the winter months, treated effluent is stored in two reservoirs. As of 1987, the combined capacity of this system totaled 135 acre-feet. Additional storage capacity may be achieved by elevating the existing dam on storage reservoir No. 2, and/or pursuing off-site storage on ranch lands to the northwest of the plant.
6. During the summer months, treated effluent is pumped to a 3.0 million gallon storage pond on the Pine Mountain Lake golf course, commingled with lake water as necessary to keep the pond full, and spray irrigated on the course

WASTE DISCHARGE REQUIREMENTS
GROVELAND COMMUNITY SERVICES DISTRICT
AND PINE MOUNTAIN LAKE ASSOCIATION
WASTEWATER TREATMENT AND DISPOSAL
TUOLUMNE COUNTY

-2-

grounds. In addition, treated effluent may be sprayed on the District's property. A long-term contract with the Pine Mountain Lake Association allows for disposal of a maximum of 315 acre-feet/year. Additional disposal capacity can be achieved by expanding the District's on-site disposal system.

7. The District operates 16 raw sewage lift stations. In 1986 and early 1987, to eliminate sewage spillage from these stations, the District upgraded and rehabilitated the existing telemetry and pump control system.
8. Due to a rehabilitated sewage conveyance system and strict quality controls imposed on the construction of additional connections, infiltration and inflow (I/I) problems are anticipated to be minimal for this plant. The maximum amount of I/I is expected to remain constant (0.02 mgd dry weather flow, 0.08 mgd, wet weather flow) over a 40-year period.
9. In the past, the Discharger has disposed of septage, recreational vehicle, and chemical toilet waste into an unlined pit at the treatment plant site. The Discharger has agreed to discontinue this practice and evaluate alternative means of receiving and disposing of this type of waste.
10. Present waste discharge requirements established by Order No. 77-216 are neither adequate nor consistent with plans and policies of the Board.
11. The Groveland wastewater treatment plant is in Section 21, T1S, R16E, MDB&M, with surface water drainage to Pine Mountain Lake.
12. The beneficial uses of Pine Mountain Lake are domestic and agricultural supply; recreation; esthetic enjoyment; ground water recharge; fresh water replenishment; and preservation and enhancement of fish, wildlife and other aquatic resources.
13. The beneficial uses of the ground water are domestic and agricultural supply.
14. The Board, on 25 July 1975, adopted a Water Quality Control Plan for the San Joaquin River Sub-Basin (5C), which contains water quality objectives. These requirements are consistent with that Plan.
15. The action to prescribe waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301, Title 14, California Administrative Code.
16. The wastewater discharge is exempt from the requirements of Subchapter 15, Chapter 3, Title 23, of the California Administrative Code (CAC), pursuant to Section 2511(b).

WASTE DISCHARGE REQUIREMENTS
GROVELAND COMMUNITY SERVICES DISTRICT
AND PINE MOUNTAIN LAKE ASSOCIATION
WASTEWATER TREATMENT AND DISPOSAL
TUOLUMNE COUNTY

-3-

17. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
18. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 77-216 be rescinded and Groveland Community Services District and Pine Mountain Lake Association, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste is prohibited.
3. Public contact with plant effluent is prohibited.
4. Resurfacing of wastewater percolating from the reservoirs or irrigation areas is prohibited.

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a pollution or nuisance as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal area at all times.
4. Reclaimed wastewater shall meet the criteria contained in Title 22, Division 4, California Administrative Code (Section 60301, et seq.)
5. The following constituent limitation shall apply to wastewater discharged to holding reservoirs and spray fields:

WASTE DISCHARGE REQUIREMENTS
GROVELAND COMMUNITY SERVICES DISTRICT
AND PINE MOUNTAIN LAKE ASSOCIATION
WASTEWATER TREATMENT AND DISPOSAL
TUOLUMNE COUNTY

-4-

<u>Constituents</u>	<u>Units</u>	<u>Monthly Average</u>	<u>Weekly Median</u>	<u>Daily Maximum</u>
20°C BOD ₅	mg/l	30		80
Total Coliform Organisms	MPN/100 ml		23	240

6. The following constituent limitation shall apply to wastewater discharged to the spray fields:

<u>Constituent</u>	<u>Units</u>	<u>Monthly Average</u>	<u>Daily Maximum</u>
Settleable Matter	ml/l hr	0.5	1.0

7. The Discharger's treated effluent storage reservoirs shall have a minimum freeboard of 24 inches.
8. The Discharger may not spray dispose of effluent during periods of precipitation or for at least 24 hours after cessation of precipitation.
9. The 30-day average daily dry weather plant influent flow shall not exceed 400,000 gallons.
10. Peak daily wet weather plant influent flow shall not exceed 500,000 gallons.
11. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
12. The dissolved oxygen content of all reservoirs shall not be less than 1.0 mg/l for 16 hours in any 24-hour period.
13. Effluent discharged to the spray fields shall be managed to minimize erosion, runoff, and aerosol movement from the disposal area.
14. Septage, chemical toilet waste, and recreational vehicle waste shall only be discharged to the treatment system in a manner approved by the Executive Officer.

C. Provisions:


1. The Discharger may be required to submit technical reports as directed by the Executive Officer.

WASTE DISCHARGE REQUIREMENTS
GROVELAND COMMUNITY SERVICES DISTRICT
AND PINE MOUNTAIN LAKE ASSOCIATION
WASTEWATER TREATMENT AND DISPOSAL
TUOLUMNE COUNTY

-5-

2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 87-121.
3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 September 1985, which are a part of this Order.
4. The Discharger shall submit, by 15 November 1987, an interim report appraising any existing or potential threat to water quality resulting from past operation of the unlined septage receiving impoundment. This report should include plans and a time schedule for reclassification or closure of the impoundment.
5. The Discharger shall submit, for staff approval, a detailed report on septage, recreational vehicle, chemical toilet, and sludge treatment and disposal practices by 15 February 1988. Practices shall meet the requirements of Subchapter 15 of Title 23.
6. The Discharger shall report promptly to the Board any material change or proposed change in the character, location, or volume of the discharge.
7. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
8. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 26 June 1987.



WILLIAM H. CROOKS, Executive Officer

Revised:6/1/87:GDS:gs

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 87-121

FOR
GROVELAND COMMUNITY SERVICES DISTRICT
AND PINE MOUNTAIN LAKE ASSOCIATION
WASTEWATER TREATMENT AND DISPOSAL
TUOLUMNE COUNTY

INFLUENT MONITORING

The following shall constitute the influent monitoring program:

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Flow	mgd	Cumulative	Daily

A log shall be kept which quantifies the amount of septage, recreational vehicle, and chemical toilet waste received by the District on a monthly basis. This information shall be included in the monthly monitoring report.

EFFLUENT MONITORING

Effluent samples shall be collected downstream from the last connection through which wastes can be admitted into the effluent reservoir or spray disposal system. Effluent samples should be representative of the volume and nature of the discharge. Time of collection of a grab sample shall be recorded. The following shall constitute the effluent monitoring program:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
20°C BOD ₅	mg/l	Grab	Weekly
Settleable Matter	ml/l	Grab	Weekly
Coliform	MPN/100 ml	Grab	Three Times/Week

EFFLUENT RESERVOIR MONITORING

<u>Constituents</u>	<u>Units</u>	<u>Sampling Frequency</u>
Dissolved Oxygen	mg/l	Weekly
Reservoir Elevation	Feet	Daily

In conducting the water sampling, a log shall be kept of the effluent reservoirs condition. Attention shall be given to the presence or absence of:

MONITORING AND REPORTING PROGRAM
GROVELAND COMMUNITY SERVICES DISTRICT
AND PINE MOUNTAIN LAKE ASSOCIATION
WASTEWATER TREATMENT AND DISPOSAL
TUOLUMNE COUNTY

-2-

- a. Floating or suspended matter
- b. Discoloration
- c. Bottom deposits
- d. Aquatic life

Notes on irrigated area/conditions shall be summarized in the monitoring report.

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the 15th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

→ The Discharger shall submit a report to the Board by 15 February 1988 and 30 January of each subsequent year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharge shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

This report will include an annual analysis and evaluation of the District's treatment, storage, and disposal capacity. The information provided should parallel that presented in "Wastewater Treatment Plant and Disposal Study for Groveland Community Services District, November 1986". The report should clearly review the District's previous year's data on wastewater flows and evaluate future projections on storage and disposal.

The annual report shall include documentation of septage, recreational vehicle, chemical toilet, and sludge management practices for the previous year and projections for the current year. This shall include the amount of sludge generated and disposed of, as well as disposal methods.

The first annual report shall include a detailed description and discussion of the design and operation of the reclaimed wastewater system. Special attention should be given to the transmission and distribution systems, and use areas. At a

MONITORING AND REPORTING PROGRAM
GROVELAND COMMUNITY SERVICES DISTRICT
AND PINE MOUNTAIN LAKE ASSOCIATION
WASTEWATER TREATMENT AND DISPOSAL
TUOLUMNE COUNTY

-3-

minimum, this should include maps and/or diagrams of the golf course and spray field layout, spray field operational parameters, and methods applied to assure compliance with Discharge Prohibition No. 3, and Discharge Specification Nos. 4 and 13. Subsequent annual reports will address any significant proposed or implemented changes in the reclamation system, when appropriate.

The Discharger shall implement the above monitoring program on the effective date of this Order.

Ordered by



WILLIAM H. CROOKS, Executive Officer

26 June 1987

Date

Revised: 6/1/87:GDS:gs

INFORMATION SHEET

GROVELAND COMMUNITY SERVICES DISTRICT AND PINE MOUNTAIN LAKE ASSOCIATION WASTEWATER TREATMENT AND DISPOSAL TUOLUMNE COUNTY

Groveland Community Services District (GCSD) Wastewater Treatment and Disposal System, located in the Community of Groveland, serves the wastewater disposal needs of that community, the Pine Mountain Lake subdivision, and the nearby community of Big Oak Flat. The District expanded its treatment capacity in 1986 to 400,000 gpd. Present flow averages 150,000.


Plant effluent is stored in the system's effluent reservoirs during winter and applied on land by spray irrigation during the summer. The District maintains a long-term contract with the Pine Mountain Lake Association to store and dispose of up to 315 acre-feet of effluent on the Pine Mountain Golf Course. Surface water drainage in this area is to Pine Mountain Lake.

Specific treatment improvements include a rotostrainer system; increased aeration and pumping capacity; an oxygen control system; a new solids handling system; and increased disinfection facilities. The District also recently rehabilitated its sewage conveyance system and lift station telemetry system. Due to the dynamic nature of growth and seasonal occupancy of this foothill area, continual planning is necessary to assure adequate treatment, storage, and disposal capacity. The District has assured the Board of a commitment to continual planning for, and implementation of, adequate storage and disposal capacity to conform with the prohibitions of this Order.

The Discharger has agreed to discontinue the practice of receiving septage, recreational vehicle, and chemical toilet waste in an on-site, unlined pit and to evaluate alternative modes of treatment/disposal of this type of waste.

Waste discharge requirements are being updated to reflect the changes in the treatment system. As a requirement of this Order, the District will submit an annual evaluation of the projections and plans for continuing storage and disposal of treated effluent.

Revised:6/1/87:GDS:gs

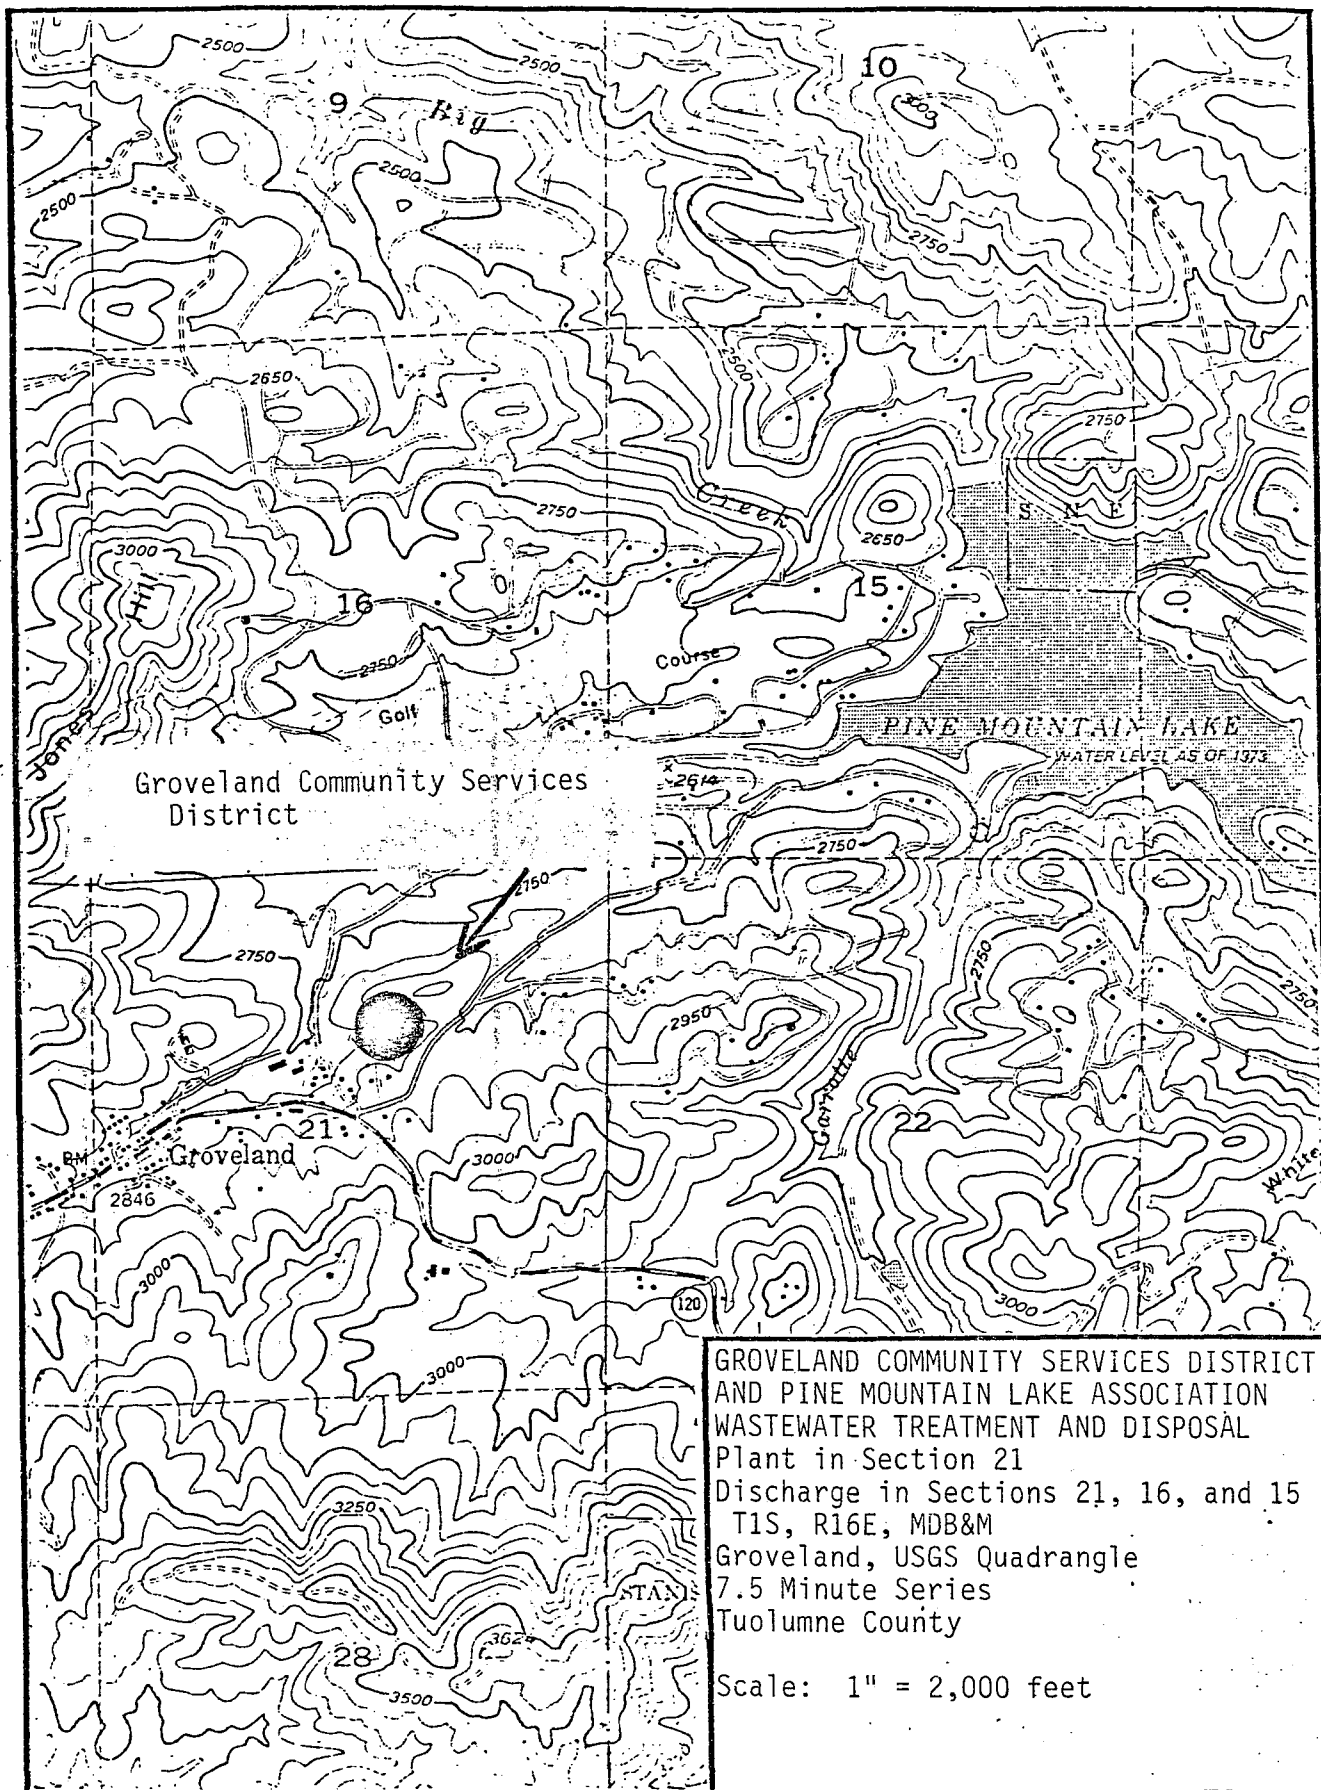

GROVELAND COMMUNITY SERVICES DISTRICT
AND PINE MOUNTAIN LAKE ASSOCIATION
WASTEWATER TREATMENT AND DISPOSAL
Plant in Section 21
Discharge in Sections 21, 16, and 15
T1S, R16E, MDB&M
Groveland, USGS Quadrangle
7.5 Minute Series
Tuolumne County

Scale: 1" = 2,000 feet