

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION**

ORDER NO. 94-013

**WASTE DISCHARGE REQUIREMENTS
FOR
PRINCETON WATER WORKS DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY**

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Princeton Water Works District (hereafter Discharger) submitted a Report of Waste Discharge, dated 16 November 1993, for their wastewater treatment and disposal facility. The property is owned by the Discharger.
2. Waste Discharge Requirements Order No. 87-122, adopted by the Board on 26 June 1987, prescribes requirements for a discharge from the community of Princeton to an aeration ditch for treatment and evaporation/percolation ponds for disposal.
3. Order No. 87-122 is neither adequate nor consistent with current plans and policies of the Board.
4. The wastewater facility design flow is 40,000 gpd and consists of an influent pump station, a concrete lined aeration ditch and two evaporation/percolation ponds.
5. The Discharger discharges approximately 18,260 gallons per day of domestic wastewater to the treatment/disposal facility.
6. The wastewater treatment/disposal facility is in Section 19, T18N, R1W, MDB&M, with surface water drainage to the Sacramento River, as shown in Attachment A, which is attached hereto and part of the Order by reference.
7. The Board adopted a Water Quality Control Plan, Second Edition, for the Sacramento River Basin (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.
8. The beneficial uses of the Sacramento River are municipal, industrial, and agricultural supply; recreation; esthetic enjoyment; navigation; ground water recharge; fresh water replenishment; and preservation and enhancement of fish, wildlife, and other aquatic resources.

WASTE DISCHARGE REQUIREMENTS
PRINCETON WATER WORKS DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY

-2-

9. The beneficial uses of underlying ground water are domestic, industrial, and agricultural supply.
10. The action to update waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act (CEQA), in accordance with Title 14, California Code of Regulations (CCR), Section 15301.
11. This discharge is exempt from the requirements of Title 23, CCR, Section 2510, et seq. (hereafter Chapter 15). The exemption, pursuant to Section 2511(b), is based on the following:
 - a. The Board is issuing waste discharge requirements, and
 - b. The discharge complies with the Basin Plan, and
 - c. The wastewater does not need to be managed according to 22 CCR, Division 4, Chapter 30, as a hazardous waste.
12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 87-122 is rescinded and Princeton Water Works District, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.

WASTE DISCHARGE REQUIREMENTS
PRINCETON WATER WORKS DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY

-3-

2. Bypass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous' or 'designated', as defined in Sections 2521(a) and 2522(a) of Chapter 15, is prohibited.

B. Discharge Specifications:

1. The monthly average dry weather discharge flow shall not exceed 0.04 million gallons/day.
2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment and disposal areas.
3. As a means of discerning compliance with Discharge Specification No. 2, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
4. The treatment and disposal facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
5. Ponds shall not have a pH less than 6.5 or greater than 8.5.
6. Ponds shall be managed to prevent breeding of mosquitos. In particular,
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
7. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.

WASTE DISCHARGE REQUIREMENTS
PRINCETON WATER WORKS DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY

-4-

8. Ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the nonirrigation season. Design seasonal precipitation shall be based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns. Freeboard shall never be less than two feet (measured vertically to the lowest point of overflow).

9. On or about 1 October of each year, available pond storage capacity shall at least equal the volume necessary to comply with Discharge Specification 8.

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15, Division 3, Title 23, of the California Code of Regulations and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice from a previously approved practice shall be reported to the Executive Officer and U.S. Environmental Protection Agency (EPA) Regional Administrator at least 90 days in advance of the change.
3. Use and Disposal of sewage shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.

If the State Water Resources Control Board and the Regional Water Quality Control Boards are given the authority to implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR 503 whether or not they have been incorporated into this Order.

4. The Discharger is encouraged to comply with the State Guidance Manual issued by the Department of Health Services titled *Manual of Good Practice for Landspreading of Sewage Sludge*.

WASTE DISCHARGE REQUIREMENTS
PRINCETON WATER WORKS DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY

-5-

D. Ground Water Limitations:

The discharge shall not cause underlying ground water to:

1. Contain waste constituents in concentrations statistically greater than receiving water limits, where specified below, or background water quality where not specified.
2. Contain chemicals, heavy metals, or trace elements in concentrations that adversely affect beneficial uses or exceed maximum contaminant levels specified in 22 CCR, Division 4, Chapter 15.
3. Exceed a most probable number of total coliform organisms of 2.2/100 ml over any seven-day period.
4. Exceed concentrations of radionuclides specified in 22 CCR, Division 4, Chapter 15.
5. Contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.
6. Contain concentrations of chemical constituents in amounts that adversely affect agricultural use.

E. Provisions:

1. The Discharger shall comply with the Monitoring and Reporting Program No. 94-013, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The wastewater treatment/disposal plant shall be supervised and operated by persons possessing certificates of appropriate grade in accordance with California Code of Regulations, Title 23, Division 4, Chapter 14, and State Water Code Section 13627.

WASTE DISCHARGE REQUIREMENTS
PRINCETON WATER WORKS DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY

-6-

3. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
4. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
5. At least 90 days prior to termination or expiration of any lease, contract, or agreement involving disposal or reclamation areas or off-site reuse of effluent, used to justify the capacity authorized herein and assure compliance with this Order, the Discharger shall notify the Board in writing of the situation and of what measures have been taken or are being taken to assure full compliance with this Order.
6. The Discharger shall use the best practicable cost-effective control technique currently available to comply with salinity limits specified in this order.
7. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
8. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
9. If reclaimed water is used for construction purposes, it shall comply with the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes". Other uses of reclaimed water not specifically authorized herein shall be subject to the approval of the Executive Officer and shall comply with 22 CCR, Division 4.

WASTE DISCHARGE REQUIREMENTS
PRINCETON WATER WORKS DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY

-7-

10. The Board will review this Order periodically and will revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 28 January 1994.

A handwritten signature in cursive script, reading "William H. Crooks", is written over a horizontal line.

WILLIAM H. CROOKS, Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 94-013
FOR

PRINCETON WATER WORKS DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY

Specific sample station locations shall be established under direction of the Board's staff and a description of the stations shall be attached to this Order.

INFLUENT MONITORING

<u>Constituent</u>	<u>Units</u>	<u>Sample Type</u>	<u>Sample Frequency</u>
Flow	gallons/day	meter	continuous

POND MONITORING

<u>Constituent</u>	<u>Units</u>	<u>Sample Type</u>	<u>Sample Frequency</u>
Freeboard	Feet	Measure	Monthly
Color	—	observation	Monthly
Odors	—	observation	Monthly
Levee Condition	—	observation	Monthly

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the 20th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

MONITORING AND REPORTING PROGRAM
PRINCETON WATER WORKS DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY

-2-

Upon written request of the Board, the Discharger shall submit a report to the Board by **30 January** of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring program as of the date of this Order.


Ordered By: William H. Crooks

WILLIAM H. CROOKS, Executive Officer

28 January 1994

(Date)

ATTACHMENT A

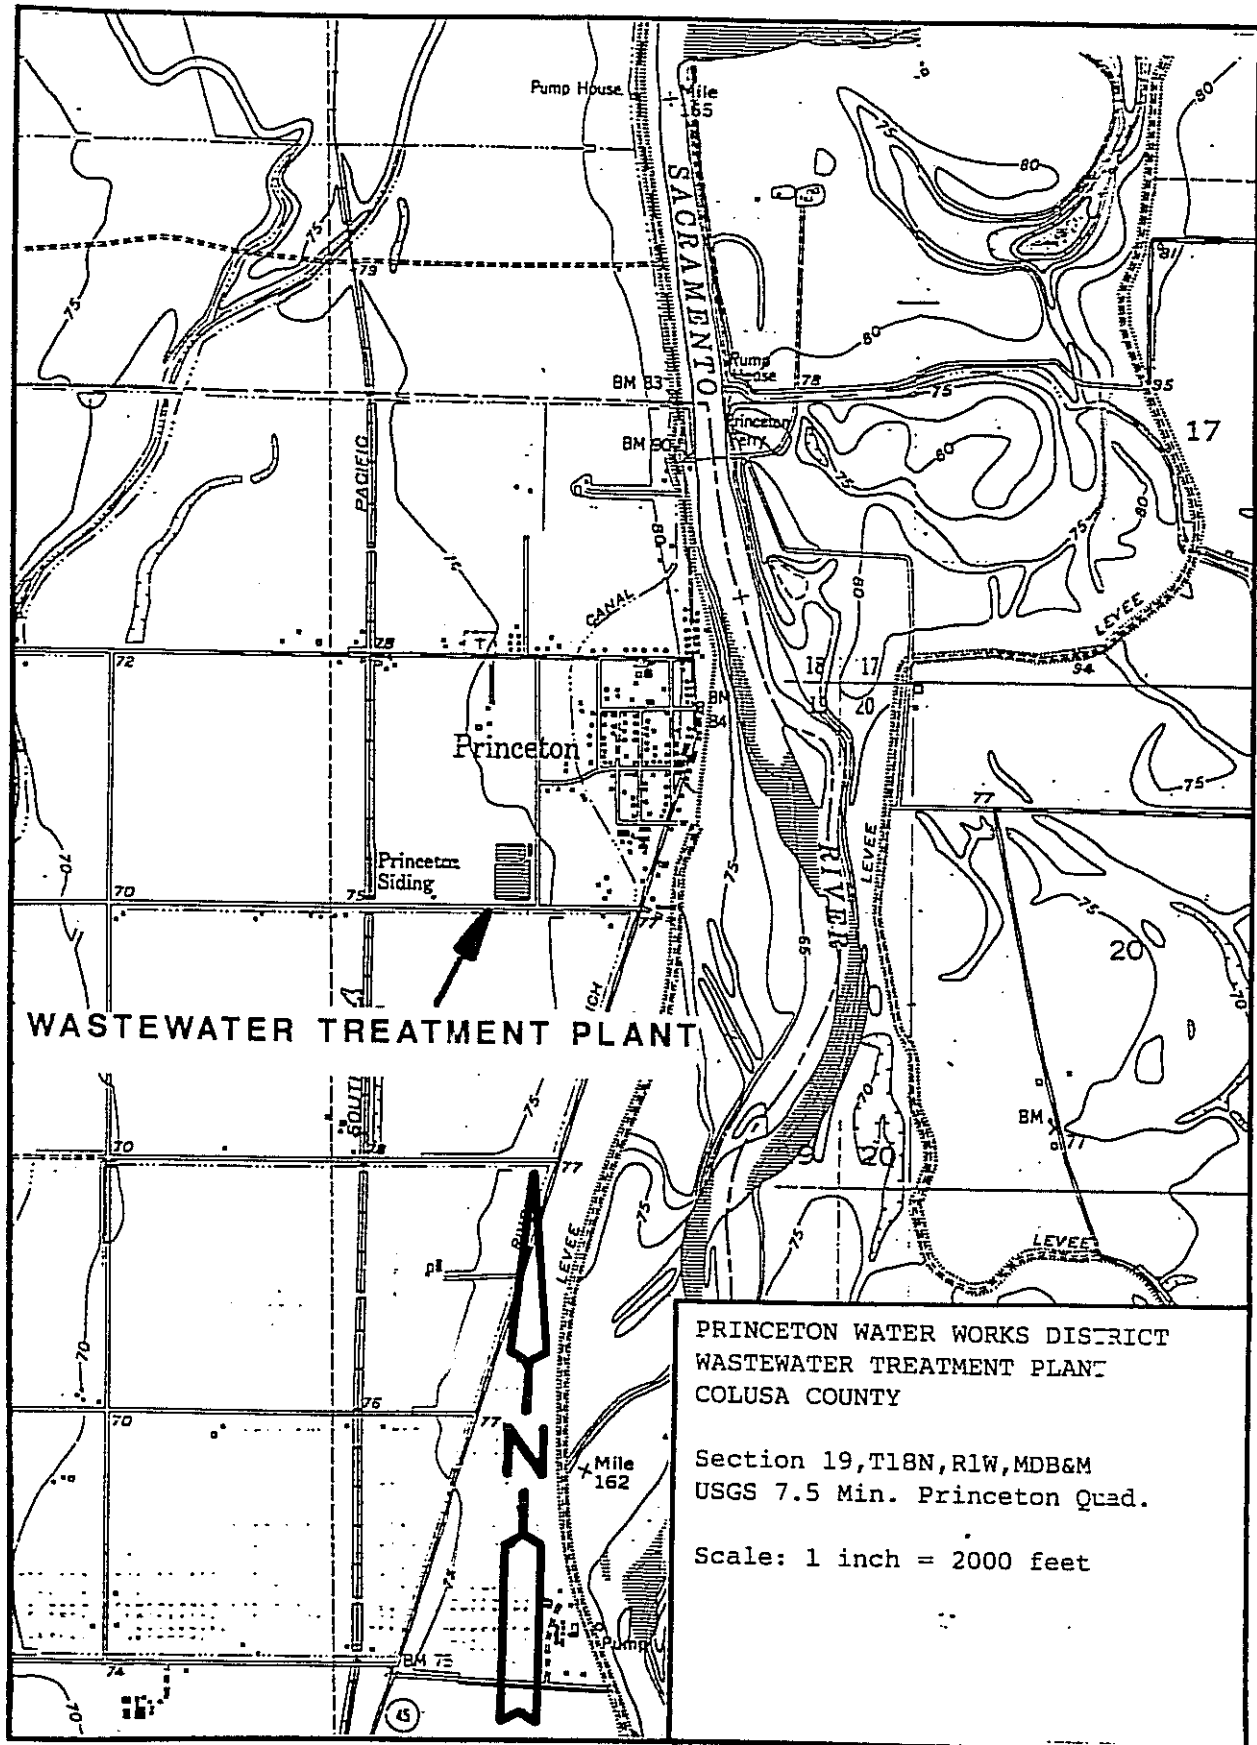

INFORMATION SHEET

PRINCETON WATER WORKS DISTRICT WASTEWATER TREATMENT PLANT COLUSA COUNTY

The Princeton Water Works District discharges approximately 18,260 gallons per day (gpd) of domestic wastewater to their treatment/disposal facility. The facility was designed to treat 40,000 gpd and consists of an influent pump station, a concrete lined aeration ditch and two evaporation/percolation ponds. The community of Princeton is in the northeast of Colusa County on the west bank of the Sacramento River. The wastewater treatment/disposal facility is on the southwest edge of town.