

06

California Regional Water Quality Control Board
North Coast Region

Order No. 98-125
ID No. 1B98055RSON

Waste Discharge Requirements

for

Odd Fellows Recreation Club
Odd Fellows Park

Lower Russian River
(Guerneville)

Sonoma County

The California Regional Water Quality Control Board, North Coast Region, (hereinafter the Regional Water Board) finds that:

1. The Odd Fellows Recreation Club (hereinafter discharger) submitted a Report of Waste Discharge dated August 6, 1998, to discharge domestic wastewater from a series of septic tanks to a leachfield system. Additional information was submitted on November 30, 1998.
2. The discharger has owned and operated the 375 acre Odd Fellows Park for approximately 70 years. Odd Fellows Park includes approximately 200 cabins and houses of mostly seasonal use, a campground, summer rental cabins, and various other community buildings and recreational facilities. Ninety percent of the property is sloping mixed conifer forest with the remaining property consisting of a relatively flat flood plain terrace with approximately one mile of river frontage.
3. The site is located along the south bank of the lower Russian River approximately two miles upstream of Guerneville, latitude $38^{\circ} 30'$ and longitude $122^{\circ} 57'$ (Figure 1). Currently, all sewage disposal is handled by various types of on-site septic systems, many of which are substandard, consisting of cesspools, seepage pits, or other substandard septic tank-leachfield systems; many of these are in need of replacement or upgrade. Septic system failures in the Odd Fellows Park have been documented by the Sonoma County Permit and Resource Management Department. Steep slopes and lack of suitable soils and land area to permit individual septic system upgrades in the hillside residential area dictates that a community sewerage system is desirable for the entire Park.
4. The discharger submitted a Master Plan describing expected maximum daily flows, layout of septic tanks and leachfields, zone of contribution for the two on-site domestic water wells, and a maintenance and monitoring program for the

community sewerage system. A detailed study was performed to assure that groundwater in the area would not be adversely impacted by high nitrate levels. Total expected daily design flows are expected to be approximately 39,800 gallons per day during the summer season and approximately 12,600 gallons per day during the winter season. Design capacity of the domestic wastewater disposal system is 45,000 gallons per day. The discharger has indicated that the site contains 25 acres of well drained alluvial loamy sand and sandy loam soils with percolation rates averaging 1.3 minutes per inch and winter groundwater levels in excess of 10 feet below ground surface.

5. The wastewater conveyance, treatment, and disposal system will be separated into four service areas for the resident homes, rental cabins, community buildings, and campground and teen center.
 - a. Resident homes and campground will be serviced by a central collection system, individual and cluster septic tanks, and leachfield systems 001 and 002. A portion of leachfield system 001 is located within the 10-year flood plain. The remainder of 001 is more than 100 feet outside of the 10-year flood plain. Due to these limitations the 001 leachfield system will only be used in the summer months. Leachfield system 002 is located greater than 100 feet from the 10-year flood plain and will only be used in the winter.
 - b. Rental cabins will be serviced by a central collection system, single septic tank, and leachfield system 003 located in the 10-year flood zone. This system (003) will only be utilized during the summer months.
 - c. Community buildings will be serviced by a collection system, septic tanks, and leachfield system 004 year-round.
 - d. Teen center will be serviced by existing septic tanks and leachfield systems 005 year-round.

All leachfield systems will be monitored by wells placed to evaluate field performance and groundwater impacts (Figure 2).

6. Domestic water is supplied by two on-site wells drawing water from alluvial deposits hydraulically connected to the Russian River. The discharger has determined the zone of contribution for each well and found the leachfields to be downgradient of both zones of contribution.
7. Soil and groundwater investigations were conducted in conformance with the regulations of the Sonoma County Permit and Resource Management Department, Division of Environmental Health; Water Quality Control Plan for the North Coast Region, On-site Waste Treatment and Disposal Practices; and State Department of Health Services, Draft Drinking Water Source Assessment and Protection Program.
8. The Regional Water Board Water Quality Control Plan for the North Coast Region includes water quality objectives and receiving water limitations.

9. The beneficial uses of the Russian River include:
 - a. municipal and domestic supply
 - b. agricultural supply
 - c. industrial service supply
 - d. industrial process
 - e. groundwater recharge
 - f. freshwater replenishment
 - g. navigation
 - h. hydropower generation
 - i. water contact recreation
 - j. noncontact water recreation
 - k. agricultural
 - l. warm freshwater habitat
 - m. cold freshwater habitat
 - o. estuarine habitat
 - q. wildlife habitat
 - r. preservation of areas of special biological significance
 - s. preservation of rare and endangered species
 - t. migration of aquatic organisms
 - u. spawning, reproduction, and/or early development
10. Beneficial uses of areal groundwaters include:
 - a. domestic water supply
 - b. agricultural water supply
 - c. industrial service supply
 - d. industrial process supply
11. A Mitigated Negative Declaration was prepared and approved by the County of Sonoma on October 26, 1998. The County found that the following impacts could be potentially significant unless mitigated by the issuance of Waste Discharge Requirements:
 - a. Two community domestic wells serving the Odd Fellows Recreation Club are located up-gradient from the leachfield with the closest well being approximately 100 feet from the proposed leachfield site. The leachfields may impact the domestic wells.
 - b. Portion of the subsurface leachfield systems are within the 10-year flood plain and may become inundated during 10-year flood events.
12. The Regional Water Board has considered the Negative Declaration. The following requirements in these Waste Discharge Requirements will mitigate the above impacts to a less than significant level:

- a. Groundwater monitoring wells located around the two community domestic wells will be monitored monthly for nitrates, and total and fecal coliform and groundwater elevations. In addition, both domestic wells will be monitored monthly for nitrates, and total and fecal coliform.
 - b. The discharge of waste to the system which serves the rental cabins (System 003) that is located in the 10-year flood plain is prohibited between November 1 and May 14 each year. Waste from the resident homes is prohibited from being discharged to the summer disposal area (System 001) between November 1 and May 14 each year. During the winter months (November 1 and May 14 Each year) waste from the resident homes will only be discharged to the winter disposal area (System 002), which is located outside the 10-year flood plain.
13. The permitted discharge is consistent with antidegradation policy State Water Resources Control Board Resolution No. 68-16, impact on existing water quality will be insignificant.
 14. The Regional Water Board has notified the discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations.
 15. The Regional Water Board, in a public meeting, heard and considered all comments pertaining to the discharge.

THEREFORE, IT IS HEREBY ORDERED that in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, the discharger shall comply with the following:

A. DISCHARGE PROHIBITIONS

1. The discharge of any waste not specifically regulated by this Order is prohibited.
2. Creation of a pollution, contamination, or nuisance, as defined by Section 13050 of the California Water Code (CWC), is prohibited. [Health and Safety Code, Section 5411]
3. The discharge of waste to land that is not under the control of the discharger is prohibited.
4. Wastewater from anywhere within the collection, treatment, or disposal facility must be kept underground at all times.

5. The total daily waste flow to all systems that serve the park shall not exceed 45,000 gallons per day.
6. The discharge of waste to the system which serves the resident homes (system 001) (Bocce Courts) is prohibited between November 1 and May 14 each year.
7. The discharge of waste to the system which serves the rental cabins (System 003) is prohibited between November 1 and May 14 each year.
8. The daily waste flow to System 001 shall not exceed 40,000 gallons per day from May 15 through October 31 each year.
9. The daily waste flow to System 002 shall not exceed 12,000 gallons per day between November 1 and May 14 each year. The discharge of waste to the System 002 is prohibited between May 15 and October 31 each year.
10. The discharge of wastewater from the Odd Fellows Recreation Club to the Russian River or its tributaries is prohibited.
11. Nitrate concentrations in ground water shall not exceed 10 parts per million.
12. Leachfield replacement areas equivalent to 100 percent of the initial fields shall be reserved for future leachfield repair. Incompatible uses of the initial field or replacement area are prohibited.

B. SOLIDS DISPOSAL

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of at a legal point of disposal, and in accordance with the provisions of Title 23, Division 3, Chapter 15 of the California Code of Regulations or as waived pursuant to Section 13269 of the California Water Code.

C. PROVISIONS

1. All waste treatment and disposal facilities shall be installed in accordance with plans and specifications conforming with all regulations and approved by the Sonoma County Permit and Resource Management Department, Division of Environmental Health and in conformance with the policies and procedures detailed in the Water Quality Control Plan for the North Coast Region, On-site Waste Treatment and Disposal Practices.
2. Depth to groundwater beneath leachfield trench bottoms must be no less than five feet when in use.

3. The Mitigated Negative Declaration identified two potentially significant impacts to groundwater unless they are mitigated with Waste Discharge Requirements. This Order contains Prohibitions, Provisions and a Monitoring and Reporting Program to protect surface and ground water quality.

4. A copy of this Order shall be maintained at the discharge facility and be available at all times to operating personnel.

5. Severability

Provisions of these waste discharge requirements are severable. If any provision of these requirements is found invalid, the remainder of these requirements shall not be affected.

6. Operation and Maintenance

The discharger must maintain in good working order and operate as efficiently as possible any facility or control system installed by the discharger to achieve compliance with the waste discharge requirements. Routine maintenance of the septic tanks, pumping equipment, pump chambers, lift station, and flow records are essential to the operation of this system. The discharger shall develop an operation and maintenance plan for the entire waste treatment and disposal system and submit it to the Regional Water Board prior to operation.

7. Change in Discharge

The discharger must promptly report to the Regional Water Board any material change in the character, location, or volume of the discharge.

8. Change in Ownership

In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the discharger, the discharger must notify the succeeding owner or operator of the following items by letter, a copy of which must be forwarded to the Regional Water Board:

- a. existence of this Order, and
- b. the status of the dischargers' annual fee account

9. Vested Rights

This Order does not convey any property rights of any sort or any exclusive privileges. The requirements prescribed herein do not authorize the commission of any act causing injury to persons or property, nor protect the discharger from his liability under federal, state, or local laws, nor create a vested right for the discharger to continue the waste discharge.

10. Monitoring

The discharger must comply with the Contingency Planning and Notification Requirements Order No. 74-151 and the Monitoring and Reporting Program No. 98-125 and any modifications to these documents as specified by the Executive Officer. Such documents are attached to this Order and incorporated herein. Chemical, bacteriological, and bioassay analyses must be conducted at a laboratory certified for such analyses by the State Department of Health Services.

11. Inspections

The discharger shall permit authorized staff of the Regional Water Board:

- a. entry upon premises in which an effluent source is located or in which any required records are kept;
- b. access to copy any records required to be kept under terms and conditions of this Order;
- c. inspection of monitoring equipment or records; and
- d. sampling of any discharge.

12. Noncompliance

In the event the discharger is unable to comply with any of the conditions of this Order due to:

- a. breakdown of waste treatment equipment;
- b. accidents caused by human error or negligence; or
- c. other causes such as acts of nature;

the discharger must notify the Executive Officer by telephone as soon as he or his agents have knowledge of the incident and confirm this notification in writing within two weeks of the telephone notification. The written notification shall include pertinent information explaining reasons for the noncompliance and shall indicate the steps taken to correct the problem and the dates thereof, and the steps being taken to prevent the problem from recurring.

13. Revision of Requirements

This Regional Water Board requires the discharger to file a report of waste discharge at least 120 days before making any material change or proposed change in the character, location, or volume of the discharge.

14. Adequate Capacity

When the wastewater treatment and disposal system will reach capacity within four years, the discharger shall notify the Regional Water Board. The discharger must demonstrate that adequate steps are being taken to address the capacity problem. The discharger shall submit a technical report to the Regional Water

Board showing how flow volumes will be prevented from exceeding capacity, or how capacity will be increased, within 120 days after providing notification to the Regional Water Board, or within 120 days after receipt of Regional Water Board notification, that the will reach capacity within four years. The time for filing the required technical report may be extended by the Regional Water Board. An extension of 30 days may be granted by the Executive Officer, and longer extensions may be granted by the Regional Water Board itself.

Certification

I, Lee Michlin, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, North Coast Region, on December 10, 1998.

Lee Michlin
Executive Officer

(oddfwdr1)

Site Location Map

Odd Fellows Recreation Club
Odd Fellows Park
Guerneville

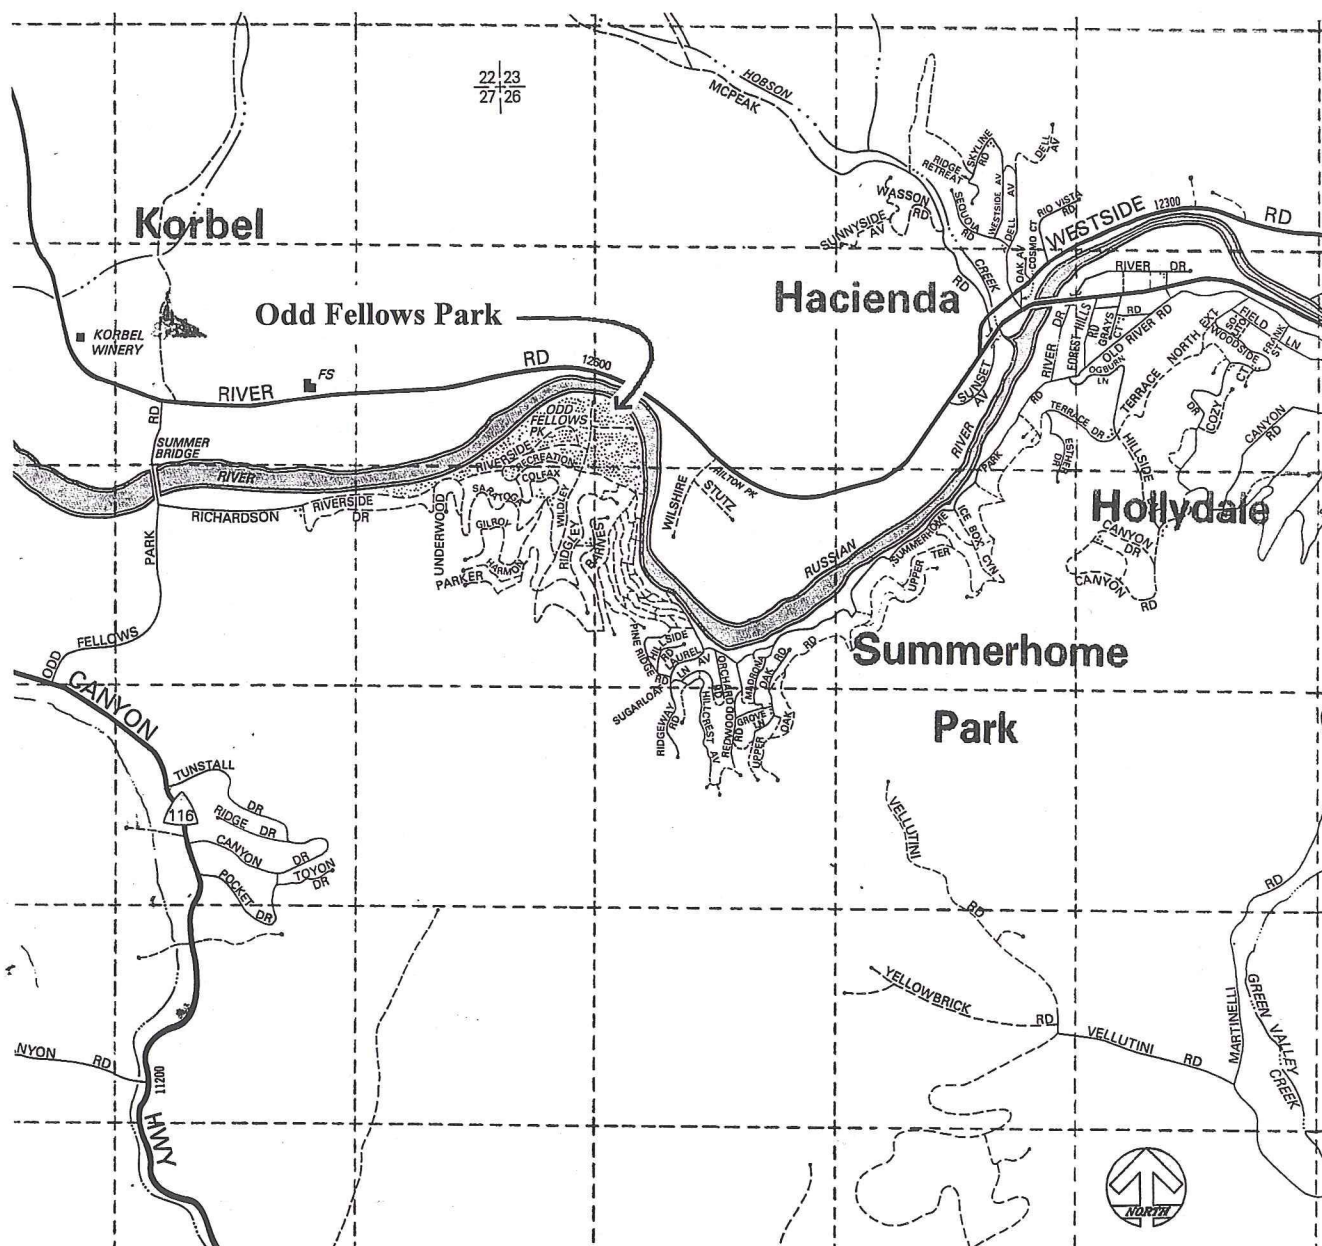


Figure 1

LEGEND

⊙ WATER SUPPLY

⊕ EXISTING MONITORING WELL

⊙ PROPOSED NEW MONITORING WELL



**MASTER PLAN
LEACHFIELD AREAS
ODD FELLOWS PARK
GUERNEVILLE, CALIFORNIA**

Questa Engineering Corporation
1220 Brickyard Cove Road
Point Richmond, Ca 94807-0356

JOB No:9511302A4 Appr: N.H. Date: 8/04/98

Source:
Topographic survey by
Leisure Engineering
HTB SZ 10WG

Leachfield Areas and Monitoring Well Locations