

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 85-114

WASTE DISCHARGE REQUIREMENTS
FOR
YOSEMITE LAKES PARK, INC.
CLUBHOUSE FACILITY
MADERA COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Yosemite Lakes Park, Inc. (hereafter Discharger) owns and operates a wastewater treatment facility that serves the Yosemite Lakes Park Clubhouse.
2. The Board, on 24 September 1970, adopted Resolution No. 71-82 which prescribed requirements for a discharge from the clubhouse to an adjacent spray field.
3. Present waste discharge requirements established by the Resolution No. 71-82 are neither adequate nor consistent with plans and policies of the Board.
4. The treatment facility consists of an extended aeration tank and clarifier. Disposal is accomplished by an adjacent leachfield or spray disposal field. The design capacity of the facility is 9,000 gpd (0.394 l/s).
5. The clubhouse facility is in Section 34, T8S, R20E, MDB&M with surface water drainage to Coarsegold Creek, a tributary to the Fresno River.
6. The beneficial uses of the Fresno River are municipal, industrial, and agricultural supply; recreation; esthetic enjoyment; ground water recharge; fresh water replenishment; hydroelectric power generation; and preservation and enhancement of fish, wildlife and other aquatic resources.
7. The beneficial uses of the ground water are municipal, industrial, and agricultural supply.
8. The Board, on 25 July 1975, adopted a Water Quality Control Plan for the San Joaquin River Basin (5C) which contains water quality objectives. These requirements are consistent with that Plan.
9. The action to adopt waste discharge requirements for this existing facility is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301, Title 14, California Administrative Code.
10. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.

WASTE DISCHARGE REQUIREMENTS
YOSEMITE LAKES PARK, INC.
CLUBHOUSE FACILITY
MADERA COUNTY

-2-

11. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED, that Order No. 71-82 be rescinded and Yosemite Lakes Park, Inc. in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste is prohibited.

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a pollution or nuisance as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal area at all times.
4. The 30-day average daily dry weather discharge flow shall not exceed 0.009 million gallons (34.1 m³).
5. The discharge to the spray field shall not contain constituents in excess of the following:

<u>Constituent</u>	<u>Units</u>	<u>30-Day Average</u>	<u>Daily Maximum</u>
BOD ₅ ^{1/}	mg/l	40	80
Settleable Solids	ml/l	0.5	1.0

^{1/} Five-day, 20° Celsius biochemical oxygen demand.

6. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
7. Reclaimed wastewater shall meet the criteria contained in Title 22, Division 4, California Administrative Code (Section 60301, et seq.).

WASTE DISCHARGE REQUIREMENTS
YOSEMITE LAKES PARK, INC.
CLUBHOUSE FACILITY
MADERA COUNTY


-3-

8. The discharge to the leachfield shall remain underground at all times.
9. There shall be no discharge to the spray field during periods of precipitation or runoff.
10. A 100-foot buffer area shall be maintained around the spray field.
11. Public access to the treatment and spray disposal facilities shall be precluded through a satisfactory combination of signing and/or fencing, or some other equivalent alternative.

C. Provisions:

1. The Discharger may be required to submit technical or monitoring reports as directed by the Executive Officer.
2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 85-114.
3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 October 1983, which are a part of this Order.
4. The Discharger shall report promptly to the Board any material change or proposed change in the character, locations, or volume of the discharge.
5. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
6. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 31 May 1985.


WILLIAM H. CROOKS, Executive Officer

SGT:bro

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 85-114

FOR
YOSEMITE LAKES PARK, INC.
CLUBHOUSE FACILITY
MADERA COUNTY

EFFLUENT MONITORING

Effluent samples shall be collected downstream from the last connection through which wastes can be admitted to the disposal area. Effluent samples should be representative of the volume and nature of the discharge. The following shall constitute the monitoring program:

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Flow	gpd	Estimate	Daily
BOD ₅ ^{1/}	mg/l	Grab	2/month ^{2/}
Settleable Solids	ml/l	Grab	2/month ^{2/}

^{1/} Five-day, 20° Celsius biochemical oxygen demand.

^{2/} Sampling is required only during discharge to the spray field.

If the discharge is intermittent rather than continuous, then on the first day of each such intermittent discharge, the Discharger shall monitor and record data for all of the constituents listed above, after which the frequencies of analysis given in the schedule shall apply for the duration of each such intermittent discharge. In no event shall the Discharger be required to monitor and record data more often than twice the frequencies listed in the schedule.

SPRAY DISPOSAL FIELD MONITORING

During use of the spray field the Discharger shall review the spray field two times per month. In conducting the review, a log shall be kept of the spray field conditions. Attention shall be given to the presence or absence of:

- a. breaches of berms
- b. overspray outside of the 100-foot buffer area

MONITORING AND REPORTING PROGRAM
YOSEMITE LAKES PARK, INC.
CLUBHOUSE FACILITY
MADERA COUNTY

-2-

- c. runoff of effluent
- d. erosion
- e. standing water

Notes on the spray field shall be summarized in the monitoring report.

REPORTING

Monitoring reports shall be submitted to the Regional Board by the 15th day of the following month. In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Ordered by



WILLIAM H. CROOKS, Executive Officer

31 May 1985

(Date)

SGT:bro

3/12/85

INFORMATION SHEET

YOSEMITE LAKES PARK, INC.
CLUBHOUSE FACILITY
MADERA COUNTY

The Yosemite Lakes Park clubhouse is about 20 miles northeast of Madera near the center of Section 34, T8S, R20E, MDB&M, Madera County. The clubhouse is used exclusively by lot owners and their guests. Discharges have previously been governed by Resolution No. 71-82.

The treatment facility consists of a 12,000 gallon (45.4 m^3) aerated tank, effluent weir, and clarifier. Following the clarifier are the leachfield and spray field disposal systems. The design flow of the treatment facility is 9,000 gpd (0.394 l/s). The current wastewater flow is approximately 600 gpd (0.026 l/s). The leachlines and sprinklers are about 250 feet from a nearby man-made lake on a small, unnamed tributary to Coarsegold Creek. No flow information is available regarding this tributary.

Originally, the effluent was disposed of by means of the spray field. However, past inspections had indicated that runoff to the nearby lake was occurring during periods of precipitation. Consequently, the leachlines were installed. The spray field is used only as a backup system.


Soils in the area are Ahwahnee and Vista rocky coarse sandy loams. The terrain is rolling and hilly, and land slopes range from 8 to 30 percent. runoff is slow to medium, moisture holding capacity is moderate to low, erosion hazards are slight, and drainage is good. Surface water courses in the area are intermittent in nature and at the present time the only known beneficial uses are for stock and wildlife watering.

The normal precipitation in this area is about 17 (0.43 m) inches annually and the evaporation rate is about 61 (1.55 m) inches annually.

The action to adopt waste discharge requirements for this existing facility is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301, Title 14, California Administrative Code.

SGT:bro


3/12/85

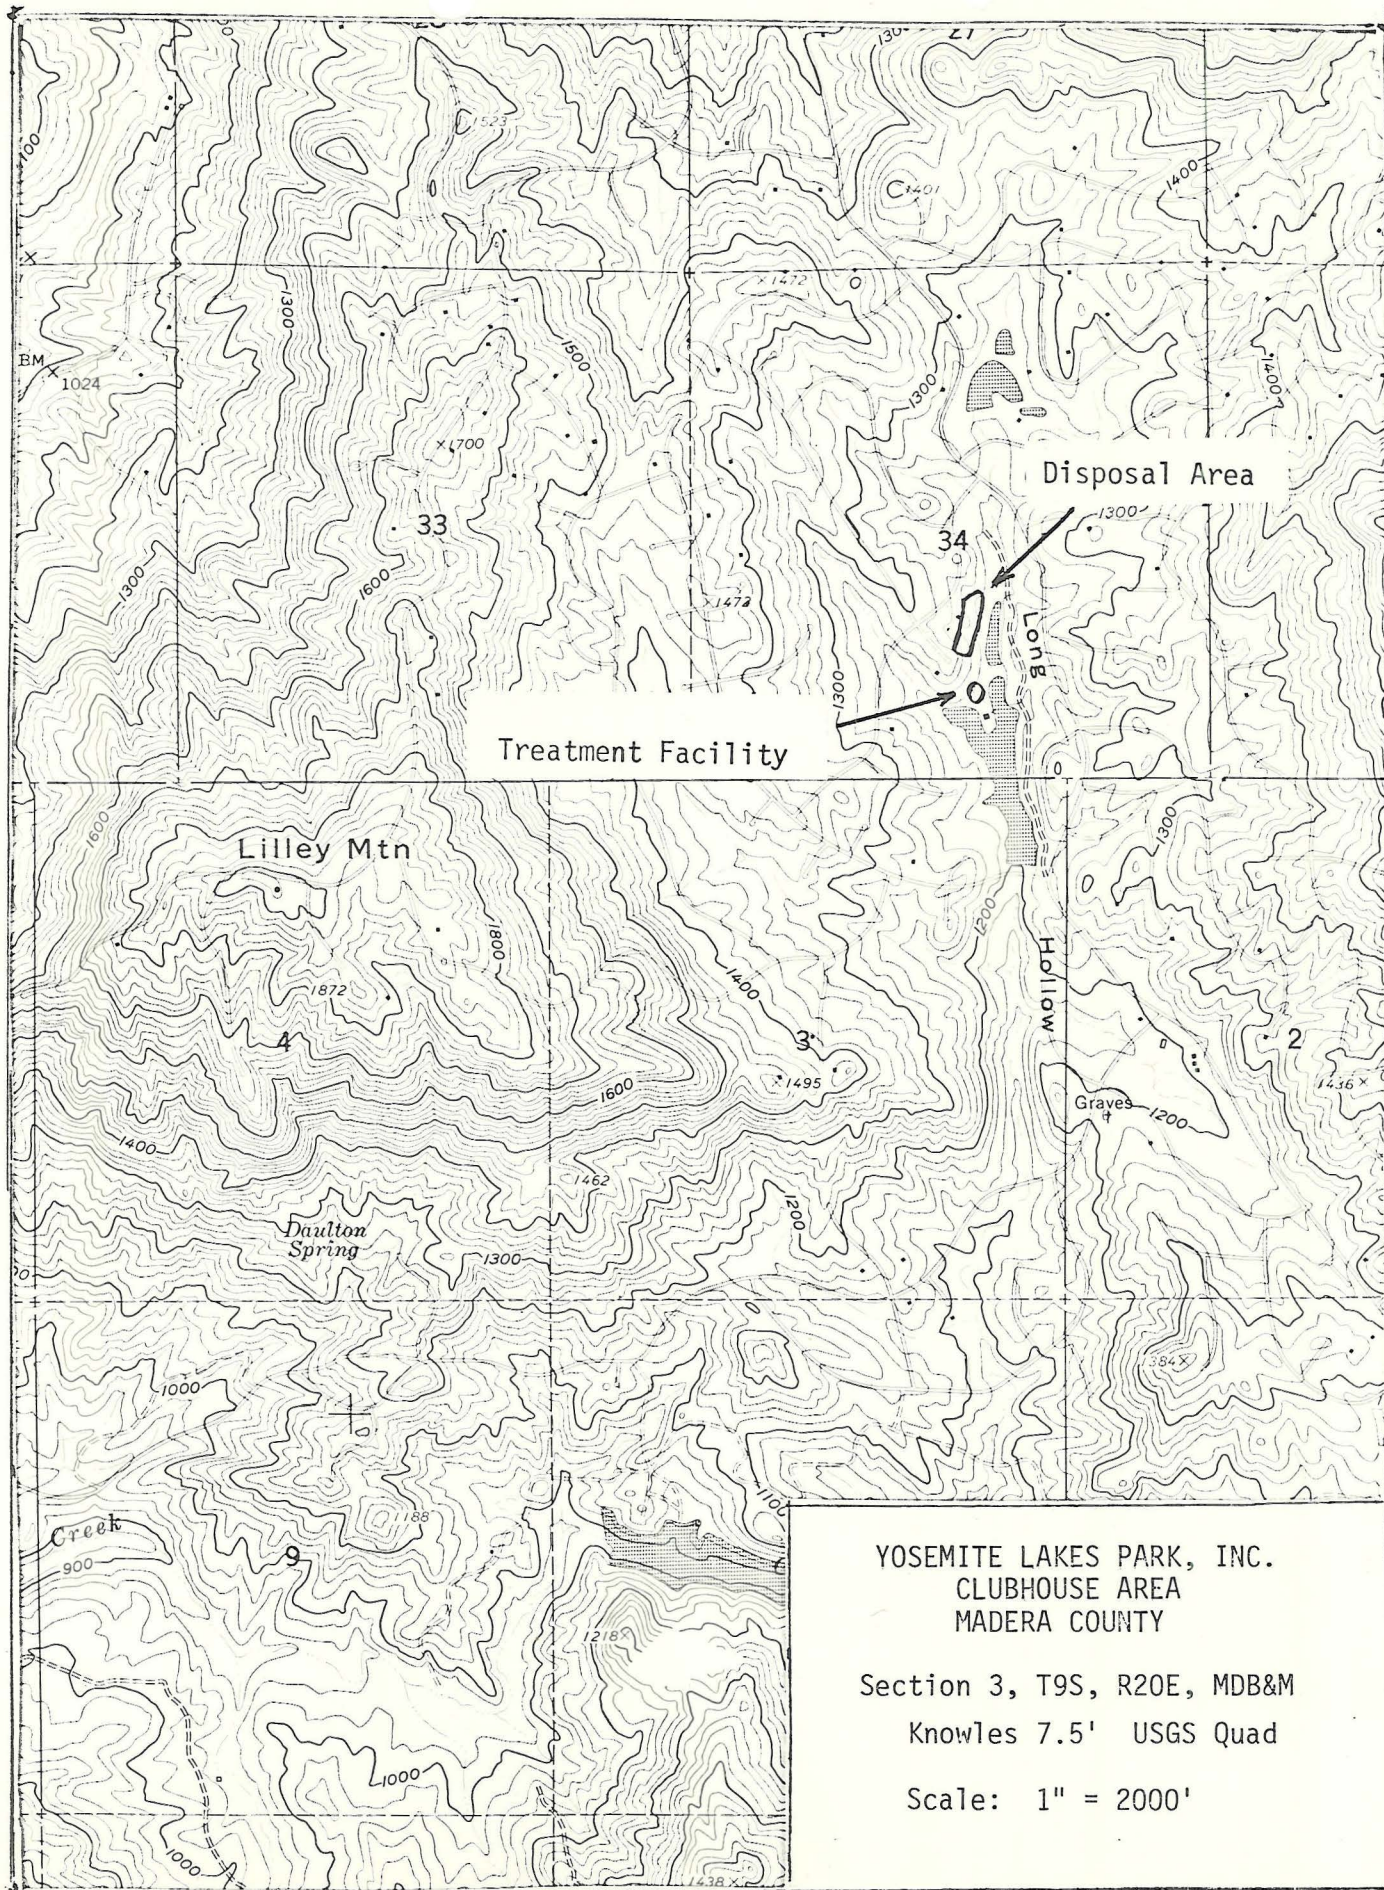

YOSEMITE LAKES PARK, INC.
CLUBHOUSE AREA
MADERA COUNTY

Section 3, T9S, R20E, MDB&M
Knowles 7.5' USGS Quad

Scale: 1" = 2000'

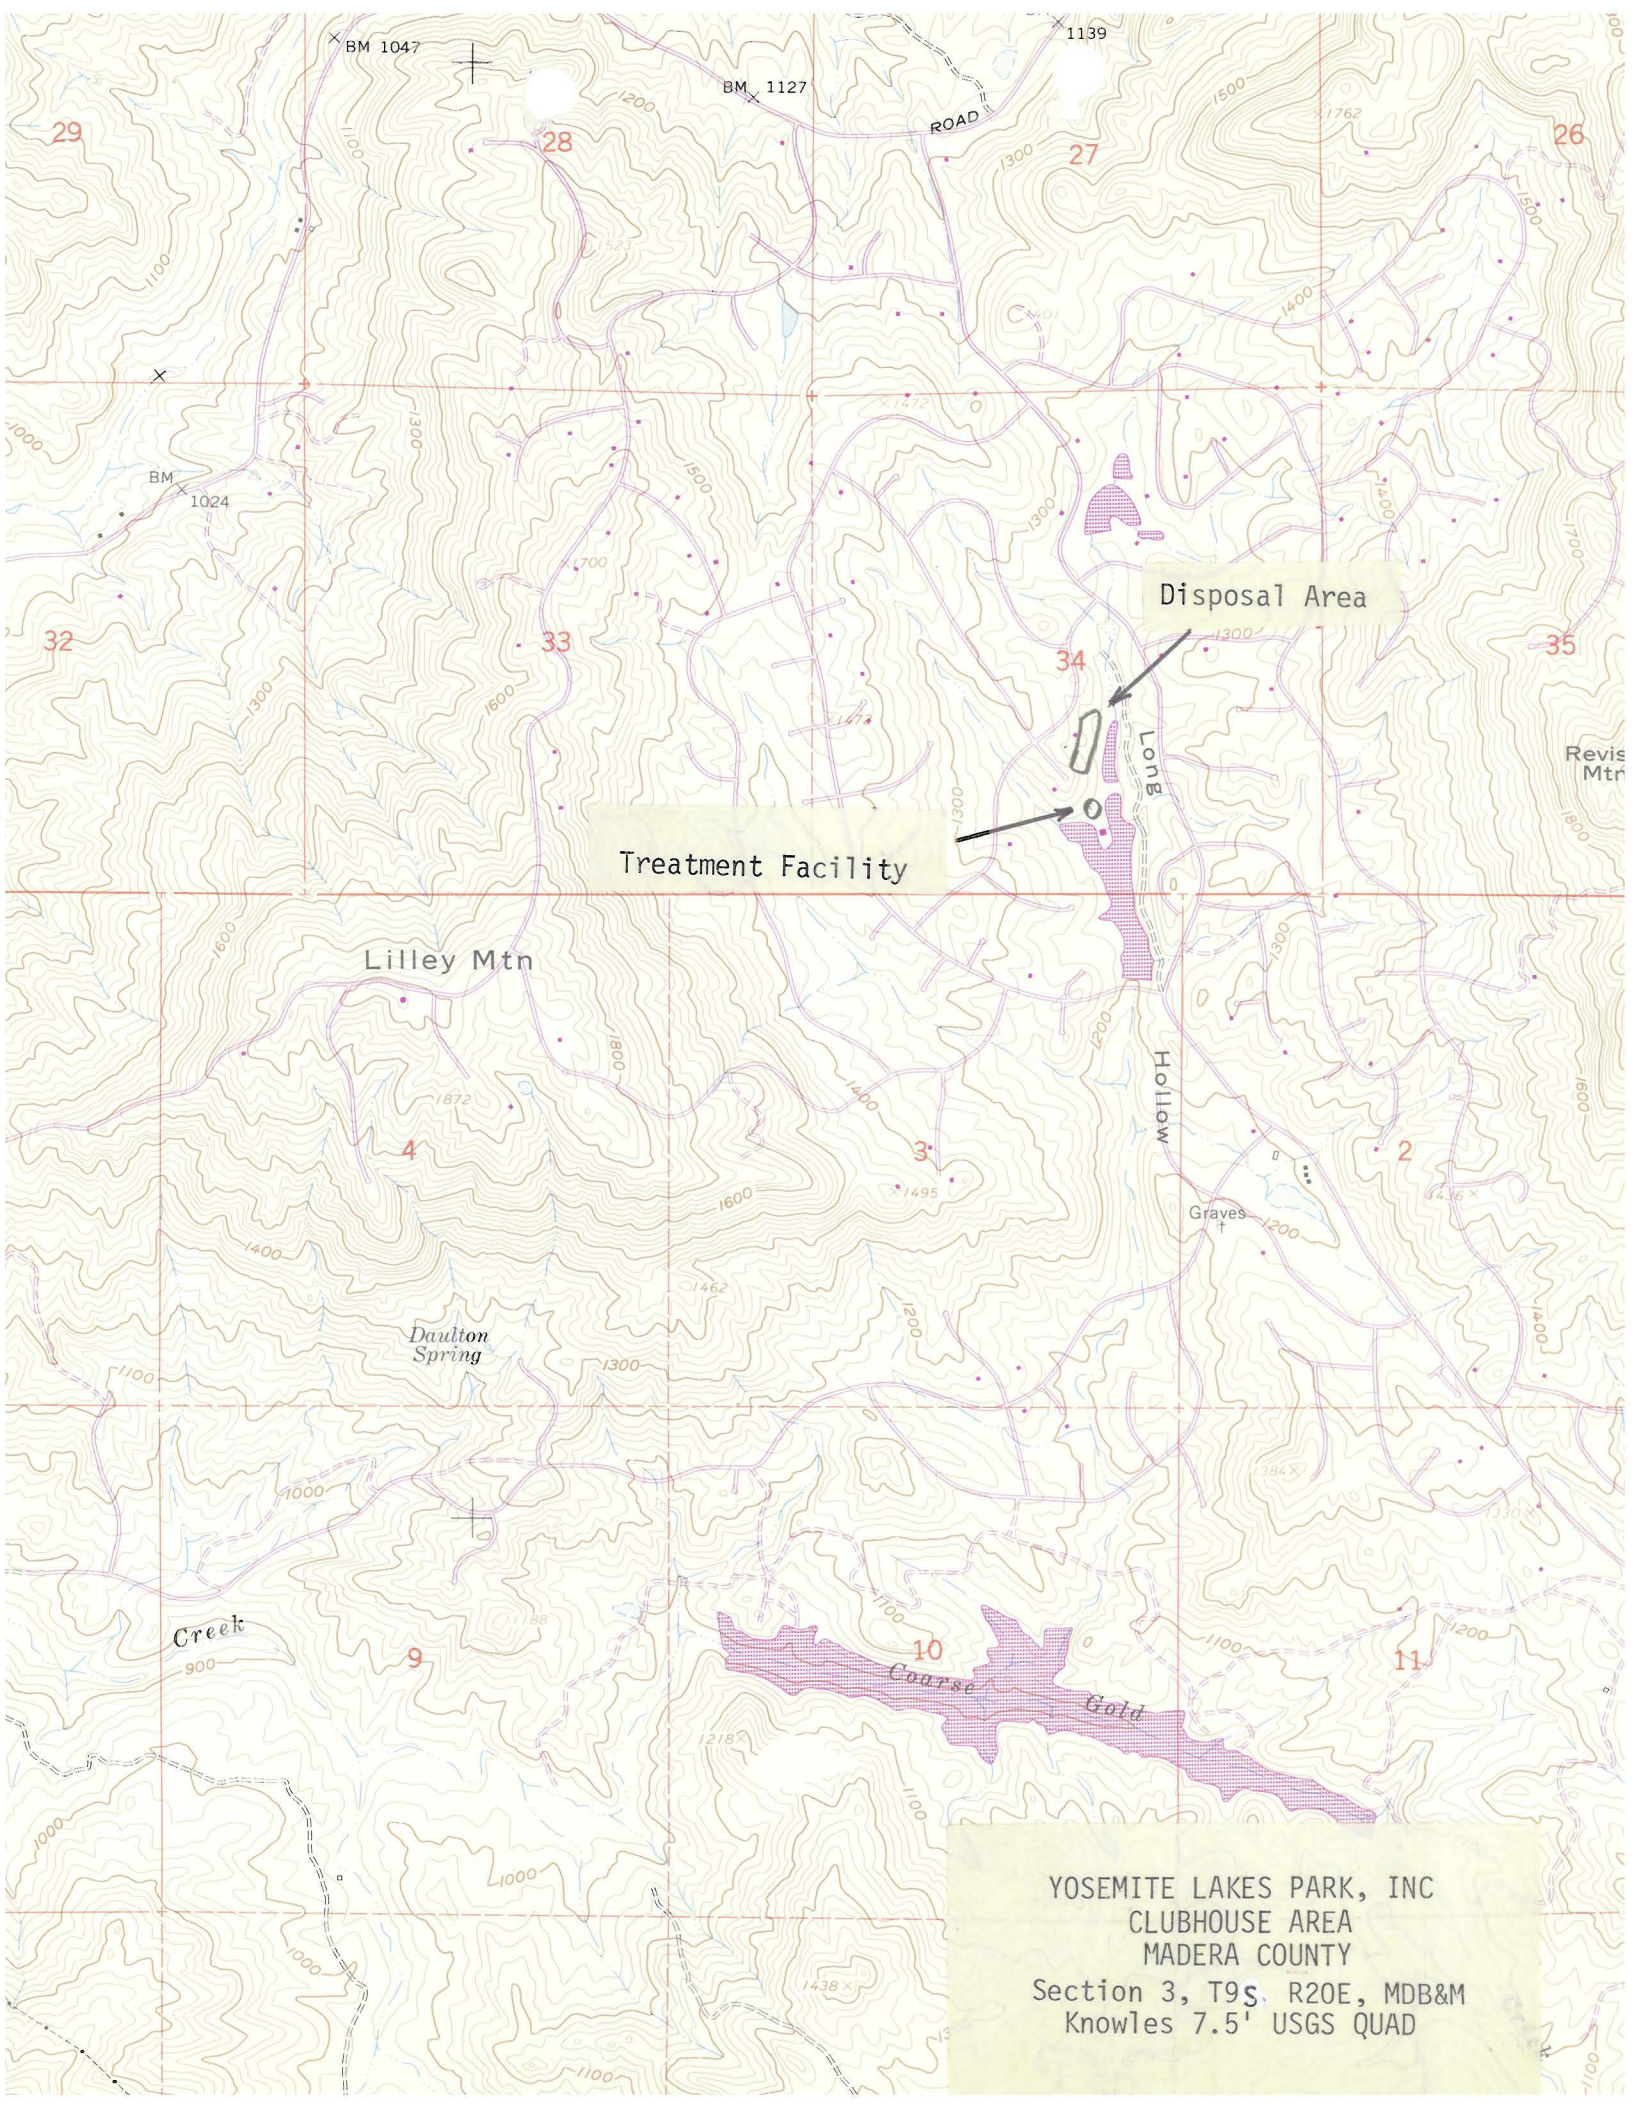

Treatment Facility

Disposal Area

Lilley Mtn

Daulton Spring

Creek

Long Hollow

Graves

Coarse Gold

YOSEMITE LAKES PARK, INC
CLUBHOUSE AREA
MADERA COUNTY
Section 3, T9S. R20E, MDB&M
Knowles 7.5' USGS QUAD