



California Regional Water Quality Control Board

Lahontan Region



Alan C. Lloyd, Ph.D.
Agency Secretary

2501 Lake Tahoe Boulevard, South Lake Tahoe, California 96150
(530) 542-5400 • Fax (530) 544-2271
<http://www.waterboards.ca.gov/lahontan>

Arnold Schwarzenegger
Governor

JUL 29 2005

Cathy Seabourn
Leavitt Lake Community Services District
471-830 Buffum Lane
Susanville, CA 96130

AMENDED MONITORING AND REPORTING PROGRAM NO. 96-18-A1, LEAVITT LAKE CSD WASTEWATER TREATMENT AND DISPOSAL FACILITIES, LASSEN COUNTY, WDID 6A180004501

At your request, Regional Board staff conducted a review of monitoring data and the Monitoring and Reporting Program for Leavitt Lake CSD. We have determined that a decreased sampling frequency and a reduction in sampling locations is warranted while still adequately characterizing groundwater and monitoring for potential impacts to groundwater from the facility's discharge.

Enclosed is an Amended Monitoring and Reporting Program No. 96-18-A1 for the Leavitt Lake Community Services District Wastewater Treatment and Disposal Facilities. Changes have been made to reduce the number of groundwater monitoring wells required to be sampled and the frequency in collecting the samples. Groundwater sampling will now be required quarterly. Only sample monitoring wells 2,3,4,5 and 6 and determine the groundwater flow direction. The Amended Monitoring and Reporting Program is effective as of the date of this letter. Please conduct your monitoring and reporting in accordance with the attached MRP No. 96-18-A1.

If you have questions regarding this Amended Monitoring and Reporting Program, please contact Alan Miller, Chief of the Regulatory Unit at (530) 542-5430, or Robert Tucker at (530) 542-5467.

HAROLD J. SINGER
EXECUTIVE OFFICER

RTT/dcc T:\leavittlakecsd05.doc
[Leavitt Lake CSD]

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

AMENDED MONITORING AND REPORTING PROGRAM NO. 96-18-A1
WDID NO. 6A180004501

FOR

LEAVITT LAKE COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT AND DISPOSAL FACILITIES

Lassen County

I. MONITORING

A. Flow Monitoring

The following shall be recorded in a permanent, bound log book and the information shall be reported quarterly:

1. The total volume, in million gallons, of wastewater flow to the treatment facility for each month.
2. The total volume, in million gallons, of wastewater flow to the treatment facility for each day.
3. The freeboard (distance from the top of the lowest part of the dike to the wastewater surface in the pond) measured each month in each wastewater impoundment. If a surface impoundment does not contain wastewater, indicate that it is empty.

B. Plant Influent Monitoring

Grab samples of the influent shall be collected and analyzed to determine the magnitude of the following parameter:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Total Nitrogen	mg/l as N	monthly

C. Plant Effluent Monitoring

Grab samples of the effluent from west pond #4 and east pond #3 shall be collected and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Biochemical Oxygen Demand	mg/l	monthly
Suspended Solids	mg/l	monthly
Total Nitrogen	mg/l as N	monthly
pH (field measurement)	pH	monthly
Conductivity (field measurement)	µs/cm	monthly

D. Ground Water Monitoring

1. Prior to sampling each ground water monitoring well, the depth to ground water in each well shall be measured and recorded. The ground water elevations with respect to mean sea level and ground water flow directions shall be determined and reported each quarterly report.
2. Monitoring Well Purging
 - a. Prior to sampling, each well shall be pumped or bailed. Field measurements of electrical conductivity, temperature, and pH shall be recorded after each well volume is purged. Ground water samples shall be collected after at least three volumes of water in the well casing have been removed and the temperature, electrical conductivity, and pH readings have stabilized to approximately 10% for each successive well volume. If there is insufficient water in the well to remove three volumes the well shall be purged to dryness. The well shall be allowed to recover for 24 hours before sampling
 - b. The measurements of electrical conductivity, temperature, and pH during purging shall be reported with the results of ground water analyses. Parameter values shall be reported in the following units, with a minimum of four sets of readings per ground water monitoring well.

<u>Parameter</u>	<u>Units</u>
Temperature	C or F
Electrical Conductivity	µS/cm
pH	pH units

- c. The well casing diameter, well depth, and total volume purged prior to sampling shall be reported with the results of ground water analyses.

3. Groundwater samples from Wells No. 2, 3, 4, 5 and 6 as shown in Attachment "A" shall be collected and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Nitrate Nitrogen	mg/l as N	quarterly
Chloride	mg/l	quarterly

E. Operation and Maintenance

A brief summary of any operational problems and maintenance activities affecting compliance with waste discharge requirements shall be submitted to the Regional Board with each quarterly monitoring report.

II. REPORTING

A. General Provisions

1. The Discharger shall comply with "General Provisions for Monitoring and Reporting" in Attachment "B", dated September 1, 1994, which is attached to and made part of this Monitoring and Reporting Program.
2. Each monitoring report submitted to the Regional Board shall be transmitted using the cover letter form, Attachment "C". An electronic copy of the cover letter form can be downloaded at:
<http://www.swrcb.ca.gov/rwqcb6/AvailDocs.htm>.
3. The Discharger shall clearly identify any violations of waste discharge requirements in self-monitoring reports and any other facility compliance information provided to the Regional Board. For every item where the requirements are not met, the Discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge into full compliance with requirements at the earliest time, and shall submit a timetable for correction.

B. Submittal Periods


The Discharger shall submit monitoring reports on a quarterly basis. Each quarterly monitoring report shall contain the monitoring information obtained during the previous quarter, as required in this Amended Monitoring and Reporting Program. Reporting due dates are specified as follows:

<u>Monitoring Period</u>	<u>Report Due Date</u>
January 1 – March 31	April 15
April 1 – June 30	July 15
July 1 – September 30	October 15
October 1 – December 31	January 15

C. Annual Report

By **January 15** of each year, the Discharger shall submit an annual report to the Regional Board with the following information:


1. The compliance record, and corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.
2. Graphical or tabular presentation of the monitoring data obtained for the previous year.

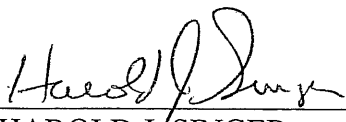Order by:  Dated: July 25, 2005
HAROLD J. SINGER
EXECUTIVE OFFICER

Attachments: A. Location of Sampling Sites and Monitoring Well
B. General Provisions for Monitoring and Reporting
C. Monitoring Cover Letter and Reporting form

ATTACHMENT "A"

LOCATION OF SAMPLING SITES AND MONITORING WELLS
LEAVITT LAKE COMMUNITY SERVICE DISTRICT

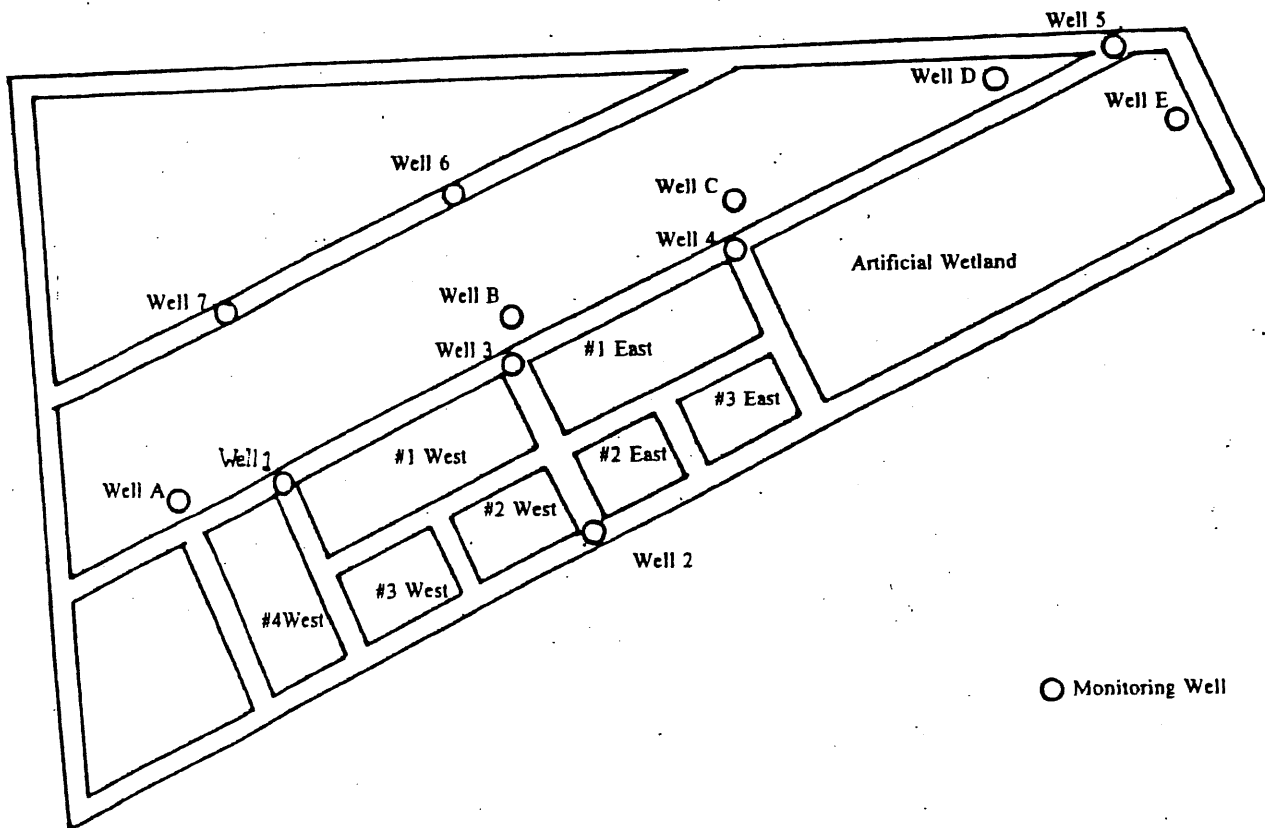

NOT TO SCALE

ATTACHMENT "B"

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

GENERAL PROVISIONS
FOR MONITORING AND REPORTING

1. SAMPLING AND ANALYSIS

- a. All analyses shall be performed in accordance with the current edition(s) of the following documents:
 - i. Standard Methods for the Examination of Water and Wastewater
 - ii. Methods for Chemical Analysis of Water and Wastes, EPA
- b. All analyses shall be performed in a laboratory certified to perform such analyses by the California State Department of Health Services or a laboratory approved by the Regional Board Executive Officer. Specific methods of analysis must be identified on each laboratory report.
- c. Any modifications to the above methods to eliminate known interferences shall be reported with the sample results. The methods used shall also be reported. If methods other than EPA-approved methods or Standard Methods are used, the exact methodology must be submitted for review and must be approved by the Regional Board prior to use.
- d. The Discharger shall establish chain-of-custody procedures to insure that specific individuals are responsible for sample integrity from commencement of sample collection through delivery to an approved laboratory. Sample collection, storage, and analysis shall be conducted in accordance with an approved Sampling and Analysis Plan (SAP). The most recent version of the approved SAP shall be kept at the facility.
- e. The Discharger shall calibrate and perform maintenance procedures on all monitoring instruments and equipment to ensure accuracy of measurements, or shall insure that both activities will be conducted. The calibration of any wastewater flow measuring device shall be recorded and maintained in the permanent log book described in 2.b, below.
- f. A grab sample is defined as an individual sample collected in fewer than 15 minutes.
- g. A composite sample is defined as a combination of no fewer than eight individual samples obtained over the specified sampling period at equal intervals. The volume of each individual sample shall be proportional to the discharge flow rate at the time of sampling. The sampling period shall equal the discharge period, or 24 hours, whichever period is shorter.

- iv. In the case of a municipal, state or other public facility, by either a principal executive officer, ranking elected official, or other duly authorized employee.
- e. Monitoring reports are to include the following:
 - i. Name and telephone number of individual who can answer questions about the report.
 - ii. The Monitoring and Reporting Program Number.
 - iii. WDID Number.
- f. Modifications

This Monitoring and Reporting Program may be modified at the discretion of the Regional Board Executive Officer.

4. NONCOMPLIANCE

Under Section 13268 of the Water Code, any person failing or refusing to furnish technical or monitoring reports, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in an amount of up to one thousand dollars (\$1,000) for each day of violation under Section 13268 of the Water Code.

ATTACHMENT "C"

Date _____

California Regional Water Quality Control Board
Lahontan Region
2501 Lake Tahoe Boulevard
South Lake Tahoe, CA 96150

Facility Name:

Address:

Contact Person:

Job Title:

Phone:

Email:

WDR/NPDES Order Number:

WDID Number:

Type of Report (circle one):

Monthly Quarterly Semi-Annual Annual Other

Month(s) (circle applicable month(s)*:

**JAN FEB MAR APR MAY JUN
JUL AUG SEP OCT NOV DEC**

*annual Reports (circle the first month of the reporting period)

Year:

Violation(s)? (Please check one):

_____ **NO**

_____ **YES***

***If YES is marked complete a-g (Attach Additional information as necessary)**

a) Brief Description of Violation:

**b) Section(s) of WDRs/NPDES
Permit Violated:**

c) Reported Value(s) or Volume:

**d) WDRs/NPDES
Limit/Condition:**

**e) Date(s) and Duration of
Violation(s):**

f) Explanation of Cause(s):

g) Corrective Action(s)
(Specify actions taken and a schedule
for actions to be taken)

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision following a system designed to ensure that qualified personnel properly gather and evaluate the information submitted. Based on my knowledge of the person(s) who manage the system, or those directly responsible for data gathering, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment.

If you have any questions or require additional information, please contact _____ at the number provided above.

Sincerely,

Signature: _____

Name: _____

Title: _____