

California Regional Water Quality Control Board
North Coast Region

Order No. 82-76

WASTE DISCHARGE REQUIREMENTS

for

CASPER SOUTH WATER DISTRICT

Mendocino County

The California Regional Water Quality Control Board, North Coast Region, finds that:

1. Mr. Kenneth H. Morgan, President of the Caspar South Water District, hereafter the discharger, submitted a report of waste discharge dated June 7, 1982.
2. The discharger proposes to modify existing waste treatment and disposal facilities utilizing Clean Water Grant funds, to eliminate a non-conforming discharge of waste to the Pacific Ocean which is the subject of Cease and Desist Order No. 79-210 adopted by the Regional Board on December 5, 1979.
3. The proposed waste collection, treatment, and disposal facilities consist of the following:
 - a. Collection system to serve 78 lots;
 - b. Renovation of the existing headworks and septic tanks;
 - c. Conversion of the chlorinator housing to a lift station; and
 - d. Pumping treated effluent by force main to a community leachfield disposal area.
 - e. A bypass seepage pit is to be provided in the event of a power outage to prevent an overflow to the land surface and/or the Pacific Ocean.
 - f. An odor control device consisting of an activated carbon filter is to be installed at the septic tank/lift station to prevent nuisance odors.
4. On October 28, 1976, the Regional Board adopted Order No. 76-169, NPDES No. CA 0023931, Waste Discharge Requirements for the Caspar South Service Corporation, Mendocino County. The requirements included a time schedule for the implementation of measures necessary to eliminate the discharge of waste (septic tank effluent) to the Pacific Ocean.
5. The location of the waste treatment and disposal facilities is approximately one mile south from the Pygmy Forest ecological staircase, an area which has been designated by the State Water Resources Control Board as an Area of Special Biological Significance (ASBS). The proposed facilities are further described as in the S₂ of Section 1, T17N, R18W, MDB&M, as shown in Attachment A, incorporated herein and made a part of this Order.

6. The discharger has caused a site evaluation with regard to on-site disposal and the evaluation has determined that all of the guidelines and criteria established by the Regional Board for the successful operation of the on-site system will be met.
7. Other existing on-site domestic wastewater treatment and disposal systems in the Caspar South development have been approved by the Mendocino County Public Health Services.
8. On March 20, 1975, the Regional Board adopted the Water Quality Control Plan for the North Coastal Basin. The Basin Plan prohibits the discharge of waste to all intertidal reaches of the coast.
9. The beneficial uses of the Pacific Ocean and coastal waters include:
 - a. industrial service supply
 - b. navigation
 - c. water contact recreation
 - d. non-contact water recreation
 - e. ocean commercial and sport fishing
 - f. preservation of areas of special biological significance
 - g. marine habitat
 - h. fish migration
 - i. fish spawning
 - j. shellfish harvesting
 - k. scientific study
 - l. aesthetic enjoyment
10. The discharger has caused a project environmental analyses pursuant to federal (NEPA) and state (CEQA) regulations.
11. The Regional Board finds that this facility will not cause adverse environmental impacts if conducted in accordance with the prohibitions, specifications, and provisions contained in this Order.
12. The Board has notified the discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
13. The Board in a public meeting heard and considered all comments pertaining to the discharge.

THEREFORE, IT IS HEREBY ORDERED that the discharger shall comply with the following:

A. DISCHARGE PROHIBITIONS

1. The discharge of waste to the Pacific Ocean or tributaries thereof is prohibited.
2. The discharge of waste to property not owned by the discharger is prohibited.
3. The surface discharge of waste is prohibited.

B. DISCHARGE SPECIFICATIONS

1. The treatment or disposal of waste shall not cause pollution or nuisance as defined in Section 13050 of the California Water Code.
2. The average daily wastewater flow shall not exceed 13,200 gallons.

C. PROVISIONS

1. The discharger shall maintain in good working order and operate as efficiently as possible any facility or control system installed by the discharger to achieve compliance with the waste discharge requirements.
2. The discharger shall comply with Monitoring and Reporting Program No. 82-76 as specified by the Executive Officer.
3. All treatment, collection, and disposal facilities shall be installed according to applicable ordinances of Mendocino County.
4. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the discharger, the discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to the Regional Board.
5. The discharger shall comply with the Contingency Planning and Notification Requirements for Accidental Spills and Dischargers, Order No. 74-151, within 60 days of the adoption of these requirements.
6. The discharger shall permit the Regional Board:
 - a. Entry upon premises in which an effluent source is located or in which any required records are kept;
 - b. Access to copy any records required to be kept under terms and conditions of this Order;
 - c. Inspection of monitoring equipment or records; and
 - d. Sampling of any discharge.

Regional Board access for the above purposes shall be during normal working hours and with reasonable prior notification given to the discharger.

7. The Board requires the discharger to file a report of waste discharge at least 120 days before making any material change or proposed change in the character, location, or volume of waste discharges from the facility.
8. In the event the discharger is unable to comply with any of the conditions of this Order due to:

- a. Breakdown of waste treatment equipment;
- b. Accidents caused by human error or negligence; or
- c. Other causes, such as acts of nature.

the discharger shall notify the Executive Officer by telephone as soon as he or his agents have knowledge of the incident and confirm this notification in writing within two weeks of the telephone notification. The written notification shall include pertinent information explaining reasons for the noncompliance and shall indicate what steps are taken to correct the problem and the dates thereof, and what steps are being taken to prevent the problem from recurring.

Certification

I, David C. Joseph, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, North Coast Region, on July 22, 1982.

ORIGINAL SIGNED BY

David C. Joseph
Executive Officer

California Regional Water Quality Control Board
North Coast Region

MONITORING AND REPORTING PROGRAM NO. 82-76

for

CASPAR SOUTH WATER DISTRICT

Mendocino County

MONITORING

1. The discharger shall determine and record weekly the volume of waste-water discharged to the disposal fields.
2. The discharger shall visually inspect weekly the waste disposal fields for malfunction.

REPORTING


The discharger shall submit the monitoring data to the Regional Board by the 15th day of the following month. In addition, the discharger shall submit to the Regional Board a written report providing detailed information relative to any malfunction of the treatment or disposal facilities no later than five days after the malfunction.

Ordered by

ORIGINAL SIGNED BY

David C. Joseph
Executive Officer

July 22, 1982

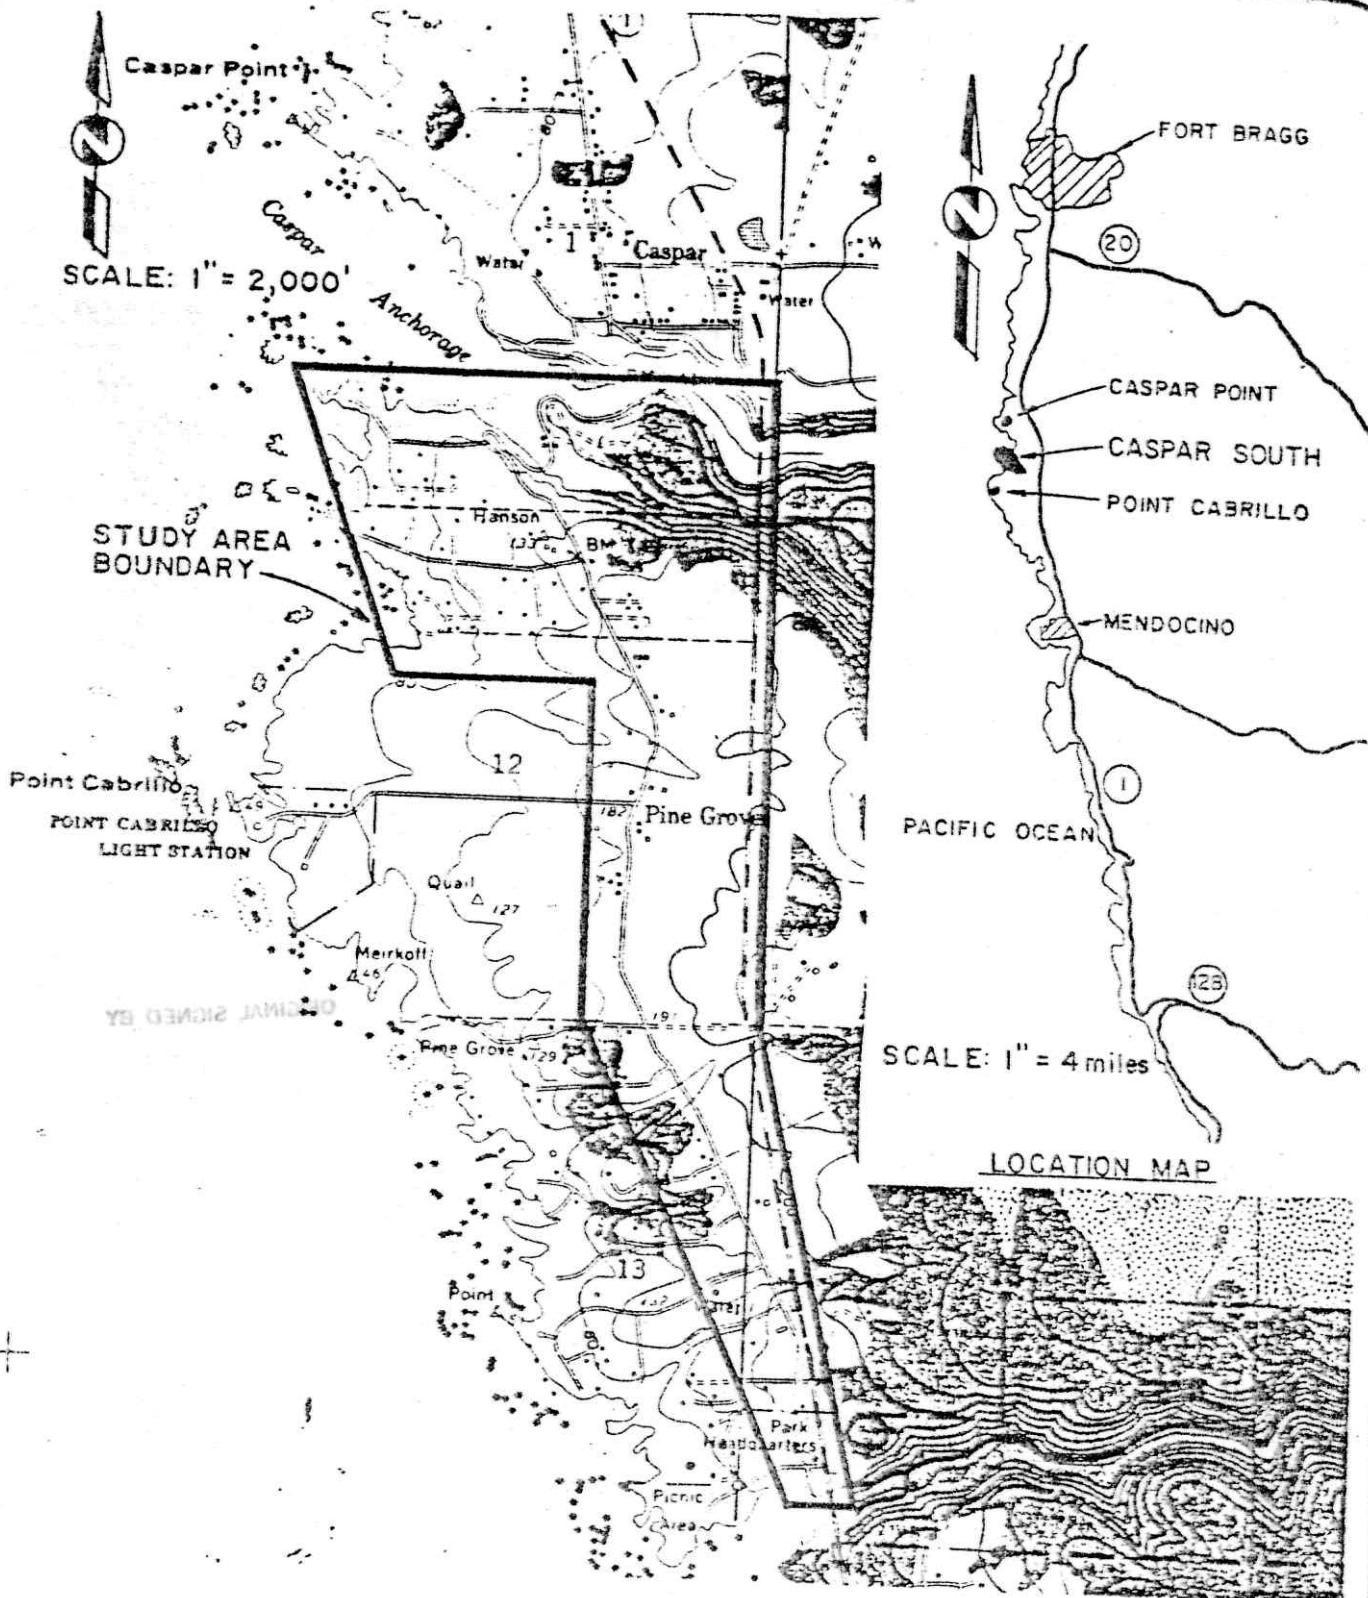

CASPAR SOUTH
WASTEWATER FACILITIES
LOCATION AND STUDY AREA MAPS

California Regional Water Quality Control Board
North Coast Region

CONTINGENCY PLANNING AND NOTIFICATION REQUIREMENTS
FOR ACCIDENTAL SPILLS & DISCHARGES

ORDER NO. 74-151

The California Regional Water Quality Control Board, North Coast Region, finds that:

1. Section 13225 of the Porter-Cologne Water Quality Control Act requires the Regional Board to perform general duties to assure positive water quality control.
2. The Regional Board has been advised of situations in which preparation for, and response to accidental discharges and spills have been inadequate.
3. Persons discharging waste or conveying, supplying, storing or managing wastes or hazardous materials have the primary responsibility for contingency planning, incident reporting and continuous and diligent action to abate the effects of such unintentional or accidental discharge.


THEREFORE, IT IS HEREBY ORDERED THAT:

- I. All persons who discharge wastes or convey, supply, store or otherwise manage wastes or other hazardous material shall:
 - A. Prepare and submit to this Regional Board, according to a time schedule prescribed by the Executive Officer, a contingency plan defining the following:
 - (1) potential locations and/or circumstances under which accidental discharge incidents might be expected to occur,
 - (2) possible water quality effects of accidental discharges,
 - (3) the conceptual plan for cleanup and abatement of accidental discharge incidents, including:
 - (a) the individual who will be in charge of cleanup and abatement activities, on behalf of the discharger,
 - (b) the equipment and manpower available to the discharger to implement the cleanup and abatement plans.
 - B. Immediately report to the Regional Board any accidental discharge incidents. Such notification shall be made by telephone as soon as the responsible person or his agent has knowledge of the incident.

Order No. 74-151

- C. Immediately begin diligent and continuous action to cleanup and abate the effects of any unintentional or accidental discharge. Such actions shall include temporary measures to abate the discharge prior to completing permanent repairs to damaged facilities.
- D. Confirm the telephone notification in writing within two weeks of the telephone notification. The written notification shall include: reasons for the discharge, duration and volume of the discharge, steps taken to correct the problem, and steps being taken to prevent the problem from recurring.
- II. Upon original receipt of phone report (I.B), the Executive Officer shall immediately notify all affected agencies and known users of waters affected by the unintentional or accidental discharge.
- III. Provide updated information to the Regional Board in the event of change of staff, size of the facility, or change of operating procedures which will affect the previously established contingency plan.
- IV. The Executive Officer or his employees shall maintain liaison with the discharger and other affected agencies and persons to provide assistance in cleanup and abatement activities.
- V. The Executive Officer shall transmit copies of this order to all persons whose discharges or waste handling activities are governed by Waste Discharge Requirements or an NPDES Permit. Such transmittal shall include a current listing of telephone numbers of the Executive Officer and his key employees to facilitate compliance with Item I.A(3)(a) of this Order.

Ordered by


David C. Joseph
Executive Officer

July 24, 1974

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
NORTH COAST REGION

GENERAL MONITORING AND REPORTING PROVISIONS

February 3, 1971

GENERAL PROVISIONS FOR SAMPLING AND ANALYSIS

Unless otherwise noted, all sampling, sample preservation, and analyses shall be conducted in accordance with the current edition of "Standard Methods for the Examination of Water and Waste Water" or approved by the Executive Officer.

All analyses shall be performed in a laboratory certified to perform such analyses by the California State Department of Health or a laboratory approved by the Executive Officer.

All samples shall be representative of the waste discharge under the conditions of peak load.

GENERAL PROVISIONS FOR REPORTING

For every item where the requirements are not met, the discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge into full compliance with requirements at the earliest time and submit a timetable for correction.

By January 30 of each year, the discharger shall submit an annual report to the regional board. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The discharger shall file a written report within 90 days after the average dry-weather flow for any month that equals or exceeds 75% of the design capacity of the waste treatment or disposal facilities. The report shall contain a schedule for studies, design, and other steps needed to provide additional capacity or limit the flow below the design capacity prior to the time when the waste flow rate equals the capacity of the present units.

