

California Regional Water Quality Control Board
Santa Ana Region

February 11, 1987

ITEM: 10

SUBJECT: Waste Discharge Requirements for Running Springs Water District, San Bernardino County, Order No. 87-7

DISCUSSION:

These requirements are being revised for the discharge of treated municipal wastewater to evaporation-percolation ponds adjacent to Fredalba Creek.

RECOMMENDATION:

Adopt Order No. 87-7 as presented.

Comments were solicited from the following agencies:

State Water Resources Control Board - Archie Matthews, Division of Water Quality
State Department of Water Resources - Los Angeles
State Department of Health Services - San Bernardino
San Bernardino County Department of Environmental Health Services
San Bernardino County Flood Control District
USDA Forest Service - Gary Boyle
Arrowbear Park County Water District

California Regional Water Quality Control Board
Santa Ana Region

ORDER NO. 87-8

Waste Discharge Requirements
for
Running Springs Water District
San Bernardino County

The California Regional Water Quality Control Board, Santa Ana Region (hereinafter Board), finds that:

1. Running Springs Water District (hereinafter discharger) currently discharges an average of 0.4 MGD (1500 m³/day) of treated municipal wastewater to evaporation-percolation ponds located in the N½ of Section 18, T1N, R2W, SBB&M, adjacent to Fredalba Creek.
2. The discharger's sewage treatment plant capacity is 1.0 MGD (3800m³/day).
3. The discharge of wastes from this facility is presently regulated under waste discharge requirements contained in Order No. 81-45.
4. The Board adopted a Water Quality Control Plan (Basin Plan) on May 13, 1983. This Plan contains water quality objectives and beneficial uses of waters in the Santa Ana Region.
5. Order No. 81-45 must be updated to conform with the new Water Quality Control Plan.
6. Surface drainage in the area is to Fredalba Creek, which is beneficially used for:
 - a. Groundwater recharge,
 - b. Non-contact water recreation,
 - c. Warm freshwater habitat, and
 - d. Wildlife habitat.
7. Ground and surface waters in the vicinity of the discharge are tributary to the Bunker Hill II Groundwater Basin, which is beneficially used for:
 - a. Municipal and domestic supply,
 - b. Industrial service supply,
 - c. Industrial process supply, and
 - d. Agricultural supply.

8. The project involves the discharge of waste from an existing facility and, as such, is exempt from the provisions of the California Environmental Quality Act (Public Resources Code, Section 21000 et seq.) in accordance with Section 15301, Chapter 3, Title 14, California Administrative Code.
9. The Board has notified the discharger and other interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
10. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Running Springs Water District shall comply with the following:

A. Discharge Specifications

1. a. The discharge of wastes as described in Finding 1 above, shall not contain average concentrations that exceed the following listed values:

<u>Constituent</u>	<u>3-Sample Average Concentration</u>
BOD	30 mg/l
Suspended Solids	30 "
Filtrable Residue	520 "
Chloride	70 "

- b. The discharge of wastes with an average filtrable residue concentration based on 3 consecutive samples which exceeds the filtrable residue concentration in the water supply by more than 250 mg/l is prohibited.

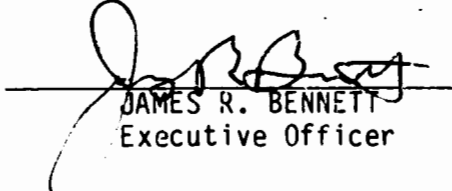
For Discharge Specifications 1a. and b., whichever filtrable residue limit that results in the lower average concentration shall be controlling.

2. The discharge of wastes to property not owned or controlled by the discharger is prohibited.
3. The discharge of highly mineralized wastes to the ground is prohibited.
4. The discharge shall not contain any substances in concentrations toxic to human, animal, plant, or aquatic life.

B. Provisions

1. Neither the treatment nor the discharge of wastes shall cause a nuisance and/or pollution, as defined in the California Water Code.
2. The discharge shall comply with Monitoring and Reporting Program No. 87-8.
3. The discharge shall promptly report to the Board any proposed change in the character, location, or method of disposal of the discharge or any change in ownership of the facility.
4. The discharger shall report any noncompliance that may endanger health or the environment. Any information shall be provided to the Executive Officer (714-782-4130) and the Office of Emergency Services (1-800-852-7550), if appropriate, as soon as the discharger becomes aware of the circumstances. A written report shall be submitted within five days and shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times and, if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance.
5. The discharger shall permit the Regional Board:
 - a. Entry upon the premises in which an effluent source is located or in which any required records are kept;
 - b. Access to copy any records required to be kept under the terms and conditions of this order;
 - c. Inspection of monitoring equipment or records; and
 - d. Sampling of any discharge.
6. This order also rescinds Order No. 81-45, the present discharge requirements for this facility.

I, James R. Bennett, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an order adopted by the California Regional Water Quality Control Board, Santa Ana Region, on February 11, 1987.


JAMES R. BENNETT
Executive Officer

California Regional Water Quality Control Board
Santa Ana Region

Monitoring and Reporting Program No. 87-8
for
Running Springs Water District
San Bernardino County

Effluent Monitoring

1. Unless otherwise noted, all sampling, sample preservation, and analyses shall be performed in accordance with the latest edition of "Guidelines Establishing Test Procedures for Analysis of Pollutants," promulgated by the United States Environmental Protection Agency.
2. All analyses shall be conducted at a laboratory certified for such analyses by the State Department of Health Services.
3. All samples shall be representative of the waste discharge under the conditions of peak load.
4. A sampling station shall be established where representative samples of the final effluent can be obtained.
 - a. At least once every week on a day at random, a composite sample shall be collected and analyzed for BOD and suspended solids. Corresponding with the first weekly sampling of each month, the sample shall also be analyzed for filtrable residue and chloride. Analytical results shall be reported in milligrams per liter.
 - b. A composite sample is defined as a combination of no fewer than eight individual samples obtained over the specified sampling period. The volume of each individual sample shall be proportional to the discharge flow rate at the time of sampling. The compositing period shall equal the specific sampling period, or 24 hours, if no period is specified.
5. The average daily flow, maximum daily flow, and the flow on the days of sampling shall be determined and reported in million gallons per day (MGD).
6. Weekly, the freeboard in all disposal ponds shall be determined and reported in inches of freeboard.

Monitoring and Reporting Program - continued

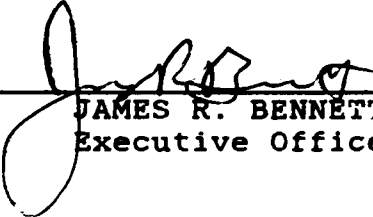
Water Supply Monitoring

Monthly, the representative water supply filtrable residue concentration shall be determined.

Reporting

1. All reports shall be submitted by the third Monday of the following month and shall include:
 - a. Results of all analyses described under Effluent Monitoring 4.a. and in Water Supply Monitoring;
 - b. Pond freeboard data;
 - c. Flow data; and
 - d. A statement regarding maintenance of the wastes on land owned or controlled by the discharger.
2. For every item where the requirements are not met, the discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge into full compliance with requirements at the earliest time and submit a timetable for correction.
3. All reports shall be signed by a responsible officer or duly authorized representative of the discharger and shall be submitted under penalty of perjury.

Ordered by


JAMES R. BENNETT
Executive Officer

February 11, 1987

