

06

California Regional Water Quality Control Board
North Coast Region

ORDER NO. 96-68
I.D. NO. 1A760810SIS

WASTE DISCHARGE REQUIREMENTS
AND
WATER RECYCLING REQUIREMENTS

FOR

THE CITY OF MONTAGUE
AND
DONALD L. MEAMBER, JR.

Siskiyou County

The California Regional Water Quality Control Board, North Coast Region (hereinafter Regional Water Board), finds that:

1. The City of Montague operates facilities for wastewater treatment, land disposal, and water recycling. The facilities and disposal areas are located in the NE 1/4 of Section 21, T45N, R6W, MDB&M as shown in Attachment "A" and "B", incorporated herein and made a part of this Order.
2. Waste treatment and disposal facilities include an influent bar screen, four facultative treatment ponds in series, lift pumps, storage reservoir, and flood irrigation. Two pumps lift treated and undisinfected effluent to the reservoir (178.4 acre feet) for storage until withdrawn for irrigation purposes. Treatment plant and disposal facilities are located adjacent to Oregon Slough, a tributary of the Shasta River.
3. The design dry weather flow capacity of the treatment plant is 0.24 million gallons per day (mgd). Current dry weather flows average 0.088 mgd. The design peak wet weather flow capacity is 0.99 mgd.
4. Final effluent disposal consists of wintertime discharge to a storage reservoir (178 acre feet) and/or summer irrigation on 52 acres of forage/fodder crops by spray and flood irrigation. During irrigation season, treated effluent from the reservoir is pumped to disposal fields. All tailwater runoff flows by gravity ditch back to the reservoir.
5. The City of Montague has entered into an agreement with Donald L. Meamber Jr., Route 1, Box 653, Montague, California, 96064, to provide recycled water for irrigation of fodder crops. Under the agreement, the City operates and maintains the effluent pumping facility, reservoir, power supply to irrigation pumping facility and tailwater ditches. The landowner operates the irrigation pumping facility as necessary for disposal purposes on 52.2 acres of his land. Both parties agree to distribute and dispose of treated effluent in a manner that avoids a direct or indirect discharge to Oregon Slough. Furthermore, the parties agree to draw effluent in a manner consistent with Montague's water recycling requirements. Finally, the agreement provides that Meamber's utilization of effluent is subject to overall supervision by Montague for purposes of assuring continuous, reasonable, and efficient operation and management of wastewater treatment facilities.

6. Discharge self-monitoring and staff inspections have disclosed that the extraordinary rainfall events which occurred during winter 1996 (12 inches of rain in two successive storms) overloaded the treated-wastewater storage reservoir and required an unpermitted discharge to Oregon Slough to avoid dam-safety violations. Repeat of this type of overload is threatened until an I/I reduction and systems maintenance program is defined and implemented.
7. Pursuant to Section 13523 of the California Water Code, the Regional Water Board, after consultation with and receipt of recommendations from the Department of Health Services (DOHS), determines that in order to protect the public health, safety, or welfare, it is necessary to prescribe water recycling requirements. The requirements of this Order conform with and implement the water recycling criteria contained in Title 22, Division 4, Chapter 3, California Code of Regulations, Section 60301 through 60355, promulgated by DOHS pursuant to Section 13521 of the California Water Code.
8. The regulated discharge is consistent with the antidegradation provision of State Water Resources Control Board Resolution No. 68-16. The impact on existing groundwater and surface water quality will be insignificant.
9. The Water Quality Control Plan for the North Coast Region includes water quality objectives, implementation plans for point source and nonpoint source discharge prohibitions and statewide plans and policies.

The Basin Plan prohibits discharge to the Klamath River and its tributaries except as provided in the Action Plan for Storm Water Discharges adopted by the Regional Water Board on June 22, 1995 and approved by the Office of Administrative Law on February 21, 1996. The Action Plan is effective as of February 21, 1996 and is now an official component of the Basin Plan.

10. The beneficial uses of Oregon Slough, the Shasta River, and the Klamath River include:
 - a. municipal supply
 - b. agricultural supply
 - c. groundwater recharge
 - d. freshwater replenishment
 - e. water contact recreation
 - f. non-contact water recreation
 - g. warm freshwater habitat
 - h. cold freshwater habitat
 - i. wildlife habitat
 - j. migration of aquatic organisms
 - k. spawning, reproduction, and/or early development
11. Montague's wastewater treatment plant and disposal facilities are presently governed by Waste Discharge Requirements Order No. 85-84, adopted by the Regional Water Board on May 23, 1985.
12. The action to adopt waste discharge requirements is exempt from the provisions of the California Environmental Quality Act (Public Resources Code Section 21000 et. seq.), as an existing facility (Title 14, California Code of Regulations, Section 15301).

13. The Regional Water Board has notified the discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations.
14. The Regional Water Board, in a public meeting, heard and considered all comments pertaining to the discharge.

THEREFORE, IT IS HEREBY ORDERED that Waste Discharge Requirements Order No. 85-84 be rescinded and City of Montague and Donald L. Meamber, Jr., shall comply with the following:

A. DISCHARGE PROHIBITIONS

1. There shall be no discharge of recycled water to the Shasta River or its tributaries.
2. Discharge of any waste not specifically regulated by this Order is prohibited.
3. Discharge of waste from the wastewater treatment facility to the Shasta River or its tributaries is prohibited.
4. The discharge of untreated waste from anywhere within the collection, treatment, or disposal facility is prohibited.
5. Discharge of recycled water to lands other than those listed in Finding No. 1 of this Order is prohibited.
6. Creation of a pollution, contamination, or nuisance, as defined by Section 13050 of the California Water Code (CWC) is prohibited. [Health and Safety Code, Section 5411].
7. Discharge of any radiological, chemical, or biological warfare agent or high level radiological waste is prohibited. [CWC Section 13375]
8. Discharge of sludge is prohibited except as authorized under D. Solids Disposal.

B. DISCHARGE SPECIFICATIONS:

1. The mean daily dry weather flow of waste shall not exceed 0.24 mgd average over a period of thirty consecutive days.
2. Representative samples of wastewater effluent shall not contain constituents in excess of the following limits:

<u>Constituent</u>	<u>Unit</u>	<u>30-DAY AVERAGE</u>	<u>DAILY MEAN</u>	<u>DAILY MAXIMUM</u>
BOD (20°C, 5-day)	mg/l	50	---	80
Suspended Solids	mg/l	50	---	80
Settleable Solids	ml/l		0.1	0.2
Hydrogen Ion	pH Not less than 6.5 nor greater than 8.5			

3. The dissolved oxygen concentration of the treatment ponds and reservoir shall not be depressed below 1.0 mg/l.
4. The application period of recycled water to forage crops shall be the irrigation season of April 1 through November 15. Prior to April 1, or start of irrigation period, wastewater supply ditches, diversions and berms shall be prepared for proper conveyance of recycled water. All necessary drainage facilities shall be installed to adequately manage and control the application and transport of reclaimed water with no runoff to surface waters.

C. WATER RECYCLING REQUIREMENTS

1. Recycled water must be managed in conformance with regulations (water recycling criteria) contained in Title 22, Division 4, Chapter 3, California Code of Regulations. Existing Title 22 regulations for water recycling and additional site specific requirements to prevent nuisance and public health threats are contained in this Order. The discharger shall provide a copy of this Order to all persons to whom it provides recycled water and shall obtain their agreement in writing to comply with all applicable provisions of this Order.
2. The use of recycled water that results in unreasonable waste of water is prohibited.
3. The use of recycled water that creates a condition of pollution or nuisance is prohibited.
4. The discharger shall be responsible to insure that all users of recycled water comply with the terms and conditions of this Order.
5. All areas where recycled water is used and that are accessible to the public shall be fenced and posted with conspicuous signs that include the following wording in a size no less than four inches high by eight inches wide: **RECYCLED WATER - DO NOT DRINK** or **RECLAIMED WATER - DO NOT DRINK**. Each sign shall display an international symbol similar to that shown in Figure 1 attached hereto and made a part of this Order. Signs are to be posted along the perimeter of accessible recycling areas at intervals not to exceed 500 feet with a minimum of one sign at each side of each corner of the parcel and at access road entrances.
6. Except as allowed under Section 7604 of Title 17, no physical connection shall be made or allowed to exist between any recycled water system and any separate system conveying potable water. All piping, valves, and outlets must be marked to differentiate recycled water from other sources. The recycled water piping system shall not include any hose bibbs. Quick couplers that are different from those used on the potable water system may be used.
7. There shall be no discharge of inadequately treated (waste characteristics do not comply with effluent limitations) wastewater from the wastewater treatment facility to any of the water recycling areas.
8. Recycled water, including windblown spray, mist, and runoff of effluent applied for irrigation, must not be discharged onto lands not specifically permitted by this Order or into Oregon Slough and the Shasta River or their tributaries.

9. Recycled water must be controlled in a manner that ensures that irrigation runoff is confined to the recycled water use area and/or returned to the reservoir.
10. Recycled water must not be irrigated (wetted perimeter of irrigation area), impounded, or allowed to runoff within 100 feet of any domestic water supply well.
11. Recycled water must be managed so as to prevent ponding and conditions conducive to the proliferation of mosquitoes and other disease vectors, and to avoid creation of a public nuisance or health hazard.
12. Recycled water must be managed, and spray and mist of recycled water must be controlled, to minimize contact with workers.
13. Recycled water must not be applied to pastures where lactating cows are present. Lactating cows must not be allowed to graze on recycling areas until recycled water has dried on the vegetation.
14. On all water recycling areas:
 - a. Recycled water must not be applied to irrigation areas during periods when soils are saturated. Recycled water must be applied at a rate and volume that does not exceed vegetative demand and soil moisture requirements (Type 1 irrigation).
 - b. Pipelines and conveyance ditches must be maintained to prevent leaks.
15. Crops must be harvested or grazed at appropriate intervals to maintain low vegetative levels in order to permit maintenance and inspection of recycled water areas.
16. Extraneous wet-weather runoff from areas upgradient of the water recycling area shall be diverted around the area and storage reservoir. Diversion facilities shall be installed by October 1 each year and maintained throughout the wet-weather season.

D. SOLIDS DISPOSAL

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of at a legal point of disposal, and in accordance with the provisions of Title 23, Chapter 3, Subchapter 15 of the California Code of Regulations or as waived pursuant to Section 13269 of the California Water Code.

E. PROVISIONS

1. A copy of this Order shall be maintained at the discharge facility and be available at all times to operating personnel.
2. Severability

Provisions of these waste discharge requirements are severable. If any provision of these requirements is found invalid, the remainder of these requirements shall not be affected.

3. Operation and Maintenance

The discharger must maintain in good working order and operate as efficiently as possible any facility or control system installed by the discharger to achieve compliance with the waste discharge requirements.

4. Change in Discharge

The discharger must promptly report to the Regional Water Board any material change in the character, location, or volume of the discharge.

5. Change in Ownership

In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the discharger, the discharger must notify the succeeding owner or operator of the existence of this Order by letter, a copy of which must be forwarded to this office.

6. Vested Rights

This Order does not convey any property rights of any sort or any exclusive privileges. The requirements prescribed herein do not authorize the commission of any act causing injury to persons or property, nor protect the discharger from his liability under federal, State, or local laws, nor create a vested right for the discharger to continue the waste discharge.

7. Monitoring

The discharger must comply with the Contingency Planning and Notification Requirements Order No. 74-151 and the Monitoring and Reporting Program No. 96-68 and any modifications to these documents as specified by the Executive Officer. Such documents are attached to this Order and incorporated herein. Chemical, bacteriological, and bioassay analyses must be conducted at a laboratory certified for such analyses by the State Department of Health Services.

8. Inspections

The discharger shall permit authorized staff of the Regional Water Board:

- a. entry upon premises in which an effluent source is located or in which any required records are kept;
- b. access to copy any records required to be kept under terms and conditions of this Order;
- c. inspection of monitoring equipment or records; and
- d. sampling of any discharge.

9. Noncompliance

In the event the discharger is unable to comply with any of the conditions of this Order due to:

- a. breakdown of waste treatment equipment;
- b. accidents caused by human error or negligence; or
- c. other causes such as acts of nature;

the discharger must notify the Executive Officer by telephone as soon as he or his agents have knowledge of the incident and confirm this notification in writing within two weeks of the telephone notification. The written notification shall include pertinent information explaining reasons for the noncompliance and shall indicate the steps taken to correct the problem and the dates thereof, and the steps being taken to prevent the problem from recurring.

10. Revision of Requirements

This Regional Water Board requires the discharger to file a report of waste discharge at least 120 days before making any material change or proposed change in the character, location, or volume of the discharge.

11. Adequate Capacity

Whenever a publicly owned wastewater treatment plant will reach capacity within four years, the discharger shall notify the Regional Water Board. A copy of such notification shall be sent to appropriate local elected officials, local permitting agencies, and the press. The discharger must demonstrate that adequate steps are being taken to address the capacity problem. The discharger shall submit a technical report to the Regional Water Board showing how flow volumes will be prevented from exceeding capacity, or how capacity will be increased, within 120 days after providing notification to the Regional Water Board, or within 120 days after receipt of Regional Water Board notification, that the POTW will reach capacity within four years. The time for filing the required technical report may be extended by the Regional Water Board. An extension of 30 days may be granted by the Executive Officer, and longer extensions may be granted by the Regional Water Board itself. [CCR Title 23, Section 2232]

12. Operator Certification

Supervisors and operators of municipal wastewater treatment plants shall possess a certificate of appropriate grade in accordance with Title 23, California Code of Regulations, Section 3680. The State Board may accept experience in lieu of qualification training. In lieu of a properly certified wastewater treatment plant operator, the State Board may approve use of a water treatment plant operator of appropriate grade certified by the State Department of Health Services where reclamation is involved.

13. In Order to assure compliance with Discharge Prohibition A-3 of this Order, the discharger shall comply with the following time schedule:

Task

- a. Retain a Civil Engineer to evaluate overloading and unpermitted discharges.

Due by: November 1, 1996

- b. Submit report of sewer system evaluation which describes nature and timing of corrective actions to prevent unpermitted discharges.

Due by: April 1, 1997

- c. Implement a corrective plan to prevent unpermitted discharges.

Due by: September 1, 1998

14. National Pretreatment Standards: Prohibited Discharges

- a. General prohibitions. Pollutants introduced into POTWs by a non-domestic source shall not pass-through [40 CFR403.3(n)] the POTW or interfere [40 CFR 403.3(i)] with the operation or performance of the works. These general prohibitions and the specific prohibitions in paragraph (b) of this provision apply to all non-domestic sources introducing pollutants into a POTW whether or not the source is subject to other National Pretreatment Standards or any national, state, or local Pretreatment Requirements.
- b. Specific prohibitions. In addition, the following pollutants shall not be introduced into a POTW:
 - i. Pollutants which create a fire or explosion hazard in the POTW;
 - ii. Pollutants which will cause corrosive structural damage to the POTW, but in no case discharges with pH lower than 5.0, unless the works is specifically designed to accommodate such discharges;
 - iii. Solid or viscous pollutants in amounts which will cause obstruction to the flow in the POTW resulting in interference;
 - iv. Any pollutant, including oxygen demanding pollutants (BOD, etc.) released in a discharge at a flow rate and/or pollutant concentration which will cause interference with the POTW; and
 - v. Heat in amounts which will inhibit biological activity in the POTW resulting in interference, but in no case heat in such quantities that the temperature at the POTW Treatment Plant exceeds 40°C (104°F) unless the Regional Water Board upon request of the POTW approves alternate temperature limits.
 - vi. Petroleum oil, nonbiodegradable cutting oil, or products of mineral oil origin in amounts that will cause interference or pass through;
 - vii. Pollutants which results in the presence of toxic gases, vapors, or fumes within the POTW in a quantity that may cause acute worker health and safety problems;
 - viii. Any trucked or hauled pollutant, except at discharge points designated by the POTW.


- c. When specific limits must be developed by a POTW.
 - i. POTWs developing POTW Pretreatment Programs pursuant to 40 CFR 403.8 shall develop and enforce specific limits to implement the prohibitions listed in paragraphs (a) and (b) of this provision.
 - ii. All POTWs shall, in cases where pollutants contributed by User(s) result in interference or pass-through, and such violation is likely to recur, develop and enforce specific effluent limits for Industrial User(s), and all other users, as appropriate, which, together with appropriate changes in the POTW Treatment Plant's facilities or operations, are necessary to ensure renewed and continued compliance with the POTW's Order or sludge use or disposal practices.
 - iii. Specific effluent limits shall not be developed and enforced without individual notice to persons or groups who have requested such notice and an opportunity to respond.
- d. Local limits. Where specific prohibitions or limits on pollutants or pollutant parameters are developed by a POTW in accordance with paragraph (c) above, such limits shall be deemed Pretreatment Standards for the purposes of Section 307(d) of the Clean Water Act. [40 CFR 403.5(a) through (d)]

Certification

I, Craig R. Johnson, Acting Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, North Coast Region, on September 26, 1996.

Craig R. Johnson
Acting Executive Officer


(mntguwdr)

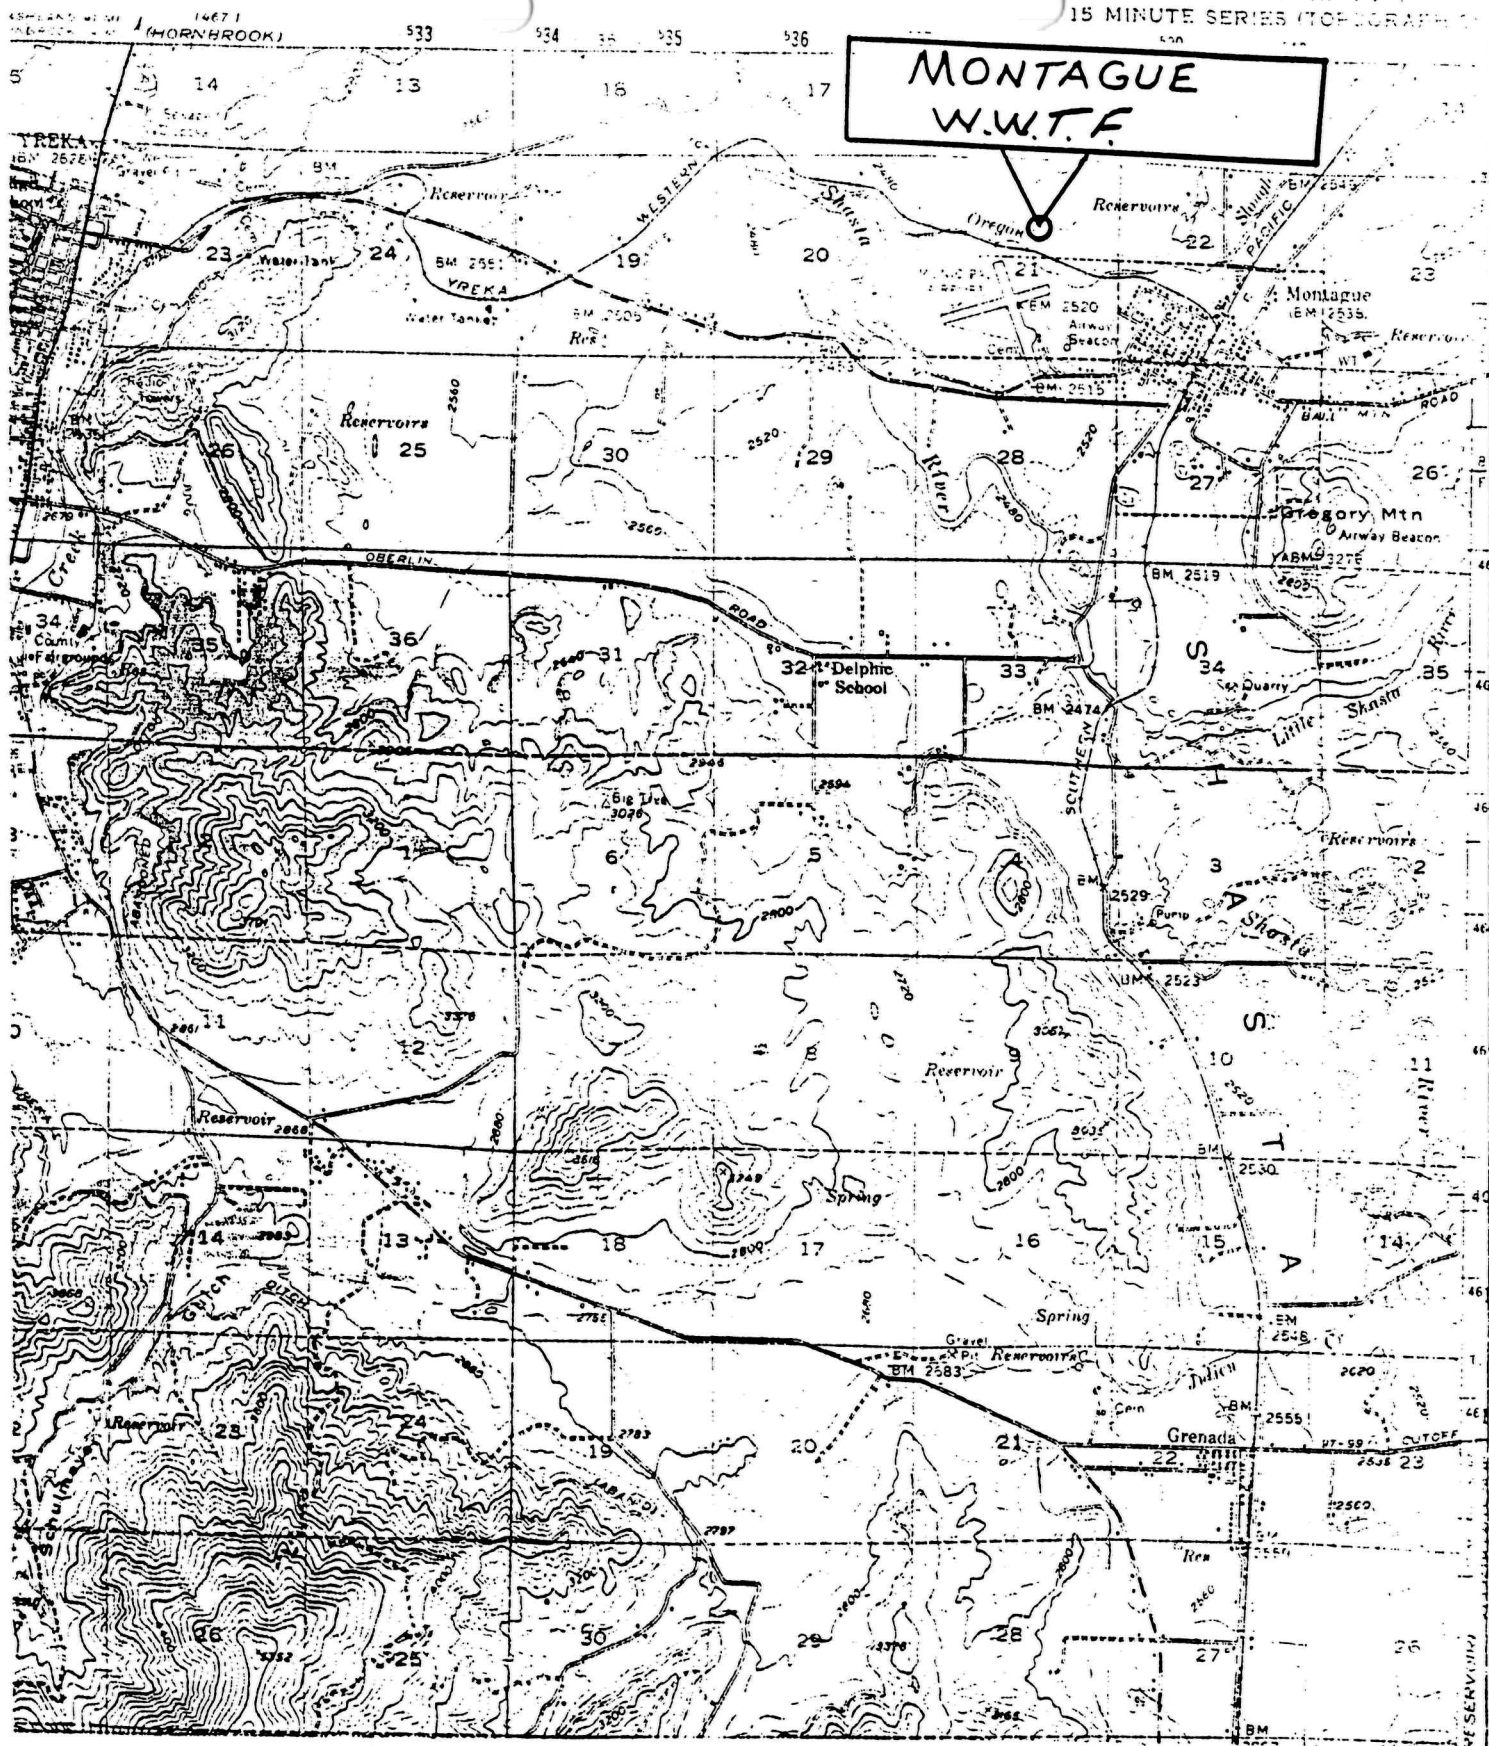

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
NORTH COAST REGION


ATTACHMENT "A" TO ORDER NO. 96-68

QUADRANGLE Yreka 15 Minute

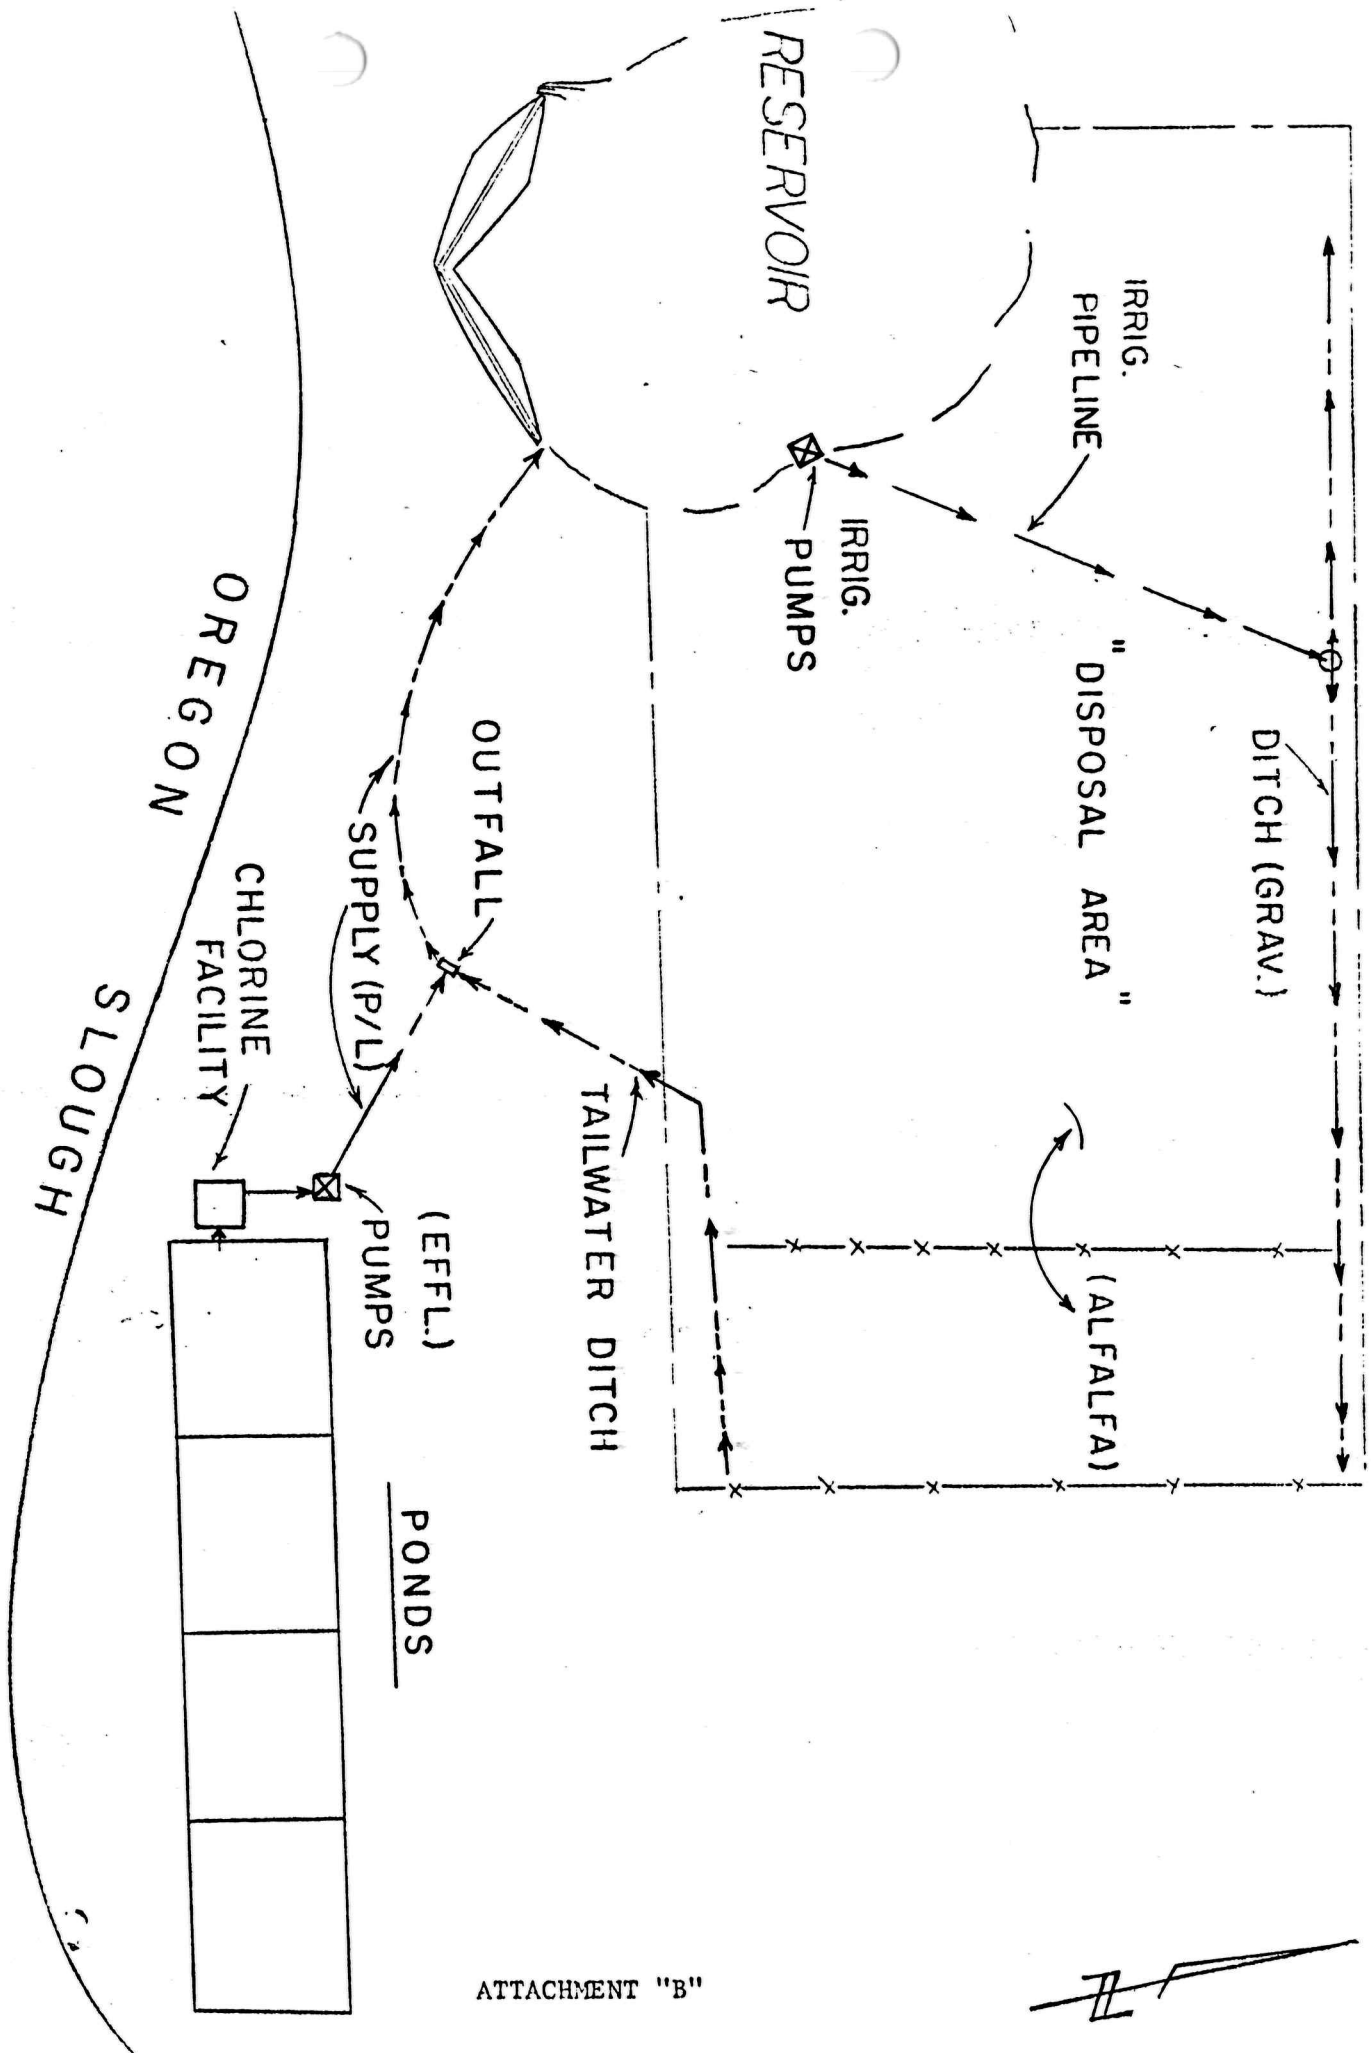

ATTACHMENT "B"

FIGURE 1

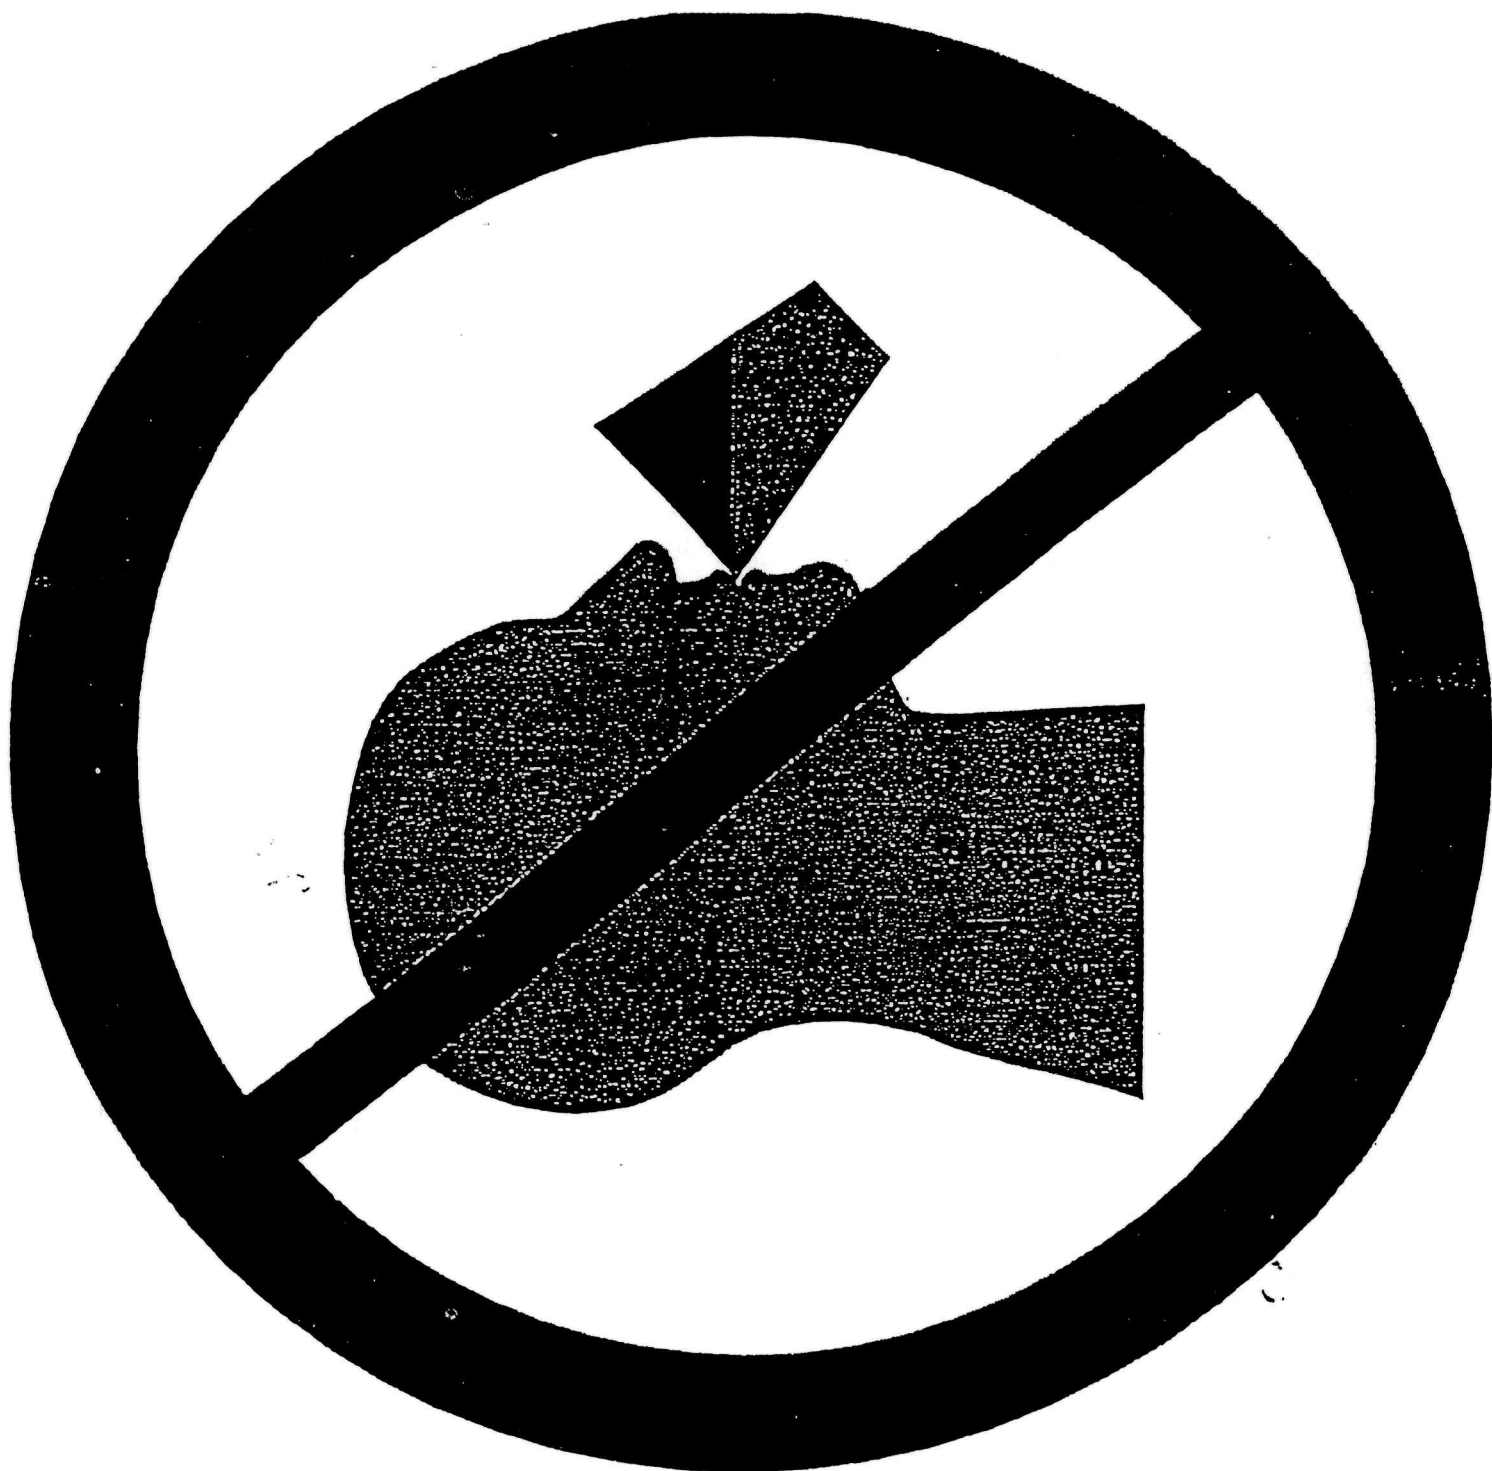

California Regional Water Quality Control Board
North Coast Region

MONITORING AND REPORTING PROGRAM NO. 96-68

FOR

CITY OF MONTAGUE

Siskiyou County

WASTEWATER MONITORING

Effluent samples shall be collected below the overflow weir at pond No. 4. Composite samples may be taken by a proportional sampling device approved by the Executive Officer or by grab samples composited in proportion to flow. In compositing grab samples, the sampling interval shall not exceed one hour. The following shall constitute the monitoring program:

<u>Constituent</u>	<u>Unit</u>	<u>Type of Sample</u>	<u>Frequency</u>
BOD (20°C, 5-day)	mg/l	8-hour composite	Monthly
Suspended Solids	mg/l	8-hour composite	Monthly
Settleable Solids	ml/l	8-hour composite	Monthly
pH	---	grab	weekly
Effluent Flow	gpd	----	Daily
Effluent Flow	gpd	----	Daily maximum

RESERVOIR MONITORING

A staff gage for freeboard levels shall be maintained at a convenient location within the reservoir. Distances below the spillway invert to the lowest water level (red line mark) necessary to provide winter storage shall be calibrated in feet and tenths of feet. Water level shall be measured as follows:

<u>Period</u>	<u>Frequency</u>
October 1 to May 31	Once Weekly
June 1, to September 30	Bi-weekly

The dissolved oxygen content of the recycled water within the irrigation reservoir shall be determined once monthly. Sampling shall be conducted during the early morning hours.

Operation and Maintenance Schedule

Effluent Pumping Facilities

- a. Pumping facilities shall be inspected at least once each year for wear, repairs, and required maintenance to permit irrigation and disposal of wastewater stored in the reservoir.
- b. Records shall be kept of preventative maintenance performed on pump facilities.

WATER RECYCLING MONITORING

Recycled Water Use

- a. An irrigation plan and schedule for using stored recycled water shall be submitted to the Regional Water Board prior to start of each irrigation season. The schedule shall describe projected monthly withdrawal rates and/or reservoir drawdown levels necessary to achieve capacity, by October 1, for winter storage of wastewater.
- b. Weekly estimates of the quantity of recycled water shall be recorded and reported to the Regional Water Board. Climatic conditions which affect recycled water usage shall be recorded.
- c. Installation and maintenance of wet-weather diversion facilities shall be reported to the Regional Water Board as part of each monthly monitoring report.
- d. During the water recycling season, weekly inspections shall be conducted, unannounced, at the site where water is being recycled. Observations shall be made and recorded regarding compliance with section C. WATER RECYCLING REQUIREMENTS of Order No. 96-68. Observations shall include location of recycled water use, setback distances from specified objects/areas, saturated or ponded conditions, runoff or windblown spray/mist, crop harvesting, leaky or broken pipes/sprinklers/ditches, and presence or absence of "wet" (lactating) cows on either wet or dry pastures that receive recycled water.

Daily water recycling quantities and a summary of daily recycling observations shall be submitted with monthly monitoring reports. Observed violations and corrective measures should be noted in the report. Significant violations that impact or threaten to impact public health or water quality are subject to notification requirements contained in Provision D. 9 Noncompliance.

REPORTING

Monthly monitoring reports shall be submitted to the Regional Water Board by the 15th day of the following month. Monitoring reports shall contain all monitoring results that were obtained during the month for which the report is prepared. In reporting the monitoring data, the discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with Waste Discharge Requirements. Narrative reporting should be in letter form and signed by the responsible representative.

Ordered by _____

Craig R. Johnson
Acting Executive Officer

September 26, 1996

(MTGUSMR)

California Regional Water Quality Control Board
North Coast Region

CONTINGENCY PLANNING AND NOTIFICATION REQUIREMENTS

FOR

ACCIDENTAL SPILLS AND DISCHARGES

ORDER NO. 74-151

The California Regional Water Quality Control Board, North Coast Region, finds that:


1. Section 13225 of the Porter-Cologne Water Quality Act requires the Regional Board to perform general duties to assure positive water quality control.
2. The Regional Board has been advised of situations in which preparations for, and response to accidental discharges and spills have been inadequate.
3. Persons discharging waste or conveying, supplying, storing, or managing wastes or hazardous materials have the primary responsibility for contingency planning, incident reporting and continuous and diligent action to abate the effects of such unintentional or accidental discharge.

THEREFORE, IT IS HEREBY ORDERED THAT:

- I. All persons who discharge wastes or convey, supply, store, or otherwise manage wastes or other hazardous material shall:
 - A. Prepare and submit to this Regional Board, according to a time schedule prescribed by the Executive Officer, a contingency plan defining the following:
 1. Potential locations and/or circumstances under which accidental discharge incidents might be expected to occur,
 2. Possible water quality effects of accidental discharges,
 3. The conceptual plan for cleanup and abatement of accidental discharge incidents, including:
 - a. The individual who will be in charge of cleanup and abatement activities on behalf of the discharger,
 - b. The equipment and manpower available to the discharger to implement the cleanup and abatement plans,
 - B. Immediately report to the Regional Board any accidental discharge incidents. Such notification shall be made by telephone as soon as the responsible person or his agent has knowledge of the incident.
 - C. Immediately begin diligent and continuous action to cleanup and abate the effects of any unintentional or accidental discharge. Such action shall include temporary measures to abate the discharge prior to completing permanent repairs to damaged facilities.

- D. Confirm the telephone notification in writing within two weeks of the telephone notification. The written notification shall include: reasons for the discharge, duration and volume of the discharge, steps taken to correct the problem and steps being taken to prevent the problem from recurring.
- II. Upon original receipt of phone report (I.B.), the Executive Officer shall immediately notify all affected agencies and known users of waters affected by the unintentional or accidental discharge.
- III. Provide updated information to the Regional Board in the event of change of staff, size of the facility, or change of operating procedures which will affect the previously established contingency plan.
- IV. The Executive Officer or his employees shall maintain liaison with the discharger and other affected agencies and persons to provide assistance in cleanup and abatement activities.
- V. The Executive Officer shall transmit copies of this Order to all persons whose discharges of waste handling activities are governed by Waste Discharge Requirements or an NDPES permit. Such transmittal shall include a current listing of telephone numbers of the Executive Officer and his key employees to facilitate compliance with Item I.B of this Order.

Ordered by

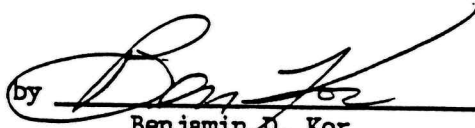
Benjamin D. Kor
Executive Officer

July 24, 1974
(Retyped February 15, 1990)

Your primary notification should be to the Regional Board office in Santa Rosa at (707) 576-2220. During off hours, you will be able to leave a recorded message at that number and, if you have a spill or discharge emergency, you will also be referred to the State Office of Emergency Services (OES) at (800) 852-7550. OES maintains a roster of key employees and will relay your notification to Regional Board staff.

California Regional Water Quality Control Board
North Coast Region

GENERAL MONITORING AND REPORTING PROVISIONS

February 3, 1971
(Retyped May 20, 1993)

GENERAL PROVISIONS FOR SAMPLING AND ANALYSIS

Unless otherwise noted, all sampling, sample preservation, and analyses shall be conducted in accordance with the current edition of "Standard Methods for the Examination of Water and Waste Water" or approved by the Executive Officer.

All analyses shall be performed in a laboratory certified to perform such analyses by the California State Department of Health or a laboratory approved by the Executive Officer.

All samples shall be representative of the waste discharge under the conditions of peak load.

GENERAL PROVISIONS FOR REPORTING

For every item where the requirements are not met, the discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge in full compliance with requirements at the earliest time and submit a timetable for correction.

By January 30 of each year, the discharger shall submit an annual report to the Regional Board. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The discharger shall file a written report within 90 days after the average dry weather flow for any month that equals or exceeds 75 percent of the design capacity of the waste treatment or disposal facilities. The report shall contain a schedule for studies, design, and other steps needed to provide additional capacity or limit the flow below the design capacity prior to the time when the waste flow rate equals the capacity of the present units.