

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
CENTRAL VALLEY REGION

ORDER NO. 97-254

WASTE DISCHARGE REQUIREMENTS  
FOR  
WEST ALMANOR COMMUNITY SERVICES DISTRICT  
LAKE ALMANOR WEST  
PLUMAS COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Waste Discharge Requirements Order No. 88-087, adopted by the Board on 20 May 1988, prescribes requirements for Plumas County Service Area No. 2 for the discharge of domestic wastewater from individual homes to individual septic tank/leachfield systems within the Lake Almanor West 654-lot subdivision.
2. On 10 August 1994, Plumas County notified the Board that Plumas County Service Area No. 2 was dissolved and West Almanor Community Services District (hereafter Discharger) was established to control, maintain, and administer wastewater disposal systems within the Lake Almanor West subdivision.
3. Present waste discharge requirements, established by Order No. 88-087, are neither adequate nor consistent with plans and policies of the Board.
4. Lake Almanor West is a 654-lot subdivision on the west shore of Lake Almanor, 5 miles south of Chester on State Highway 89, in Sections 29, 32, and 33; T28N; R7E; MDB&M. Surface water drainage is to Lake Almanor, as shown on Attachment A, which is attached hereto and part of this Order by reference. The site lies within the Lake Almanor hydrologic unit/area/subarea (No. 518.41) as depicted on interagency hydrologic maps prepared by the Department of Water Resources in August 1986.
5. The 615-acre subdivision is at an elevation ranging from 4,500 to 4,800 feet MSL. The underlying soils consists of pleistocene volcanics mainly composed of andesite and basalt rock. The lake site area is quaternary lake deposits. Soils are classed as Cohasset Association by the Soil Conservation Service. Cohasset soils have slightly acid, soft, granular, brown loam surface layers and strongly acid, hard, blocky, reddish-brown clay loam subsoils. Permeability is moderate.
6. The Discharger has monitored groundwater at this site since July 1975. Monitoring results submitted to date indicate no significant impact on the shallow groundwater or the waters of Lake Almanor.

WASTE DISCHARGE REQUIREMENTS  
WEST ALMANOR COMMUNITY SERVICES DISTRICT  
LAKE ALMANOR WEST  
PLUMAS COUNTY

-2-

7. The Discharger submitted a Septic System Maintenance Plan dated 24 November 1997. The plan establishes an ongoing public education program on the proper septic system maintenance and establishes a monitoring and maintenance program within the district boundaries.
8. The Board adopted a Water Quality Control Plan, Third Edition, for the Sacramento River Basin and the San Joaquin River Basin (hereafter Basin Plan), which designates beneficial uses, establishes water quality objectives, and describes an implementation program and policies to achieve those objectives for all waters of the Basin. These requirements implement the Basin Plan.
9. The beneficial uses of Lake Almanor are agricultural supply; recreation; esthetic enjoyment; navigation; groundwater recharge; freshwater replenishment; hydroelectric power generation; and preservation and enhancement of fish, wildlife, and other aquatic resources.
10. The beneficial uses of underlying groundwater are municipal, industrial, and agricultural supply.
11. The action to revise waste discharge requirements for this existing facility is exempt from the provisions of the California Environmental Quality Act (CEQA) in accordance with Title 14, California Code of Regulations (CCR), Section 15301.
12. This discharge is exempt from the requirements of *Consolidated Regulations for Treatment, Storage, Processing, or Disposal of Solid Waste*, as set forth in Title 27, CCR, Division 2, Subdivision 1, Section 20005, et seq., (hereafter Title 27). The exemption, pursuant to Section 20090(b), is based on the following:
  - a. The Board is issuing waste discharge requirements, and
  - b. The discharge complies with the Basin Plan, and
  - c. The wastewater does not need to be managed according to 22 CCR, Division 4.5, Chapter 11, as a hazardous waste.
13. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.

WASTE DISCHARGE REQUIREMENTS  
WEST ALMANOR COMMUNITY SERVICES DISTRICT  
LAKE ALMANOR WEST  
PLUMAS COUNTY

-3-

14. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 88-087 is rescinded and West Almanor Community Services District, Lake Almanor West, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

**A. Discharge Prohibitions**

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. By-pass or overflow of untreated or partially treated waste is prohibited.
3. The discharge of solid or liquid waste materials, including soil, silt, clay, sand, and other earthen or organic materials, to Lake Almanor or any tributaries is prohibited.
4. The discharge to leachfield systems below elevation 4,500 feet (PG&E datum) is prohibited.
5. The discharge to leachfield systems less than 100 feet horizontal distance from the high waterline of Lake Almanor, elevation 4,494 feet (PG&E datum), is prohibited.
6. The discharge of industrial wastes and/or washwater other than domestic wastewater to septic tank leachfield systems is prohibited.

**B. Discharge Specifications**

1. Neither the treatment nor the discharge shall cause a pollution or nuisance as defined by the California Water Code, Section 13050.
2. The discharge shall not cause a degradation of any water supply.
3. The discharge to subsurface leaching systems shall remain underground at all times.

WASTE DISCHARGE REQUIREMENTS  
WEST ALMANOR COMMUNITY SERVICES DISTRICT  
LAKE ALMANOR WEST  
PLUMAS COUNTY

-4-

4. Depth of soil below the bottom of the leaching trenches to the highest anticipated groundwater, fractured rock, or impervious soil layer shall not be less than 5 feet.

**C. Sludge Disposal**

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Title 27 and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice from a previously approved practice shall be reported to the Executive Officer at least 90 days in advance of the change.

**D. Groundwater Limitations**

1. The discharge, in combination with other sources, shall not cause underlying groundwater to contain waste constituents in concentrations statistically greater than background water quality.

**E. Provisions**

1. The Discharger shall comply with Monitoring and Reporting Program No. 97-254, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements," dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
4. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.

WASTE DISCHARGE REQUIREMENTS  
WEST ALMANOR COMMUNITY SERVICES DISTRICT  
LAKE ALMANOR WEST  
PLUMAS COUNTY

-5-

5. A copy of this Order shall be kept at the facility for reference by all property owners and operating personnel. Key operating personnel shall be familiar with its contents.
6. The Board will review this Order periodically and will revise requirements when necessary.

I, GARY M. CARLTON, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 5 December 1997.

  
GARY M. CARLTON, Executive Officer

GDD:djc

AMENDED 12/5/97

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 97-254

FOR  
WEST ALMANOR COMMUNITY SERVICES DISTRICT  
LAKE ALMANOR WEST  
PLUMAS COUNTY

**GROUNDWATER MONITORING**

Groundwater monitoring points consist of the following:

- Well No. 1: Lot #52, Unit 1 on Kokanee Trail, established in 1975
- Well No. 2: Lot #93, Unit 1 on Lake Almanor West Drive, established in 1975
- Well No. 5: Beach and recreation area, established in 1981
- Well No. 6: Driving range, established in 1981
- Well No. 7: Boat launch area H, Unit 4, established in 1981

The following shall constitute the groundwater monitoring program for Well Nos. 1, 2, 5, 6, and 7:

| <u>Parameter</u>         | <u>Unit</u>   | <u>Sampling<br/>Frequency</u> |
|--------------------------|---------------|-------------------------------|
| Total and Fecal Coliform | MPN/100 ml    | April, October                |
| Specific Conductance     | $\mu$ mhos/cm | April, October                |
| Chlorides                | mg/l          | April, October                |
| Nitrate (N)              | mg/l          | April, October                |
| Depth to Water           | Feet, Tenths  | April, October                |

**REPORTING**

The monitoring reports shall be submitted to the Regional Board by the **15th day of May and November**. In reporting the data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.


MONITORING AND REPORTING PROGRAM  
WEST ALMANOR COMMUNITY SERVICES DISTRICT  
LAKE ALMANOR WEST  
PLUMAS COUNTY

-2-

Upon written request of the Board, the Discharger shall submit a report to the Board by **30 January of each year**. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered by:

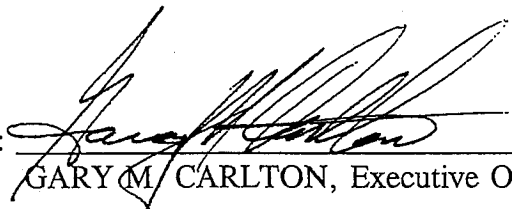
  
GARY M. CARLTON, Executive Officer

5 December 1997

(Date)

GDD:djc

ATTACHMENT A

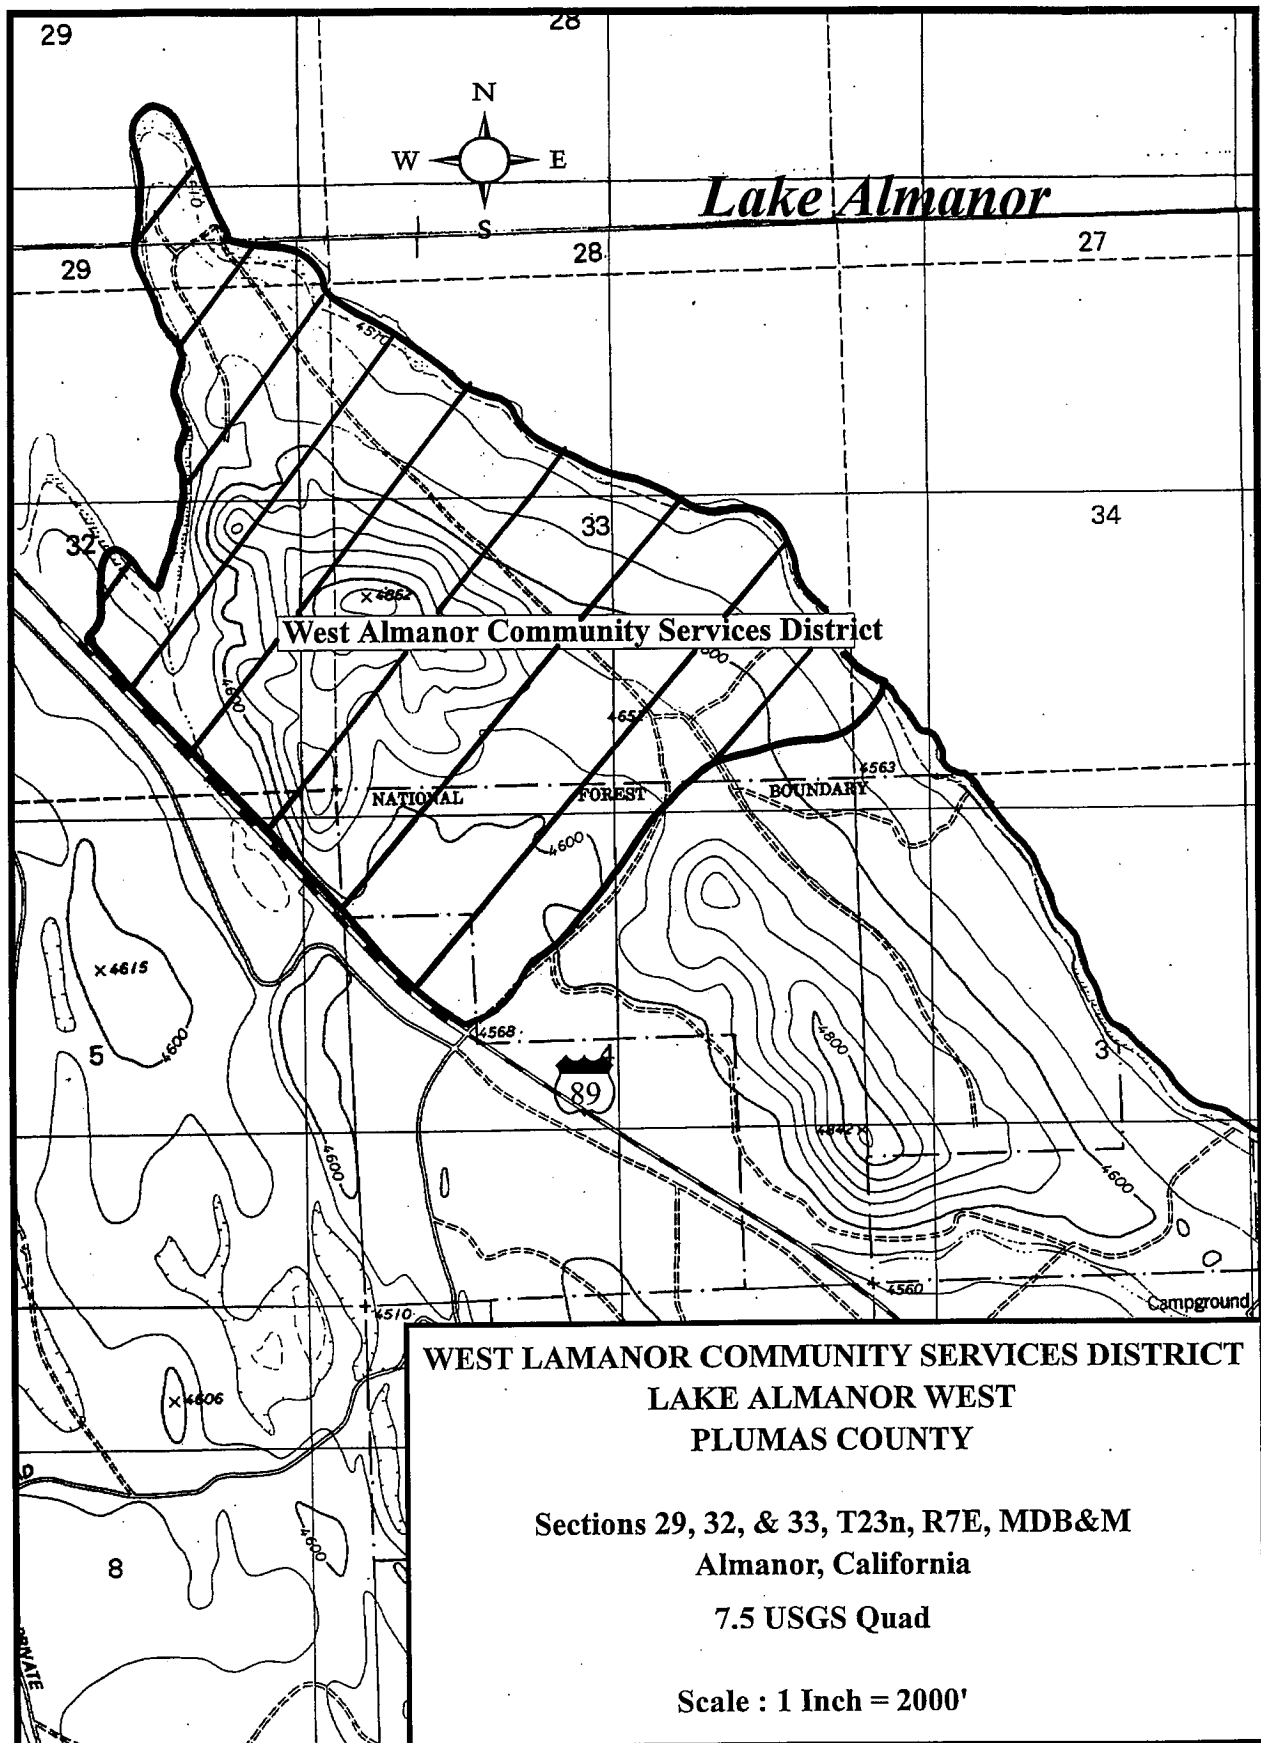



## INFORMATION SHEET

### WEST ALMANOR COMMUNITY SERVICES DISTRICT LAKE ALMANOR WEST PLUMAS COUNTY

On 10 August 1994, Plumas County notified the Board that Plumas County Service Area No. 2 was dissolved and West Almanor Community Services District was established to control, maintain and administer wastewater disposal systems within the Lake Almanor West subdivision. The Lake Almanor West is an existing 654-lot subdivision on the west shore of Lake Almanor, 5 miles south of Chester and adjacent to State Highway 89 in Sections 29, 32, and 33; T28N; R7E; MDB&M. Surface water drainage is to Lake Almanor (hydrologic unit/area/subarea (No. 518.41)). The subdivision covers approximately 615 acres and ranges in elevation from 4,500 to 4,800 feet MSL. The 4,500-foot elevation is the Pacific Gas & Electric Company's lake boundary and high water mark.

The geologic formation below the subdivision consists of pleistocene volcanics mainly composed of andesite and basalt rock. The lake site area is quaternary lake deposits. Soils are classed as Cohasset Association by the Soil Conservation Service. Cohasset soils have slightly acid, soft, granular, brown loam surface layers and strongly acid, hard, blocky, reddish-brown clay loam subsoils. Permeability is moderate.

The average-annual precipitation is 30 inches (mostly snow), and the average annual evaporation is 40 inches.

GDD:djc 12/5/97