

California Regional Water Quality Control Board
Santa Ana Region

April 17, 1998

ITEM: 14

SUBJECT: Waste Discharge Requirements for the City of Redlands Wastewater Treatment Plant, San Bernardino County, Order No. 98-54.

DISCUSSION:

The City of Redlands operates a wastewater treatment plant located at 1950 Nevada Street in the City of Redlands. The plant currently treats approximately 6 million gallons per day (MGD) of domestic, commercial and industrial wastewaters from the City of Redlands and a portion of the unincorporated areas of San Bernardino County. The design capacity of the plant is 9.5 MGD. The plant employs secondary treatment and includes headwork structures, primary clarifiers, trickling filters, peak storage ponds, nitrification/denitrification basins, and final clarifiers. Treated wastewater is discharged to eight percolation ponds which cover 36 acres, east of Alabama Street in the City of Redlands. The ponds are operated on an alternating fill and dry basis.

The percolation ponds overlie the Bunker Hill II Groundwater Subbasin which has the following beneficial uses: municipal and domestic supply; agricultural supply; industrial service supply; and industrial process supply. The Bunker Hill II Groundwater Subbasin lacks assimilative capacity for total dissolved solids (TDS). The Basin Plan includes a TDS wasteload allocation of 465 mg/l for the City's discharge to the percolation ponds. However, the plan notes that this allocation is applicable only if the discharger participates in a suitable TDS offset program. If the discharger does not participate in an offset program, discharges to this subbasin must meet the subbasin's TDS objective of 290 mg/l.

The City, with its present treatment system, cannot comply with the 290 mg/l TDS limit. Effluent monitoring data for the period between September 1996 and October 1997 shows a maximum TDS concentration of 432 mg/l, a minimum of 332 mg/l and an average of 398 mg/l.

Currently, a number of dischargers to the Santa Ana River and other interested parties, including the City of Redlands, are conducting a watershed-wide study of total inorganic nitrogen (TIN) and TDS (hereafter, the TDS/TIN study) which is being coordinated by Santa Ana Watershed Project Authority. This study may lead to revised findings regarding TDS/TIN assimilative capacity, recommendations for changes to the TDS/TIN wasteload allocations, and other TDS/TIN management strategies.

The proposed Order states that the Board will not take any enforcement action against the City for violations of the 290 mg/l TDS limit provided the City develops and implements a plan to offset the effects of the violation on the receiving waters. The proposed Order also finds that participation in the TDS/TIN study constitutes an acceptable TDS offset for the duration of the study or the discharger's participation in it.

The Basin Plan also specifies a wasteload allocation of 10 mg/l for TIN to be achieved by 1995. Effluent monitoring data (Sept. 1996 to October 1997) indicate that the City will not be able to comply with that wasteload allocation. The Regional Board has determined that deferring full compliance with the TIN wasteload allocation, as implemented by the TIN effluent limitations contained in Order No. 98-54 is appropriate for participants in the TDS/TIN study.

The proposed Order contains a compliance schedule¹ and establishes interim effluent limit for TIN until full compliance with the limits can be achieved. The interim effluent limitation is based upon past operational performance. If warranted by the results of the TDS/TIN study, Order No. 98-54 will be updated to incorporate revised TDS/TIN requirements.

The proposed limitations for suspended solids and biochemical oxygen demand are at levels that are technologically and economically achievable. The proposed metals and mineral limits specified in the Order are based on the groundwater quality objectives specified in the Basin Plan.

This Order contains requirements for the implementation of an effective pretreatment program pursuant to: Section 307 of the Federal Clean Water Act; Parts 35 and 403 of Title 40, Code of Federal Regulations (40 CFR 35 and 40 CFR 403); and Section 2233, Title 23, California Code of Regulations.

The facility location is shown in Attachment "A"

The flow diagram of waste treatment is shown in Attachment "B".

RECOMMENDATION:

Adopt Order No. 98-54 as presented.


Comments were solicited from the following agencies and or persons:

State Water Resources Control Board, Office of the Chief Counsel - Ted Cobb
State Water Resources Control Board, Division of Water Quality - John Youngerman
Department of Health Services, San Bernardino - Kalyanpur Y. Baliga
State Department of Water Resources - Glendale
State Department of Fish and Game - Long Beach
Santa Ana Watershed Project Authority


¹ For discharges to the Santa Ana River which are regulated under federal National Pollutant Elimination System (NPDES) permit, this compliance schedule relief has been provided in the issuance of a Cease and Desist Order. Federal regulations preclude incorporation of compliance schedule in permits unless specified in the Basin Plan. The Basin Plan does not include compliance schedule provisions.

Santa Ana River Dischargers Association - Joseph Zoba
San Bernardino County Transportation and Flood Control Department - Naresh Varma
San Bernardino County Environmental Health Services - Scott Maass
Orange County Water District - Nira Yamachika
City of Redlands – City Manager

Location Map

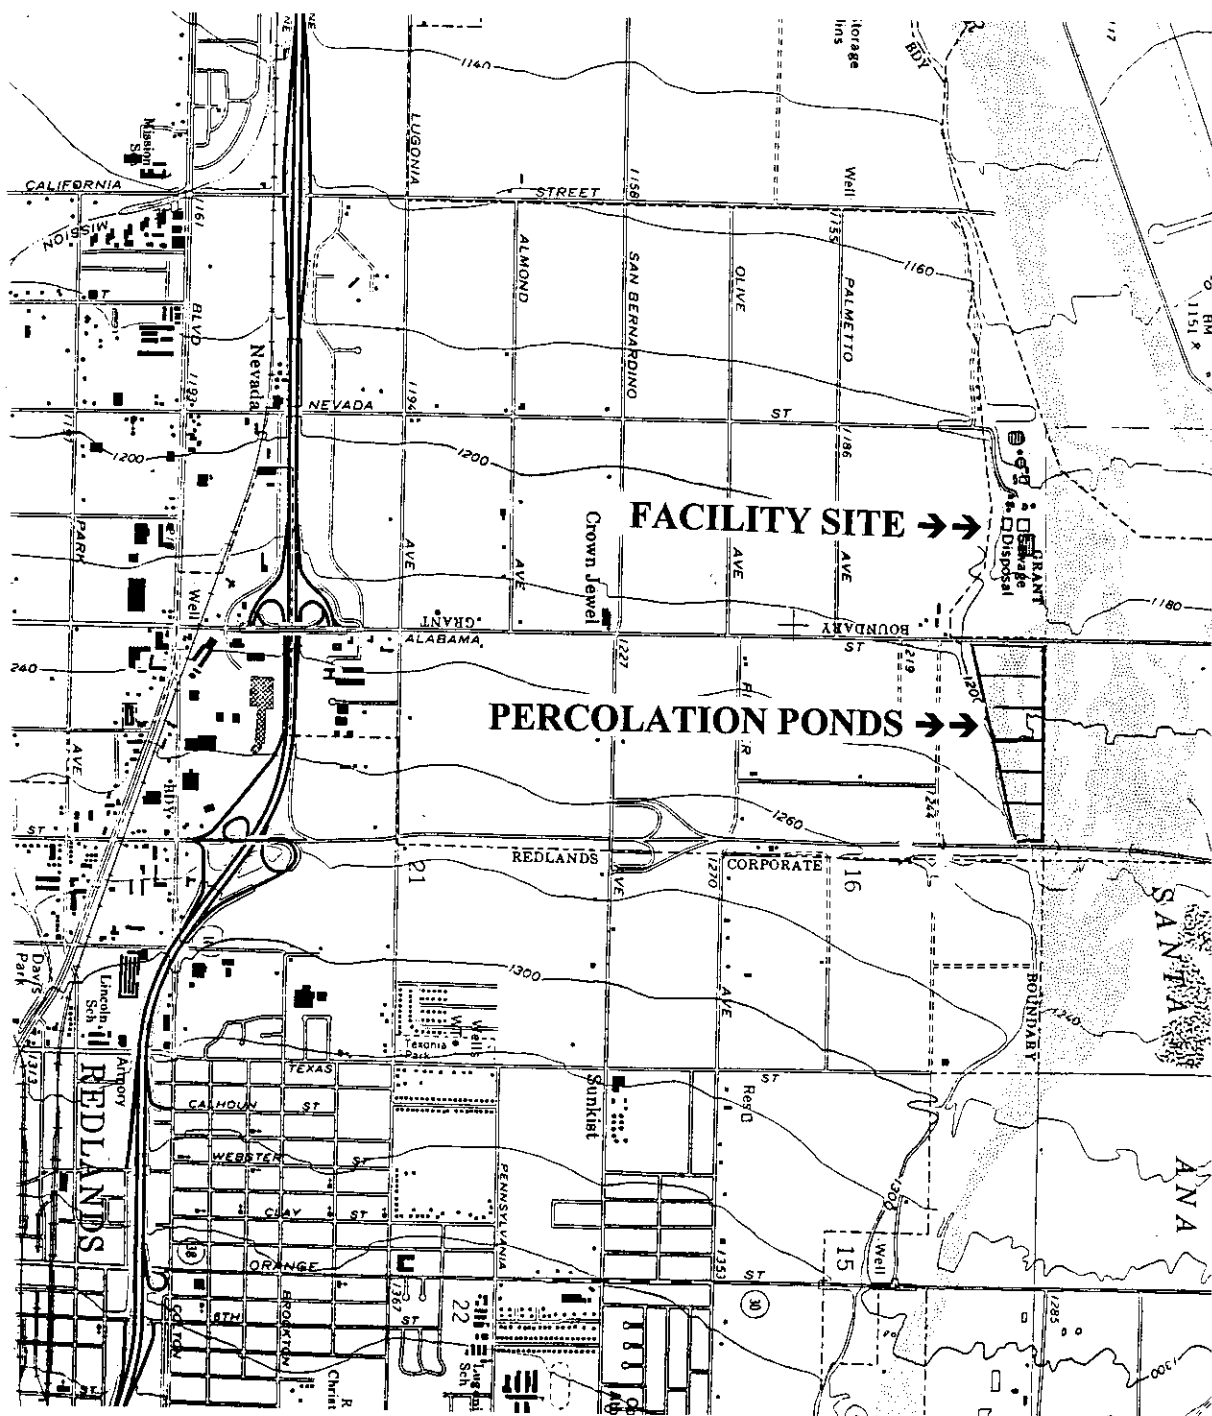

Schematic of Treatment Plant Wastewater Flow

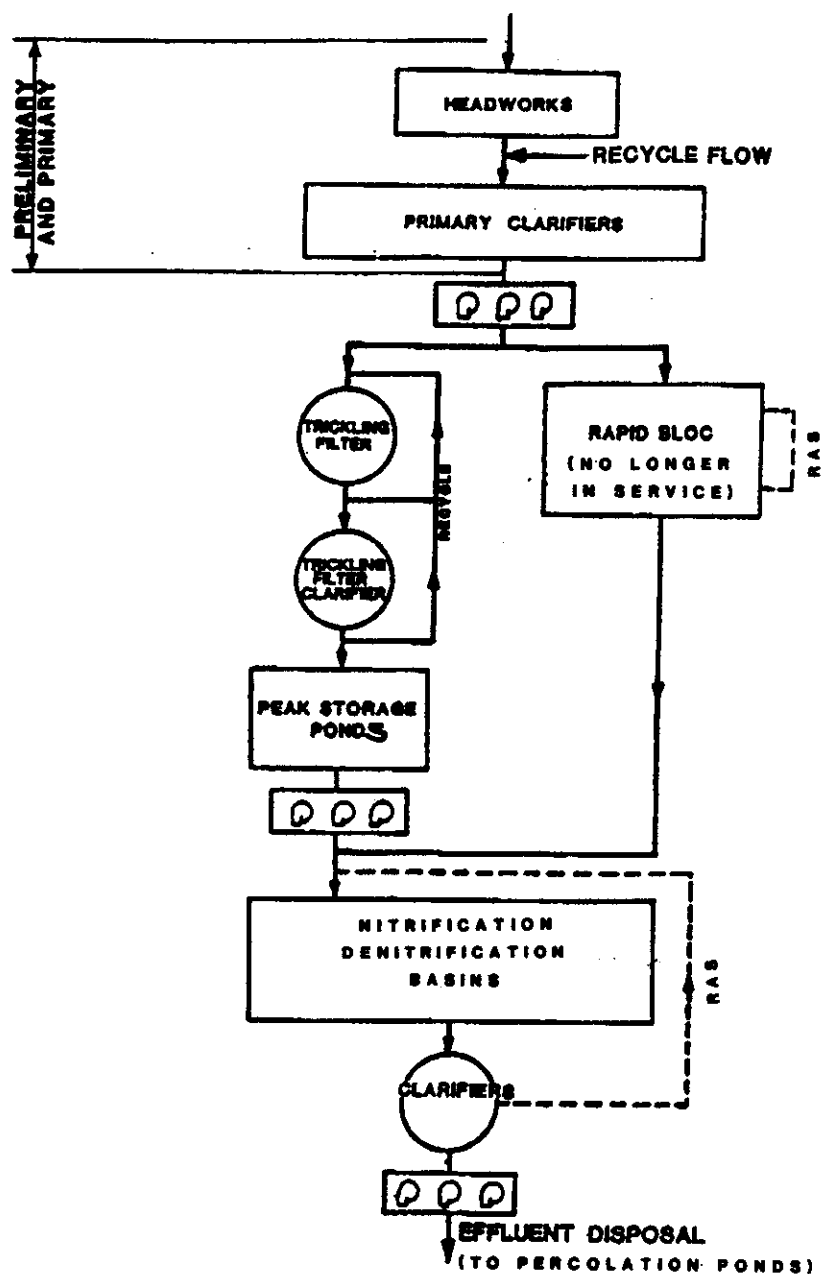

California Regional Water Quality Control Board
Santa Ana Region

ORDER NO. 98-54

Waste Discharge Requirements

for the

City of Redlands
Wastewater Treatment Plant
San Bernardino County

The California Regional Water Quality Control Board, Santa Ana Region (hereinafter, Regional Board), finds that:

1. The City of Redlands (hereinafter, discharger) operates a municipal wastewater treatment plant located at 1950 Nevada Street in the City of Redlands (N1/2 of the NE1/4 of Section 17, T1S, R3W, SBB&M). Approximately 6 MGD of treated wastewater is currently discharged from the plant under Order No. 88-16, adopted by the Regional Board on March 11, 1988.
2. The design capacity of the treatment plant is 9.5 million gallons per day. It provides secondary treatment of domestic, commercial and industrial wastewater from the City of Redlands and a portion of the unincorporated area of San Bernardino County.
3. The treatment plant consists of a headwork structure, primary clarifiers, trickling filters, equalization basins, nitrification and denitrification basins and final clarifiers.
4. Secondary treated wastewater is discharged into eight percolation ponds under conditions of alternating fill and dry cycles. The percolation ponds cover 36 acres and are located east of Alabama Street adjacent to the Alabama Street Landfill and Santa Ana River. They are approximately 2000 feet east of the treatment plant.
5. A Water Quality Control Plan (Basin Plan) became effective on January 24, 1995. The Basin Plan contains beneficial uses and water quality objectives for waters in the Santa Ana Region.
6. The discharge overlies the Bunker Hill II Groundwater Subbasin, the beneficial uses of which include:
 - a. Municipal and domestic supply,
 - b. Agricultural supply,
 - c. Industrial service supply, and
 - d. Industrial process supply.

7. The requirements contained in this Order are necessary to meet the water quality objectives and protect the beneficial uses specified in the Basin Plan.
8. It is appropriate and necessary to limit the concentrations of individual mineral/inorganic constituents that may be in the discharge.
9. The Bunker Hill II Groundwater Subbasin lacks assimilative capacity for total dissolved solids (TDS). Consequently, this order contains a TDS limit of 290 mg/l, the water quality objective for that groundwater subbasin.
10. The Basin Plan includes a TDS wasteload allocation of 465 mg/l for discharges to the percolation ponds. However, the Basin Plan notes that this allocation applies in lieu of direct application of the groundwater subbasin objective, only if the discharger participates in an approved mitigation (offset) program.
11. Currently, a number of river dischargers and interested parties, including the discharger, are conducting a watershed-wide study of TDS and TIN (hereinafter TDS/TIN study) which is being coordinated by the Santa Ana Watershed Project Authority. This study may lead to revised findings regarding TDS/TIN assimilative capacity, recommendations for changes to wasteload allocations, and other TDS/TIN management strategies. Participation in the TDS/TIN study is an acceptable offset for discharges in excess of the 290 mg/l TDS limit specified in this Order for the duration of the study or, if the discharger elects to discontinue its involvement, for the duration of the discharger's participation in the study.
12. The Basin Plan also includes wasteload allocations for discharges of total inorganic nitrogen (TIN) within the Region. In conformance with the TIN wasteload allocation, this order specifies a limit of 10 mg/l TIN for all discharges from the City of Redlands' wastewater treatment plant.
13. Effluent monitoring data collected between September 1996 and October 1997 shows an average TIN concentration in the discharge of approximately 13.4 mg/l. The discharger cannot meet the TIN limit specified in this Order unless the existing treatment plant is modified or a revised wasteload allocation is adopted by the Regional Board.
14. It is appropriate to defer requiring full compliance with the TIN limit specified in this Order, based upon the discharger's commitment to participate in the TDS/TIN study. If warranted by the results of the TDS/TIN study, this Order will be updated to incorporate a revised TIN effluent limit.
15. This Order establishes an interim effluent limit for TIN until full compliance with the specified effluent limit can be achieved. The interim effluent limitation is based upon past operational performance.

16. This Order contains limits for average concentrations of sodium, chloride, sulfate, total dissolved solids and total hardness which the discharger may reasonably achieve using reasonable methods such as, but not limited to a source control program and or the control of water supply sources.
17. On April 17, 1997, the State Water Resources Control Board adopted the General Industrial Storm Water Permit, Order No. 97-03-DWQ, NPDES No. CAS000001. This General Permit implements the Final Regulations (40 CFR 122, 123, and 124) for storm water runoff published on November 16, 1990 by the U.S. EPA in compliance with Section 402(p) of the Clean Water Act (CWA). The City of Redlands' wastewater treatment plant is regulated under the General Industrial Storm Water Permit.
18. This order contains requirements for the implementation of an effective pretreatment program pursuant to Section 307 of the CWA; Parts 35 and 403 of Title 40, Code of Federal Regulations (40 CFR 35 and 40 CFR 403); and/or Section 2233, Title 23, California Code of Regulations.
19. This order incorporates the requirements specified in the EPA and the Regional Board approved pretreatment program for the discharger's service areas as enforceable conditions of this Order.
20. On February 19, 1993, the EPA issued a final rule for the use and disposal of sewage sludge (40 CFR 503). This rule requires that producers of sewage sludge meet certain reporting, handling, and disposal requirements. The State of California has not been delegated the authority to implement this program, therefore, the EPA is the implementing agency. This Order includes provisions recommended by EPA Region IX regarding the treatment, storage and use or disposal of sewage sludge.
21. The Regional Board has considered antidegradation pursuant to State Board Resolution No. 68-16 and finds that the discharge is consistent with those provisions.
22. The project involves the issuance of waste discharge requirements for an existing facility and as such, is exempt from the California Environmental Quality Act (Public Resources Code, Section 2110 et. seq.) in accordance with Section 15301, Chapter 3, Title 14, California Code of Regulations..
23. The Regional Board has notified the discharger and other interested agencies and persons of its intent to prescribe waste discharge requirements for the discharge and has provided them with an opportunity to submit their written views and recommendations.
24. The Regional Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that the City of Redlands in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder and the applicable provisions of the Clean Water Act and regulations adopted thereunder, shall comply with the following:

A. DISCHARGE SPECIFICATIONS:

1. The discharge of wastes to the percolation ponds shall not contain constituent concentrations in excess of the following limits:

a. Biological Limitations:

Constituent	Average Monthly Limit
	mg/l
Biochemical Oxygen Demand	30
Suspended Solids	30

b. Mineral/Inorganic Limitations:

Constituent	12-Month Average Limit
	(mg/l)
Boron	0.75
Chloride	90
Sodium	80
Sulfate	62
Total Dissolved Solids (TDS) with offset	465
TDS without offset	290
Total Hardness	190
TIN	10 (see also Sections E.6., & E.7., Compliance Determination)

c. Water supply based TDS Limitation:

The discharge of wastes containing a 12-month average total dissolved solids concentration which exceeds the 12-month average total dissolved solids concentration in the water supply by more than 250 mg/l is prohibited. For Discharge Specification No. 1.b. and 1.c., the lower of the two dissolved solids limits is the limit.

2. The monthly average biochemical oxygen demand and suspended solids concentrations of the discharge shall not be greater than fifteen percent (15%) of the monthly average influent concentrations.
3. The discharge of any substances in concentrations toxic to animal or plant life is prohibited.
4. The pH of the discharge shall be within 6 and 9 pH units¹.

B. SEWAGE SLUDGE MANAGEMENT:

1. All sewage sludge generated by the discharger shall be reused or disposed of in compliance with the applicable portions of:
 - a. CFR 503²: for sewage sludge that are land applied, placed in surface disposal sites (dedicated land disposal sites or monofills), or incinerated;
 - b. 40 CFR 258: for sewage sludge disposed of in Municipal Solid Waste landfills;
 - c. CFR 257: for all sewage sludge disposal practices not covered under 40 CFR 258 or 503.
2. The discharger is responsible for assuring that all sewage sludge produced at its facility is used or disposed of in accordance with 40 CFR 257, 258, and 503, whether the discharger reuses or disposes of the sewage sludge itself or transfers it to another party for further treatment, reuse, or disposal. The discharger is responsible for informing subsequent preparers, appliers, or disposers of the requirements they must meet under 40 CFR 257, 258, and 503.
3. The discharger shall take all reasonable steps to prevent or minimize any sewage sludge use or disposal which has a likelihood of adversely affecting human health or the environment.

¹ See Compliance Determination E. 3.

² 40 CFR 503 Subpart B (land application) applies to sewage sludge placed on the land for the purpose of providing nutrients or conditioning the soil for crops or vegetation. 40 CFR 503 Subpart C (surface disposal) applies to sewage sludge placed on the land for the purpose of disposal.

4. No sewage sludge shall be allowed to enter wetlands or other waters of the United States.
5. Sewage sludge treatment, storage, and use or disposal shall not contaminate groundwater.
6. Sewage sludge treatment, storage, and use or disposal shall not create a nuisance such as objectionable odors or flies.
7. The discharger shall assure that haulers who transport sewage sludge off site for treatment, reuse, or disposal take all necessary measures to keep the sewage sludge contained.
8. If sewage sludge is stored for over two years from the time it is generated, the discharger must ensure compliance with all the requirements for surface disposal under 40 CFR 503 Subpart C, or must submit a written request to EPA with the information in 40 CFR 503.20 (b), requesting permission for longer temporary storage.
9. Sewage sludge containing more than 50 mg/kg PCB's shall be disposed of in accordance with 40 CFR 761.
10. Any sewage sludge treatment, disposal, or storage site shall have facilities adequate to divert surface runoff from the adjacent area, to protect the site boundaries from erosion, and to prevent any conditions that would cause drainage from the materials in the disposal site to escape from the site. Adequate protection is defined as protected from at least a 100-year storm.

D. PRETREATMENT REQUIREMENTS:

1. The discharger shall update as necessary and appropriate the contractual agreements with governmental sewerage agencies contributing wastewater into the treatment plant. The contractual agreements shall give the discharger the authority to implement and enforce the EPA approved pretreatment program within the sewer service areas. The discharger shall assure that any other steps necessary to provide this implementation and enforcement authority (e.g. adoption of ordinances, etc.) are taken by all governmental agencies. If a governmental agency has an EPA approved pretreatment program for any portion of the service area of the treatment plant, the discharger's pretreatment program shall contain provisions ensuring that that governmental agency's program is implemented. In the event that any contributory agency fails to effectively implement its individual EPA approved pretreatment program, the discharger shall implement and enforce its approved program within that agency's service area.

2. The discharger shall implement and enforce a publicly owned treatment works (POTW) pretreatment program for all contributory agencies to the treatment plant and shall be responsible and liable for the performance of all Control Authority pretreatment requirements contained in 40 CFR 403, including any subsequent regulatory revisions to Part 403. Where Part 403 or subsequent revisions place mandatory actions upon the discharger as Control Authority but does not specify a timetable for completing the actions, the discharger shall submit for approval of the Regional Board's Executive Officer, a schedule for implementing the required actions and shall implement the approved schedule. The schedule for implementation shall be submitted within six months from the date that such mandatory actions are established. The discharger's approved POTW Pretreatment Program is hereby made an enforceable requirement of this Order.
3. For violations of pretreatment requirements, the discharger shall be subject to enforcement actions, penalties, fines and other remedies by the EPA, or other appropriate parties, as provided in the CWA, as amended (33 USC 1351 et seq.). The EPA or the Regional Board may also initiate enforcement action against an industrial user (IU) for non-compliance with applicable standards and requirements as provided in the CWA.
4. The discharger shall enforce the requirements promulgated under Sections 307(b), 307(c), 307(d), and 402(b) of the CWA with timely, appropriate and effective enforcement actions. The discharger shall cause industrial users (IUs) subject to the Federal Categorical Standards to achieve compliance no later than the date specified in those requirements or, in the case of a new IU, upon commencement of the discharge.
5. The discharger shall perform the pretreatment functions as required in 40 CFR Part 403 including, but not limited to:
 - a. Enforce the pretreatment requirements under 40 CFR 403.5 and 403.6;
 - b. Implement the necessary legal authorities as provided in 40 CFR 403.8(f)(1);
 - c. Implement the programmatic functions as provided in 40 CFR 403.8(f)(2);
 - d. Publish a list of significant non-compliance as required by 40 CFR 403.8(f)(2)(vii), and
 - e. Provide the requisite funding and personnel to implement the pretreatment program as provided in 40 CFR 403.8(f)(3).
6. The following wastes shall not be introduced into the treatment works:
 - a. Wastes which create a fire or explosion hazard in the treatment works;

- b. Wastes which will cause corrosive structural damage to treatment works, but, in no case, wastes with a pH lower than 5.0 unless the works are designed to accommodate such wastes;
 - c. Wastes at a flow rate and/or pollutant discharge rate which is excessive over relatively short time periods so that there is a treatment process upset and subsequent loss of treatment efficiency;
 - d. Solid or viscous wastes in amounts which would cause obstruction to the flow in sewers or otherwise interfere with the proper operation of the treatment works.
7. The discharger shall ensure compliance with any existing or future pretreatment standard promulgated by EPA under Section 307 of the CWA or amendments thereto for any discharge to the municipal system.
8. The discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the CWA for toxic pollutants within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement.
9. The discharger shall require each user not in compliance with any pretreatment standard to submit periodic notice (over intervals not to exceed nine months) of progress toward compliance with applicable toxic and pretreatment standards developed pursuant to the CWA or amendments thereto. The discharger shall forward a copy of such notice to the Regional Board and to the EPA Regional Administrator.

E. COMPLIANCE DETERMINATION:

- 1. Compliance with average monthly discharge limitations specified under Discharge Specifications shall be determined from the average of the analytical results of all samples collected during a calendar month.
- 2. Compliance with the 12-month average limit under Discharge Specification A.1.b. shall be determined by the arithmetic mean of the last twelve monthly averages.
- 3. The discharger shall be in compliance with the pH limitation specified in this Order (Discharge Specification A.4) when the daily pH test result(s) is within the required range of 6-9 pH values. Any effluent test result with a pH value outside the pH limitation of this Order is a single violation.
- 4. The Regional Board will not initiate enforcement action for violations of the 290 mg/l TDS limit specified in Discharge Specification A.1.b provided that:
 - a. The discharger demonstrates to the satisfaction of the Regional Board's Executive Officer that:

- 1) the violation is due to the TDS quality of water supply sources utilized in the discharger's service area; and
 - 2) that all reasonable steps, as agreed upon by the Executive Officer, have been taken to ensure that best TDS quality supplies are obtained and utilized in the discharger's service area; and
 - b. The discharger develops and implements, with the approval of the Executive Officer, an offset program to address the effects of the violation on the affected receiving waters.
5. The Regional Board will not initiate enforcement action for violations of the TDS limits specified in Discharge Specifications A.1.b. and A.1.c. above, provided that:
- a. The discharger demonstrates to the satisfaction of the Executive Officer that:
 - 1) The TDS violation(s) are due solely to chemical additions in the treatment process needed to meet waste discharge requirements or other valid regulatory requirements; and
 - 2) The discharger has taken all steps to optimize chemical additions so as to minimize the TDS increases; and
 - b. For violations of the TDS limit in Discharge Specification A.1.b., the discharger develops and implements, with the approval of the Executive Officer, an offset program to address the effects of the violation on the affected receiving waters.
6. The discharger shall comply with the 10 mg/l TIN limit specified in Discharge Specification A.1.b in accordance with the following deadlines, whichever occurs first:
- a. By May 31, 2001;
 - b. Within 24 months of the TDS/TIN studies conclusion or termination;
 - c. Within 24 months of the discharger's participation withdrawal in the TDS/TIN studies.
7. Until full compliance with the TIN limit is achieved by the dates specified in Section E.6. above, the discharger shall meet a 12-month average TIN interim limit of 15 mg/l.
8. Compliance determinations shall be based on available analyses for the time interval associated with the effluent limitation. Where only one sample analysis is available in a specified time interval (e.g., monthly or weekly average), that sample shall serve to characterize the discharge for the entire interval.

F. REQUIRED NOTICES AND REPORTS:

1. Reporting Provisions:

- a. All reports, or information submitted to the Regional Board shall be signed by a responsible officer or duly authorized representative of the discharger and shall be submitted under penalty of perjury.
- b. The discharger shall furnish, within a reasonable time, any information the Regional Board may request to determine compliance with this Order or whether cause exists for modifying, revoking and reissuing, or terminating this Order. The discharger shall also furnish to the Regional Board, upon request, copies of records required to be kept by this Order.
- c. All reports prepared in accordance with the terms of this Order shall be available for public inspection at the offices of the Regional Board. Knowingly making any false statements on any such report may result in the imposition of criminal penalties as provided for in Section 13387 of the California Water Code.

2. By August 1, 1998, the discharger shall submit a report evaluating the current ability and capacity of the treatment plant to remove TIN, and evaluating how the treatment plant facilities and operations could be modified to provide additional TIN removal. The report shall include an evaluation of the effects of such modifications on treatment capacity. The report shall also include a plan and schedule for approval by the Regional Board's Executive Officer identifying how and when the discharger will provide additional TIN removal at the treatment plant. The discharger shall implement the plan upon the Executive Officer's approval.

3. The discharger shall submit for approval by the Executive officer a plan and time schedule for completing projects necessary to comply with the specified TIN limits. The plan and schedule shall be submitted within 30 days of the following deadlines.

- a. May 31, 1999;
- b. Within 6 months of the termination of the TDS/TIN studies; or
- c. Within 6 months of the discharger's withdrawal from participation in the TDS/TIN studies.

The plan and schedule shall be implemented upon approval by the Executive Officer. The discharger shall submit quarterly compliance status reports (due March 15, June 15, September 15, and December 15 of each year) on the implementation of the approved plan and schedule.

4. The discharger shall comply with the following notification requirements for sewage sludge treatment, storage, and use or disposal:
 - a. At least 60 days prior to the use or disposal of any sewage sludge from this facility to a new or previously unreported site, the discharger shall submit a reuse/disposal plan to the EPA and the Regional Board's Executive Officer. The plan shall include results of the analyses required under the Sewage sludge Monitoring Section of M&RP No. 98-54, a description and topographic map of the proposed site(s) for reuse or disposal, names and addresses of the applier(s) and site owner(s), and a listing of any state or local permits which must be obtained. For land application sites, the plan shall include a description of the crops or vegetation to be grown, proposed loading rates and nitrogen loadings to be used for the crops, and a groundwater monitoring plan if one exists. If the sewage sludge do not meet 40 CFR 503.13 Table 3 metals concentration limits, the discharger must notify the EPA of any previous applications of sewage sludge subject to cumulative loading limits to the site, the cumulative amounts of pollutants applied to date, and background concentrations if known.
 - b. For sewage sludge that are land applied, the discharger shall notify the applier in writing of the nitrogen content of the sewage sludge, and of the applier's requirements under 503, including the requirement that the applier certify that the management practices, site restrictions, and any applicable vector attraction reduction requirements required in 40 CFR 503 Subpart B have been met. The discharger shall require the applier to certify at the end of 38 months following application of Class B sewage sludge that those harvesting restrictions in effect for up to 38 months have been met.
 - c. If sewage sludge are shipped to another State or to Indian Lands, the discharger must send 60 days prior notice of the shipment to the permitting authorities in the receiving State or Indian Land (the EPA Regional Office for that area and the State/Indian authorities).
 - d. The discharger shall notify EPA Region 9 and the Regional Board's Executive Officer of any non-compliance within 24 hours if the noncompliance may endanger health or the environment. For other instances of non-compliance, the discharger shall notify EPA Region 9 and the Regional Board of the non-compliance in writing within 5 working days of becoming aware of the non-compliance.

5. The discharger shall provide adequate notice to the Regional Board of:
 - a. Any new introduction of pollutants into the POTW from an indirect discharger that would be subject to Sections 301 or 306 of the CWA if it were directly discharging those pollutants.³
 - b. Any change in the volume or character of pollutants being introduced by an existing or new source into the treatment facility that will cause or threaten to cause a violation of this Order.
6. The discharger shall file a written report with the Regional Board within ninety (90) days after the average dry-weather waste flow for any month equals or exceeds 75 percent of the design capacity of the waste treatment and/or disposal facilities. The discharger's senior administrative officer shall sign a letter which transmits that report and certifies that the policy making body is adequately informed about it. The report shall include:
 - a. Average daily flow for the month, the date on which the instantaneous peak flow occurred, the rate of that peak flow, and the total flow for the day.
 - b. The discharger's best estimate of when the average daily dry-weather flow rate will equal or exceed the design capacity of the treatment facilities.
 - c. The discharger's intended schedule for studies, design, and other steps needed to provide additional capacity for the waste treatment and/or disposal facilities before the waste flow rate equals the capacity of present units.
7. The discharger shall file with the Regional Board a Report of Waste Discharge at least 120 days before making any material change in the character, location, or volume of the discharge. A material change includes, but is not limited to, the following:
 - a. Significantly changing the disposal method or location, such as changing the disposal to another drainage area or water body.
 - b. Significantly changing the method of treatment.
 - c. Increasing the discharge flow beyond that specified in this Order.

³ Adequate notice shall include information on the quality and quantity of effluent introduced, and any anticipated impact of the change on the quantity or quality of the discharger's effluent and/or sludge.

8. The discharger shall report any condition related to the discharger's collection, treatment or disposal facilities that may endanger human health or the environment. All available information concerning the condition shall be provided to the Executive Officer or the Executive Officer's designee (909-782-4130) and the Office of Emergency Services (800-852-7550), as soon as the discharger becomes aware of the circumstances. A written report shall be submitted within 5 days and shall contain a description of the condition and its cause; the duration of the condition, including exact dates and times, and, if the condition has not been corrected, the anticipated time it is expected to continue; and the steps taken or planned to reduce, eliminate, and prevent recurrence of the condition, with a schedule for their implementation. The Executive Officer or the Executive Officer's designee may waive the above-required written report on a case-by-case basis.

G. PROVISIONS:

1. Neither the treatment nor the discharge of wastes shall cause a nuisance or pollution as defined in Section 13050 of the California Water Code.
2. Order No. 88-16 is hereby rescinded.
3. The discharger shall comply with M&RP No. 98-54 as issued by the Executive Officer. This M&RP may be modified by the Executive Officer at any time during the term of this Order, and may include a reduction or an increase in the number of parameters to be monitored, the frequency of the monitoring or the number and size of samples to be collected.
4. The discharger shall maintain a copy of this Order at the site so that it is available to site operating personnel at all times. Key operating personnel shall be familiar with its content.
5. The discharger shall, at all times, properly operate and maintain all facilities and systems of treatment and control including sludge use, disposal facilities, and related appurtenances which are installed or used by the discharger to achieve compliance with this Order. Proper operation and maintenance includes adequate laboratory controls, appropriate quality assurance procedures, effective performance, adequate funding, adequate staffing and training, and adequate process controls. This provision requires the operation of back up or auxiliary facilities or similar systems which are installed by a discharger only when the operation is necessary to achieve compliance with the requirements of this Order.
6. The discharger shall take all reasonable steps to minimize or prevent any discharge that has a reasonable likelihood of adversely affecting human health or the environment.

7. The discharger shall take all reasonable steps to minimize any adverse impact to receiving waters resulting from noncompliance with any requirements specified in this Order, including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge.
8. The discharger shall develop and maintain an "Operation and Maintenance Manual (O&M Manual)". If an O&M Manual has been developed, the discharger shall update it as necessary to conform with latest plant changes and requirements. The O&M Manual shall be readily available to operating personnel onsite. The O&M Manual shall include the following:
 - a. Description of the treatment plant table of organization showing the number of employees, duties and qualifications and plant attendance schedules (daily, weekends and holidays, part-time, etc.). The description should include documentation that the personnel are knowledgeable and qualified to operate the treatment facility so as to achieve the required level of treatment at all times.
 - b. Detailed description of safe and effective operation and maintenance of treatment processes, process control instrumentation and equipment.
 - c. Description of laboratory and quality assurance procedures.
 - d. Process and equipment inspection and maintenance schedules.
 - e. Description of safeguards to assure that, should there be reduction, loss, or failure of electric power, the discharger will be able to comply with requirements of this Order.
 - f. Description of preventive (fail-safe) and contingency (response and cleanup) plans for controlling accidental discharges, and for minimizing the effect of such events. These plans shall identify the possible sources (such as loading and storage areas, power outage, waste treatment unit failure, process equipment failure, tank and piping failure) of accidental discharges, untreated or partially treated waste bypass, and polluted drainage.
9. The discharger's wastewater treatment plant shall be supervised and operated by persons possessing certificates of appropriate grade pursuant to Title 23, Division 3, Chapter 14 California Code of Regulations.
10. The requirements prescribed herein do not authorize the commission of any act causing injury to the property of another, nor protect the discharger from liabilities under federal, state, or local laws, nor guarantee the discharger a capacity right in the receiving waters.
11. This Order does not convey any property rights of any sort, or any exclusive privilege.

12. Collected screenings, sludge, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Regional Board's Executive Officer.
13. If the discharger demonstrates a correlation between the biochemical oxygen demand (BOD) and total organic carbon (TOC) concentrations in the effluent to the satisfaction of the Executive Officer, compliance with the BOD limits contained in this Order may be determined based on analyses of the TOC of the effluent.
14. In the event of any change in control or ownership of land or waste discharge facility presently owned or controlled by the discharger, the discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to the Regional Board.
15. The Regional Board and other authorized representatives shall be allowed:
 - a. Entry upon premises where a regulated facility or activity is located or conducted, or where records are kept under the requirements of this Order;
 - b. Access to copy any records that are kept under the requirements of this Order;
 - c. To inspect any facility, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order; and
 - d. To photograph, sample and monitor for the purpose of assuring compliance with this Order.
 - e. Access to interview any plant operating personnel.

I, Gerard J. Thibeault, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an order adopted by the California Regional Water Quality Control Board, Santa Ana Region, on April 17, 1998.


Gerard J. Thibeault
Executive Officer

California Regional Water Quality Control Board
Santa Ana Region

Monitoring and Reporting Program No. 98-54

for
City of Redlands
Wastewater Treatment Plant
San Bernardino County

A. GENERAL MONITORING GUIDELINES AND REQUIREMENTS

1. All sampling, sample preservation, and analysis shall be performed in accordance with the latest edition of 40 Code of Federal Regulations (CFR) 136 "Guidelines Establishing Test Procedures for the Analysis of Pollutants", promulgated by the United States Environmental Protection Agency (EPA) unless otherwise noted in this monitoring and reporting program (M&RP). In addition, the Regional Board Executive Officer may specify test methods which are more sensitive than those specified in 40 CFR 136.
2. Chemical, bacteriological, and bioassay analyses shall be conducted at a laboratory certified for such analyses by the State Department of Health Services for the constituent(s) being analyzed or at laboratories approved by the Regional Board's Executive Officer.
3. All solids sampling, sample preservation, and analyses shall be performed in accordance with the latest edition of California Code of Regulation (CCR) Title 22 Section 66700 "Waste Extraction Test", unless otherwise specified elsewhere in this M&RP.
4. All analytical data shall be reported with method detection limit¹ (MDLs) and with identification of either practical quantitation levels (PQLs²) or limits of quantitation (LOQs).
5. The discharger shall comply with this M&RP and be in accordance with the following:
 - a. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
 - b. The discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this order, and records of all data used to complete the application for a period of at least five years from the date of the sample, measurement, report or application. This period may be extended by request of the Executive Officer at any time.
 - c. Records of monitoring information shall include:
 - (1) The date, exact place, and time of sampling or measurements.
 - (2) The individual(s) who performed the sampling or measurements.

¹ The standardized test procedure to be used to determine the method detection limit (MDL) is given at Appendix B, 'Definition and Procedure for the Determination of the Method Detection Limit' of 40 CFR 136.

² PQL is the lowest concentration of a substance which can be determined within ± 20 percent of the true concentration by 75 percent of the analytical laboratories tested in a performance evaluation study. Alternatively, if performance data are not available, the PQL is the method detection limit (MDL) $\times 5$ for carcinogens and MDL $\times 10$ for noncarcinogens.

- (3) The date(s) the analyses were performed.
 - (4) The individual(s) who performed the analyses.
 - (5) The results of such analyses.
6. The discharger shall tabulate the monitoring data to clearly illustrate compliance and/or noncompliance with the requirements of this order. For every item where the requirements are not met, the discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge into full compliance with the requirements at the earliest time and submit a timetable for correction.
7. The freeboard in each pond shall be measured every Friday of each week and recorded in a permanent log.
8. A permanent log of all wastes hauled from the facility for final disposal elsewhere shall be maintained. This should include name of the hauler, hauling date, waste volume, waste type, and final disposal site of each waste.
9. The monthly report shall include the following:
 - a) A copy of weekly freeboard log for the pond;
 - b) Amount of sewage sludge and other solids (from the sewage treatment facility) hauled away and disposed of offsite, including the destination.
 - c) The report for December shall include a roster of plant personnel, including job titles, duties, and level of state certification for each individual.
10. The annual monitoring report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements. The annual report shall also include a summary of the quantities of all chemicals listed by both trade and chemical names which are used by the discharger during its operation (e.g. chemicals used for cooling and/or boiler water treatment) and which are discharged into the treatment plant.
11. All reports shall be signed by a responsible officer or duly authorized representative of the discharger and shall be submitted under penalty of perjury.
12. A composite sample is defined as a combination of no fewer than eight individual samples obtained over the specified sampling period. The volume of each individual sample shall be proportional to the discharge flow rate at the time of sampling. The composite period shall equal the specific sampling period, or 24 hours, if no period is specified.
13. Daily samples shall be collected on each day of the week.
14. Monthly samples shall be collected on any representative day of each month.
15. Quarterly samples shall be collected on any representative day of January, April, July, and October.
16. Semi-annual samples shall be collected on any working day of February and August.

B. INFLUENT MONITORING:

1. Sampling stations shall be established and located upstream of any in-plant return flows and where a representative sample of the influent to the treatment facility can be obtained. The date and time of sampling (as appropriate) shall be reported with the analytical values determined.
2. The following shall constitute the influent monitoring program:

INFLUENT MONITORING			
Constituent	Units	Type of Sample	Minimum Frequency of Sampling & Analysis
Flow	gpd	Recorder/Totalizer	Continuous
Specific Conductance	µmhos/cm	Recorder	"
pH	pH	"	"
BOD	mg/l	24-Hour Composite	Daily
Suspended Solids	"	"	"
COD	"	"	"
Total Hardness	"	"	Monthly
Ammonia -Nitrogen	"	"	"
Total Inorganic Nitrogen	"	"	"
Total Dissolved Solids	"	"	"
Boron	"	"	"
Chloride	"	"	"
Fluoride	"	"	"
Sulfate	mg/l	"	Monthly
Arsenic	µg/l	"	Quarterly
Cadmium	"	"	"
Chromium (VI)	"	"	"
Copper	"	"	"
Lead	"	"	"
Mercury	"	"	"
Nickel	"	"	"
Silver	"	"	"
Zinc	"	"	"
Cyanide	"	"	"
Phenolic Compounds	µg/l	24-Hour Composite	Quarterly

C. EFFLUENT MONITORING:

1. Sampling station(s) shall be located at the point of discharge to the percolation ponds. Sampling station(s) shall be located where representative samples of the effluent can be obtained. The date and time of sampling shall be reported with the analytical values determined. Sampling locations must be safe, convenient, and accessible to treatment plant personnel and to persons authorized by the Regional Board to conduct sampling and inspection of the treatment facility.
2. The following shall constitute the effluent monitoring program:

EFFLUENT MONITORING			
CONSTITUENT	UNITS	TYPE OF SAMPLE	MINIMUM FREQUENCY OF SAMPLING AND TESTING
Flow	gpd	Flow meter	Continuous
Specific Conductance	µmhos/cm	Recorder	"
pH	pH units	Grab	Daily
BOD	mg/l	24-hr Composite	"
Suspended Solids	"	"	Daily
Total Dissolved Solids	mg/l	24-hr Composite	Monthly
Total Hardness	"	"	"
Total Inorganic Nitrogen	"	"	"
Nitrate Nitrogen	"	"	"
Boron	"	"	"
Chloride	"	"	"
Sodium	"	"	"
Sulfate	"	"	"
Total Hardness	mg/l	"	Monthly
Arsenic	µg/l	"	Quarterly for the first year and semi-annually thereafter
Cadmium	"	"	"
Chromium, Total	"	"	"
Cobalt	"	"	"
Copper	"	"	"
Cyanide	"	"	"
Iron	"	"	"

EFFLUENT MONITORING			
CONSTITUENT	UNITS	TYPE OF SAMPLE	MINIMUM FREQUENCY OF SAMPLING AND TESTING
Lead	"	"	"
Manganese	"	"	"
Mercury	"	"	"
Selenium	"	"	"
Silver	"	"	"
Phenolic Compounds	µg/l	24-hr Composite	Quarterly for the first year and semi-annually thereafter

D. WATER SUPPLY MONITORING:

1. In August of each year, a sample of each source of the water supplied to areas served by the treatment plant shall be obtained and analyzed for the following constituents:

Water Supply Constituents Monitoring		
Bicarbonate	Magnesium	Sodium
Boron	Nitrate	Sulfate
Calcium	pH	Total Dissolved Solids
Chloride	Potassium	Total Hardness
Fluoride	Specific Conductance	

2. All of the above constituents shall be expressed in "mg/l" except specific conductance and pH, which shall be expressed in "micromhos/cm" and "pH units," respectively.
3. Monthly reports stating the amount of water (in percentage or acre-feet) supplied to areas served by the treatment plant from each water source and the resulting flow weighted water supply quality for total dissolved solids, chloride, sulfate, sodium, and total hardness shall be submitted.

E. SEWAGE SLUDGE MONITORING:

1. Sewage sludge monitoring shall be conducted as follows:
 - a. Sewage sludge shall be tested for the metals required in 40 CFR 503.16 (for land application) or 40 CFR 503.26 (for surface disposal), using the methods in "Test Methods for Evaluating Solid Waste, Physical/Chemical Methods" (SW846), as required in 40 CFR 503.8 (4), at the following minimum frequencies:

Volume (dry metric tons)/year	Frequency
0 – 290	once per year
290 – 1500	once per quarter
1500 – 15000	once per 60 days
> 15000	once per month

- 1) For accumulated, previously untested sewage sludge, the discharger shall develop a representative sampling plan, including number and location of sampling points, and collect representative samples.
 - 2) Test results shall be expressed in mg pollutant per kg³ sewage sludge on a 100 % dry weight basis.
 - 3) Sewage sludge to be land applied shall be tested for total kjeldahl nitrogen (TKN), ammonium-nitrogen (N), and nitrate-N at the frequencies required above.
- b. Prior to land application, the discharger shall demonstrate that the sewage sludge meet Class A or Class B pathogen reduction levels by one of the methods listed in 40 CFR 503.32. Prior to disposal in a surface disposal site, the discharger shall demonstrate that the sewage sludge meets Class B levels or shall ensure that the site is covered at the end of each operating day.
 - c. For sewage sludge that is land applied or placed in a surface disposal site, the discharger shall track and keep records of the operational parameters used to achieve Vector Attraction Reduction requirements in 40 CFR 503.33(b).
 - d. Class I facilities (facilities with pretreatment programs or others designated as Class I by the Regional Administrator) and Federal facilities with > 5 mgd influent flow shall sample sewage sludge for pollutants listed under Section 307(a) of the CWA (as required in the pretreatment section of this order for POTW's with pretreatment programs.) Class 1 facilities and Federal Facilities with > 5 mgd influent flow shall test dioxins/dibenzofurans using a detection limit of < 1 mg/g⁴ during their next sampling period if they have not done so within the past 5 years and once per 5 years thereafter.
 - e. The sewage sludge shall be tested annually using the Toxicity Characteristic Leaching Procedure, or more frequently if necessary to determine hazardousness.
 - f. If sewage sludge is placed in a surface disposal site (dedicated land disposal site or monofill), a qualified groundwater scientist shall develop a groundwater monitoring program for the site, or shall certify that the placement of sewage sludge on the site will not contaminate an aquifer.

³ kilograms

⁴ micrograms per grams

- g. Sewage sludge placed in a municipal landfill shall be tested by the Paint Filter Test (method 9095) at the frequency in paragraph E.1.a., above or more often if necessary to demonstrate that there are no free liquids.
- 2. The discharger shall submit an annual sewage sludge report to EPA and the Regional Board by February 19 of each year for the period covering the previous calendar year. The report shall include:
 - a. The amount of sewage sludge generated that year, in dry metric tons, and the amount accumulated from previous years.
 - b. Results of all pollutant monitoring required in paragraph E.1., above.
 - c. Descriptions of pathogen reduction methods, vector attraction reduction methods, site and harvesting restrictions, and management practices, and certifications of these, as required in 40 CFR 503.17 and 40 CFR 503.27.
 - d. Results of any groundwater monitoring or certification by groundwater scientist that the application/disposal will not contaminate an aquifer.
 - e. Names and addresses of land appliers and surface disposal site operators, location of sites (latitude and longitude and names of sites); volumes applied (dry metric tons) and loading rates (metric tons/ha⁵), dates of applications, crops grown and dates of seeding and harvesting.
 - f. Names, mailing addresses, and street addresses of persons who received sewage sludge for storage, further treatment, disposal in a municipal waste landfill, or for other reuse/disposal methods not covered above, and volumes delivered to each.
- 3. Reports shall be submitted to:
 - a. US EPA (WTR-7)
75 Hawthorne St.
San Francisco, CA 94105 -3901
 - b. State Water Resources Control Board
Division of Water Quality, Pretreatment Unit
P.O. Box 944213
Sacramento, CA 94244-2130
 - c. Gerard J. Thibeault, Executive Officer
California Regional Water Quality Control Board
Santa Ana Region
3737 Main Street, Suite 500
Riverside, CA 92501-3339

⁵ hectares

F. PRETREATMENT REPORTING:

1. The discharger shall submit to the Regional Board a quarterly compliance status report. The quarterly compliance status reports shall cover the periods January 1 - March 31, April 1 - June 30, July 1 - September 30, and October 1 - December 31. Each report shall be submitted by the end of the month following the quarter, except that the report for October 1 - December 31 may be included in the annual report. This quarterly reporting requirement shall commence for the first full quarter following issuance of this order. The reports shall identify:
 - a. All significant industrial users (SIUs) which violated any standards or reporting requirements during that quarter;
 - b. The violations committed (distinguish between categorical and local limits);
 - c. The enforcement actions undertaken; and
 - d. The status of active enforcement actions from previous periods, including closeouts (facilities under previous enforcement actions which attained compliance during the quarter).
2. The discharger shall submit quarterly compliance status reports to EPA Region 9, the State Board and the Regional Board at the following addresses:
 - a. Regional Administrator
U.S. Environmental Protection Agency
Region 9 - Attention WTR-1
75 Hawthorne Street
San Francisco, CA 94105
 - b. State Water Resources Control Board
Division of Water Quality , Pretreatment Unit
P.O. Box 944213
Sacramento, CA 94244-2130
 - c. Gerard J. Thibeault, Executive Officer
California Regional Water Quality Control Board
Santa Ana Region
3737 Main Street, Suite 500
Riverside, CA 92501-3339
3. Annually, the discharger shall submit a report to the Regional Board, the State Water Resources Control Board and the EPA Region 9 describing the pretreatment activities within the service area during the previous year. In the event that any control authority within the service area is not in compliance with any conditions or requirements of this order or their approved pretreatment program (such as due to industrial user discharges, inter-jurisdictional agency agreement implementation issues, or other causes,) then the discharger shall also include the reasons for non-compliance and state how and when the discharger and the control authority shall comply with such conditions and requirements. This annual report shall cover operations from January 1 through December 31 of each year and is due on April 1 of each year. The report shall contain, but not be limited to, the following information:

- a. A summary of analytical results from representative, flow-proportioned, 24-hour composite sampling of the POTW's influent and effluent wastewaters for those pollutants which are known or suspected to be discharged by industrial users (IUs) as identified by EPA under Section 307(a) of the CWA. The summary will include the result of annual full priority pollutant scan, with quarterly samples analyzed only for those pollutants⁶ detected in the full scan. The discharger shall also provide any influent or effluent monitoring data for non-priority pollutants which the discharger believes may be causing or contributing to Interference, Pass Through or adversely impacting sludge quality. Sampling and analysis shall be performed in accordance with the techniques prescribed in 40 CFR 136 and amendments thereto.
- b. A discussion of any upset, interference, or pass-through incidents at the treatment plant (if any), which the discharger knows or suspects were caused by IUs of the POTW system. The discussion shall include the following:
 - 1) The reasons why the incidents occurred, the corrective actions taken, and, if known, the name and address of the IU(s) responsible.
 - 2) A review of the applicable pollutant limitations to determine whether any additional limitations, or changes to existing requirements, may be necessary to prevent pass through, interference or noncompliance with sludge disposal requirements.
- c. A complete and updated list of the discharger's significant industrial users (SIUs), including names, Standard Industrial Classification (SIC) code(s) and addresses, and a list of any SIU deletions and/or additions. The discharger shall provide a brief explanation for each deletion. The SIU list shall identify the SIUs subject to Federal Categorical Standards by specifying which set(s) of standards are applicable to each SIU. The list shall also indicate which SIUs are subject to local limitations more stringent than Federal Categorical Standards and those which are not subject to local limits.
- d. A list or table characterizing the industrial compliance status of each SIU, including:
 - 1) SIU name;
 - 2) Industrial category;
 - 3) The type (processes) of wastewater treatment in place;
 - 4) Number of samples taken by the POTW during the year;
 - 5) Number of samples taken by the SIU during the year;
 - 6) Whether all needed certifications (if allowed) were provided by SIUs which have limits for total toxic organics;
 - 7) Federal and Regional Standards violated during the year, reported separately;
 - 8) Whether the SIU at any time in the year was in Significant Noncompliance (SNC)⁷, as defined by 40 CFR 403.12 (f)(2)(vii); and

⁶ The discharger is not required to analyze for asbestos.

⁷ SNC is determined at the beginning of each quarter based on data of the previous six months.

- 9) A summary of enforcement actions against the SIU taken during the year, including the type of action, final compliance date, and amount of fines assessed/collected (if any). Proposed actions, if known, should be included.
 - 10) Number of inspections conducted at each SIU during the year.
- e. A compliance summary table which includes:
- 1) SIU's which were in SNC at any time during the year;
 - 2) The total number of SIUs which are in SNC with pretreatment compliance schedules during the year;
 - 3) The total number of notices of violation and administrative orders issued against SIUs during the year;
 - 4) The total number of civil and criminal judicial actions filed against SIUs during the year;
 - 5) The number of SIUs which were published as being in SNC during the year; and
 - 6) The number of IUs from which penalties were collected during the year.
- f. A short description of any significant changes in operating the pretreatment program which differ from the previous year including, but not limited to changes concerning:
- 1) the program's administrative structure;
 - 2) local industrial discharge limitations;
 - 3) monitoring program or monitoring frequencies;
 - 4) legal authority or enforcement policy;
 - 5) funding mechanisms; and
 - 6) resource requirements and/or staffing levels.
- g. A summary of the annual pretreatment budget, including the cost of pretreatment program functions and equipment purchases.
- h. A summary of public participation activities to involve and inform the public.
- i. A description of any changes in sludge disposal methods and a discussion of any concerns not described elsewhere in the report.
4. The cumulative number of industrial users that the discharger has notified regarding Baseline Monitoring Reports and the cumulative number of industrial user responses.


G. REPORTING:

1. Monitoring reports shall be submitted by the dates in the following schedule:

Report	Reporting period	Report Due Date
Continuous and daily influent and effluent constituents	Monthly	By the 30th day of the month following the monitoring period
Monthly influent/effluent constituents	"	"
Monthly water supply monitoring	"	"
Quarterly effluent constituents		
Quarterly pretreatment compliance status report (see Section F.1., above)	Quarterly	"
Sewage sludge monitoring report	See Section E. above	See Section E. above
Semi-annual effluent monitoring	Semi-annual	By the 30th day of the month following the monitoring period
Annual water supply parameters from each source	Annually	March 30, each year
Annual Pretreatment Reporting (see Section F.3., above)	Annually	March 30, each year
Annual Monitoring Report	Annually	March 30, each year

2. The following reports shall also be submitted by the dates indicated:

REQUIRED REPORTS PER SECTION F. OF ORDER NO. 98-54	
Report	Report Due Date
Report per Section F.2.	August 1, 1998
Report per Section F.3.	March 15, June 15, September 15, and December 15 of each year (see Section F.3.)
Sewage Sludge Notification per Section F.4.	See Section F.4.
Report per Section F.5.	See Section F.5.
Report per Section F.6.	within 90-days (see Section F.6.)
Report of Waste Discharge per Section F.7.	at least 120 days (see Section F.7.)
Report per Section F.8.	See Section F.8.

Ordered by: 
Gerard J. Thibeault
Executive Officer

April 17, 1998