

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 98-081

WASTE DISCHARGE REQUIREMENTS
FOR
HAMILTON CITY WASTEWATER TREATMENT PLANT
HAMILTON CITY COMMUNITY SERVICE DISTRICT
GLENN COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. The Hamilton City Community Services District (hereafter Discharger) owns and operates the wastewater treatment plant at 98 Sacramento Avenue in Glenn County (Assessor's Parcel Number 032-25-0-002-9).
2. The wastewater treatment plant consists of seven stabilization ponds designed to treat a maximum daily dry weather influent flow of 0.5 million gallons. The ponds range in size from two to four acre-feet. Total pond storage, while providing two feet of clearance from the surface of wastewater to the top of pond levees, is approximately 18 acre-feet.
3. Order No. 87-015, adopted by the Board on 23 January 1987, prescribes requirements for a discharge to the stabilization ponds. Order No. 87-015 is neither adequate nor consistent with current plans and policies of the Board.
4. The treatment plant is in T22N, R1W, MDB&M, with surface water drainage to the Sacramento River, as shown in Attachment A, which is attached hereto and part of the Order by reference.
5. The Board adopted a Water Quality Control Plan, Third Edition, for the Sacramento River and the San Joaquin River Basins (hereafter Basin Plan) which contains water quality objectives for waters of the Basins. These requirements implement the Basin Plan.
6. The existing beneficial uses of the Sacramento River are municipal, domestic and agricultural supply; industrial service supply, power; recreation; warm and cold freshwater habitat, warm and cold migration, warm and cold spawning, wildlife habitat; esthetic enjoyment; navigation, and preservation and enhancement of fish, wildlife and other aquatic resources.
7. The beneficial uses of the underlying ground water are domestic, industrial, and agricultural supply.
8. The Basin Plan encourages reclamation.

WASTE DISCHARGE REQUIREMENTS
HAMILTON CITY WASTEWATER TREATMENT PLANT
HAMILTON CITY COMMUNITY SERVICES DISTRICT
GLENN COUNTY

2

9. The action to adopt waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301, Title 14, California Code of Regulations (CCR).
10. This discharge is exempt from the requirements of *Consolidated Regulations for Treatment, Storage, Processing, or Disposal of Solid Waste*, as set forth in Title 27, CCR, Division 2, Subdivision 1, Section 20005, et seq., (hereinafter Title 27). The exemption, pursuant to Section 20090(b), is based on the following:
 - a. The Board is issuing waste discharge requirements,
 - b. The discharge complies with the Basin Plan, and
 - c. The wastewater does not need to be managed according to 22 CCR, Division 4.5, Chapter 11, as a hazardous waste.
11. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
12. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 87-015 is rescinded and Hamilton City Community Services District, its agents, successors and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. By-pass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous,' as defined in Sections 2521(a) of Title 23, CCR, Section 2510, et seq., (hereinafter Chapter 15), or 'designated,' as defined in Section 13173 of the California Water Code, is prohibited.

B. Discharge Specifications:

1. The 30-day average daily dry weather discharge flow shall not exceed 0.5 million gallons.

WASTE DISCHARGE REQUIREMENTS
HAMILTON CITY WASTEWATER TREATMENT PLANT
HAMILTON CITY COMMUNITY SERVICES DISTRICT
GLENN COUNTY

3

2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment and disposal areas.
3. As a means of discerning compliance with Discharge Specification No. 2, the dissolved oxygen content in the upper zone (one foot) of wastewater in ponds shall not be less than 1.0 mg/l.
4. Ponds shall not have a pH less than 6.5 or greater than 8.5.
5. The discharge shall not cause degradation of any water supply.
6. Reclaimed wastewater shall meet the criteria contained in Title 22, Division 4, CCR (Section 60301, et seq.)
7. A two foot freeboard shall be maintained in the storage ponds at all times.
8. On or about **1 October** of each year, available pond storage capacity shall at least equal the volume necessary to comply with Discharge Specification No. 7.
9. Ponds shall be managed to prevent breeding of mosquitoes. In particular,
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
10. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Title 27 and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice from a previously approved practice shall be reported to the Executive Officer and U.S. Environmental Protection Agency Regional Administrator at least 90 days in advance of the change.

WASTE DISCHARGE REQUIREMENTS
HAMILTON CITY WASTEWATER TREATMENT PLANT
HAMILTON CITY COMMUNITY SERVICES DISTRICT
GLENN COUNTY

4

3. Use and disposal of sewage sludge shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.
4. If the State Water Resources Control Board and the Regional Water Quality Control Boards are given the authority to implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR 503 whether or not they have been incorporated into this Order.

D. Ground Water Limitations:

The discharge shall not cause underlying ground water to be degraded.

E. Provisions:

1. The Discharger shall comply with the Monitoring and Reporting Program No. 98-081, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
4. The Discharger shall comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
5. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
6. The Board will review this Order periodically and will revise requirements when necessary.

WASTE DISCHARGE REQUIREMENTS
HAMILTON CITY WASTEWATER TREATMENT PLANT
HAMILTON CITY COMMUNITY SERVICES DISTRICT
GLENN COUNTY

5

I, GARY M. CARLTON, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 17 April 1998.

for Thomas R Pinker

for GARY M. CARLTON, Executive Officer

EAH:dlk/17 April 1998

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 98-081
FOR
HAMILTON CITY WASTEWATER TREATMENT PLANT
HAMILTON CITY COMMUNITY SERVICES DISTRICT
GLENN COUNTY

The Discharger shall comply with the following monitoring and reporting program. Wastewater samples shall be representative of the volume and nature of the discharge. Time of collection of a grab sample shall be recorded. The following shall constitute the wastewater monitoring program.

STABILIZATION POND MONITORING

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Influent flow	mgd	cumulative	Daily
Freeboard ¹	feet	measured	Every fourteenth day

¹ The vertical distance between the surface of wastewater in all ponds to the top of pond levees to the nearest tenth of a foot.

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Quarterly monitoring reports shall be submitted to the Regional Board by the 15th day of each month following the calendar quarter. The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.


Upon written request of the Board, the Discharger shall submit a report to the Board by 30 January of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring and reporting program on the effective date of this Order.

Ordered by: Thomas R. Pinker
for GARY M. CARLTON, Executive Officer

17 April 1998

(Date)

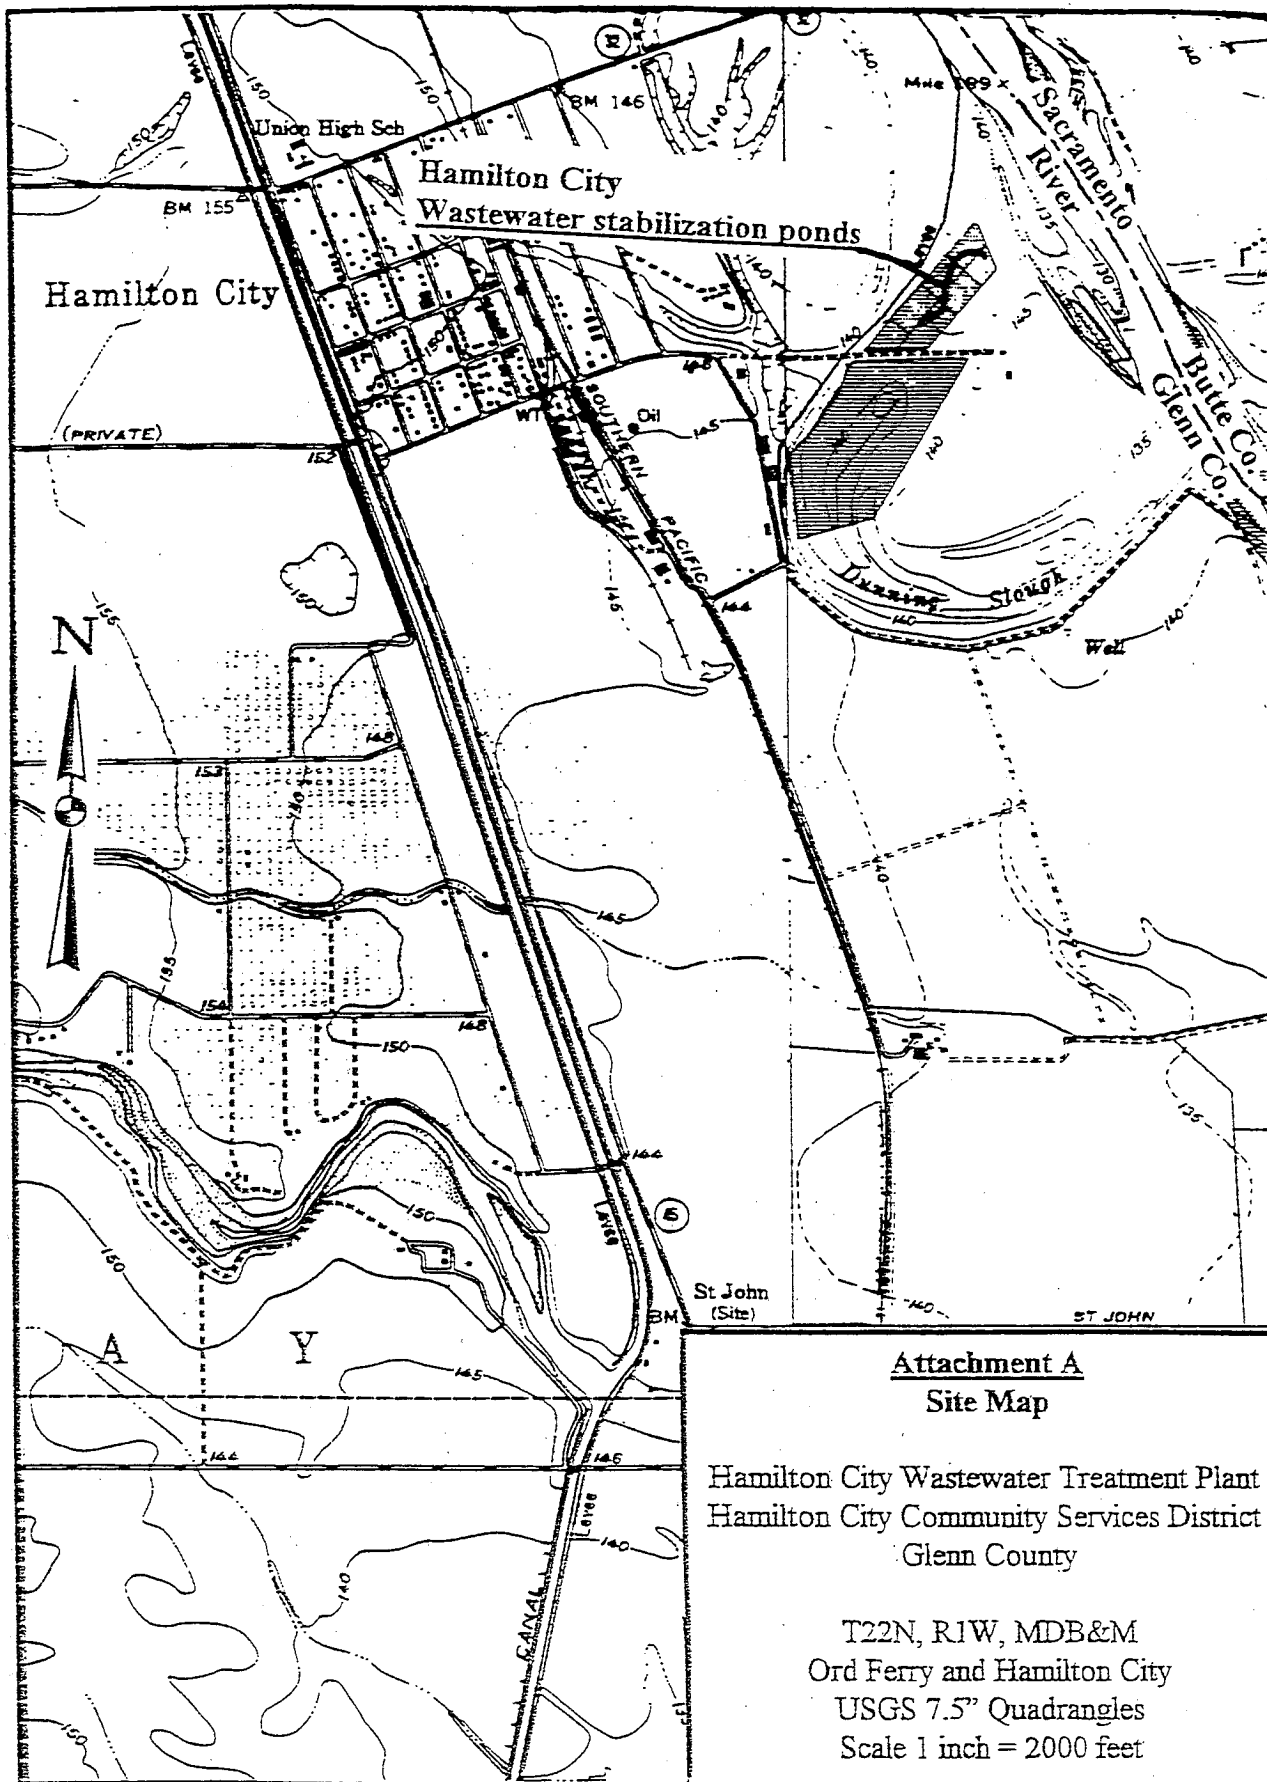

Attachment A
Site Map

Hamilton City Wastewater Treatment Plant
Hamilton City Community Services District
Glenn County

T22N, R1W, MDB&M
Ord Ferry and Hamilton City
USGS 7.5" Quadrangles
Scale 1 inch = 2000 feet

INFORMATION SHEET

HAMILTON CITY WASTEWATER TREATMENT PLANT HAMILTON CITY COMMUNITY SERVICES DISTRICT GLENN COUNTY

The Hamilton City Community Services District owns and operates the wastewater stabilization ponds at 98 Sacramento Avenue (Assessor's Parcel Number 032-25-0-002-9) serving the community of Hamilton City in Glenn County.

The seven stabilization ponds are designed to treat a maximum daily dry weather influent flow of 0.5 million gallons. The ponds range in size from two to four acre-feet. Total pond storage, while providing a minimum vertical clearance of two feet between the surface of wastewater in ponds to the top of pond levees ("freeboard"), is approximately 18 acre-feet.

The Board first prescribed requirements for the facility in September of 1965. At that time, the District constructed the stabilization ponds and discharged the treated wastewater to Dunning Slough. Later, the District ceased discharging to the slough and, on 26 March 1976, the Board revised the waste discharge requirements to prohibit discharges of waste from the facility to surface waters. On 23 January 1987, the Board updated the waste discharge requirements and included a limit on the 30-day average daily dry weather discharge flow to the ponds, 0.5 million gallons.

The new waste discharge requirements include the requirement that the District provide a minimum "freeboard" of two feet. Presently, there are 640 connections to the wastewater treatment plant serving an estimated 2000 people. Influent flows during dry weather average 300,000 gallons per day. The District anticipates serving up to 119 additional connections in the future. The anticipated increased influent flow is not expected to exceed the capacities of the stabilization ponds.

Waste Discharge Requirements Order No. 87-015 is being updated to adequately reflect current policies of the Board.

Surface water drainage from the wastewater stabilization ponds is to the Sacramento River.

EAH:dlk/2 March 1998