

STATE OF CALIFORNIA  
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
CENTRAL COAST REGION  
81 Higuera Street  
San Luis Obispo, California 93401

**WASTE DISCHARGE AND RECYCLED WATER PRODUCER REQUIREMENTS  
ORDER NO. 98-58**

Waste Discharger Identification No. 3270100009

For *California - America Co*  
**MONTEREY COUNTY SERVICE AREA NO. 10**  
**Monterey County** *Logan, Monterey Co  
Established*

The California Regional Water Quality Control Board, Central Coast Region, (hereafter the Board) finds:

1. Joe Cochran, Manager for Monterey County Public Works, submitted a complete Report of Waste Discharge on April 22, 1998, in accordance with Section 13260 of the California Water Code. The report was filed for authorization to discharge treated domestic wastewater within the Monterey Peninsula Hydrologic Area.

wastewater produced from CSA 10. A deed restriction has been placed on the property.
2. Monterey County Department of Public Works (hereafter Producer) operates a wastewater treatment and disposal system for residential development projects located in Monterey County along Highway 68. The wastewater treatment facility will serve flows from Laguna Seca development and the Rancho Monterey development. The two residential subdivisions and the proposed treatment and spray irrigation area (Section 1, T16S, R1E, MD B&M Seaside quad.), are shown on attachment "A" of this order.
3. Average peak dry weather flow from the two subdivisions is estimated at 106,000 gallons per day. Flow estimates are based on per household water consumption rates for existing facilities in the area.
4. The Producer owns and operates County Service Area No. 10 (CSA 10). The Producer will provide sewer service to the two subdivisions. CSA 10 uses golf course irrigation as the primary method of waste disposal. CSA 10 has a written agreement with the Rancho Monterey Golf Course requiring reuse of all available
5. Soils in the area consist of Santa Ynez fine sandy loam. Depth to groundwater is generally about 150 feet below the ground surface, and moves approximately in a south-westerly direction.
6. The Producer stores treated recycled water in a lined reservoir having a long term storage capacity of 120 days. Long term storage is used when irrigation is not allowed, typically during the wet season. The Producer can divert inadequately treated flows to a short term (3 day) storage pond. Inadequately treated flows will be redirected back through the plant prior to long term storage and delivery for reuse.
7. The Water Quality Control Plan, Central Coastal Basin, (Basin Plan), was revised and adopted by the Board on September 8, 1994. The Basin Plan incorporates statewide plans and policies by reference and contains a strategy for protecting beneficial uses of State waters.
8. Beneficial uses of groundwater in the vicinity of areas reclaimed water use and disposal include Domestic, Agricultural, and Industrial Water Supply.
9. State Department of Health Services' criteria for use of reclaimed water is in Title 22, Chapter 3, of the California Code of Regulations. The

Board has consulted with this Department regarding the regulation of this discharge.

10. The Supervisors of Monterey County certified a final Environmental Impact Report on September 12, 1995 in accordance with the California Environmental Quality Act (Public Resources Code, Section 21000, et seq.) and the California Code of Regulations.
11. Discharge of waste is a privilege, not a right, and authorization to discharge is conditional upon the discharge complying with provisions of Division 7 of the California Water Code and any more stringent effluent limitations necessary to implement water quality control plans, to protect beneficial uses, and to prevent nuisance. Compliance with this Order should assure this and mitigate any potential adverse changes in water quality due to the discharge.
12. On July 20, 1998 the Board notified the Discharger and interested persons of its intent to issue waste discharge requirements, provided them with an opportunity to submit their written views and recommendations, and scheduled a public hearing.
13. In a public hearing on October 23, 1998, the Board heard and considered all comments pertaining to the discharge and found this Order consistent with the above findings.

**IT IS HEREBY ORDERED**, pursuant to authority in Section 13263 of the California Water Code, the Monterey County Department of Public Works, County Service Area No. 10, its agents, successors, and assigns, may produce and deliver recycled water for golf course and landscape irrigation, providing they comply with the following:

(Requirements are based on staff's professional judgment and recommendations from state and county environmental health agencies for protection of public health and the environment.)

#### A. PROHIBITIONS

1. Delivery of inadequately treated recycled water is prohibited.

2. Daily flow averaged over each month shall not exceed 106,000 gallons.
3. The introduction of any substance into the waste stream which adversely affects the collection, treatment, or disposal facility is prohibited
4. Storage pond freeboard shall not be less than 2 feet.

#### B. RECLAMATION PRODUCER SPECIFICATIONS

1. Production of reclaimed water shall be in conformance with the reclamation criteria established in Title 22, Division 4, Chapter 3, of the California Code of Regulations.
2. Reclaimed water produced shall be suitable for nonrestricted spray irrigation. Reclaimed waste water shall be adequately disinfected, coagulated, clarified, and filtered.
3. Reclaimed water discharged to storage ponds shall not contain constituents in excess of the following:

| Constituent            | Unit | Mean | Maximum |
|------------------------|------|------|---------|
| BOD <sub>5</sub>       | mg/l | 5*   | 10      |
| Suspended Solids       | mg/l | 5*   | 10      |
| Settleable Solids      | ml/l | -    | 0.1     |
| Total Dissolved Solids | mg/l | -    | 600     |
| Sodium                 | mg/l | -    | 125     |
| Chloride               | mg/l | -    | 125     |

\* Compliance shall be determined based on a thirty day average.

4. Reclaimed water discharged from the storage ponds shall not contain Nitrate (as Nitrogen) in excess of 6 Mg/L.
5. The median number of total coliform bacteria in disinfected recycled water discharged to storage ponds shall not exceed 2.2 per 100 milliliters, as determined from the bacteriological results of the last 7 days for which analyses have been completed, and the number of coliform organisms shall not exceed an MPN\* of 23 per 100 milliliters in more than one sample in any thirty (30) day period. No sample shall

October 23, 1998

exceed an MPN of 240 total coliform bacteria per 100 milliliters.

\* Most Probable Number

5. Reclaimed water delivered shall not have a pH less than 6.5 or greater than 8.4.
6. Turbidity of filtered recycled water shall not exceed any of the following:

| Parameter                      | NTU* |
|--------------------------------|------|
| Daily Average                  | 2    |
| 5% of the samples greater than | 5    |
| Maximum at any time            | 10   |

\*Nephelometric Turbidity Units

7. Recycled water shall be subject to a chlorine disinfection process that provides a CT\* value of not less than 450 milligram-minutes per liter at all times with a modal contact time of 90 minutes, based on peak dry weather flow.

\*defined as chlorine concentration times modal contact time.

### C. PROVISIONS


1. Discharger shall comply with "Monitoring and Reporting Program No. 98-58," as specified by the Executive Officer.
2. Discharger shall comply with all items of the attached "Standard Provisions and Reporting Requirements for Waste Discharge Requirements," dated January, 1984 (also



referred to as "Standard Provisions"), except Item Nos. A.8 and C.16.

3. Pursuant to Title 23, Division 3, Chapter 9, of the California Code of Regulations, the Discharger must submit a written report to the Executive Officer not later than July 1, 2007, addressing:
  - a. Whether there will be changes in the continuity, character, location, or volume of the discharge; and,
  - b. Whether, in their opinion, there is any portion of the Order that is incorrect, obsolete, or otherwise in need of revision.
4. The Discharger is required to cease reclaimed water delivery if monitoring shows non-compliance with reclamation producer specifications.
5. If, in the opinion of the Executive Officer, the Discharger fails to comply with the provisions of this Order, including compliance with the above limits, such failure to comply shall constitute adequate grounds to initiate action for administrative civil liability, pursuant to Section 13323, to request the Attorney General take appropriate enforcement action pursuant to Section 13350 of the California Water Code.

dg\H:\Admin\Oct23.98\98-58.wdr

I, **Roger W. Briggs, Executive Officer**, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional water Quality Control Board, Central Coast Region, on **October 23, 1998**.

  
\_\_\_\_\_  
Roger W. Briggs, Executive Officer

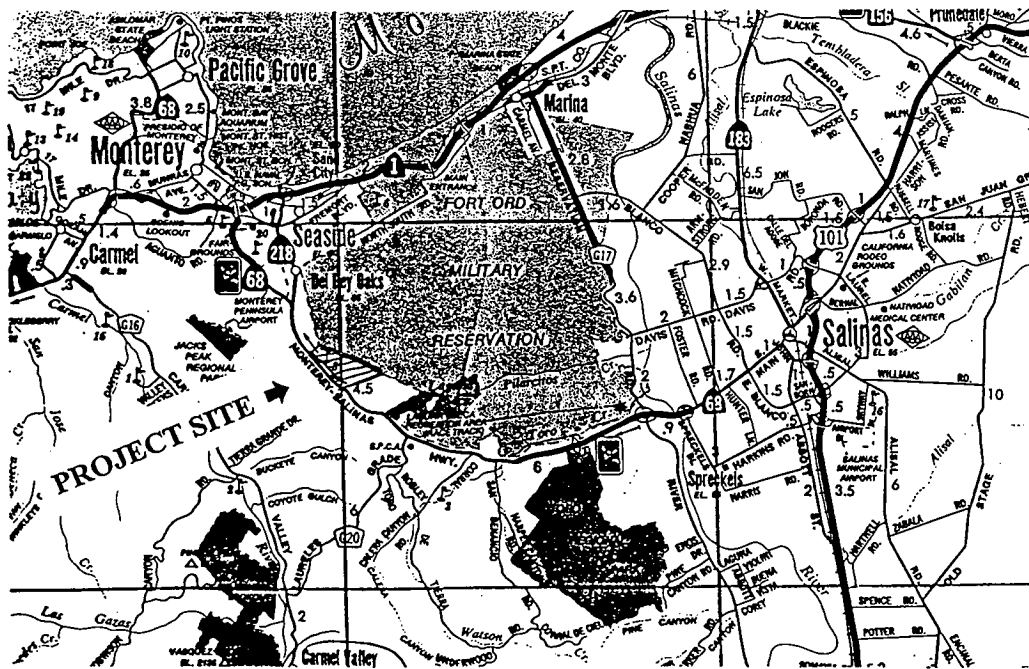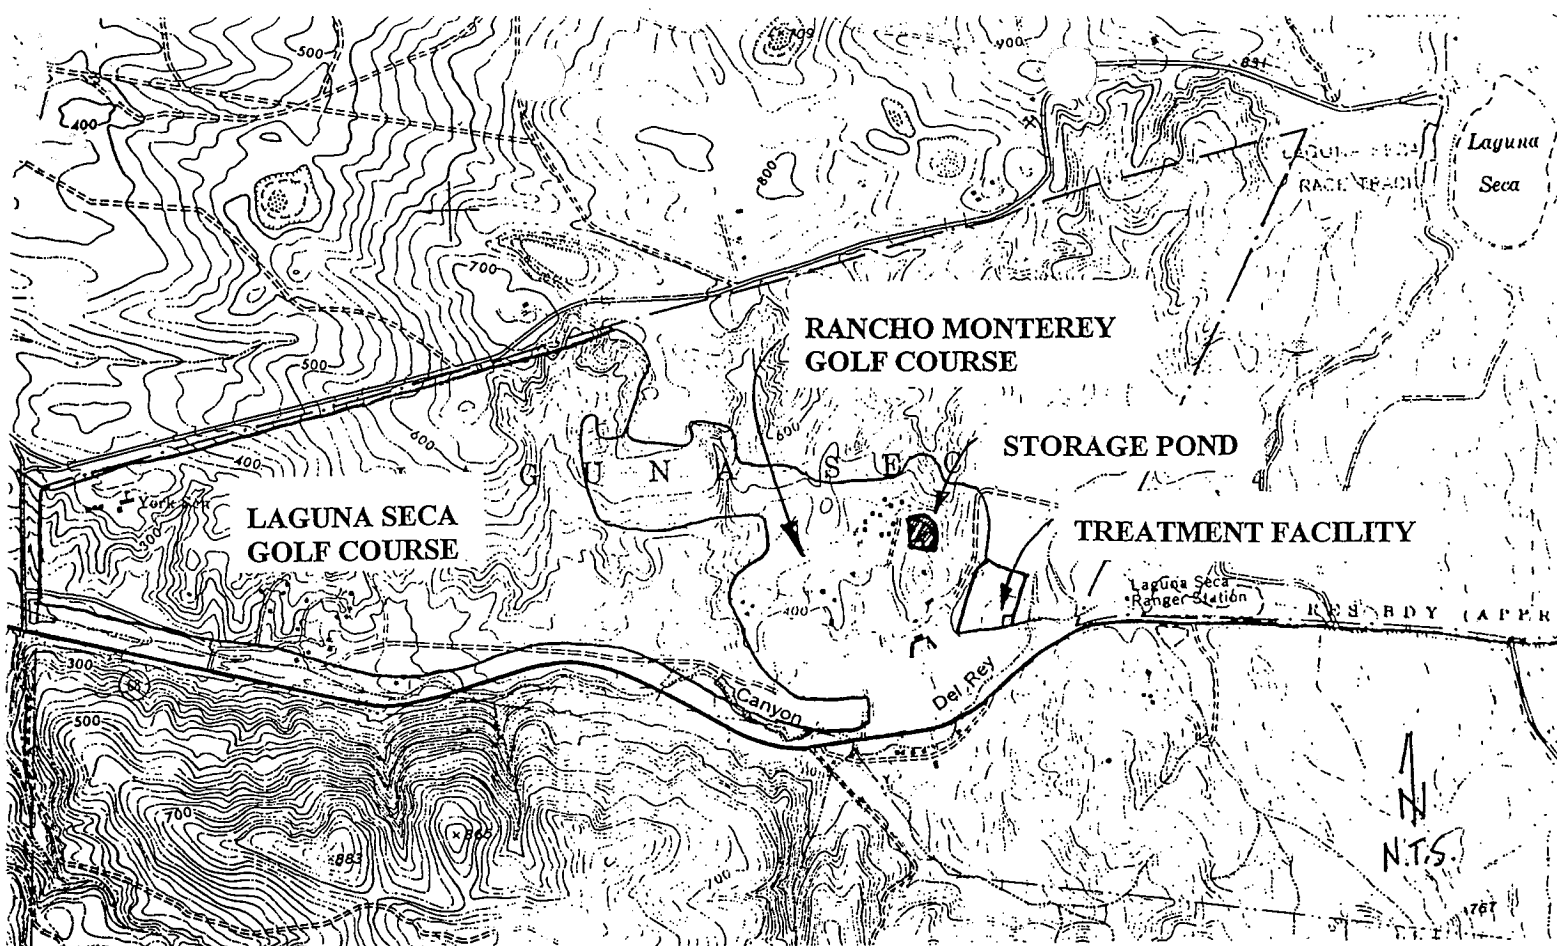

VICINITY MAP

ATTACHEMENT A  
MONTEREY COUNTY SERVICE AREA NO. 10



# California Regional Water Quality Control Board

## Central Coast Region



Winston H. Hickox

Secretary for  
Environmental  
Protection

Internet Address: <http://www.swrcb.ca.gov/rwqcb3>

81 Higuera Street, Suite 200, San Luis Obispo, California 93401-5411

Phone (805) 549-3147 • FAX (805) 543-0397

Gray Davis  
Governor

April 23, 2002

Mr. Tom Peterson  
Cal-Am Water Company  
50 Ragsdale Dr., Suite 100  
P.O. Box 951  
Monterey, CA 93942-0951

Dear Mr. Peterson:

### REVISED MONITORING AND REPORTING PROGRAM NO. 98-58 FOR LAGUNA SECA / PASADERA WWTP, MONTEREY COUNTY

Please see the attached Monitoring and Reporting Program No. 98-58 (MRP), which contains the following revisions:

- Samples of effluent for total dissolved solids, sodium, chloride, BOD<sub>5</sub>, and suspended solids are now required to be taken with a 24-hour compositor (previously grab);
- Frequency of sampling and analysis of effluent for settleable solids is reduced from daily to weekly;
- Frequency of sampling and analysis of storage pond effluent for total nitrogen is reduced from weekly to quarterly;
- Quarterly monitoring of storage pond effluent for nitrate, nitrite, and Total Kjeldahl Nitrogen is added.

Please implement the revised MRP immediately. If you have questions, please feel free to call **Matt Thompson** at (805) 549-3159.

Sincerely,

Roger W. Briggs  
Executive Officer

Enclosure

File: Monterey CSA 10 -Laguna Seca

S:\WB\Coastal Watershed\Staff\MThompson\Regulated Facilities\WDR\Monterey CSA No. 10, Laguna Seca\First Semester 2001 NOV.doc



cc:

Mr. Ed Waggoner  
Carmel Valley Ranch WWTP  
One Old Ranch Road  
Carmel, CA 93923

Mr. Joseph A. Cochran  
Environmental Services Manager  
Monterey County Department of Public Works  
312 East Alisal Street  
Salinas, CA 93901-4303

Bc: Keith Elliot, MRP Binders



**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
CENTRAL COAST REGION**

**81 Higuera Street  
San Luis Obispo, California 93401**

**MONITORING & REPORTING PROGRAM NO. 98-58**

Waste Discharger Identification No. 3270100009

Revised April 23, 2002

For

**LAGUNA SECA / PASADERA WWTP  
Monterey County**

**WATER SUPPLY MONITORING**

Representative samples of the water supply for the area that is serviced by the Laguna Seca / Pasadera Wastewater Treatment Plant shall be collected and analyzed according to the following schedule:

| Constituent            | Units | Sample Type | Minimum Frequency of Sampling and Analysis |
|------------------------|-------|-------------|--------------------------------------------|
| Total Dissolved Solids | mg/L  | Grab        | Semi-Annually <sup>1</sup>                 |
| Sodium                 | mg/L  | Grab        | Semi-Annually <sup>1</sup>                 |
| Chloride               | mg/L  | Grab        | Semi-Annually <sup>1</sup>                 |

**INFLUENT MONITORING**

Representative samples of the influent to the Laguna Seca / Pasadera Wastewater Treatment Plant shall be collected and analyzed according to the following schedule:

| Constituent            | Units | Sample Type | Minimum Frequency of Sampling and Analysis |
|------------------------|-------|-------------|--------------------------------------------|
| Total Dissolved Solids | mg/L  | Grab        | Quarterly                                  |
| Sodium                 | mg/L  | Grab        | Quarterly                                  |
| Chloride               | mg/L  | Grab        | Quarterly                                  |

**EFFLUENT MONITORING**

Representative samples of tertiary effluent shall be collected and analyzed according to the following schedule:

| Constituent            | Units   | Sample Type       | Minimum Frequency of Sampling and Analysis |
|------------------------|---------|-------------------|--------------------------------------------|
| Daily Flow             | gal/day | Metered           | Continuous                                 |
| Total Dissolved Solids | mg/L    | 24-hour composite | Weekly                                     |
| Sodium                 | mg/L    | 24-hour composite | Weekly                                     |
| Chloride               | mg/L    | 24-hour composite | Weekly                                     |
| BOD <sub>5</sub>       | mg/L    | 24-hour composite | Weekly                                     |
| Suspended Solids       | mg/L    | 24-hour composite | Weekly                                     |
| pH                     | units   | Grab              | Weekly                                     |
| Settleable Solids      | mL/L    | Grab              | Weekly                                     |
| Total Coliform         | MPN     | Grab              | Daily                                      |
| Turbidity              | NTU     | Metered           | Continuous                                 |

<sup>1</sup> Semi-annual samples shall be sampled and analyzed on a representative day of the 1<sup>st</sup> and 3<sup>rd</sup> quarters of each year.

**STORAGE POND EFFLUENT MONITORING**

Representative samples of recycled wastewater storage pond effluent shall be collected and analyzed according to the following schedule:

| Constituent                    | Units | Sample Type | Minimum Frequency of Sampling and Analysis |
|--------------------------------|-------|-------------|--------------------------------------------|
| Nitrate (as N)                 | mg/L  | Grab        | Quarterly                                  |
| Nitrite (as N)                 | mg/L  | Grab        | Quarterly                                  |
| Total Kjeldahl Nitrogen (as N) | mg/L  | Grab        | Quarterly                                  |
| Total Nitrogen (as N)          | mg/L  | Grab        | Quarterly                                  |


**STORAGE FACILITY INSPECTION**

Wastewater storage areas shall be inspected weekly. Notes shall be kept of observations and shall be summarized in annual monitoring reports. In the event of impending storage pond overflow, the Executive Officer and the County Environmental Health Department shall be notified immediately.

**REPORTING**

Monitoring results shall be submitted quarterly by the 30<sup>th</sup> day of January, April, July, and October. The report shall include a summary of operational or equipment problems, reasons for any violations of waste discharge requirements, and corrective actions taken to eliminate violations.

Ordered By: \_\_\_\_\_

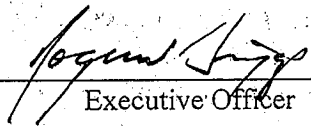  
Executive Officer

Date: \_\_\_\_\_

4-23-02