

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 86-133

WASTE DISCHARGE REQUIREMENTS
FOR
HUNTINGTON PINES MUTUAL WATER COMPANY
AND
THE HUNTINGTON ASSOCIATION
HUNTINGTON CONDOMINIUMS
FRESNO COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Huntington Pines Mutual Water Company provides water and sewer services to Huntington Condominiums. The property and condominium complex are owned by The Huntington Association.
2. Huntington Pines Mutual Water Company and the Huntington Association are hereafter jointly referred to as Discharger.
3. The Board, on 26 April 1974, adopted Order No. 74-277 which prescribed requirements for a discharge from "The Huntington" Condominium complex to a leachfield.
4. Present waste discharge requirements established by Order No. 74-277 are neither adequate nor consistent with plans and policies of the Board.
5. The Discharger discharges approximately 12,000 gallons per day of treated domestic waste to a leachfield for effluent disposal. The plant capacity is 44,000 gallons per day.
6. The treatment and disposal facilities are in Section 6, T8S, R26E, MDB&M with surface water drainage to Huntington Lake, thence the San Joaquin River.
7. The beneficial uses of Huntington Lake and the San Joaquin River are municipal, industrial, and agricultural supply; recreation; esthetic enjoyment; fresh water replenishment; hydroelectric power generation; and preservation and enhancement of fish, wildlife and other aquatic resources.
8. The beneficial use of the ground water is domestic supply.
9. The Board, on 25 July 1975, adopted a Water Quality Control Plan for the San Joaquin River Basin (5C) which contains water quality objectives. These requirements are consistent with that Plan.

WASTE DISCHARGE REQUIREMENTS
HUNTINGTON PINES MUTUAL WATER COMPANY
AND THE HUNTINGTON ASSOCIATION
HUNTINGTON CONDOMINIUMS, FRESNO COUNTY

-2-

10. The action to adopt waste discharge requirements for this existing facility is exempt from the provisions of the California Environmental Quality Act, in accordance with Section 15301, Title 14, California Administrative Code.
11. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
12. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 74-277 be rescinded and the Discharger, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste is prohibited.
3. Wastes from chemical toilets, including those in campers, trailers, etc., shall not be discharged into this system at any point.

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a pollution or nuisance as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge to the leachfield shall remain underground at all times.
4. The 30-day average daily dry weather discharge flow shall not exceed 0.044 million gallons.
5. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
6. The discharge shall not contain constituents in excess of the following limits:

WASTE DISCHARGE REQUIREMENTS
HUNTINGTON PINES MUTUAL WATER COMPANY
AND THE HUNTINGTON ASSOCIATION
HUNTINGTON CONDOMINIUMS, FRESNO COUNTY

-3-


<u>Constituents</u>	<u>Units</u>	<u>Monthly Mean</u>	<u>Daily Maximum</u>
Settleable Matter	ml/l	0.2	1.0
BOD ₅ ^{1/}	mg/l	40	80
Suspended Matter	mg/l	40	80

1/ Five-day, 20° Celsius biochemical oxygen demand.

C. Provisions:

1. The Discharger may be required to submit technical reports as directed by the Executive Officer.
2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 86-133.
3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 September 1985, which are a part of this Order.
4. The Discharger shall report promptly to the Board any material change or proposed change in the character, locations, or volume of the discharge.
5. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
6. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 27 June 1986.


WILLIAM H. CROOKS, Executive Officer

SGT:bro:5/1/86

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 86-133

FOR
HUNTINGTON PINES MUTUAL WATER COMPANY
AND THE HUNTINGTON ASSOCIATION
HUNTINGTON CONDOMINIUMS
FRESNO COUNTY

EFFLUENT MONITORING

Effluent samples shall be collected downstream from the last connection through which wastes can be admitted into the outfall. Effluent samples shall be representative of the volume and nature of the discharge. The following shall constitute the effluent monitoring program:

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Settleable Matter	ml/l	Grab	Weekly
Suspended Matter	mg/l	Grab	Weekly
BOD ₅	mg/l	Grab	Weekly
Total Daily Flow	mgd	Continuous	Daily

If the discharge is intermittent rather than continuous, then on the first day of each such intermittent discharge, the Discharger shall monitor and record data for all of the constituents listed above, after which the frequencies of analysis given in the schedule shall apply for the duration of each such intermittent discharge. In no event shall the Discharger be required to monitor and record data more often than twice the frequencies listed in the schedule.

GROUND WATER MONITORING

The following ground water monitoring program shall be implemented to detect any impacts to local ground waters from the leachfield disposal operation. Samples shall be collected monthly from both the "Dempsey" well and the "Shaw" well. The wells shall be clearly identified by their State well numbers. Samples shall be analyzed quarterly for the following constituents:

<u>Constituents</u>	<u>Units</u>
Nitrate	mg/l
Chlorides	mg/l
Total Coliform Organisms	mg/l

MONITORING AND REPORTING PROGRAM
HUNTINGTON PINES MUTUAL WATER COMPANY
AND THE HUNTINGTON ASSOCIATION
HUNTINGTON CONDOMINIUMS
FRESNO COUNTY

-2-

<u>Constituents</u>	<u>Units</u>
pH	pH Units
Specific Electrical Conductance	micromhos/cm
Depth to Ground Water	feet

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the 15th day of the following month.

Quarterly reports of the constituents specified in the Ground Water Monitoring Program shall be submitted to the Regional Board by 15 April, 15 July, 15 October, and 15 January of each year.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by 30 January of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring program on the effective date of this Order.

Ordered by William H Crooks
WILLIAM H. CROOKS, Executive Officer

SGT:bro
5/1/86

27 June 1986
(Date)

INFORMATION SHEET

HUNTINGTON PINES MUTUAL WATER COMPANY
AND THE HUNTINGTON ASSOCIATION
HUNTINGTON CONDOMINIUMS
FRESNO COUNTY

The Huntington Pines Mutual Water Company supplies water and sewer services to the Huntington Condominiums, a development owned by The Huntington Association. There will ultimately be 125 units in the development. The property, owned by The Huntington Association, is approximately 50 air miles northeast of Fresno in the SE 1/4 of Section 6, T8S, R26E, MDB&M. The condominiums are used mainly by vacationers and skiers. Peak use is during the summer and winter months, with the heaviest use occurring during the winter ski season. Sierra Summit Ski Resort is only two miles from the development.

The wastewater treatment plant consists of an influent lift station, Imhoff Tank, rotary biological contactor (RBC), final clarifier and effluent lift station. Final effluent disposal is accomplished by a leachfield. The design flow of the treatment plant is 0.044 mgd.

Areal soils consist of 3 to 6 feet of silty sands, 2 to 6 feet of glacial till, and 20 to 50 feet of decomposed granite underlain by bedrock. According to a site evaluation plan prepared by Wilsey & Ham (February 1974), percolation rates at testholes dug in the vicinity of the leachfield ranged from 5 to 20 minutes per inch in the silty sands and glacial till. The decomposed granite yielded a percolation rate of 1 minute per inch.


Ground water is estimated to be, at its highest, 20 feet below the existing ground surface. Test pits (8 to 10 feet deep) dug in 1972 showed no evidence of ground water. There are two wells in the vicinity of the disposal site ("Dempsey" and "Shaw" wells). The closest well (Dempsey) is over 250 feet away. Both wells are situated in the same aquifer as the disposal site. The wells are cased and sealed off to a depth of 36 feet. The Discharger is required to monitor these wells to detect any possible ground water degradation from the disposal site. The beneficial use of the ground water is domestic supply.

Surface water drainage is to Huntington Lake, thence the San Joaquin River system. The beneficial uses of Huntington Lake and the San Joaquin River are municipal, industrial, and agricultural supply, recreation, esthetic enjoyment, fresh water replenishment, hydroelectric power generation, and preservation and enhancement of fish, wildlife and other aquatic resources.

Precipitation, mostly in the form of snow, averages 35 inches per year. Approximately 40 inches per year is lost through evaporation.

The action to adopt waste discharge requirements for this existing facility is exempt from the provisions of the California Environmental Quality Act, in accordance with Section 15301, Title 14, California Administrative Code.

SGT:bro
5/1/86

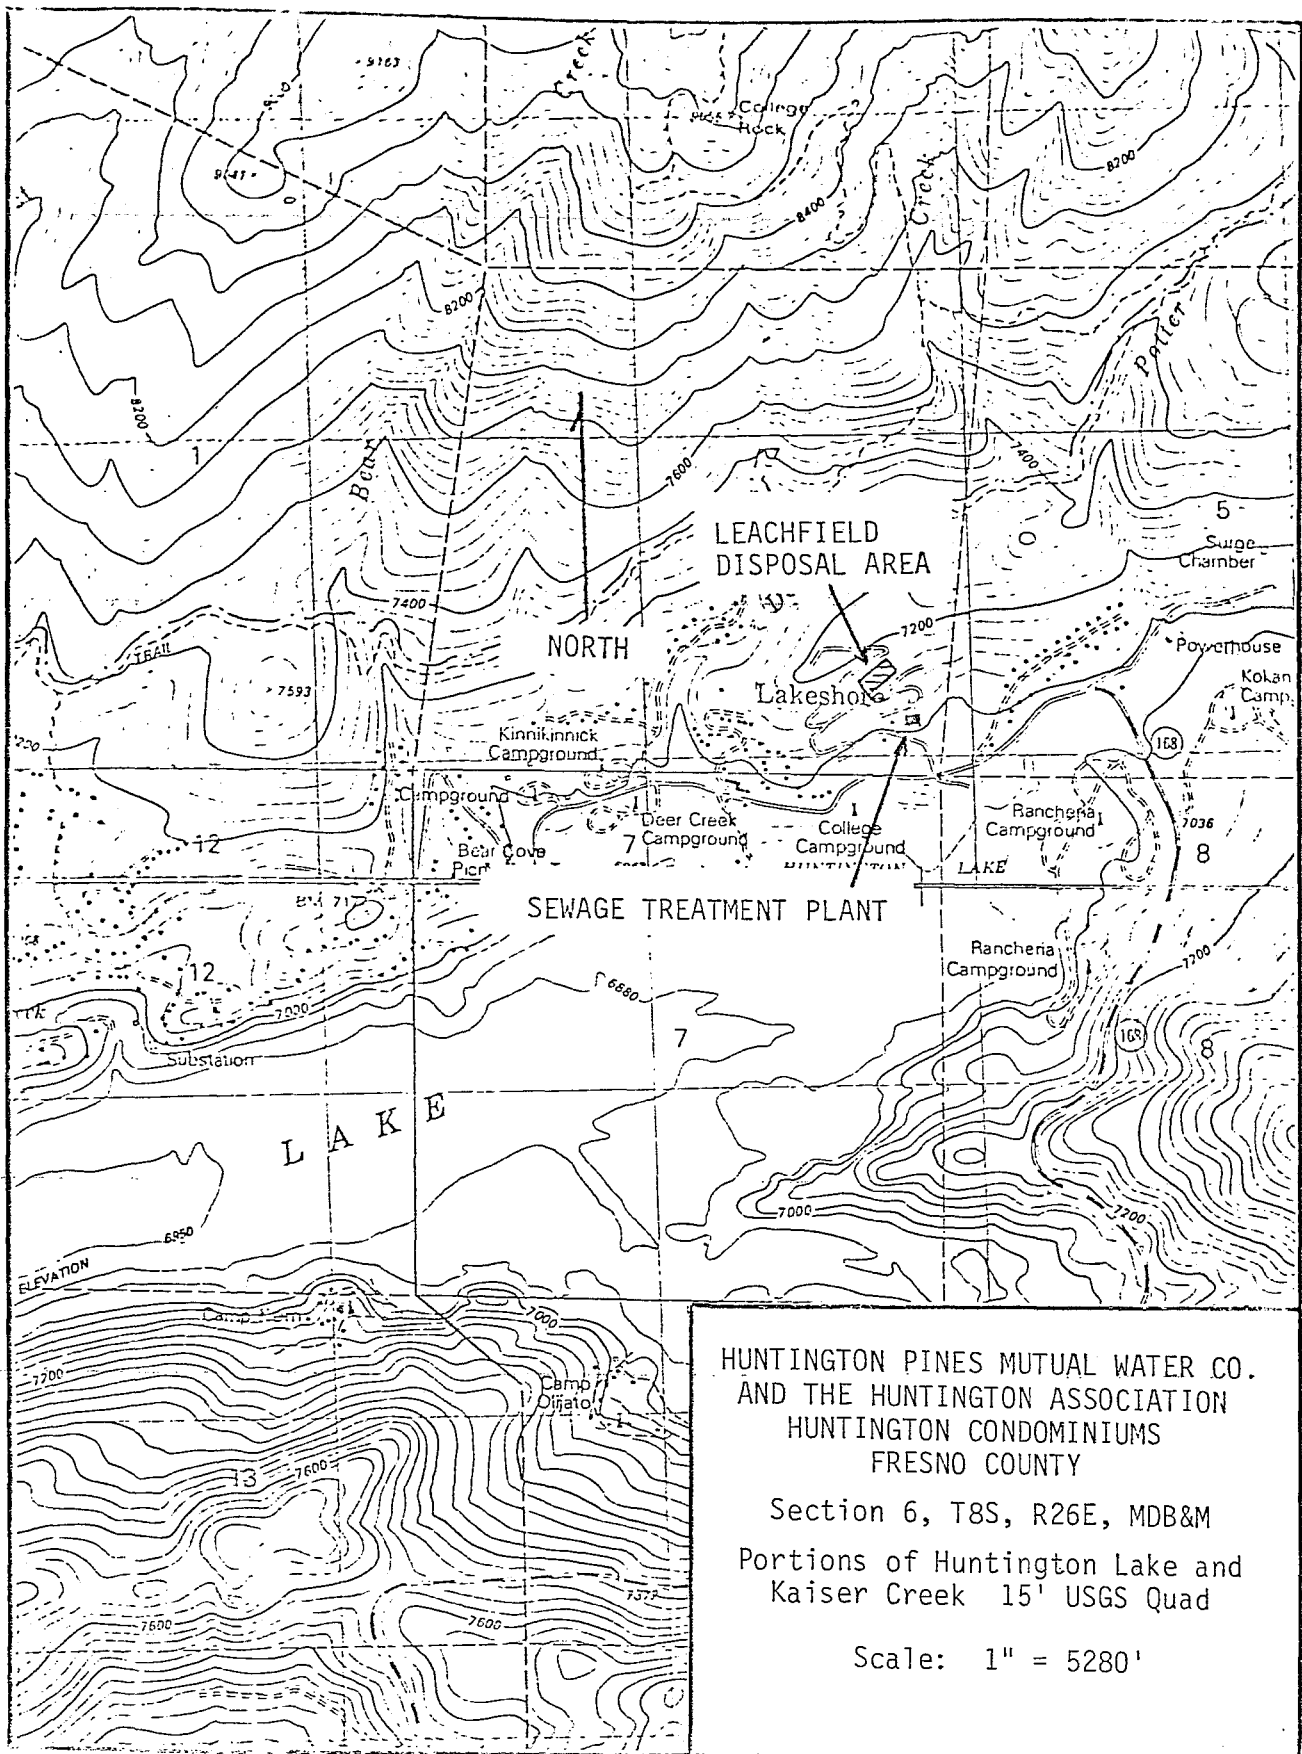

HUNTINGTON PINES MUTUAL WATER CO.
AND THE HUNTINGTON ASSOCIATION
HUNTINGTON CONDOMINIUMS
FRESNO COUNTY

Section 6, T8S, R26E, MDB&M
Portions of Huntington Lake and
Kaiser Creek 15' USGS Quad