

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION
81 Higuera Street, Suite 200
San Luis Obispo, California 93401-5427**

**MASTER WATER RECLAMATION REQUIREMENTS ORDER NO. 98-052
Waste Discharger Identification No. 3 430100003**

FOR

**SOUTH COUNTY REGIONAL WASTEWATER AUTHORITY
AND INDIRECT USERS
SANTA CLARA COUNTY**

The California Regional Water Quality Control Board, Central Coast Region (hereafter Board), finds that:

1. The South County Regional Wastewater Authority (hereafter referred to as the "SCRWA") owns and operates a wastewater collection, treatment, disposal, and water recycling facility (hereafter referred to as the "Facility").

The treatment consists of influent screening, aerated grit removal, nitrification, denitrification, oxidation using an oxidation ditch, and secondary clarification. Plant effluent can be discharged to 370 acres of percolation/evaporation ponds.
2. The Facility is located in South Santa Clara County along Southside Drive, approximately two miles southeast of the City of Gilroy (Sections 9, 15, 16 & 17, T11S, R4E, MD B&M) as shown on Attachment "A" of this Order.
3. The Facility serves the domestic sanitary wastewater pretreatment, collection, treatment and disposal needs of the Cities of Gilroy and Morgan Hill (hereafter referred to as the "Cities"). That aspect of the Facility is regulated under a separate Order issued by the Regional Board and is not the subject of this Order.
4. The Facility discharges stormwater flows directly to surface waters and has applied for a separate stormwater discharge permit under the State Water Resources Control Board's Water Quality Order No. 97-03-DWQ National Pollutant Discharge Elimination System General Permit No. CAS000001, Waste Discharge Requirements for Discharges of Storm Water Associated with Industrial Activities Excluding Construction Activities.
5. SCRWA treats an average dry weather flow (ADWF) of 7.5 million gallons per day (MGD) using an advanced secondary treatment process.
6. SCRWA can divert up to three MGD of the secondary effluent to a tertiary treatment process which meets the water reclamation criteria of the State Department of Health Services (Title 22, Division 4, Chapter 3, Sections 60301-60355 of the California Code of Regulations). The tertiary treatment process consists of coagulation, filtration, chlorination, then dechlorination. A portion of the tertiary treated wastewater is used onsite for landscape irrigation in-plant process water, and to supply the fire protection system.
7. SCRWA has plans to increase tertiary treatment capacity to 15 MGD.
8. The Facility augments the water resources needs of the Cities and the Santa Clara Valley Water District (hereafter referred to as the "SCVWD") by supplying recycled water to those entities. For purposes of this Order, the SCRWA is hereafter referred to as the "Producer" of recycled water. Historic water recycling has been regulated by Waste Discharge Requirements Order No. 85-82, adopted by the Regional Water Quality Control Board on May 10, 1985.

9. Agents for SCRWA filed a Report of Waste Discharge on April 4, 1997, for authorization to use up to 15 MGD of disinfected tertiary recycled water in conformance with water reclamation criteria contained in California Code of Regulations, Title 22.
10. The Producer will authorize specific reuse projects on a case-by-case basis in accordance with an approved permit-based program of rules and regulations for recycled water users. The Producer will use existing recycled water transmission facilities as shown in Attachment B to transport recycled water to Users. The Producer will also design and incrementally install recycled water transmission facilities to serve other, future projects.
11. Users will document compliance with all conditions of the Order and of Title 17 and Title 22 of the California Code of Regulations (CCR). Each User will demonstrate to the Producer the absence of cross-connections before being issued a permit. The Producer will maintain this information at its facility.
12. The Producer will continue to investigate other potential reuse strategies such as groundwater recharge, surface water augmentation, and dual water supply for new construction. This will enable the Producer to move towards achieving a goal of reusing the maximum possible amount of recycled water.
13. On July 14, 1992, the Governor approved Assembly Bill No. 3012 (AB 3012), which added Section 13523.1 to the California Water Code, and authorizes regional boards to issue master reclamation permits to a supplier and/or distributor of recycled water in lieu of prescribing water reclamation requirements for a user of recycled water. AB 3012 also removes the requirement, except upon written request of a regional board, that the Users file a report with a regional board to use Recycled water from a supplier/distributor for whom a master reclamation permit has been issued. Similarly, AB 3012 exempts any such user of recycled water from the requirement to file a report with a regional board related to any material change in the character of the recycled water or its use. This Order is intended to be a master reclamation permit that is consistent with Section 13523.1.
14. California Water Code Section 13512 states that it is the intention of the legislature that the State undertake all possible steps to encourage development of water reclamation facilities so that recycled water may be made available to help meet the growing water demands of the State.
15. California Water Code Section 13523 provides that a regional board, after consulting with and receiving the recommendations of the State Department of Health Services, and if it determines such action to be necessary to protect the public health, safety, or welfare, shall prescribe water reclamation requirements for water which is used or proposed to be used as recycled water. The use of recycled water could affect the public health, safety, or welfare, and requirements for those uses are, therefore, necessary in accordance with the California Water Code.
16. In California Water Code Section 13550, the Legislature defines the use of potable domestic water for non-potable uses, including but not limited to cemeteries, golf courses, parks, highway landscaped areas, irrigation, and industrial uses as a waste or an unreasonable use of such water within the meaning of Section 2 of Article X of the California Constitution when suitable Recycled water is available.
17. California Water Code Section 13576(e) states that the use of recycled water has proven to be safe from a public health standpoint and that the State Department of Health Services is updating regulations for the use of recycled water.
18. This Order's requirements conform with and implement the water reclamation criteria of the State Department of Health Services (Title 22, Division 4, Chapter 3, Sections 60301-60355 of the California Code of Regulations [CCR]) to protect the public health, safety, and welfare.

19. State Department of Health Services' criteria for use of recycled water is in Title 22, Chapter 3, of the California Code of Regulations. The Board has consulted with the Department of Health Services regarding the regulation of this discharge.
 20. The Water Quality Control Plan, Central Coastal Basin (Basin Plan) was adopted by the Board on September 8, 1994. The Basin Plan incorporates State Board plans and policies by reference and contains a strategy for protecting beneficial uses of State waters.
 21. Federal regulations require effluent limitations for all pollutants that are or may be discharged at a level that will cause or have reasonable potential to cause, or contribute to in-stream excursions above narrative or numerical water quality standards. Based on information submitted as part of the application, in studies, and as directed by monitoring and reporting programs, the Board finds that the discharge does not have a reasonable potential to cause or contribute to an in-stream excursion above a water quality objective.
 22. Existing and anticipated beneficial uses of ground water in the vicinity of the discharge include:
 - a. Domestic water supply;
 - b. Agricultural water supply
 - c. Industrial process supply; and,
 - d. Industrial service supply.
 23. Present and anticipated beneficial that could be affected by the discharge include:
 - a. Municipal and Domestic Supply;
 - b. Agricultural Water Supply;
 - c. Industrial Service Supply;
 - d. Groundwater Recharge;
 - e. Water Contact Recreation;
 - f. Non-Contact Water Recreation;
 - g. Wildlife Habitat;
 - h. Cold Freshwater Habitat;
 - i. Warm Freshwater Habitat;
 - j. Migration of Aquatic Organisms;
 - k. Spawning, Reproduction, and/or Early Development;
 - l. Preservation of Habitats of Special Significance;
 - m. Rare, Threatened, or Endangered Species;
 - n. Estuarine Habitat;
 - o. Freshwater Replenishment;
 - p. Navigation;
 - q. Commercial and Sport Fishing; and
 - r. Shellfish Harvesting.
 24. These waste discharge requirements are for an existing facility and are exempt from the provisions of the California Environmental Quality Act (Public Resources Code, Section 21000, et seq.) in accordance with Section 15301, Chapter 3, Title 14, of the California Code of Regulations.
 25. A permit and the privilege to discharge waste into waters of the State is conditional upon the discharge complying with provisions of Division 7 of the California Water Code and of the Clean Water Act (as amended or as supplemented by implementing guidelines and regulations) and with any more stringent effluent limitations necessary to implement water quality control plans, protect beneficial uses, and prevent nuisance. Compliance with this Order should assure conditions are met and mitigate any potential changes in water quality due to the project.
 26. The Board has notified the Producer and interested persons of its intent to prescribe waste discharge requirements and water reclamation requirements for the proposed discharges, and provided them with an opportunity for a public hearing and to submit their written views and recommendations.
 27. The Board, at a public meeting held May 29, 1998, heard and considered all comments pertaining to the discharge and found this Order consistent with the above findings.
- IT IS HEREBY ORDERED**, pursuant to authority in Section 13377 of the California Water Code, that South County Regional Wastewater Authority, its agents, successors, and assigns, may discharge waste

from its wastewater treatment plant providing it complies with the following:^a

A. PROHIBITIONS

1. The treatment, storage, distribution, or reuse of recycled water shall not create a nuisance as defined in section 13050(m) of the California Water Code.^{CWC}
2. No recycled water used for irrigation shall be applied during periods of rainfall or when soils are saturated such that runoff occurs.^{BPJ}
3. No recycled water used for irrigation shall be allowed to escape to areas outside the designated use areas by surface flow or by airborne spray.^{DHS}
4. Recycled water shall be confined to areas of authorized use without discharge to surface waters or drainageways.^{BPJ}
5. Spray, mist, or runoff shall not enter a dwelling or food handling facility, and shall not contact any drinking fountain, or designated outdoor eating areas.^{DHS}
6. No recycled water shall be discharged from the treatment facilities, irrigation holding tanks, storage ponds, or other containment, other than for irrigation or industrial reuse in accordance with this Order, Waste Discharge Requirements for the Producer, or for discharge to a municipal sewage collection system.^{BPJ}
7. There shall be no cross-connections between the potable water supply and pipes containing recycled water. Supplementing recycled water with water used for domestic supply shall not be allowed except through an air-gap separation. In accordance with CCR Title 17, Section 7604, a reduced pressure principle backflow device shall be provided at premises where recycled water is used and there is no interconnection with the potable water system. This requirement does not apply to individual residences using recycled water for landscape irrigation as part of an approved dual plumbed use area as defined in CCR Title 22, Section 60312.^{DHS}
8. Personnel involved in producing, transporting, or using recycled water shall be informed of possible health hazards that may result from contact and use of recycled water.^{DHS}
9. Delivery of recycled water shall cease during any period these Reclamation Specifications cannot be met.^{BPJ}
10. Spray irrigation of recycled water shall be accomplished at a time and in a manner to minimize ponding and the possibility of public contact with sprayed materials.^{DHS}
11. All reclamation reservoirs and other areas with public access shall be posted (in English and Spanish) to warn the public recycled wastewater is being stored or used.^{DHS}
12. Recycled water systems shall be properly labeled and regularly inspected to assure proper operation, absence of leaks, and absence of illegal connections.^{DHS}
13. A minimum freeboard of two feet shall be maintained in the reclamation storage ponds.^{BPJ}
14. Recycled water shall not be stored or applied to any areas located within 100 feet of any well used for domestic purposes.^{BPJ}
15. For golf course use, the score cards must clearly state that reclaimed water is used for irrigation.^{DHS}
16. Hydraulic and constituent (Nitrogen, etc.) loading rates for reclamation uses shall be based on crop consumption and tolerance and shall not exceed what is reasonable for production of the crop.^{BPJ}

^a General permit conditions, definitions and the method of determining compliance are contained in the attached "Standard Provisions and Reporting Requirements for National Pollutant Discharge Elimination System Permits," dated January 1985, included as part of this Order.

B. RECYCLED WATER LIMITATIONS

1. The Producer shall assure that treated effluent put to use for disinfected tertiary recycled water shall be an adequately oxidized, filtered, and disinfected water, as defined in CCR Title 22, Division 4, Chapter 3, Sections 60301-60335, or alternatively defined and approved by State Department of Health Services (DHS).
2. The Producer shall discontinue delivery of recycled water to Users during any period which it has reason to believe that the limits established in Section B of this Order are not being met. The delivery of recycled water shall not be resumed until all conditions which caused the limits to be violated have been corrected. ^{BPJ}
3. The State Department of Health Services is currently revising the Title 22 regulations for water reuse. When revised regulations are finalized, the Executive Officer may authorize changes to the restricted and unrestricted recycled water uses consistent with those regulations. ^{DHS}
4. Monthly average flow volumes shall not exceed 15.0 MGD or the total monthly demand of the primary users. ^{ROWD}
5. Tertiary treated recycled water shall not exceed the limits^A of Table 4 - Disinfected Tertiary Recycled Water Limits

Table 4- Disinfected Tertiary Recycled Water Limits (mg/l)

Parameter	Daily Max	30-Day Mean	7-Day Mean
BOD ₅	20	10	--
Total Suspended Solids	20	10	--
Nitrate as N	10	5	--

6. Recycled Water shall not have turbidity which exceeds the following limits. ^{DHS}
 - a. Daily average turbidity must be less than or equal to 2 NTU,
 - b. turbidity shall not exceed 10 NTU at any time, and

- c. turbidity must not exceed 5 NTU for more than five percent of the time.
7. Recycled water shall not contain total coliform concentrations exceeding the following limits. ^{DHS}
 - a. the seven-day median concentration must not exceed an MPN of 2.2/100 ml,
 - b. concentrations must not exceed 23/100 ml in more than one sample taken over a 30-day range,
 - c. concentrations must be less than 240/100 ml at all times.
8. Recycled Water shall have a CT value (chlorine concentration times modal contact time) of not less than 450 mg-min/l at all times with a modal contact time of at least 90 minutes based on 9.0 MGD. ^{DHS}
9. Recycled water shall not exceed the limits of Table 5 - Maximum Contaminant Levels (see below).

C. PROVISIONS

1. This Order supersedes Order No. 85-82 for all uses specified by that Order. Order No. 85-82 is hereby rescinded.
2. The Producer has established rules and regulations for reclaimed water Users governing the design and construction of reclaimed water use facilities and the use of reclaimed water, in accordance with the uniform statewide reclamation criteria established pursuant to California Water Code Section 13521, and subject to the Department of Health Services and Executive Officer review and approval. The Producer has also developed and submitted administrative procedures specifying how the reclaimed water rules and regulations and permit-based system for regulating users will be implemented.

Table 5- Maximum Contaminant Levels (mg/l, unless indicated otherwise)


Constituent	Primary MCL	Constituent	Primary MCL
ORGANICS			
Alachlor (Alanex)	0.002	Heptachlor	0.00001
Atrazine (Aatrex)	0.003	Heptachlor epoxide	0.00001
Bentazon (Basagran)	0.018	Hexachlorobenzene	0.001
Benzene	0.001	Hexachlorocyclopentadiene	0.05
Benzo(a)pyrene	0.0002	Lindane (gamma-BHC)	0.0002
Carbofuran (Furadan)	0.018	Methoxychlor	0.04
Carbon tetrachloride	0.0005	Molinate (Ordam)	0.02
Chlordane	0.0001	Monochlorobenzene (Chlorobenzene)	0.07
2,4-D	0.07	Oxamyl	0.2
Dalapon	0.2	Pentachlorophenol	0.001
1,2-Dibromo-3-chloropropane (DBCP)	0.0002	Picloram	0.5
1,2-Dichlorobenzene (o-Dichlorobenzene)	0.6	Polychlorinated biphenyls (PCBs)	0.0005
1,4-Dichlorobenzene (p-DCB)	0.005	Simazine (Princep)	0.004
1,1-Dichloroethane (1,1-DCA)	0.005	Styrene (Vinylbenzene)	0.1
1,2-Dichloroethane (1,2-DCA)	0.0005	2,4,5-TP (Silvex)	0.05
1,1-Dichloroethylene (1,1-DCE)	0.006	2,3,7,8-TCDD (Dioxin)	0.00000003
cis-1,2-Dichloroethylene	0.006	1,1,2,2-Tetrachloroethane	0.001
trans-1,2-Dichloroethylene	0.01	Tetrachloroethylene (PCE)	0.005
Dichloromethane (Methylene chloride)	0.005	Thiobencarb (Bolero) ^a	0.07
1,2-Dichloropropane (Propylene dichloride)	0.005	Toluene (Methylbenzene)	0.15
Di(2-ethylhexyl)adipate	0.4	Toxaphene	0.003
1,3-Dichloropropene	0.0005	1,2,4-Trichlorobenzene (Unsym-Trichlorobenzene)	0.07
Di(2-ethylhexyl)phthalate (DEHP)	0.004	1,1,1-Trichloroethane (1,1,1-TCA)	0.200
Dinoseb	0.007	1,1,2-Trichloroethane (1,1,2-TCA)	0.005
Diquat	0.02	Trichloroethylene (TCE)	0.005
Endrin	0.002	Trichlorofluoromethane (Freon 11)	0.15
Endothal	0.1	1,1,2-Trichloro-1,2,2-Trifluoroethane (Freon 113)	1.2
Ethylbenzene (Phenylethane)	0.7	Sum of bromodichloromethane, dibromochloromethane, bromoform, and chloroform	0.1
Ethylene dibromide (EDB)	0.00005	Vinyl chloride	0.0005
Glyphosate	0.7	Xylenes (single isomer or sum of isomers)	1.750
INORGANICS			
Aluminum	1	Fluoride	
Antimony	0.006	Annual ave. of max. daily air temperature	
Arsenic	0.05	<53.7 degrees Fahrenheit (°F)	
Asbestos	7 MFL ^c	53.8 to 58.3 °F	2.4
Barium	1	58.4 to 63.8 °F	2.2
Beryllium	0.004	63.9 to 70.6 °F	2.0
Cadmium	0.005	70.7 to 79.2 °F	1.8
Chromium	0.05	79.3 to 90.5 °F	1.6
Cyanide	0.2		1.4
Mercury	0.002		
Nickel	0.1		
Nitrate (as NO3)	45		
Nitrate + Nitrite (sum as nitrogen)	10		
Nitrite (as nitrogen)	1		
Selenium	0.05		
Thallium	0.002		
RADIOACTIVITY			
Gross alpha particle activity ^d	15 pCi/L ^e	Strontium-90	8 pCi/L
Gross beta particle activity	50 pCi/L	Tritium	20,000 pCi/L
Combined Radium-226 and Radium-228	5 pCi/L	Uranium	20 pCi/L

^a Also listed w/Secondary MCL of 0.001 mg/L.^c MFL = million fibers per liter, MCL is for fibers exceeding 10 microns in length.^d Including radium-226 but excluding radon and uranium.^e pCi/L = picocuries per liter

3. Reclaimed Water Use permits, issued by the Producer in accordance with approved rules and regulations, form the basis of permitted reclaimed water use by specific Users. Reclaimed Water Use permits shall specify self-monitoring requirements for each User. If someone other than the User is responsible for applying the reclaimed water (Distributor), e.g. a truck hauler, then the User shall inform them of these requirements in a written permit or other suitable manner. a Distributor shall fill out a Reclaimed Water Release Form when receiving reclaimed water from the Producer.
4. A copy of the Reclaimed Water Use permit and the Order must be provided to the Users by the Producer. The Users must have these available at all times for inspection by Regional Board staff, the Producer, or State/County Health Officers. The Distributors must carry the Reclaimed Water Release Form at all times.
5. The Producer shall comply with the self-monitoring program as adopted by the Board and as may be amended by the Executive Officer. The Producer is responsible for collecting reports from Users. Users are responsible for submitting on-site observation reports and use data to the Producer, who will compile and file self-monitoring reports with the Regional Board. The Producer, at its discretion, may assume the User's responsibility for on-site observation reports and use data.
6. The Producer will be responsible for ensuring that reclaimed water meets the quality standards of this Order and for operation and maintenance of major transport facilities and associated appurtenances. Users will be responsible for the application of reclaimed water on their respective use areas and associated operations and maintenance. The Producer will conduct periodic inspections of User facilities to monitor compliance with the conditions of the Producer's issued permit and this Order.
7. The Producer and Users shall maintain in good working order and operate as efficiently as possible any facility or control system installed by the Producer or Users to achieve compliance with the water reclamation requirements.
8. The Producer, Users, and distributors shall receive employee training to assure proper operation of reclamation facilities, worker protection, and compliance with this Order. In accordance with CCR Title 17, Section 7586, each User shall designate a Reclaimed Water Supervisor responsible for compliance with permit conditions.
9. The Producer shall assure that the backflow preventers are in proper working order by testing initially and annually thereafter, in accordance with CCR Title 18, Section 7605. Reports of testing and maintenance shall be maintained by the Producer.
10. The Producer and Users shall assure that all above ground equipment, including pumps, piping, storage reservoir, and valves, etc. which may at any time contain reclaimed water shall be adequately and clearly identified with warning signs. The Producer and Users shall make all necessary provisions to inform the public that the liquid being distributed is reclaimed water and is unfit for human consumption.
11. Reclamation facilities shall be operated in conformance with the California Department of Health Services' "Guidelines for Use of Reclaimed Wastewater for Irrigation and Impoundment," "Guidelines for Worker Protection at Reclamation Use Areas," the American Water Works Association, California-Nevada Section's *Guidelines for the Distribution of Non-potable Water*, and the Producer's approved reclaimed water use rules and regulations (which may clarify and/or modify the above guidelines) and the appropriate local administrative procedures.
12. The Producer and Users shall permit the Board or its authorized representative in accordance with California Water code section 13267(c):
 - Entry upon premises where a regulated facility or activity is located or conducted,

- or where records are kept under the conditions of the Order,
- Access to and copy of any records that must be kept under conditions of this Order,
 - Inspection of any facility, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order,
 - To photograph, sample, and monitor for the purpose of assuring compliance with this Order.
13. The Discharger shall comply with "Monitoring and Reporting Program No. 98-052," as specified by the Executive Officer.
14. The Discharger shall comply with all items of the attached "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated January 1984.
15. The Board will revise this Order periodically and may revise these requirements when necessary.
16. Pursuant to Title 23, Division 3, Chapter 9, of the California Code of Regulations, the Discharger must submit a written report to the Executive Officer not later than December 5, 2012 addressing:^c
- a. Whether there will be changes in the continuity, character, location, or volume of the discharge; and,
 - b. Whether, in their opinion, there is any portion of the Order that is incorrect, obsolete, or otherwise in need of revision.

I, **ROGER W. BRIGGS, Executive Officer**, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Coast Region, on May 29, 1998.


Executive Officer


H:\NPDES\CLARA\SCRWA\SCRWAREC.WDR\SJM\ch\boardmtg.dec.5

CWC California Water Code, Division 7


BPJ Regional Water Quality Control Board Staff's Best Professional Judgment

DHS California Department of Health Services, Drinking Water Field Operations Branch under authority of Title 22, Division 4, Chapter 3 -
Water Reclamation Criteria

ROWD The Discharger's Report of Waste Discharge

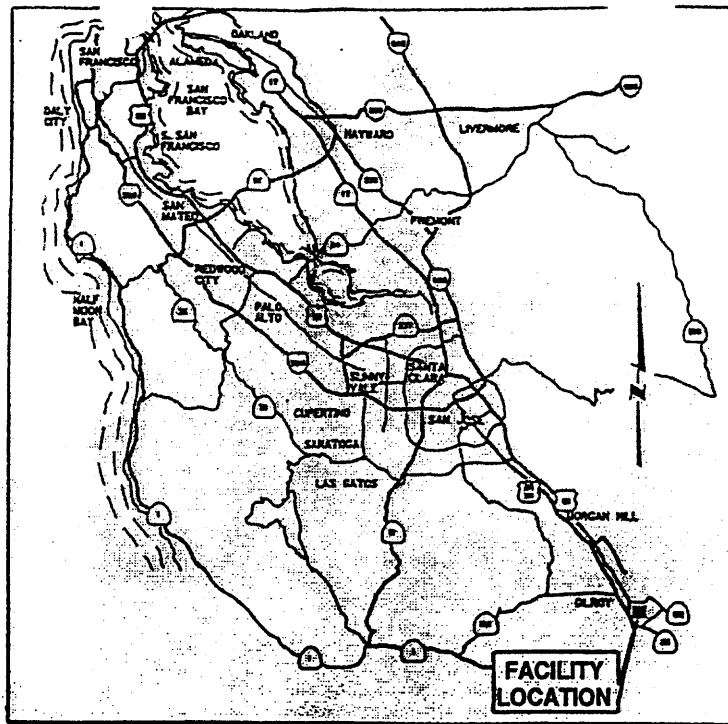

LOCATION MAP
NO SCALE

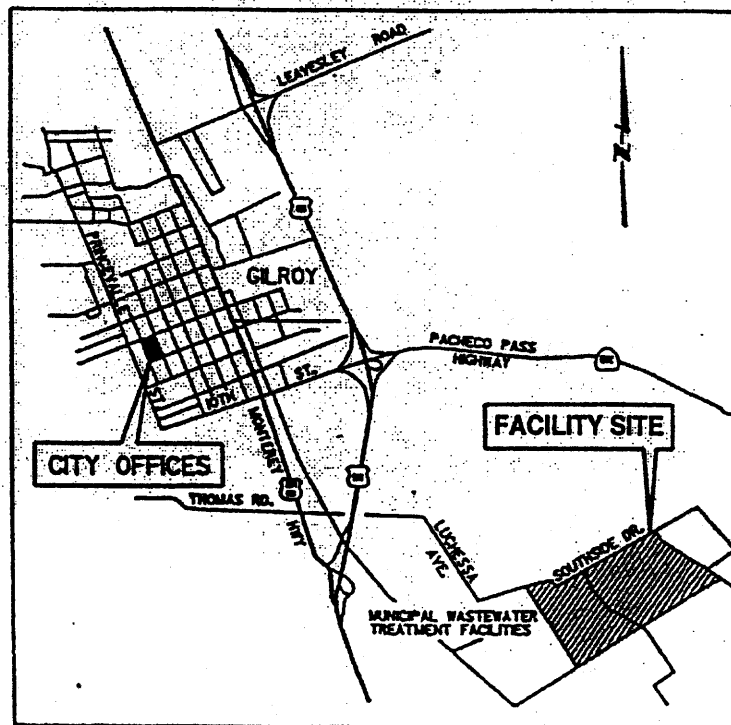


VICINITY MAP
NO SCALE

SOUTH COUNTY REGIONAL WASTEWATER AUTHORITY
TREATMENT/RECYCLING FACILITY LOCATION

ATTACHMENT "A"



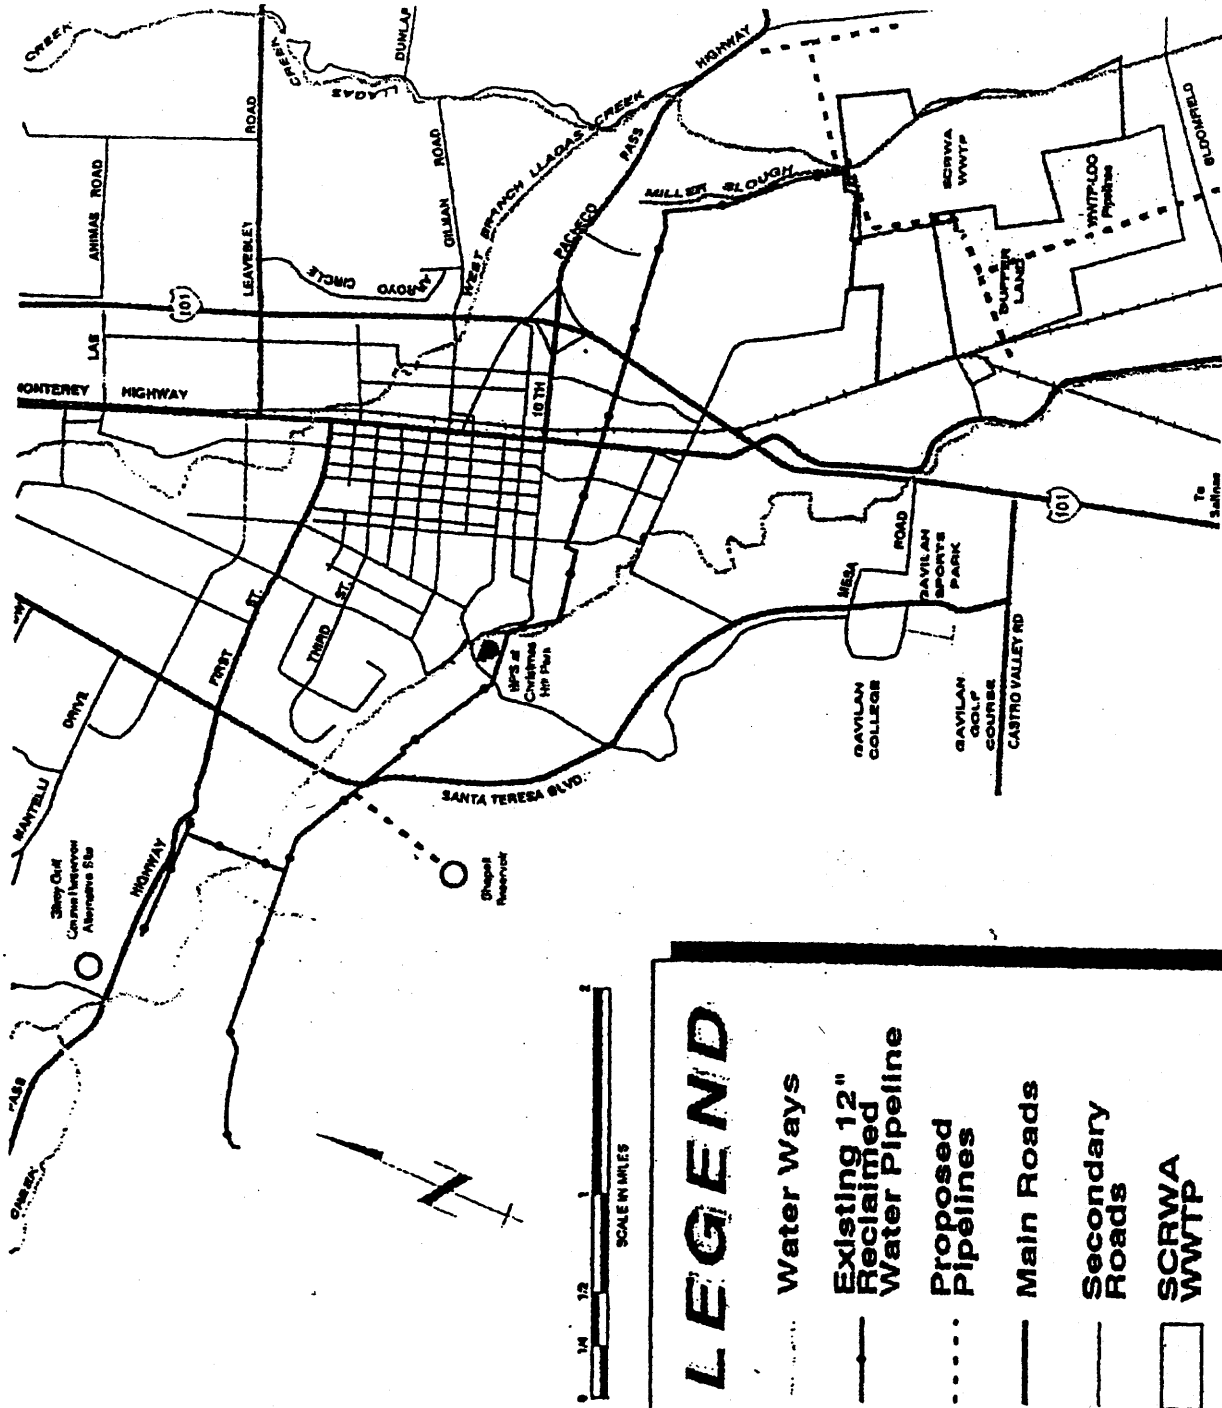

Attachment B
Recycled Water Work Plan Study Area

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION**

**WATER RECLAMATION REQUIREMENTS
MONITORING AND REPORTING PROGRAM NO. 98-052**

Waste Discharger Identification No. 3 430100003

**FOR
SOUTH COUNTY REGIONAL WASTEWATER AUTHORITY
AND
INDIRECT USERS
SANTA CLARA COUNTY**

I. GENERAL

Reporting responsibilities of waste dischargers are specified in Sections 13225(a), 13267(b), 13268, 13383, and 13387(b) of the California Water Code. The principle purposes of a monitoring program by a Producer of recycled water, also referred to as self-monitoring program, are:

1. To document compliance with water recycling requirements and prohibitions established by this Regional Board; and
2. To facilitate self-policing by the Producer in the prevention and abatement of pollution arising from water recycling.

II. RECYCLED WATER SAMPLING AND ANALYSIS

The Producer shall document tertiary effluent quality under their regular facility Waste Discharge Requirements self-monitoring program (Order No. 98-053). Table MRP-1 contains a schedule for monitoring. For any instance where Table MRP-1 does not coincide with the facility's regular monitoring requirements, the more frequent monitoring will prevail.

III. REPORTS TO BE FILED WITH THE REGIONAL BOARD

1. Violation of Requirements

In the event the Producer is unable to comply with conditions of the water recycling requirements and prohibitions, the Producer shall immediately notify the Regional Board by telephone, then submit a written follow-up report within two weeks of the noncompliance. The written report shall include pertinent information explaining reasons for noncompliance and shall indicate what steps are being taken to prevent the problems from recurring.

2. Annual Self-Monitoring Report

An annual report for each calendar year shall be submitted to the Board by January 30 of the following year. The report shall include:

- a. Letter of Transmittal: A letter transmitting self-monitoring reports should accompany each report. Such a letter shall include a discussion of requirement violations found during the reporting period and actions taken or planned for correcting noted violations, such as operation or facility modifications. If the

Producer has previously submitted a report describing corrective actions and/or a time schedule for implementing the corrective actions, reference to the previous correspondence will be satisfactory.

The transmittal letter shall contain a statement by the Producer, or the Producer's authorized agent, under penalty of perjury, that to the best of the signer's knowledge the report is true, accurate, and complete.

- b. Tabulations of the result from each required analysis by Producer specified in Table MRP-1 (Attachment A) by date, time, type of sample, and station.
- c. A list of existing and new authorized recycled water Users, including the name, location, and projected annual flow to be delivered.
- d. Tabulation of inspection and observations reuse sites, including User's standard observations and random inspections by the Producer.
- e. A summary of effluent violations related to water recycling, violations found during inspection of reuse sites, corrective actions taken, and any changes to or revoking of User authorizations.
- f. An update regarding development of the South County Regional Wastewater Authority Water Recycling Workplan, including planning, design, and construction of facilities, and preparation of required reports and technical documents.

IV. STANDARD OBSERVATIONS

1. Evidence of runoff of recycled water from the site (show affected area on a sketch, and estimate volume).
2. Odor of wastewater origin from irrigation site: If present, indicate apparent source, characterization, direction of travel, and any public use areas or offsite facilities affected by the odors.
3. Evidence of ponding of recycled water, and/or evidence of mosquitoes breeding within the irrigation area due to ponded water.
4. Warning signs properly posted to inform public that irrigation water is recycled water, which is not safe for drinking.
5. Evidence of leaks or breaks in the irrigation system pipelines or tubing.
6. Evidence of plugged, broken, or otherwise faulty drip irrigation system emitters or spray irrigation sprinklers.

V. DESCRIPTION OF SAMPLING AND OBSERVATION STATIONS

1. RECYCLED WATER

Station

Description

E-001

Location at South County Regional Wastewater Authority Treatment and Recycling Facility where a representative sample of treatment plant effluent being diverted for recycling can be obtained and total diverted flow can be measured.

2. LAND OBSERVATION STATIONSStationDescription

L-1 to L-n

Locations at a sufficient number of points at reuse areas in order to ensure compliance with water recycled requirements.

3. IMPOUNDMENT FACILITIESStationDescription

P-1 to P-n

Locations at points along the periphery of each storage, ornamental, golf course, or other pond or impoundment.

VI. SCHEDULE OF SAMPLING, MEASUREMENTS, AND ANALYSIS

1. The self-monitoring program is applicable during the periods when recycled water is in use. The Producer and Users are required to perform observations, sampling, measurements, and analyses according to the schedule given in Table 1 (Attachment A).
2. The Producer shall require the Users to conduct a complete inspection of all irrigation lines, sprinklers, and emitters at least once each year during the dormant season. A report of the findings of these inspections, including descriptions of any significant repairs or modifications made to the distribution systems, shall be submitted in the annual report (due January 30 of each year).

Ordered by: _____


Executive Officer

Date: _____

4-4-98

ATTACHMENT A

TABLE MRP-1
SCHEDULE FOR SAMPLING, MEASUREMENTS, AND ANALYSIS
South County Regional Wastewater Authority Water Recycling Program
Water Recycling Requirements

SAMPLING STATIONS	E-1	All L	All P
Flow Rate (gallons/day)	Continuous	Q ¹	Q ¹
Total Coliform (MPN/100ml)	D ²		
Turbidity (NTU)	Cont. ²		
Dissolved Oxygen (mg/l)	3/W ²		
Dissolved Sulfides (mg/l (if DO < 1 mg/l)	3/W ²		
pH (Units)	3/W ²		
Chlorine Residual (mg/l)			
Applicable Standard Observations		A ³	A ³

- 1 Flow totals for each User will be compiled by the Producer on a quarterly basis. Daily average flow will be calculated from these quarterly totals and reported for each User in the Producer's annual report.
- 2 When producing recycled water.
- 3 Observations that the Producer requires each User to complete when recycled water is being used. The Producer will establish User self-monitoring requirements that depend on the size and complexity of each site, as a condition of each User's permit.

LEGEND FOR TABLE 1**Type of Sample**

Grab = Instantaneous grab sample

C-24 = 24-hour composite sample

Cont. = Continuous monitoring (recorder)

Obs. = Observation

Sampling Frequency

D = Daily

3/W = Three times per week

W = Weekly

2/M = Twice per month

Q = Quarterly

A = Annual