

California Regional Water Quality Control Board
North Coast Region

Monitoring, Reporting, and Notification Program No. 98-125

For

Odd Fellows Recreation Club
Odd Fellows Park
Lower Russian River
(Guerneville)

Sonoma County

MONITORING

1. Waste Quantity

The discharger shall measure and record the total daily water use in the park daily.

The discharger shall record the weekly year-round flows for the residential and campground system (001 and 002).

The discharger shall record the monthly year-round flows for the rental cabins and community building systems..

The discharger shall record the monthly leachfield observations for the restaurant/store.

2. Disposal Field Inspections

The discharger shall inspect each disposal field and seeps along the banks of the river on a monthly basis and record any odors, evidence of surfacing effluent, or other signs of malfunction.

3. Groundwater Monitoring

- a. The discharger shall monitor depth to groundwater in the leachfield monitoring wells using the following schedule.

System	Frequency	Season
Residential System (summer)	monthly	May through November
(winter)	monthly	November through May
Rental Cabin System	monthly	May through November
Community Building systems	monthly	year round

- b. The discharger shall monitor the following groundwater monitoring wells for nitrate¹, and total and fecal coliform, using the following schedule:

<u>Monitoring Wells</u>	<u>Frequency</u>	<u>Season</u>
MW-1E	monthly	year round
MW-1W	quarterly	year round
MW-2 (MW-2E)	monthly	year round
MW-2W	quarterly	May through November
MW-3E	quarterly	year round
MW-3W	quarterly	May through November
MW-4 (MW-4W)	quarterly	May through November
MW-4E	quarterly	year round
MW-5E	quarterly	year round

- c. The discharger shall perform well head monitoring on domestic water wells #1 and #2 for the following parameters using the following schedule:

<u>Parameters</u>	<u>Type of Sample</u>	<u>Frequency</u>	<u>Season</u>
Nitrate Nitrogen	grab	monthly	year round
Total and Fecal Coliform	grab	monthly	year round

4. Surface Water Monitoring

In the event of a discharge of waste to the Russian River or its tributaries, the discharger shall perform three point sampling for total ammonia, total and fecal coliform, chloride, biochemical oxygen demand, and specific conductivity. Grab samples shall be collected at the point of discharge, 50 feet upstream from the point of discharge, and 50 feet downstream from the point of discharge.

5. Record of Pumping

During periods when pumping of the septic tank(s) is required the discharger shall record the following:

- Name of septic tank hauler;
- Date of pumping; and
- Volume of waste pumped.

¹ Nitrate samples shall be collected for three quarters. Nitrates samples shall not be collected during the winter months.

REPORTING

Monitoring reports shall be submitted to the Regional Water Board quarterly, within a month of the preceding month. In reporting monitoring data, the discharger shall arrange the data in tabular form on an 8 1/2 by 11 inch sheet so the date, constituents, and concentration are readily discernible. If the discharger is unable to collect samples for any reason, the monitoring report shall so indicate. An Annual Report shall be submitted by January 31st each year describing maintenance activities as required by the operational plan described in Provision 6. The monitoring data and any necessary narrative reports shall be properly titled and referenced to this Order and shall be submitted to the Regional Water Board and certified to be true and correct by penalty of perjury.

NOTIFICATION

The discharger shall submit in writing to the Regional Water Board 14 days after any discharge of sewage to the Russian River or its tributaries. The report shall include all items specified above and the dates on which monitoring was performed. In the event the of a discharge to the Russian River, the discharger must notify the Executive Officer by telephone as soon as he or his agents have knowledge of the incident and confirm this notification in writing within two weeks of the telephone notification. The written notification shall include pertinent information explaining reasons for the noncompliance and shall indicate the steps taken to correct the problem and the dates thereof, and the steps being taken to prevent the problem from recurring.

Ordered by: _____


Lee A. Michlin
Executive Officer

December 10, 1998

Site Location Map

Odd Fellows Recreation Club
Odd Fellows Park
Guerneville


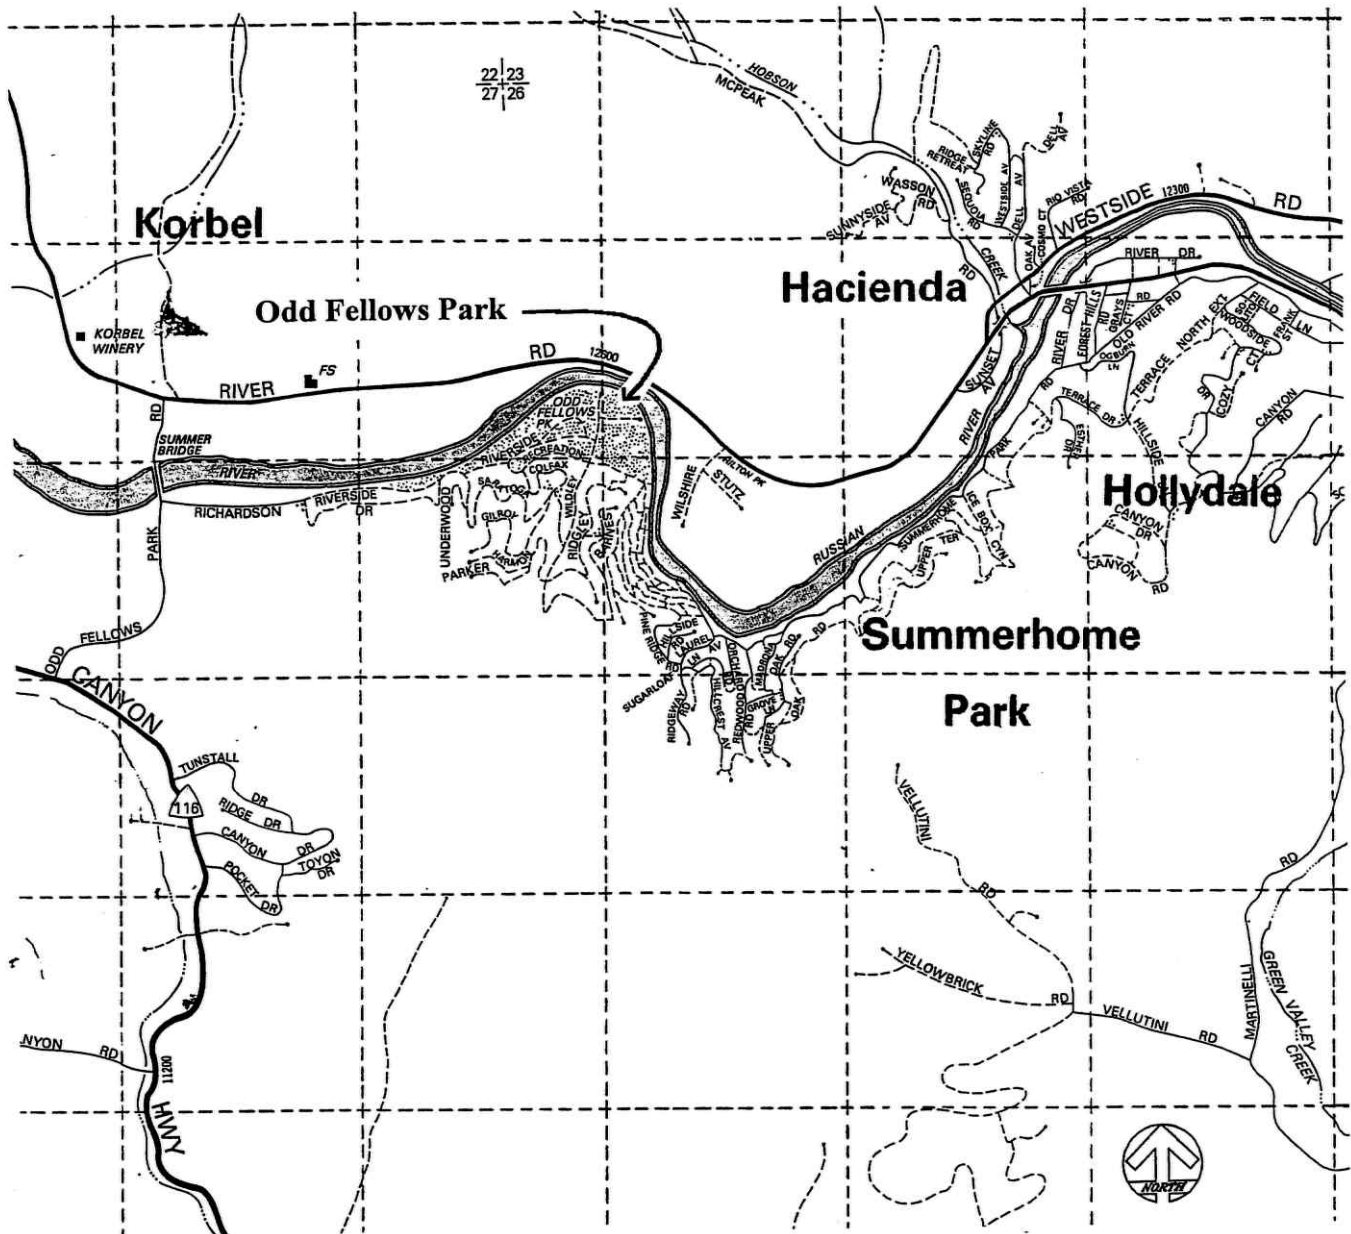


Figure 1

Site Plan

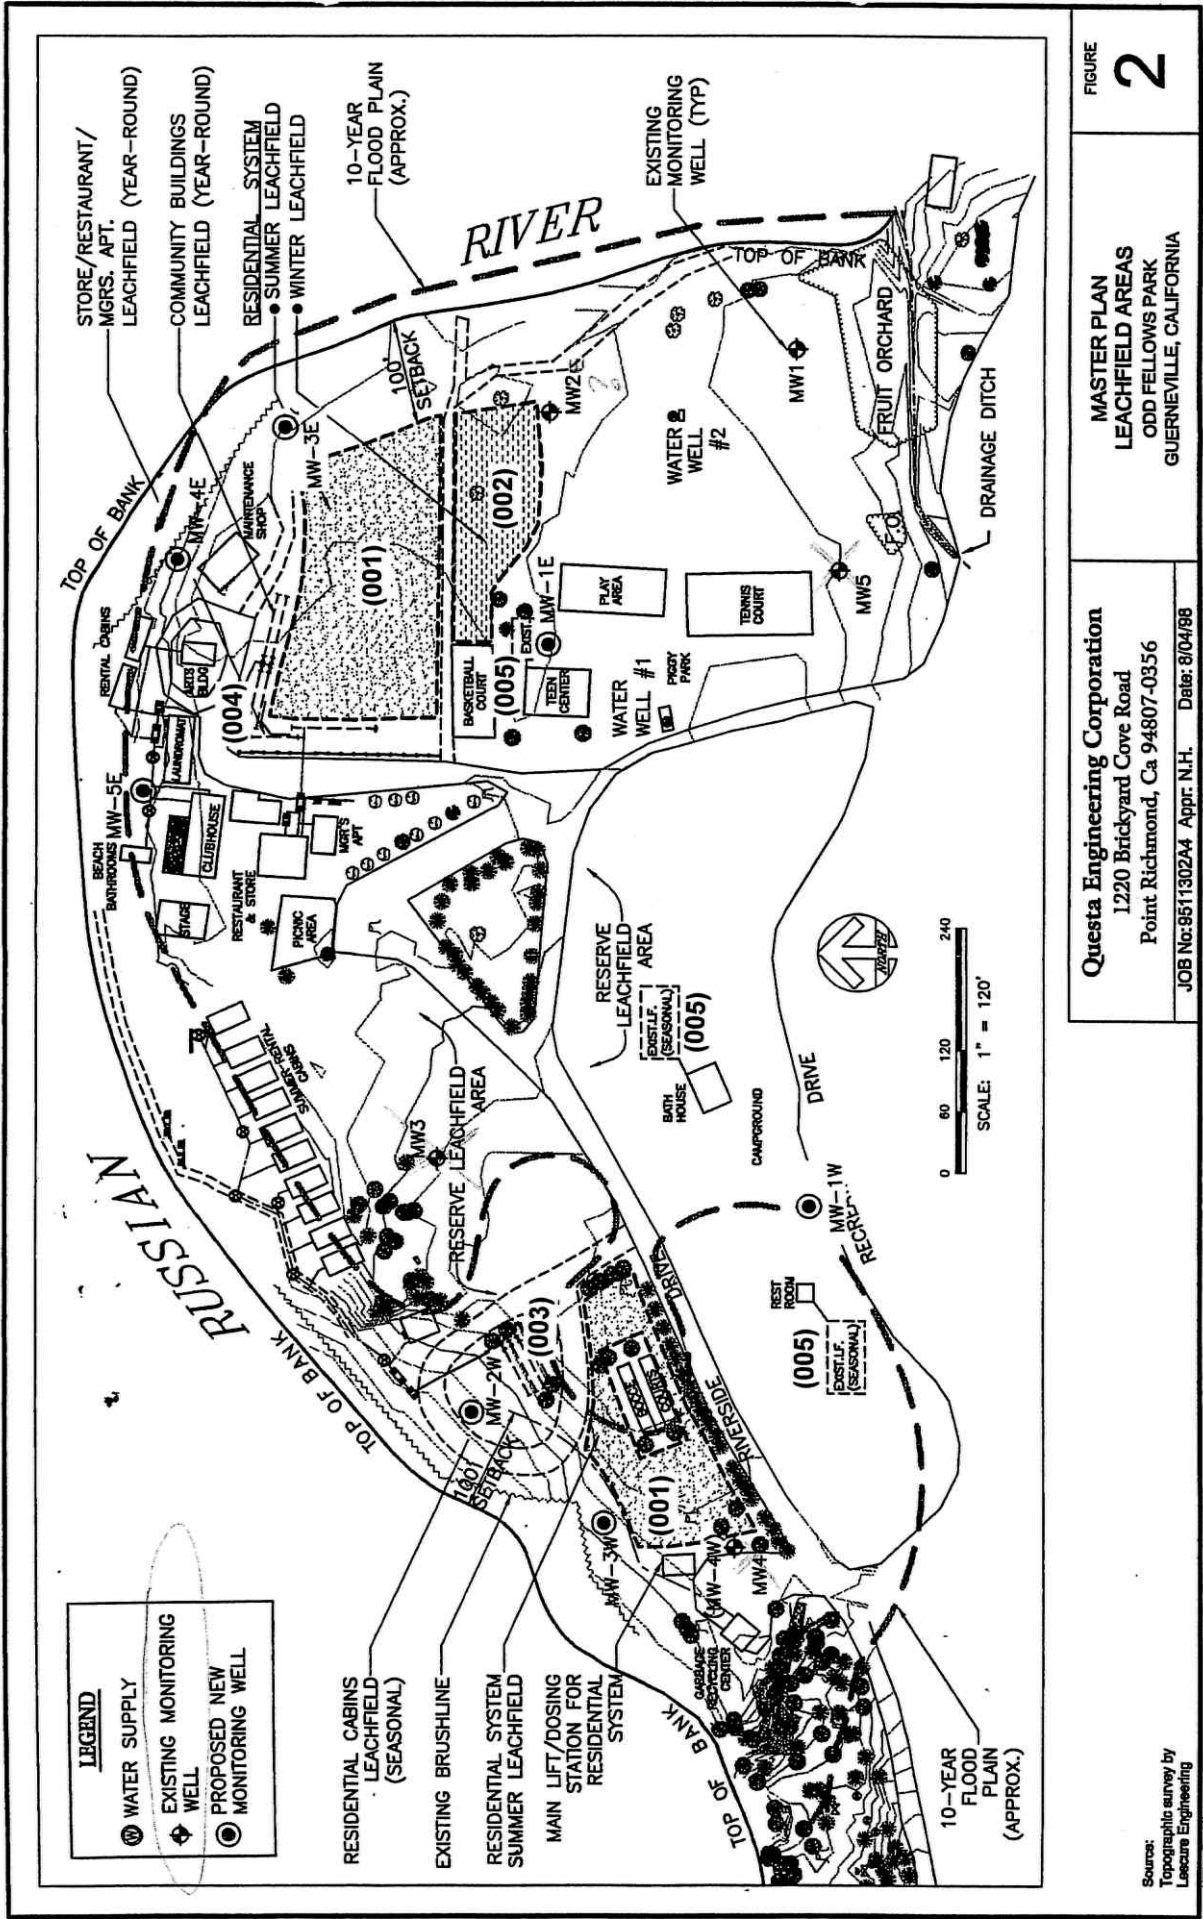

Leachfield Areas and Monitoring Well Locations