

02

California Regional Water Quality Control Board
North Coast Region

ORDER NO. 92-57
ID NO. 1B80173MAR

WASTE DISCHARGE REQUIREMENTS

FOR

NORTH MARIN WATER DISTRICT
OCEANA MARIN

Marin County

The California Regional Water Quality Control Board, North Coast Region (hereinafter the Board), finds that:

1. The North Marin Water District (hereinafter referred to as the discharger) submitted a report of waste discharge on March 21, 1991. The report of waste discharge was considered complete after the discharger submitted additional information on November 20, 1991.
2. The discharger owns and operates the wastewater treatment and disposal facilities for the Oceana Marin Subdivision in the SE 1/4 of Section 21, T5N, R10W, MDB&M near the community of Dillon Beach in Marin County as shown on Figure 1. The effluent disposal facilities lie within the watershed of the Estero de San Antonio.
3. The treatment and disposal facilities at Oceana Marin consist of an aerated pond followed by a storage pond. Solids are retained and reduced in the aerated pond. This facility has no sludge handling facility. Disinfected secondary effluent is disposed using a shallow trench, pressure distribution system. The majority of the wastewater is discharged to the disposal system during the dry summer months. Additional disposal may occur during dry periods in the winter. The projected maximum rate of effluent disposal to the pressure distribution system is 53,000 gallons per day.
4. The Board adopted Water Quality Control Plans for the Klamath River Basin (1A) and the North Coastal Basin (1B) on March 20, 1975. The Klamath River Basin Plan (1A) was combined with the North Coastal Basin Plan (1B) to form the Water Quality Control Plan for the North Coast Region. The Plan for the North Coast Region was adopted by the Board on April 28, 1988 and approved by the State Water Resources Control Board on November 15, 1988. The Plan includes water quality objectives and receiving water limitations.
5. The beneficial uses of the Estero de San Antonio and its tributaries include:
 - a. municipal and domestic supply

- b. agricultural supply
 - c. water contact recreation
 - d. noncontact water recreation
 - e. ocean commercial and sport fishing
 - f. wildlife habitat
 - g. marine habitat
 - h. fish spawning
 - i. shellfish harvesting
6. The beneficial uses of areal groundwaters include:
 - a. domestic water supply
 - b. agricultural water supply
7. The discharge is presently governed by Waste Discharge Requirements, Order No. 86-49, adopted by the Board on April 10, 1986.
8. This project consists of the operation or minor alteration of an existing facility which involves minimum change in use beyond that previously existing. Furthermore, a negative declaration for construction and operation of the disposal facilities was prepared and approved by the North Marin Water District on September 18, 1990. The Board has determined that compliance with this Order will mitigate any potential adverse water quality impact.
9. The Board has notified the discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations.
10. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

THEREFORE, IT IS HEREBY ORDERED that Waste Discharge Requirements, Order No. 86-49 are rescinded and the discharger, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. DISCHARGE PROHIBITIONS

1. The discharge of waste to land that is not under the control of the discharger is prohibited.
2. The discharge of any waste not specifically regulated by this Order is prohibited.
3. Creation of a pollution, contamination, or nuisance, as defined by Section 13050 of the California Water Code (CWC), is prohibited.
[Health and Safety Code, Section 5411]

4. The discharge of untreated waste from anywhere within the collection, treatment, or disposal facility is prohibited.
5. The discharge of waste from the Oceana Marin Wastewater Treatment and Disposal Facilities to the Estero de San Antonio or its tributaries is prohibited.
6. The discharge of waste to the surface of the ground is prohibited.

B. DISCHARGE SPECIFICATIONS

1. The maximum daily discharge to the disposal system shall not exceed 53,000 gallons per day.
2. Wastes discharged to the disposal system shall not contain constituents in excess of the following limits:

<u>Constituent</u>	<u>Units</u>	<u>Mean</u>	<u>Maximum</u>
BOD (20°C, 5-day)	mg/l	50*	80
Nonfilterable Residue	mg/l	50*	80
Coliform Organisms	MPN/100 ml	--	230

3. The discharge shall not impart taste, odor, or color to areal groundwater.

* The arithmetic mean of the values for effluent samples collected in a period of 30 consecutive days.

C. PROVISIONS

1. A copy of this Order shall be maintained at the discharge facility and be available at all times to operating personnel.

2. Severability

Provisions of these waste discharge requirements are severable. If any provision of these requirements is found invalid, the remainder of these requirements shall not be affected.

3. Operation and Maintenance

The discharger must maintain in good working order and operate as efficiently as possible any facility or control system installed by the discharger to achieve compliance with these waste discharge requirements.

4. Change in Discharge

The discharger must promptly report to the Board any material change in the character, location, or volume of the discharge.

5. Change in Ownership

In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the discharger, the discharger must notify the succeeding owner or operator of the existence of this Order by letter, a copy of which must be forwarded to the Board.

6. Vested Rights

This Order does not convey any property rights of any sort or any exclusive privileges. The requirements prescribed herein do not authorize the commission of any act causing injury to persons or property, nor protect the discharger from his liability under federal, State, or local laws, nor create a vested right for the discharger to continue the waste discharge.

7. Monitoring

The discharger must comply with the Contingency Planning and Notification Requirements Order No. 74-151 and the Monitoring and Reporting Program No. 92-57 and any modifications to these documents as specified by the Executive Officer. Such documents are attached to this Order and incorporated herein. Chemical, bacteriological, and bioassay analyses must be conducted at a laboratory certified for such analyses by the State Department of Health Services. In the event a certified laboratory is not available to the discharger, analyses performed by a noncertified laboratory will be accepted provided:

- a. A quality assurance/quality control program is instituted by the laboratory. A manual containing the steps followed in this program must be kept in the laboratory and available for inspection by staff of the Board. The quality assurance/quality control program must conform to EPA guidelines or procedures approved by the Board.
- b. The laboratory will become certified within the shortest practicable time if the State Certification Program is resumed.

8. Inspections

The discharger shall permit authorized staff of the Board:

- a. entry upon premises in which an effluent source is located or in which any required records are kept;
- b. access to copy any records required to be kept under terms and conditions of this Order;
- c. inspection of monitoring equipment or records; and
- d. sampling of any discharge.

9. Noncompliance

In the event the discharger is unable to comply with any of the conditions of this Order due to:

- a. breakdown of waste treatment equipment;
- b. accidents caused by human error or negligence; or
- c. other causes such as acts of nature;

the discharger must notify the Executive Officer by telephone as soon as he or his agents have knowledge of the incident and confirm this notification in writing within two weeks of the telephone notification. The written notification shall include pertinent information explaining reasons for the noncompliance and shall indicate what steps are being taken to prevent the problem from recurring.

10. Revision of Requirements

The Board requires the discharger to file a report of waste discharge at least 120 days before making any material change or proposed change in the character, location, or volume of the discharge.

11. Operator Certification

Supervisors and operators of municipal wastewater treatment plants shall possess a certificate of appropriate grade in accordance with Title 23, California Code of Regulations, Section 3680. The State Board may accept experience in lieu of qualification training. In lieu of a properly certified wastewater treatment plant operator, the State Board may approve use of a water treatment plant operator of appropriate grade certified by the State Department of Health Services where reclamation is involved.

12. Adequate Capacity

Whenever a publicly owned wastewater treatment plant will reach capacity within four years, the discharger shall notify the Board. A copy of such notification shall be sent to appropriate local elected officials, local permitting agencies, and the press. The

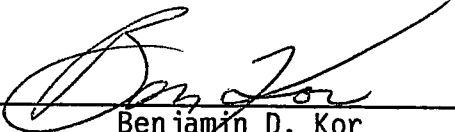
discharger must demonstrate that adequate steps are being taken to address the capacity problem. The discharger shall submit a technical report to the Board showing how flow volumes will be prevented from exceeding capacity, or how capacity will be increased, within 120 days after providing notification to the Board, or within 120 days after receipt of Board notification, that the POTW will reach capacity within four years. The time for filing the required technical report may be extended by the Board. An extension of 30 days may be granted by the Executive Officer, and longer extensions may be granted by the Board itself. (CCR Title 23, Section 2232)

13. The discharger shall comply with the following time schedule to assure compliance with the terms and conditions of this Order:

<u>Task</u>	<u>Date</u>
a. Implement a study program to develop a long-term wastewater treatment and disposal plan for the Oceana Marin Subdivision.	August 1, 1992
b. Select and complete a long-term master plan for wastewater treatment and disposal. This plan shall include a time schedule for implementation of the long-term master plan.	May 1, 1994

Certification

I, Benjamin D. Kor, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, North Coast Region, on June 25, 1992.


Benjamin D. Kor
Executive Officer

(wdromarin)

California Regional Water Quality Control Board
North Coast Region

MONITORING AND REPORTING PROGRAM NO. 92-57

FOR

NORTH MARIN WATER DISTRICT
OCEANA MARIN SUBDIVISION

Marin County

INFLUENT MONITORING

<u>Constituent</u>	<u>Units</u>	<u>Sampling Frequency</u>
Average Daily Flow	Gallons per Day	Continuously

DISPOSAL FIELD MONITORING

During periods when wastes are discharged from the Oceana Marin Treatment System to the effluent disposal field, water level measurements shall be taken weekly in monitoring wells located in the disposal field. The monitoring well locations shall be approved by the Executive Officer.

EFFLUENT MONITORING

During periods when wastes are discharged from the Oceana Marin Treatment System to the effluent disposal field, the following monitoring shall be conducted:

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
BOD (20°C, 5-Day) ¹	mg/l	Grab	Monthly
Nonfilterable Residue	mg/l	Grab	Monthly
Coliform Organisms	MPN/100ml	Grab	Monthly
Chlorine Residual	mg/l	Grab	Weekly
Average Daily Flow	gpd	--	Continuously

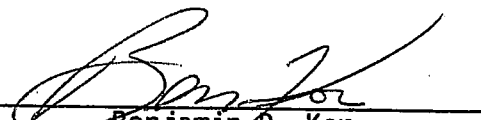
REPORTING

Monitoring reports shall be submitted monthly by the 15th day of the following month. In reporting the monitoring data, the discharger shall arrange the data in tabular form to clearly illustrate compliance with the waste discharge requirements. In any month that no waste is discharged to the effluent disposal field, the monthly monitoring report shall specify no discharge.

¹ COD monitoring may be substituted for BOD monitoring if the discharger can demonstrate a correlation between these parameters. This change must be approved, in writing, by the Executive Officer.

In addition to the above, the discharger shall have all flow measuring devices tested annually and their accuracy certified. This certification shall be submitted annually with the monitoring report for the month of October.

Ordered by


Benjamin D. Kor
Executive Officer

June 25, 1992

(omarin.m&r)

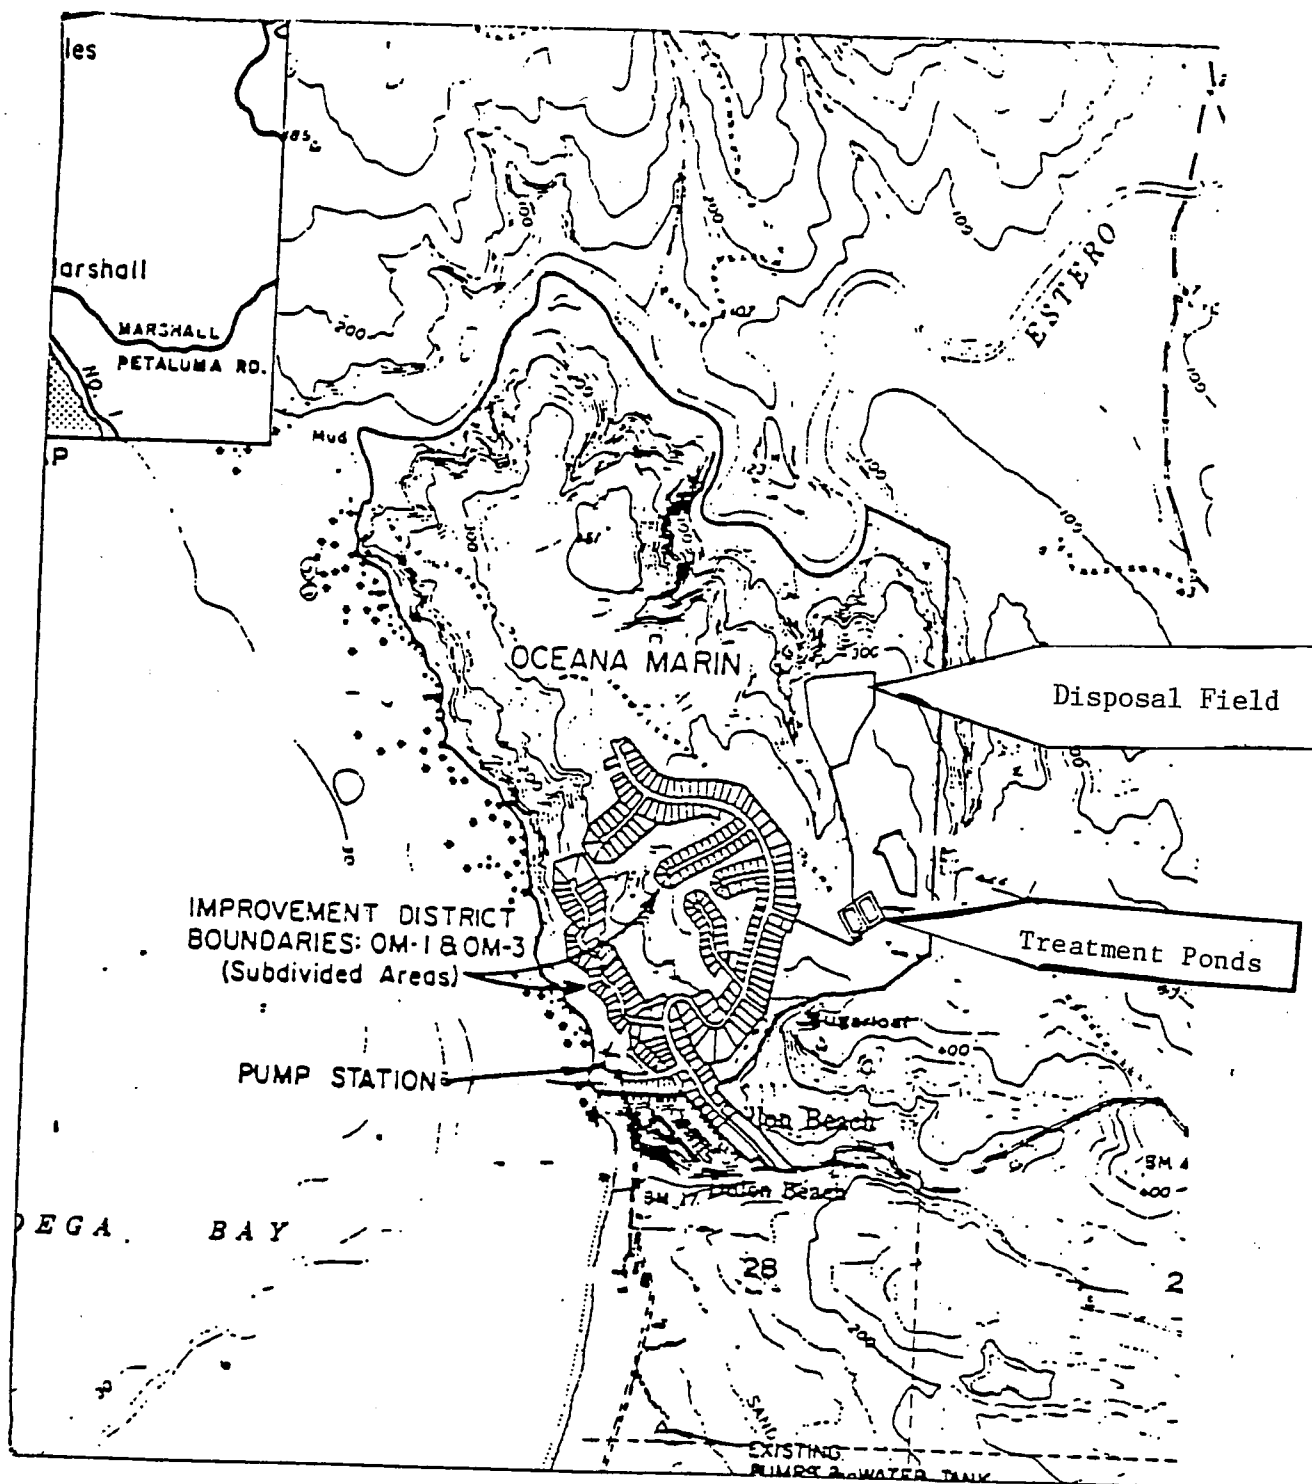


FIGURE 1
Location of Oceana Marin Wastewater Treatment and
Disposal Facilities

California Regional Water Quality Control Board
North Coast Region

CONTINGENCY PLANNING AND NOTIFICATION REQUIREMENTS

FOR

ACCIDENTAL SPILLS AND DISCHARGES

ORDER NO. 74-151

The California Regional Water Quality Control Board, North Coast Region, finds that:

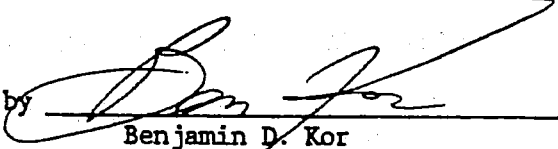
1. Section 13225 of the Porter-Cologne Water Quality Act requires the Regional Board to perform general duties to assure positive water quality control.
2. The Regional Board has been advised of situations in which preparations for, and response to accidental discharges and spills have been inadequate.
3. Persons discharging waste or conveying, supplying, storing, or managing wastes or hazardous materials have the primary responsibility for contingency planning, incident reporting and continuous and diligent action to abate the effects of such unintentional or accidental discharge.

THEREFORE, IT IS HEREBY ORDERED THAT:

- I. All persons who discharge wastes or convey, supply, store, or otherwise manage wastes or other hazardous material shall:
 - A. Prepare and submit to this Regional Board, according to a time schedule prescribed by the Executive Officer, a contingency plan defining the following:
 1. Potential locations and/or circumstances under which accidental discharge incidents might be expected to occur,
 2. Possible water quality effects of accidental discharges,
 3. The conceptual plan for cleanup and abatement of accidental discharge incidents, including:
 - a. The individual who will be in charge of cleanup and abatement activities on behalf of the discharger,
 - b. The equipment and manpower available to the discharger to implement the cleanup and abatement plans,
 - B. Immediately report to the Regional Board any accidental discharge incidents. Such notification shall be made by telephone as soon as the responsible person or his agent has knowledge of the incident.
 - C. Immediately begin diligent and continuous action to cleanup and abate the effects of any unintentional or accidental discharge. Such action shall include temporary measures to abate the discharge prior to completing permanent repairs to damaged facilities.

- D. Confirm the telephone notification in writing within two weeks of the telephone notification. The written notification shall include: reasons for the discharge, duration and volume of the discharge, steps taken to correct the problem and steps being taken to prevent the problem from recurring.
- II. Upon original receipt of phone report (I.B.), the Executive Officer shall immediately notify all affected agencies and known users of waters affected by the unintentional or accidental discharge.
- III. Provide updated information to the Regional Board in the event of change of staff, size of the facility, or change of operating procedures which will affect the previously established contingency plan.
- IV. The Executive Officer or his employees shall maintain liaison with the discharger and other affected agencies and persons to provide assistance in cleanup and abatement activities.
- V. The Executive Officer shall transmit copies of this Order to all persons whose discharges of waste handling activities are governed by Waste Discharge Requirements or an NDPES permit. Such transmittal shall include a current listing of telephone numbers of the Executive Officer and his key employees to facilitate compliance with Item I.B of this Order.

Ordered by


Benjamin D. Kor
Executive Officer

July 24, 1974

(Retyped February 15, 1990)

Your primary notification should be to the Regional Board office in Santa Rosa at (707) 576-2220. During off hours, you will be able to leave a recorded message at that number and, if you have a spill or discharge emergency, you will also be referred to the State Office of Emergency Services (OES) at (800) 852-7550. OES maintains a roster of key employees and will relay your notification to Regional Board staff.

California Regional Water Quality Control Board
North Coast Region

GENERAL MONITORING AND REPORTING PROVISIONS

February 3, 1971
(Retyped June 13, 1989)

GENERAL PROVISIONS FOR SAMPLING AND ANALYSIS

Unless otherwise noted, all sampling, sample preservation, and analyses shall be conducted in accordance with the current edition of "Standard Methods for the Examination of Water and Waste Water" or approved by the Executive Officer.

All analyses shall be performed in a laboratory certified to perform such analyses by the California State Department of Health or a laboratory approved by the Executive Officer.

All samples shall be representative of the waste discharge under the conditions of peak load.

GENERAL PROVISIONS FOR REPORTING

For every item where the requirements are not met, the discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge in full compliance with requirements at the earliest time and submit a timetable for correction.

By January 30 of each year, the discharger shall submit an annual report to the Regional Board. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The discharger shall file a written report within 90 days after the average dry weather flow for any month that equals or exceeds 75 percent of the design capacity of the waste treatment or disposal facilities. The report shall contain a schedule for studies, design, and other steps needed to provide additional capacity or limit the flow below the design capacity prior to the time when the waste flow rate equals the capacity of the present units.