

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION
81 Higuera Street
San Luis Obispo, California 93401**

MASTER WATER RECYCLING REQUIREMENTS (PRODUCER) ORDER NO. 01-066
Waste Discharger Identification No. 3 449902003

For

**CITY OF SCOTTS VALLEY WASTEWATER TREATMENT PLANT
Santa Cruz County**

The California Regional Water Quality Control Board, Central Coast Region, (hereafter the Regional Board) finds that:

SITE OWNER AND LOCATION

1. The City of Scotts Valley owns and operates a wastewater collection, treatment, disposal, and water recycling facility (hereafter referred to as the "Facility").
2. The Facility is located in the City of Scotts Valley at 700 Lundy Lane (See Attachments A and B).

PURPOSE OF ORDER

3. The primary objectives of this order are to: 1) Permit the reuse of tertiary treated domestic wastewater; 2) develop discharge limits; and 3) develop a monitoring program to evaluate the impact to water quality.

[Note: Other prohibitions and conditions, definitions, and the method of determining compliance are contained in the attached "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated January 1984. Applicable paragraphs are referenced in Provisions, Item C.11 of this Order.

Throughout the Order superscripts (^{BP}) are provided to indicate requirements taken from the Water Quality Control Plan, Central Coastal Basin, (Basin Plan).

Requirements not referenced are based on Regional Board staff's best professional judgment and recommendations from State and County Environmental Health agencies for protection of public health and the environment.]

SITE/FACILITY DESCRIPTION

Discharge Type

4. The Facility serves the commercial, industrial, and domestic sanitary wastewater needs of the City of Scotts Valley (hereafter the "City") and its vicinity. Commercial and Industrial users account for approximately 20% (15% commercial, 5% industrial) of the wastewater treatment plant flow. (The wastewater treatment facility, including wastewater pretreatment, collection, treatment, and disposal, is regulated under a separate Order No. 97-12 issued by the Regional Board and is not the subject of this Order.)

Design and Current Capacity

5. In September 1999, the City completed an upgrade that enables the Facility to produce up to 1.0 million gallons per day (MGD) of recycled water. The upgraded treatment unit includes coagulation/flocculation, filtration, denitrification, and disinfection.
6. The treatment unit receives secondary effluent and treats it to tertiary recycled water standards

in conformance with water recycling criteria contained in the California Code of Regulations, Title 22. The filtered wastewater is coagulated, as required under Section 60301.320(a) of the 2000 Water Recycling Criteria. Disinfection is achieved with a vertical low-pressure ultraviolet (UV) radiation system.

7. After tertiary treatment, the recycled water is stored in the on-site recycled water storage wet well. Tertiary treated effluent is delivered to the Scotts Valley Water District through an existing 8-inch effluent pipe to the distribution system.
8. The Facility will augment the water resource needs of the Scotts Valley Water District (hereafter referred to as the "Distributor") by supplying recycled water for distribution by the Distributor. Distribution by the Distributor is regulated under a separate Order No. 01-067 issued by the Regional Board and is not the subject of this Order.

MONITORING AND REPORTING PROGRAM (MRP)

9. The MRP requires influent monitoring, effluent monitoring, and system performance monitoring. No ground or surface water monitoring is proposed.

BASIN PLAN

10. The Water Quality Control Plan, Central Coastal Basin (Basin Plan), was adopted by the Regional Board on November 17, 1989, and approved by the State Water Resources Control Board on August 16, 1990. The Regional Board approved amendments of the Plan on February 11, 1994 and September 8, 1994. The Basin Plan incorporates statewide plans and policies by reference and contains a strategy for protecting beneficial uses of State waters.^{BP}
11. Present and anticipated beneficial uses of Zayante Creek that could be affected by the discharge include:^{BP}
 - a. Municipal and Domestic Supply;
 - b. Agricultural Supply;
 - c. Ground Water Recharge;

- d. Industrial Service Supply;
- e. Water Contact Recreation;
- f. Non-Contact Water Recreation;
- g. Wildlife Habitat;
- h. Cold Freshwater Habitat;
- i. Migration of Aquatic Organisms;
- j. Spawning, Reproduction, and/or Early Development;
- k. Preservation of Biological Habitats of Special Significance;
- l. Rare, Threatened, or Endangered Species;
- m. Freshwater Replenishment; and
- n. Commercial and Sport Fishing.

12. Present and anticipated uses of groundwater in the vicinity of the discharge include:^{BP}

- a. Domestic supply;
- b. Agricultural supply;
- c. Industrial process supply; and
- d. Industrial service supply.

13. The San Lorenzo Wastewater Management Plan (WWMP), adopted by Santa Cruz County Board of Supervisors, was approved by the Regional Board on April 5, 1995 as Resolution No. 95-04. The WWMP includes findings and recommendations resulting from investigation of elevated nitrate levels in surface water and groundwater in the San Lorenzo River watershed. The WWMP recommends the Regional Board require nitrogen control measures in the issuance of new or revised waste discharge requirements. The WWMP's goal is for at least 50 % reduction in nitrogen from onsite disposal systems.^{BP}

14. This order requires 50 % reduction of nitrates in effluent, consistent with Resolution No. 95-04.^{BP}

15. The surface water quality objectives specified in the Basin Plan for the Zayante Creek are:^{BP}

Analyte	Value	Units
Total Dissolved Solids	500	mg/l
Sodium	40	mg/l
Chloride	50	mg/l
Boron	0.2	mg/l
Sulfate	100	mg/l

16. The range of median ground water quality objectives in the San Lorenzo Sub-Basin, as specified in the Basin Plan, are reported as follows: ^{BP}

Analyte	Range	Units
Total Dissolved Solids	100-250	mg/l
Sodium	10-20	mg/l
Chloride	20-30	mg/l
Nitrate (as N)	1-5	mg/l
Sulfate	10-50	mg/l

CEQA SUMMARY

17. These waste discharge requirements are for an existing facility and are exempt from the provisions of the California Environmental Quality Act (Public Resources Code, Section 21000, et seq.) in accordance with Section 15301, Chapter 3, Title 14, of the California Code of Regulations

EXISTING ORDERS AND GENERAL FINDINGS

18. Scott Hamby, Wastewater and Environmental Program Manager of the Scotts Valley Wastewater Treatment Plant (hereafter Producer) submitted a complete Report of Waste Discharge on February 18, 1999, in accordance with Section 13522.5 of the California Water Code (CWC). The report was filed for authorization to provide up to 1.0 MGD of disinfected tertiary recycled water for distribution by the Scotts Valley Water District (hereafter Distributor). The report constitutes consent by the Producer for the adoption of master water recycling requirements. The master water recycling requirements will become active upon the Producer's initial supplying of recycled water to the Distributor.
19. CWC Section 13512 states that it is the intention of the legislature that the State undertake all possible steps to encourage development of water recycling facilities so that recycled water may be made available to help meet the growing water demands of the State.
20. CWC Section 13523 provides that a regional board, after consulting with and receiving the recommendations of the State Department of Health Services, and if it determines such action to be necessary to protect the public health, safety, or welfare, shall prescribe water recycling requirements for water which is used or proposed to be used as recycled water. The use of recycled water could affect public health, safety, or welfare, and water recycling requirements for those uses are, therefore, necessary in accordance with the CWC.
21. In CWC Section 13550, the Legislature defines the use of potable domestic water for non-potable uses, including but not limited to cemeteries, golf courses, parks, highway landscaped areas, irrigation, and industrial uses as a waste or an unreasonable use of such water within the meaning of Section 2 of Article X of the California Constitution when suitable recycled water is available.
22. On July 14, 1992, the Governor approved Assembly Bill No. 3012 (AB 3012), which added Section 13523.1 to the CWC, and authorizes regional boards to issue master water recycling permits to a supplier and/or distributor of recycled water in lieu of prescribing water recycling requirements for a user of recycled water. AB 3012 also removes the requirement, except upon written request of a regional board, that the users file a report with a regional board to use recycled water from a supplier/distributor for whom a master water recycling permit has been issued. Similarly, AB 3012 exempts any such user of recycled water from the requirement to file a report with a regional board related to any material change in the character of the recycled water or its use. This Order is intended to be a master water recycling permit that is consistent with California Water Code (CWC) Section 13523.1.
23. CWC Section 13576(e) states that the use of recycled water has proven to be safe from a public health standpoint and that the State Department of Health Services (DHS) is updating regulations for the use of recycled water.
24. This Order's requirements conform with and implement the water recycling criteria of the

DHS (Title 22, Division 4, Chapter 3, Sections 60301-60355 of the California Code of Regulations [CCR]) to protect public health, safety, and welfare.

25. DHS's criteria for use of recycled water are contained in Title 22, Chapter 3, of the CCR. The Regional Board has consulted with the DHS regarding the regulation of this discharge.
26. Federal regulations require effluent limitations for all pollutants that are, or may be, discharged at a level that will cause or have reasonable potential to cause, or contribute to in-stream excursions above narrative or numerical water quality standards. Based on information submitted as part of the application, in studies, and as directed by monitoring and reporting programs, the Regional Board finds that the discharge does not have a reasonable potential to cause or contribute to an in-stream excursion above a water quality objective.
27. The authorized discharge of waste to waters of the State is a privilege, not a right. A permit and the privilege to discharge waste into waters of the State is conditional upon the discharge complying with provisions of Division 7 of the CWC, and of the Clean Water Act (as amended or as supplemented by implementing guidelines and regulations), and with any more stringent effluent limitations necessary to implement water quality control plans, protect beneficial uses, and prevent nuisance. Compliance with this Order should assure conditions are met and mitigate any potential changes in water quality due to the project.
28. On April 13, 2001, the Regional Board notified the Producer and interested persons of its intent to prescribe waste discharge requirements and water recycling requirements for the proposed discharges, and provided them with an opportunity for a public hearing and to submit their written views and recommendations.
29. The Regional Board, at a public meeting held July 13, 2001, heard and considered all comments pertaining to the discharge and found this Order consistent with the above findings.

IT IS HEREBY ORDERED, pursuant to authority in CWC Section 13377, that Scotts Valley Wastewater Treatment Plant, its agents, successors, and assigns, may discharge waste from its wastewater treatment plant providing it complies with the following:

A. PROHIBITIONS

1. The treatment, storage, distribution, or reuse of recycled water shall not create a nuisance as defined in CWC Section 13050(m).
2. Recycled water shall be confined to areas of authorized use without discharge to surface waters or drainage ways.
3. No recycled water shall be discharged from the treatment facilities, other than for irrigation reuse in accordance with this Order, Waste Discharge Requirements for the Producer, or for discharge to a municipal sewage collection system.
4. Personnel involved in producing, transporting, or using recycled water shall be informed of possible health hazards that may result from contact and use of recycled water.
5. Delivery of recycled water shall cease during any period that the water recycling specifications contained in or referred to by Order No. 01-066 cannot be met.
6. All recycled water reservoirs and other areas with public access, within the confines of the Scotts Valley Wastewater Treatment Facility, shall be posted (in English and Spanish) to warn the public that recycled wastewater is being stored or used.
7. Recycled water systems shall be properly labeled and regularly inspected to assure proper operation, absence of leaks, and absence of illegal connections within the Scotts Valley Wastewater Treatment Facility.
8. Recycled water shall not be impounded within 100 feet of any well used for domestic purposes.

9. There shall be no bypassing of untreated or partially treated wastewater from the recycled water plant or any intermediate unit processes to the on-site recycled water storage wet well.
10. Recycled water shall not be used for irrigation within 50 feet of any well used for domestic water supply, unless the user demonstrates to the Distributor that use area requirements of California Code of Regulations, Section 60310(a) are met.

B. RECYCLED WATER LIMITATIONS

1. The Producer shall ensure that treated effluent used for disinfected tertiary recycled water shall be an adequately oxidized, filtered, and disinfected water, as defined in California Code of Regulations (CCR) Title 22, Division 4, Chapter 3, Sections 60301-60335, or alternatively defined and approved by State Department of Health Services (DHS).
2. The Producer shall ensure the treated wastewater meets the following filtration requirements (based on the actual filtration process installed at the facility, and in accordance with recommendations by the DHS): Coagulation and flocculation processes shall be used at all times. Filtration of the treated wastewater shall be accomplished by using the TETRA Denite® System. The filter loading rate shall not exceed 2.6 gallons per minute per square foot (except during backwash events) and shall not exceed 5.0 gallons per minute per square foot at any time. During filter bumping, filtered water shall be diverted into the spent backwash water line.
3. The Producer shall ensure treated wastewater meets the following disinfection requirements (based on the actual UV disinfection process installed at the facility, and in accordance with recommendations by the DHS): Disinfection of tertiary treated wastewater shall be accomplished by using the Aquaray® 40 VLS System. A minimum of two UV modules shall be operated simultaneously. The delivered UV dose for disinfection shall not be less than 100 milliJoules per square centimeter. The operational UV dose equivalent to a delivered

dose of 100 milliJoules per square centimeter shall be in accordance with the Operation Plan (comprised of the Engineering Report and the Operation and Maintenance Manual), as approved by DHS. Filtered water transmittance shall not be less than 55 percent. Water level in the disinfection channel shall not exceed 60 inches.

4. The Producer shall discontinue delivery of recycled water to Distributor during any period which it has reason to believe that the limits established in Section B of this Order are not being met. The delivery of recycled water shall not be resumed until all conditions that caused the limits to be violated have been corrected.
5. The State Department of Health Services revised and finalized Title 22 regulations for water reuse in 2000. The Regional Board Executive Officer may authorize changes to the restricted and unrestricted recycled water uses consistent with those regulations.
6. Maximum daily flow volumes shall not exceed 1.0 MGD.
7. Recycled water shall not have turbidity which exceeds the following limits:
 - a. Daily average turbidity must be less than or equal to 2 NTU;
 - b. Turbidity shall not exceed 10 NTU at any time; and
 - c. Turbidity shall not exceed 5 NTU for more than five percent of the time within a 24-hour period.
8. Tertiary treated recycled water shall not exceed the limits of Table 1.

Table 1- Disinfected Tertiary Recycled Water Limits (mg/l)

Parameter	Daily Max	30-Day Mean	7-Day Mean
BOD ₅	20	10	--
Total Suspended Solids	20	10	--
Nitrate as N	10	9	--


9. Total Nitrogen in wastewater shall be reduced by at least 50 percent prior to subsurface disposal. ^{BP} Compliance will be determined from samples taken at points before and after extended treatment.
10. Recycled water shall not contain total coliform concentrations exceeding the following limits:
 - a. The seven-day median concentration must not exceed a Most Probable Number (MPN) of 2.2/100 ml;
 - b. Concentrations must not exceed a MPN of 23/100 ml in more than one sample taken over a 30-day period; and
 - c. Concentrations must be less than a MPN of 240/100 ml at all times.

C. PROVISIONS

1. This Order supersedes the Regional Board's October 29, 1997 temporary approval of secondary treated wastewater for construction uses.
2. The Producer will be responsible for ensuring that recycled water meets the quality standards of this Order. The Distributor will be responsible for the application of recycled water on their respective use areas and associated operations and maintenance.
3. The Producer shall maintain in good working order and operate as efficiently as possible, any facility or control system installed by the Producer to achieve compliance with the water recycling requirements.
4. The Producer and its employees shall receive training to assure proper operation of water recycling facilities, worker protection, and compliance with this Order.
5. The Producer shall assure that backflow preventers, located within the Scotts Valley Wastewater Treatment Facility, are in proper working order by testing initially and annually thereafter, in accordance with California Code of Regulations Title 17, Section 7605. Reports of testing and maintenance shall be maintained by the Producer.
6. The Producer shall assure that all above-ground equipment, including pumps, piping, storage reservoir, valves, etc. at the Scotts Valley Wastewater Treatment Facility, which may at any time contain recycled water, shall be adequately and clearly identified with warning signs.
7. The Producer shall provide disinfection of the filtered wastewater in accordance with an Operation Plan (Comprised of the Engineering Report and the Operation and Maintenance Manual). Changes to the Operation Plan shall be submitted to the California Department of Health Services (DHS) for review and approval prior to implementation.
8. The Producer shall submit a revised Engineering Report to DHS for review and approval prior to any modification of the treatment processes or expansion of treatment plant capacity.
9. The production, distribution, and use of recycled water shall comply with the Engineering Report as approved by the Regional Board and DHS.
10. The Producer shall permit the Regional Board or its authorized representative in accordance with California Water code section 13267(c):
 - Entry upon premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of the Order;
 - Access to and copy of any records that must be kept under conditions of this Order;
 - Inspection of any facility, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order;

- To photograph, sample, and monitor for the purpose of assuring compliance with this Order.
11. The Producer shall comply with all items of the attached "Standard Provisions and Reporting Requirements for Waste Discharge Requirements," dated January 1984 (also referred to as "Standard Provisions"), except Item Nos. A.11, A.14, and A.15.
 12. The Producer shall comply with "Monitoring and Reporting Program No. 01-066," as specified by the Regional Board Executive Officer.
 13. The Regional Board will revise this Order periodically and may revise these requirements when necessary.
 14. Pursuant to Title 23, Division 3, Chapter 9 of the California Code of Regulations, the Discharger must submit a written report to the Regional Board Executive Officer not later than July 1, 2009 addressing:
 - a. Whether there will be changes in the continuity, character, location, or volume of the discharge; and
 - b. Whether, in the Discharger's opinion, there is any portion of the Order that is incorrect, obsolete, or otherwise in need of revision.

I, Roger W. Briggs, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Coast Region on July 13, 2001.


Executive Officer

S:\WB\Northern\Todd\Finalized\WDR\Scotts Valley WWTP\01-066\01-066 - SVWWTP WDR.doc

Task: 121-01

File: Discharger file; Scotts Valley WWTP, Master Reclamation Requirements

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION
81 Higuera Street
San Luis Obispo, California 93401**

MONITORING AND REPORTING PROGRAM ORDER NO. 01-066
Waste Discharger Identification No. 3 449902003

For

**CITY OF SCOTTS VALLEY WASTEWATER TREATMENT PLANT
PRODUCER OF RECYCLED WATER
Santa Cruz County**

I. GENERAL

Reporting responsibilities of waste discharges are specified in Sections 13225(a), 13267(b), 13268, 13383, and 13387(b) of the California Water Code. The principle purposes of a monitoring program by a Producer of recycled water, also referred to as self-monitoring program, are:

1. To document compliance with water recycling requirements and prohibitions established by this Regional Board; and
2. To facilitate self-policing by the Scotts Valley Wastewater Treatment Plant ("Producer" or "facility") in the prevention and abatement of pollution arising from water recycling.

II. EFFLUENT MONITORING

The Producer shall document tertiary effluent quality. Representative samples of effluent discharged from the treatment facility to the reclamation system shall be collected and analyzed as follows:

Constituent	Units	Type of Sample	Minimum Sampling & Analyzing Frequency
Daily Flow	gallons/day	Metered ¹	Daily
Mean Daily Flow	gallons/day	Calculated	Monthly
Chlorine Residual	mg/l	Metered	Continuously
Total Coliform Organisms	MPN/100ml	Grab	Daily ²
pH	pH Units	Grab	Weekly
BOD ₅	mg/l	24-Hour Composite	Weekly
Total Suspended Solids	mg/l	24-Hour Composite	Weekly
Total Dissolved Solids	mg/l	Grab	April & October
Sodium	mg/l	Grab	April & October
Chloride	mg/l	Grab	April & October
Organic Nitrogen (N)	mg/l	Grab	Weekly
Nitrate (N)	mg/l	Grab	Weekly
Nitrite (N)	mg/l	Grab	Weekly
Ammonia (N)	mg/l	Grab	Weekly
Turbidity	NTU	Metered ¹	Continuously ^{3,4,5,6}

¹ Meters calibrated per manufacturer's specifications. Results verified by grab samples, where applicable.

- ² Producer may retain Sunday and/or holiday sampling for analysis on the following day provided samples are properly dechlorinated and preserved and holding time does not exceed 24 hours.
- ³ Tertiary recycled water (following filtration) shall be continuously sampled for turbidity using a continuous turbidity meter and recorded.
- ⁴ Compliance with the daily average turbidity (Order No. 01-066, Part B, *RECYCLED WATER LIMITATIONS*, Subpart 7.a) shall be determined by averaging the levels of recorded operating filter effluent turbidity taken at a minimum of four-hour intervals over a 24-hour period.
- ⁵ Compliance with turbidity (Order No. 01-066, Part B, *RECYCLED WATER LIMITATIONS*, Subpart 7.c) shall be determined based on the levels of recorded operating filter effluent turbidity taken at intervals of no more than 1.2 hours over a 24-hour period.
- ⁶ Should the continuous turbidity meter and/or recorder fail, grab sampling at a minimum frequency of 1.2 hours may be substituted for a period of up to 24 hours.

III. COMPLIANCE MONITORING FOR ULTRAVIOLET (UV) DISINFECTION SYSTEM

1. Routine UV disinfection system monitoring based on continuous on-line measurement shall be performed as follows:
 - a. Wastewater – flow rate, fluid transmittance (after filtration and prior to UV disinfection), and turbidity (after filtration and prior to UV disinfection); and
 - b. UV Disinfection System – UV intensity and lamp age in hours.
2. UV Disinfection System Water Level – Compliance monitoring of the water level in the UV disinfection channel and a high water alarm are not required at this time (based on California Department of Health Services review of field measurement data from the facility).

Field measurements, however, shall be repeated and the data submitted to the California Department of Health Services and the Regional Board under any of the following conditions:

- a. The facility flow rate exceeds 1.0 million gallons per day;
 - b. Modifications are made to the UV disinfection modules;
 - c. Additional UV disinfection modules are added to the UV disinfection channel; or
 - d. Changes are made to the inlet, outlet, or floor of the UV disinfection channel.
3. If any of the conditions of Section III.2 of this Monitoring and Reporting Program are met, and if the field measurements indicate that the water level in the UV disinfection channel is higher than the top of the UV lamps' effective arc length, the following shall be required:
 - a. The installation of a water level measuring device (continuously measuring) and high water alarm for the water level in the UV disinfection channel; and
 - b. The inclusion of UV disinfection channel water level monitoring in the quarterly reports specified in Section IV of this Monitoring and Reporting Program.

IV. REPORTS TO BE FILED WITH THE REGIONAL BOARD

1. Quarterly Self-Monitoring Report

A quarterly report shall be submitted to the Regional Board by 1st of February, May, August, and November of each year. The report shall include:

- a. Results of effluent monitoring as required in Order No. 01-066, including results of daily total coliform bacteria monitoring, running 7-day median coliform calculation, maximum daily coliform reading for previous months within reporting period, minimum daily chlorine residual, results of four-hour turbidity readings, average effluent turbidity (24-hour period), 95th percentile effluent turbidity (24-hour period), and daily maximum turbidity reading;
- b. A summary of operational problems, plant equipment malfunctions, and any diversion of reclaimed water which does not meet the requirements specified in this Order;
- c. A record of equipment or process failures initiating an alarm, as well as any corrective and preventative actions;
- d. An update regarding the development of the Scotts Valley Wastewater Treatment Plant Tertiary Process, including planning, design, and construction of facilities, and preparation of required reports and technical documents; and
- e. Results of compliance monitoring for the UV disinfection system. The required results shall include results of highest daily flow rate, lowest daily fluid transmittance, lowest daily UV intensity, and lowest daily operational UV dose. UV disinfection channel water level monitoring shall be included pursuant to Sections III.2 and III.3 of this Monitoring and Reporting Program.

2. Violation of Requirements

In the event the Producer is unable to comply with the conditions of the water recycling requirements and prohibitions contained in or referred to by Order No. 01-066, the Producer shall immediately notify the Scotts Valley Water District (Distributor) by telephone and instruct the Distributor to cease distributing recycled water until the Distributor receives confirmation from the Producer that the recycled water used for distribution meets conditions of the aforementioned water recycling requirements. The Producer shall also immediately notify the Regional Board by telephone, and then submit a written follow-up report within two weeks of the noncompliance. The written report shall include pertinent information explaining the reasons for the noncompliance and shall indicate what steps are being taken to prevent the problems from recurring.

The notification of the Regional Board by telephone shall be done within 24 hours when any one of the following occurs:

- a. Failure of chlorination equipment;
- b. Failure of the UV disinfection system;
- c. Effluent total coliform bacteria MPN is greater than 240/100 ml; or
- d. Filtered effluent turbidity is greater than 10 NTU.

3. Standard Observations

The Standard Observations within the City of Scotts Valley Wastewater Treatment Facility, described below, should be noted and submitted with the quarterly reports.

- a. Evidence of runoff of recycled water from the site (show affected area on a sketch, and provide an estimate of the runoff volume).
- b. Whether warning signs are properly posted to inform the public that effluent is recycled water, and is not safe for drinking.
- c. Evidence of leaks or breaks in the distribution system pipelines or tubing.

Note that the above Standard Observations do not necessarily constitute violations of Order No. 01-066.

V. SCHEDULE OF SAMPLING, MEASUREMENTS, AND ANALYSIS

1. This self-monitoring program is applicable during the periods when recycled water is in use. The Producer is required to perform observations, sampling, measurements, and analyses according to the specifications of Monitoring and Reporting Program Order No. 01-066.


Ordered by: _____

Executive Officer

Date: _____

7-19-01

ATTACHMENT A

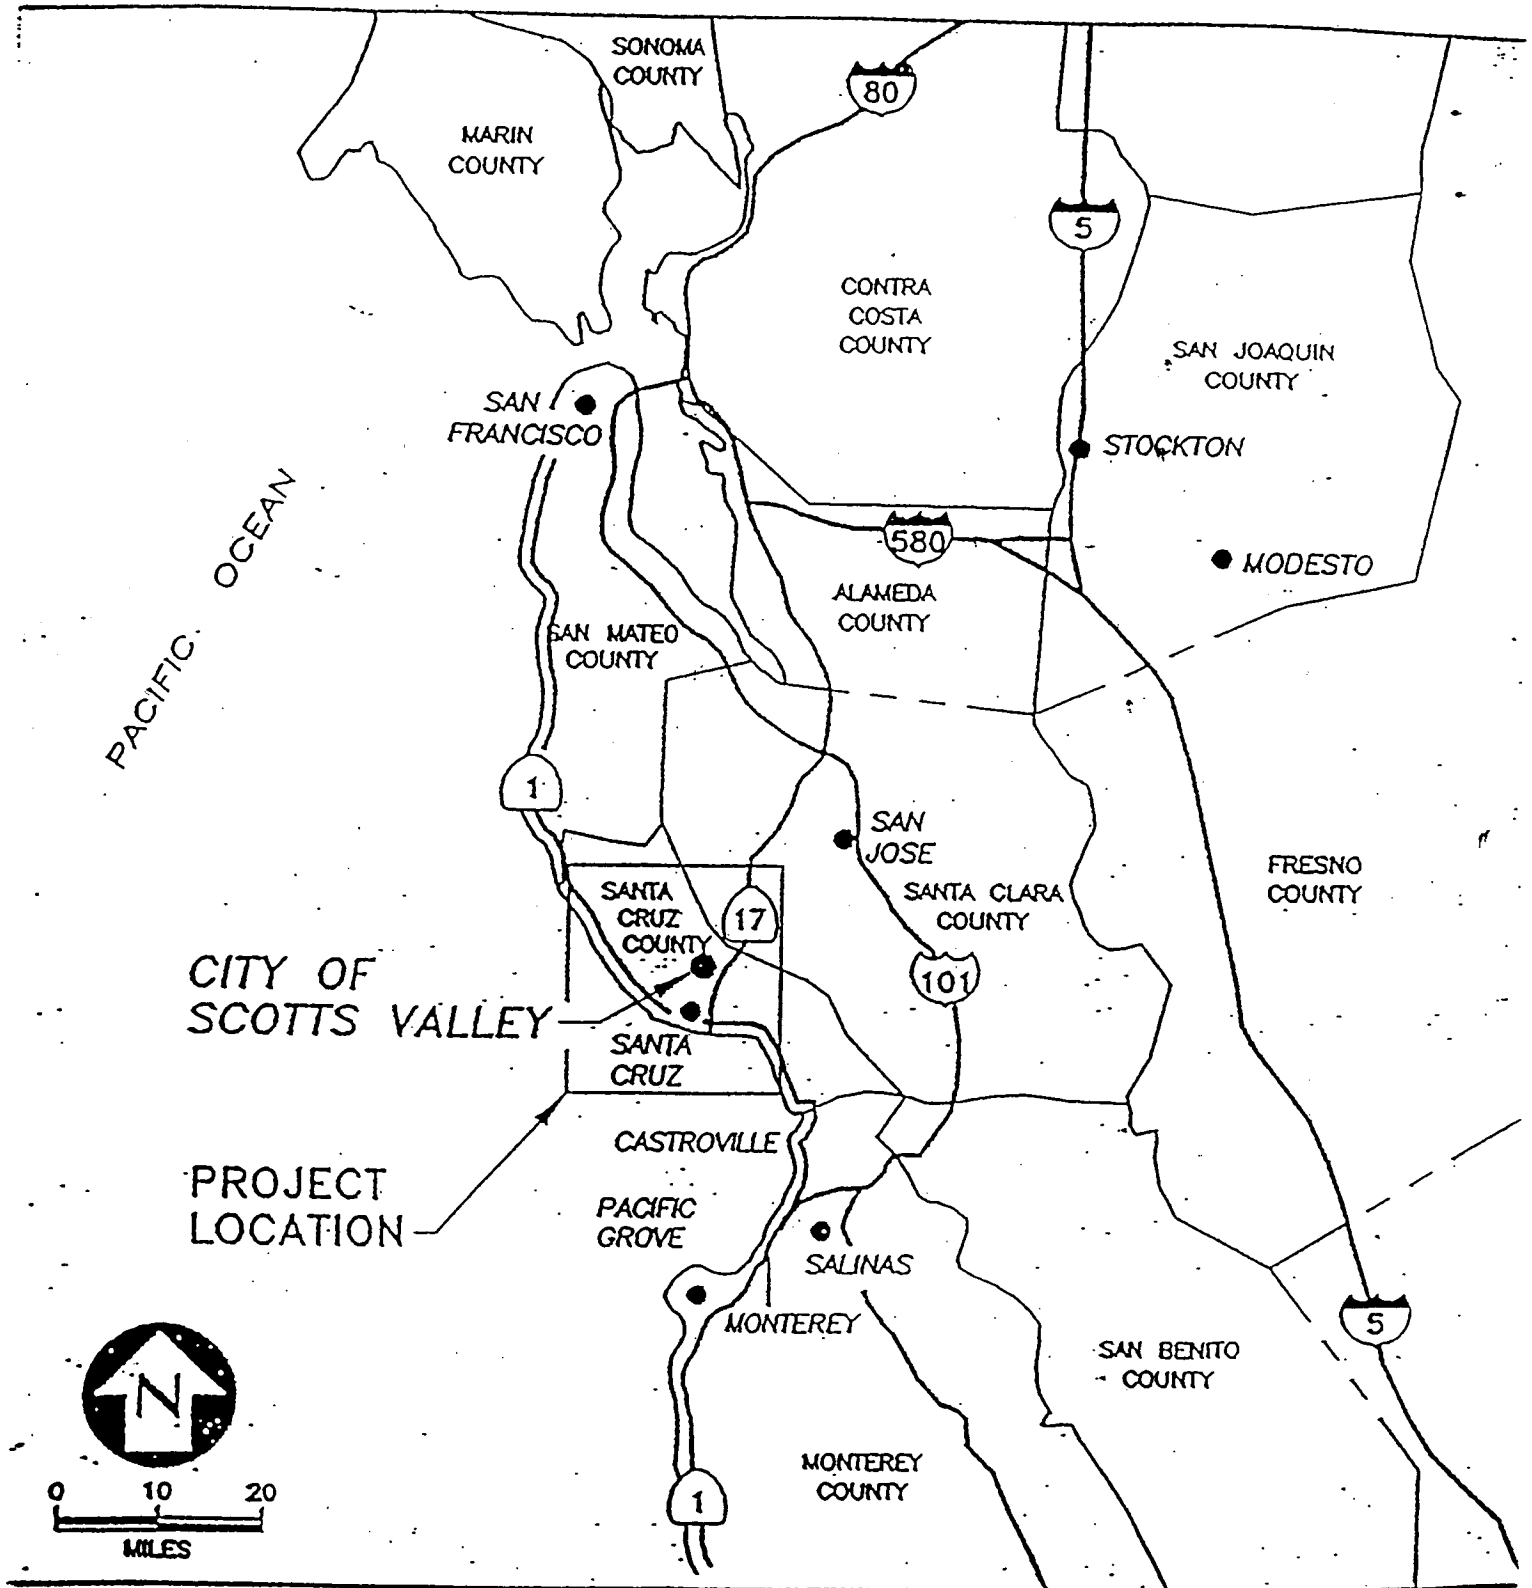

VICINITY MAP

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION
JANUARY, 1984
STANDARD PROVISIONS AND REPORTING REQUIREMENTS
for
WASTE DISCHARGE REQUIREMENTS

CONTENTS:

- A. General Conditions
- B. General Monitoring Requirements
- C. General Reporting Requirements
- D. Bypasses or Upsets
- E. Enforcement
- F. Definitions (Defines terms that appear in quotes)

A. General Permit Conditions:

Prohibitions:

1. Introduction of "incompatible wastes" to the treatment system is prohibited. (See F.9.)
2. Discharge of chemical and biological warfare agents is prohibited.
3. Discharge of "toxic wastes" is prohibited. (See F.18.)
4. Introduction of pollutants into the collection, treatment, or disposal system by an "indirect discharger" that:
 - a) inhibit or disrupt the treatment process, system operation, or the eventual use or disposal of sludge; or,
 - b) cause or "significantly contribute" to a violation of any requirement of this Order, is prohibited. (See F.17.)
5. Introduction of "pollutant-free" wastewater to the collection, treatment, and disposal system in amounts that threaten compliance with this order is prohibited. (See F.14.)

Provisions:

6. Production and use of reclaimed water shall conform with reclamation criteria established in Title 22, Chapter 3, of the California Code of Regulations. For uses of reclaimed water not addressed in Title 22 and not in the main body of this order, use is subject to review and dependent upon approval by the Executive Officer before use may begin (For uses addressed in Title 22, see C.8.).

- d) to photograph, sample, and monitor for the purpose of showing compliance with this order.
19. After notice and opportunity for a hearing, this order may be terminated or modified for cause, including, but not limited to:
- a) violation of any term or condition contained in this order;
 - b) obtaining this order by misrepresentation, or by failure to disclose fully all relevant facts;
 - c) a change in any condition or endangerment to human health or environment that requires a temporary or permanent reduction or elimination of the authorized discharge; and,
 - d) a material change in character, location, or volume of the discharge.
20. The order does not authorize commission of any act causing injury to the property of another, does not convey any property rights of any sort, does not remove liability under federal, state, or local laws, and does not guarantee a capacity right.
21. The discharger shall take all reasonable steps to minimize or correct adverse impacts on the environment resulting from noncompliance with this order.
22. Provisions of this order are severable. If any provision of the order is found invalid, the remainder of the order shall not be affected.
23. The discharger shall furnish, within a reasonable time, any information the Regional Board may request to determine compliance with this order or to determine whether cause exists for modifying or terminating this order.
24. Safeguards shall be provided to assure maximal compliance with all terms and conditions of this order. Safeguards shall include preventative and contingency plans and may also include alternative power sources, stand-by generators, retention capacity, operating procedures, or other precautions. Preventative and contingency plans for controlling and minimizing the effect of accidental discharges shall:
- a) identify possible situations that could cause "upset", "overflow" or "bypass", or other noncompliance. (Loading and storage areas, power outage, waste treatment unit outage, and failure of process equipment, tanks, and pipes should be considered.)
 - b) evaluate the effectiveness of present facilities and procedures and describe procedures and steps to minimize or correct any adverse environmental impact resulting from noncompliance with the order.
25. Physical facilities shall be designed and constructed according to accepted engineering practice and shall be capable of full compliance with this order when properly operated

6. If any parameter is monitored at locations specified in the order more frequently than required and is analyzed using approved test procedures, the results shall be included in calculations and reports.
7. All monitoring instruments and devices used by the discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary to ensure their continued accuracy.
8. The discharger shall maintain records of all monitoring information, including all calibration and maintenance records; all original strip chart recordings for continuous monitoring instrumentation; the date, exact place, and time of sampling; the individual who performed the sampling; the date analysis was performed; the laboratory and individual who performed the analysis; the analytical techniques used; and results. Records shall be maintained for a minimum of three years. This period may be extended during the course of any unresolved litigation or when requested by the Board.

C. General Reporting Requirements:

1. Monitoring results shall be reported at intervals and in a manner specified in the Monitoring and Reporting Program of this order.
2. Monitoring reports shall be submitted on State Water Resource Control Board Form Q2 or an acceptable alternate form. A master copy of the form will be supplied by the Regional Board upon request.
3. Any noncompliance that may endanger health or the environment shall be reported orally within 24 hours from the time the discharger becomes aware of the circumstances (telephone: 805-549-3147). Unless waived by the Executive Officer of the Regional Board, a written report shall be submitted within five (5) days of awareness and shall contain a description of the noncompliance and its cause; the period of noncompliance (including exact dates and times) or anticipated duration; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance. This provision includes, but is not limited to:
 - a) violation of a discharge prohibition;
 - b) any "upset", "overflow", or "bypass";
 - c) violation of a discharge limitation for any "hazardous substance."
4. Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule shall be submitted within 14 days following each scheduled date unless otherwise specified within the order. If reporting non compliance, the report shall include a description of the reason, a description and schedule of tasks necessary to achieve compliance, and an estimated date for achieving full compliance. A second report shall be submitted within 14 days of full compliance.

12. Except for data determined to be confidential under Section 13267(b) of the California Water Code, all reports prepared in accordance with this order shall be available for public inspection at the office of the Regional Board.
13. Should the Discharger discover that it failed to submit any relevant facts or that it submitted incorrect information in a report, it shall promptly submit the missing or incorrect information.
14. All reports shall be signed as below:
 - a) For a corporation; by a principle executive officer of at least the level of vice president;
 - b) For a partnership or sole proprietorship; by a general partner or the proprietor, respectively;
 - c) For a public agency; by either a principal executive officer or ranking elected official; or,
 - d) Their "duly authorize] representative."
15. Any person signing a report makes the following certification, whether it is expressed or implied:

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment."
16. By January 30 of each year, the discharger shall submit an annual report to the Regional Board. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. The Discharger shall discuss the compliance record and corrective actions taken, or which may be needed, to bring the discharger into full compliance. The report shall address operator certification and provide a list of current operating personnel and their grade of certification. The report shall inform the Board of the date of the Facility's Operation and Maintenance Manual (including contingency plans as described in Provision A.24 .), of the date the manual was last reviewed, and whether the manual is complete and valid for the current facility. The report shall restate, for the record, the laboratories used by the discharger to monitor compliance with effluent limits and provide a summary of performance relative to Section B, General Monitoring Requirements.

~~If the facility treats industrial or domestic wastewater and there is no provision for periodic sludge monitoring in the Monitoring and Reporting Program, the report shall include a summary of sludge quantities, analyses of its chemical and moisture content, and its ultimate destination.~~

- b) the facility was at the time of "upset" being properly operated; the discharger submitted notice of "upset" within 24 hours; and the discharger took all reasonable steps to minimize or correct any adverse impact on the environment.

E. Enforcement:

1. The discharger must comply with all conditions of this order. Noncompliance violates state law and is grounds for enforcement action or modification of the existing order.
2. Any person failing or refusing to furnish technical or monitoring program reports as required by subdivision (b) of section 13267 of the California Water Code, or falsifying any information provided therein, is guilty of a misdemeanor.
3. The discharger and any person who violates waste discharge requirements and/or who intentionally or negligently discharges waste or causes or permits waste to be deposited where it is discharged into surface waters of the state may be liable for civil and/or criminal remedies, as appropriate, pursuant to sections 13350, 13385, and 13387 of the California Water Code.
4. Upon reduction, loss, or failure of any part of the wastewater facility, the discharger shall, to the extent necessary to maintain compliance with this order, control production or all discharges, or both, until the facility is restored or an acceptable interim method of treatment or disposal is provided. Should enforcement action be brought against the discharger, the necessity to halt or reduce the permitted activity in order to obtain compliance with the conditions of this order shall not be a defense.

F. Definitions:

1. "Average" or "Mean" is the arithmetic mean of daily concentrations over the specified period in which "N" is the number of days samples were analyzed during the period and "X" is either the constituent concentration (mg/l) or flow for each sampled day. To be valid, "N" must be four or greater.
2. "Bypass" means the diversion of waste streams around any portion of a treatment facility to the disposal area or from the treatment facility to a nonauthorized location.
3. A "composite sample" is a combination of no fewer than eight (8) individual samples obtained at equal time intervals (usually hourly) over the specified sampling (composite) period. The volume of each individual sample is proportional to the flow rate at time of sampling. The period shall be specified in the Monitoring and Reporting Program ordered by the Executive Officer.
4. "Daily Discharge" means the discharge of a pollutant measured during a calendar day or during any 24-hour period reasonably representative of the calendar day for purposes of sampling.
5. "Daily Maximum" limit means the maximum acceptable concentration or mass emission rate of a pollutant measured during a calendar day or during any 24-hour period

in which "N" is the number of days samples were analyzed during the period and any "C" is the concentration of bacteria (MPN/100 ml) found on each day of sampling. To be valid, "N" must be five or more.

12. "Median" is the value below which half the samples (ranked progressively by increasing value) fall. It may be considered the middle value, or the average of two middle values. To be valid, three or more values are required.
13. "Overflow" means the intentional or unintentional diversion of flow from the collection and transport systems, including pumping facilities, and from disposal areas.
14. "Pollutant-free wastewater" means infiltration and inflow, storm waters, and cooling waters and condensates which are essentially free of pollutants.
15. "Severe property damage" means substantial physical damage to property, damage to treatment facilities which causes them to become inoperable, or substantial and permanent loss to natural resources which can reasonably be expected to occur in the absence of a "bypass". It does not mean economic loss caused by delays in production.
16. "Sludge" means the solids, residues, and precipitates separated from, or created in, wastewater by the unit processes of a treatment system.
17. "To significantly contribute" to a waste discharge requirement violation means an "indirect discharger" must:
 - a) Discharge a daily pollutant loading in excess of that allowed by contract with the discharger or by state or local law;
 - b) Discharge wastewater which substantially differs in nature or constituents from its average discharge;
 - c) Discharge pollutants, either alone or in conjunction with discharges from other sources, which results in a waste discharge requirement violation or prevents sludge use or disposal; or,
 - d) Discharge pollutants, either alone or in conjunction with pollutants from other sources, that increase the magnitude or duration of waste discharge requirement violations.
18. "Toxic waste" means any toxic and persistent waste which falls within the following categories:
 - a) PCB's
 - b) Pesticides
 - c) Toxic Metals
 - d) Cyanides