

Cose

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 96-132

WASTE DISCHARGE REQUIREMENTS
FOR
CLIFFORD AND ELAINE ASHBY
dba RANCHO ESPLANADE MOBILE HOME PARK
BUTTE COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Waste Discharge Requirements Order No. 73-118, adopted by the Board on 15 December 1972, prescribes requirements for a discharge of wastewater from a mobile home park owned by Clifford and Elaine Ashby (hereafter Discharger) to land disposal. The property is owned by the Discharger (Assessor's Parcel No. 006-170-029).
2. Order No. 73-118 is neither adequate nor consistent with current plans and policies of the Board.
3. The Discharger discharges approximately 75,000 gallons per day of domestic sewage from 270 mobile home spaces to septic tanks and leachfields throughout the mobile home park.
4. The Discharger's wastewater treatment system (septic tank and leachfields) are in Section 8, T22N, R1E, MDB&M with surface water drainage to Mud Creek, an indirect tributary of the Sacramento River as shown in Attachment A, which is attached hereto and part of this Order by reference.
5. Ground water depth in the vicinity of the wastewater treatment area is approximately 30 to 40 feet during most of the year.
6. Soils in the vicinity of the development are generally classified as vlna loam and vlna fine sandy loam.
7. Federal regulations for stormwater discharges were promulgated by the U.S. Environmental Protection Agency (USEPA) on 16 November 1990 (40 CFR Parts 122, 123, and 124). The regulations require specific categories of facilities which discharge stormwater associated with industrial activity to obtain NPDES permits and to implement Best Available Technology Economically Achievable and Best Conventional Pollutant Control Technology to reduce or eliminate industrial stormwater pollution.

WASTE DISCHARGE REQUIREMENTS
CLIFFORD AND ELAINE ASHBY
dba RANCHO ESPLANADE MOBILE HOME PARK
BUTTE COUNTY

-2-

This facility's capacity is less than 1.0 mgd and no Notice of Intent (NOI permit application) is required.

8. The Board adopted a Water Quality Control Plan, Third Edition, for the Sacramento River Basin and the San Joaquin River Basin (hereafter Basin Plan), which contains water quality objectives for all waters of the Basins. These requirements implement the Basin Plan.
9. The beneficial uses of Mud Creek and the Sacramento are domestic, municipal, industrial, and agricultural supply; recreation; esthetic enjoyment; navigation; ground water recharge; freshwater replenishment; and preservation and enhancement of fish, wildlife, and other aquatic resources.
10. The beneficial uses of the ground water are municipal and domestic supply.
11. The action to revise waste discharge requirements for this existing facility is exempt from the provisions of the California Environmental Quality Act (CEQA), in accordance with Title 14, California Code of Regulations (CCR), Section 15301.
12. This discharge is exempt from the requirements of Title 23, CCR, Section 2510, et seq. (hereafter Chapter 15). This exemption, pursuant to Section 2511(b) is based on the following:
 - a. The Board is issuing waste discharge requirements, and
 - b. The discharge complies with the Basin Plan, and
 - c. The wastewater does not need to be managed according to 22 CCR, Division 4.5, Chapter 11, as a hazardous waste.
13. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge, and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
14. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 73-118 is rescinded and Clifford and Elaine Ashby, dba Rancho Esplanade Mobile Home Park, its agents, successors, and assigns, in

WASTE DISCHARGE REQUIREMENTS
CLIFFORD AND ELAINE ASHBY
dba RANCHO ESPLANADE MOBILE HOME PARK
BUTTE COUNTY

-3-

order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions

1. Discharge of wastewater to surface waters or surface water drainage courses is prohibited.
2. By-pass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous' or 'designated,' as defined in Sections 2521(a) and 2522(a) of Chapter 15, is prohibited.

B. Discharge Specifications

1. The monthly average dry weather discharge flow shall not exceed 75,000 gallons per day.
2. Neither the treatment nor the discharge shall cause a nuisance or condition of pollution as defined by the California Water Code.
3. Objectionable odors originating at this facility shall not be perceived beyond the limits of the Discharger's property.
4. The discharge shall remain within the designated disposal area (septic tank and leachfields) at all times.
5. The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
6. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15, Title 23, CCR, Division 3, and approved by the Executive Officer.

C. Ground Water Limitations

The discharge, in combination with other sources, shall not cause underlying ground water or surface water to:

1. Be degraded.

WASTE DISCHARGE REQUIREMENTS
CLIFFORD AND ELAINE ASHBY
dba RANCHO ESPLANADE MOBILE HOME PARK
BUTTE COUNTY

-4-

2. Exceed a most probable number of total coliform organisms of 2.2/100 ml over any 7-day period.
3. Contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.


D. Provisions

1. The Discharger may be required to submit technical reports as directed by the Executive Officer.
2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 96-132, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
3. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements," dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
4. The Discharger shall report promptly to the Board any material change or proposed change in the character, location, or volume of the discharge.
5. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
6. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
7. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
8. The Board will review this Order periodically and may revise requirements when necessary.

WASTE DISCHARGE REQUIREMENTS
CLIFFORD AND ELAINE ASHBY
dba RANCHO ESPLANADE MOBILE HOME PARK
BUTTE COUNTY

-5-

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 3 May 1996.



WILLIAM H. CROOKS, Executive Officer

RSD:djc

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 96-132

FOR

CLIFFORD AND ELAINE ASHBY
dba RANCHO ESPLANADE MOBILE HOME PARK
BUTTE COUNTY

SYSTEM MAINTENANCE AND INSPECTIONS

Septic tank maintenance inspections (including tank sludge level measurement) shall be performed at least once every three years. Information concerning inspections and maintenance activities (including, but not limited to, pumping, replacement, and repairs) shall be included in the monitoring reports submitted to the Board. The leachfield areas shall be monitored quarterly for signs of surfacing effluent or excessive weed growth.

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monitoring reports shall be submitted to the Regional Board by the **20th day of the month** following sample collection.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by **30 January of each year**. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.


The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered by:


WILLIAM H. CROOKS, Executive Officer

3 May 1996

(Date)

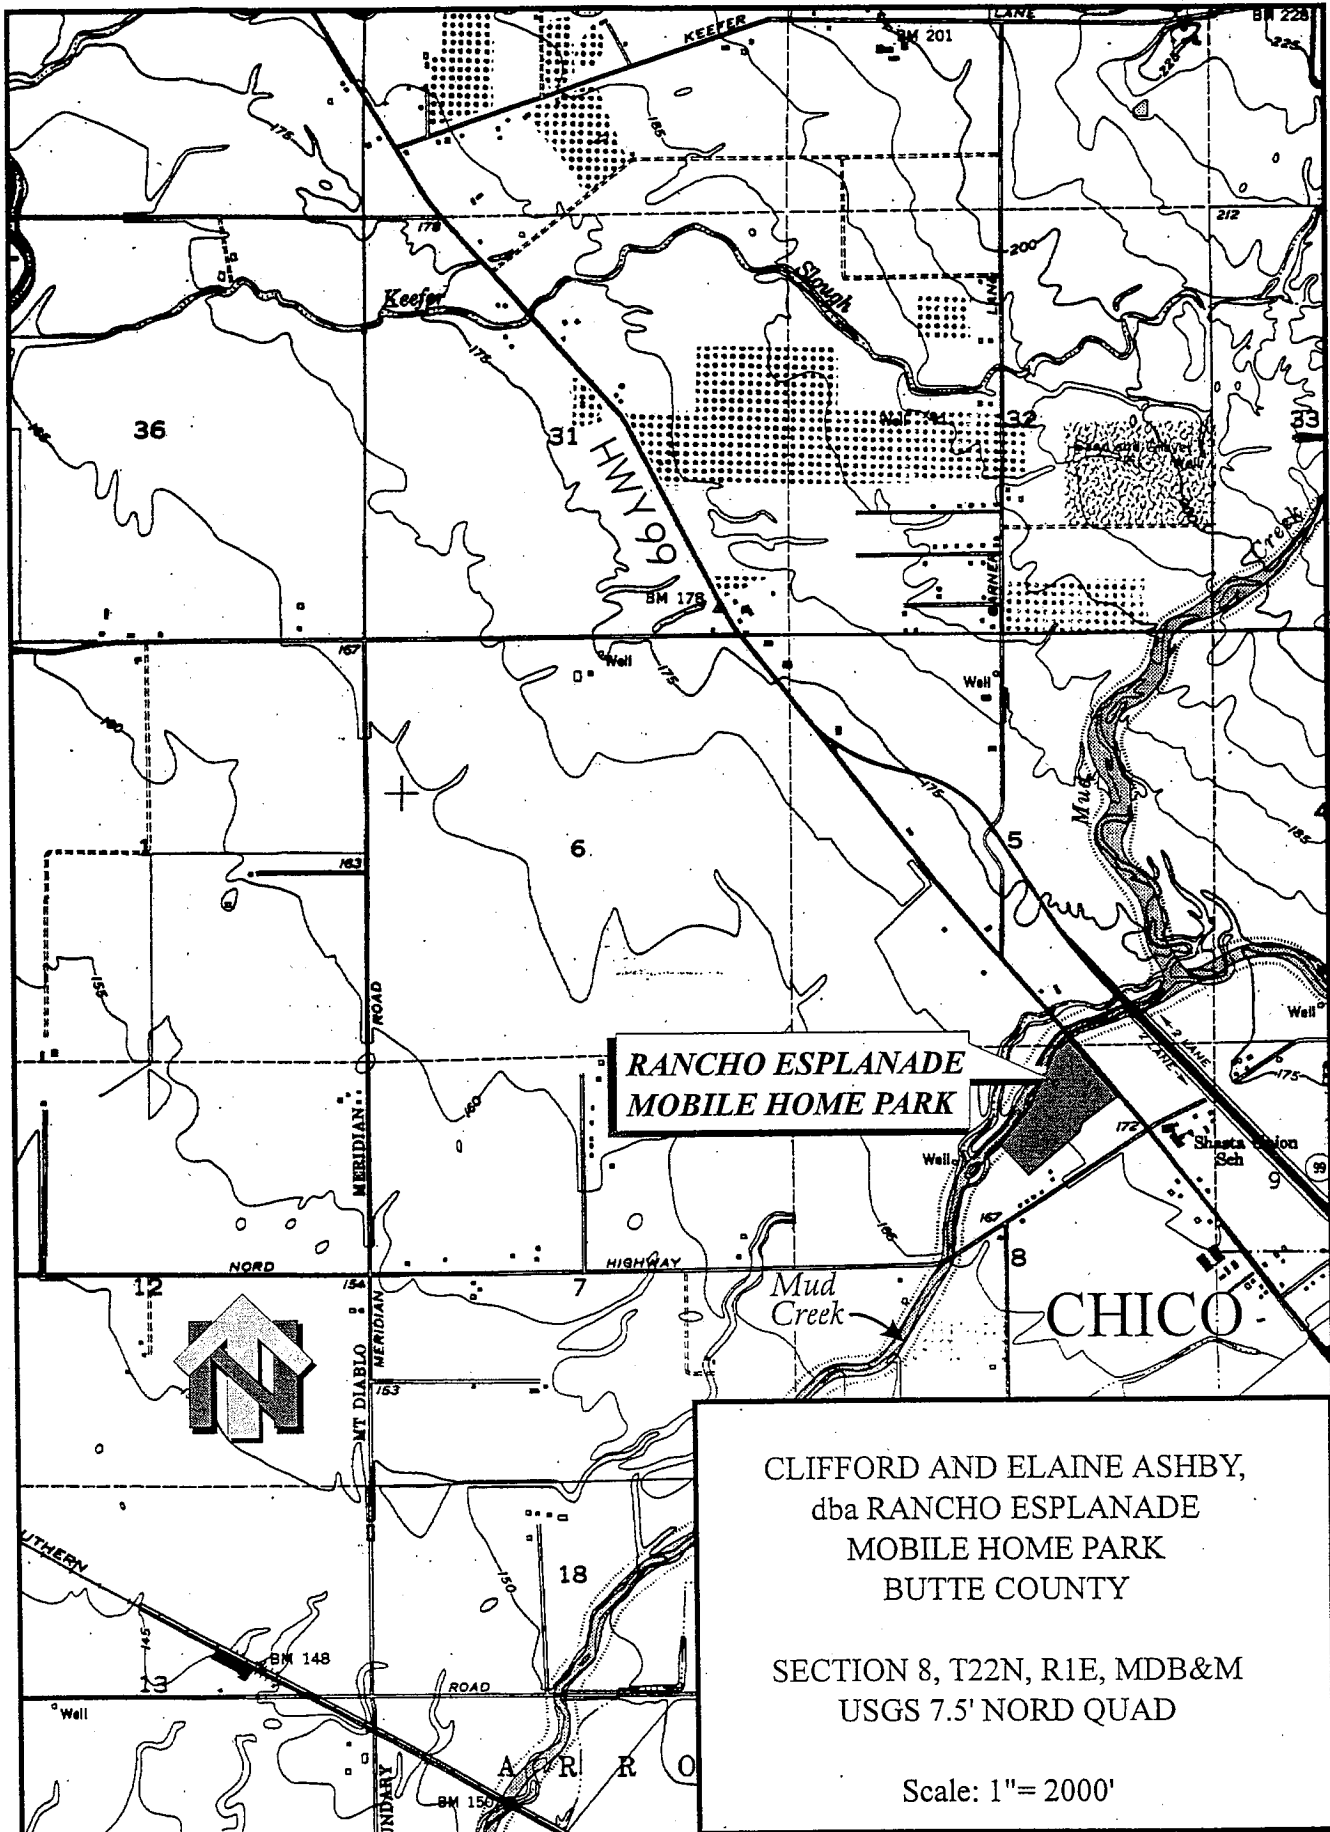

INFORMATION SHEET

CLIFFORD AND ELAINE ASHBY
dba RANCHO ESPLANADE MOBILE HOME PARK
BUTTE COUNTY

Clifford and Elaine Ashby own the Rancho Esplanade Mobile Home Park, approximately 2 miles north of the City of Chico. The mobile home park has approximately 270 spaces with an average daily wastewater flow of approximately 75,000 gallons per day. The wastewater is delivered to septic tanks and leachfields (each septic tank and leachfield serves approximately 3 to 4 coaches). Surface drainage in the area of the package treatment plant and the percolation ponds is to Mud Creek, an indirect tributary of the Sacramento River.

Four years ago, there were reports of surfacing effluent from the leachfields, and the owners were sued because of this and other alleged maintenance failures. Since that time there have been no more reports of failed systems. In addition, the implementation plan for the Chico Urban Area Basin Plan Amendment (Order No. 90-126) will most likely require that this facility be sewered or a more sophisticated and better monitored system be installed.

RSD:djc 5/3/96