



Central Coast Regional Water Quality Control Board

June 28, 2024

Sent Via Electronic Mail

Faith Zenker
Water Quality Division Manager
San Luis Obispo County
Email: fzenker@co.slo.ca.us

Dear Faith Zenker:

THE COUNTY OF SAN LUIS OBISPO – LOS OSOS RECYCLED WASTEWATER FACILITY, 2270 LOS OSOS VALLEY ROAD, LOS OSOS, TRANSMITTAL OF MODIFIED MONITORING AND REPORTING PROGRAM NO. R3-2011-0001

Please find attached **revised** monitoring and reporting program R3-2011-0001 (Attachment 1). The revised monitoring and reporting program applies to the monitoring and reporting requirements for the County of San Luis Obispo's Los Osos Recycled Wastewater Facility which is regulated by *Waste Discharge/Recycled Water Requirements Order R3-2011-0001, for the Los Osos Water Recycling Facility, County of San Luis Obispo* (Permit). This revised monitoring and reporting program is effective immediately and supersedes and replaces all previous versions of monitoring and reporting program R3-2011-0001. The revisions include:

- Elimination of CEC and Priority Pollutant Monitoring.
- Increased specificity regarding compliance sampling locations and requirements.
- New requirements to sample for disinfection byproducts in recycled water and groundwater.
- Reduction in the frequency of disposal area inspections.
- Requirements for submittal of an Operations and Maintenance manual.
- Requirements to sample for additional constituents in effluent.
- Other minor changes.

This monitoring and reporting program will also be available electronically on our GeoTracker website:

https://geotracker.waterboards.ca.gov/profile_report.asp?global_id=WDR100039574

If you have questions regarding revised monitoring and reporting program No. R3-2011-0001, please contact **James Bishop at (805) 542-4628 or james.bishop@waterboards.ca.gov** or Jennifer Epp at (805) 594-6181 or jennifer.epp@waterboards.ca.gov.

Sincerely,

 Digitally signed by Jennifer Epp
Date: 2024.06.27 15:41:25 -07'00'
Water Boards

for Ryan E. Lodge
Executive Officer

Attachment:

1. Revised Monitoring and Reporting Program R3-2011-0001

cc:

Mladen Bandov, mbandov@co.slo.ca.us

Sean Loveridge, sloveridge@co.slo.ca.us

Danielle Ruedas, druedas@co.slo.ca.us

Jason Cunningham, Jason.Cunningham@Waterboards.ca.gov

Jeff Densmore, Division of Drinking Water, jeff.densmore@Waterboards.ca.gov

Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov

James Bishop, James.Bishop@Waterboards.ca.gov

Jesse Woodard, Jesse.Woodard@Waterboards.ca.gov

WDR Program, RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-822816

GeoTracker No. = GT-WDR100039574

Rev 7/7/23

ECM Subject Name = Los Osos Recycled Wastewater Facility Revised MRP 2024

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\San Luis Obispo Co\Los

Osos\1_Recycled Water production\1- Permit\WDR Order No. R3-2011-0001 (active)\3

- Revised MRP 2024\MRP revision 2024\Los Osos WRF MRP amendment tranmittal
letter_final.docx

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

MODIFICATION OF MONITORING AND REPORTING PROGRAM R3-2011-0001 JUNE 28, 2024

FOR THE LOS OSOS WATER RECYCLING FACILITY

This Monitoring and Reporting Program contains monitoring and reporting requirements for the Los Osos Water Recycling Facility (Wastewater System) enrolled in *Waste Discharge/Recycled Water Requirements Order R3-2011-0001, for the Los Osos Water Recycling Facility, County of San Luis Obispo* (Permit).

The County of San Luis Obispo owns and operates the Wastewater System that is subject to the Permit.

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The monitoring and reporting program directs the County of San Luis Obispo to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board's GeoTracker database (see monitoring and reporting program section 7.D).

The County of San Luis Obispo must implement this amended monitoring and reporting program on July 1, 2024.

1. SAMPLING AND ANALYSIS

The County of San Luis Obispo must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Regional Water Quality Control Board (Central Coast Water Board). All samples (e.g., wastewater, groundwater, soil, sludge) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the Operations and Maintenance Manual for Central Coast Water Board review and approval.

- A. Sampling Schedule** – Unless otherwise specified below, sampling must be performed in accordance with Table 1.

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Daily	Each day of the week
Weekly	One day each week
Monthly	Each month of the year
Quarterly	March, June, September, December
Semiannually	June and December
Annually	December
Biennial	December, every 2 years

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

- B. Monitoring Location Descriptions** – All samples including influent samples (IS), effluent samples (ES), and groundwater monitoring wells (MW) must be collected at the locations described in Table 2 and as shown in Figures 1, 2, and 3. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. **The County of San Luis Obispo must upload the GeoTracker field point information for each sampling location in the GeoTracker database once, prior to uploading laboratory data (see Table 11).**

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	Field Point Description
Influent Sample (IS)	IS-1	Raw wastewater sample prior to the headworks
Effluent Sample (ES)	ES-1	Treated wastewater sample after filtration, prior to UV disinfection (i.e., filter effluent)
Effluent Sample (ES)	ES-2	Treated wastewater sample collected after UV disinfection, prior to the recycled water storage ponds
Effluent Sample (ES)	ES-3	Treated wastewater sample collected from the recycled water pipeline after the recycled water storage pond and after the recycled water pump station and after sodium chloride injection and chlorine contact time.
Effluent Sample (ES)	ES-4	Treated wastewater from the recycled water pond outlet
Midway Sample (MS)	MS-1	Sample collected just before tertiary filtration (i.e., filter influent)
Monitoring Well (MW)	MW-13G	Monitoring well 13G
Monitoring Well (MW)	MW-13H	Monitoring well 13H
Monitoring Well (MW)	MW-13L5	Monitoring well 13L5
Monitoring Well (MW)	MW-13Q1	Monitoring well 13Q1
Monitoring Well (MW)	MW-17E9	Monitoring well 17E9
Monitoring Well (MW)	MW-17F4	Monitoring well 17F4
Monitoring Well (MW)	MW-17N4	Monitoring well 17N4

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	Field Point Description
Monitoring Well (MW)	MW-18E1	Monitoring well 18E1
Monitoring Well (MW)	MW-18J6	Monitoring well 18J6
Monitoring Well (MW)	MW-18L3	Monitoring well 18L3
Monitoring Well (MW)	MW-18L4	Monitoring well 18L4
Monitoring Well (MW)	MW-18N1	Monitoring well 18N1
Monitoring Well (MW)	MW-18R1	Monitoring well 18R1
Monitoring Well (MW)	MW-24A	Monitoring well 24A
Monitoring Well (MW)	MW-7K3	Monitoring well 7K3
Monitoring Well (MW)	MW-7L3	Monitoring well 7L3
Monitoring Well (MW)	MW-7N1	Monitoring well 7N1
Monitoring Well (MW)	MW-7Q1	Monitoring well 7Q1
Monitoring Well (MW)	MW-7R1	Monitoring well 7R1
Monitoring Well (MW)	MW-8N2	Monitoring well 8N2
Monitoring Well (MW)	MW-8Ma	Monitoring well 8Ma
Monitoring Well (MW)	MW-8Mb	Monitoring well 8Mb

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	Field Point Description
Monitoring Well (MW)	MW-17D	Monitoring well 17D
Monitoring Well (MW)	MW-18A	Monitoring well 18A
Monitoring Well (MW)	MW-18B1	Monitoring well 18B1
Monitoring Well (MW)	MW-18C1	Monitoring well 18C1
Water Supply Well	WSW-1 ^[1]	Representative sample from potable supply serving the wastewater collection area

^[1] Water supply sample data should be included in the annual report but does not need to be uploaded to GeoTracker.

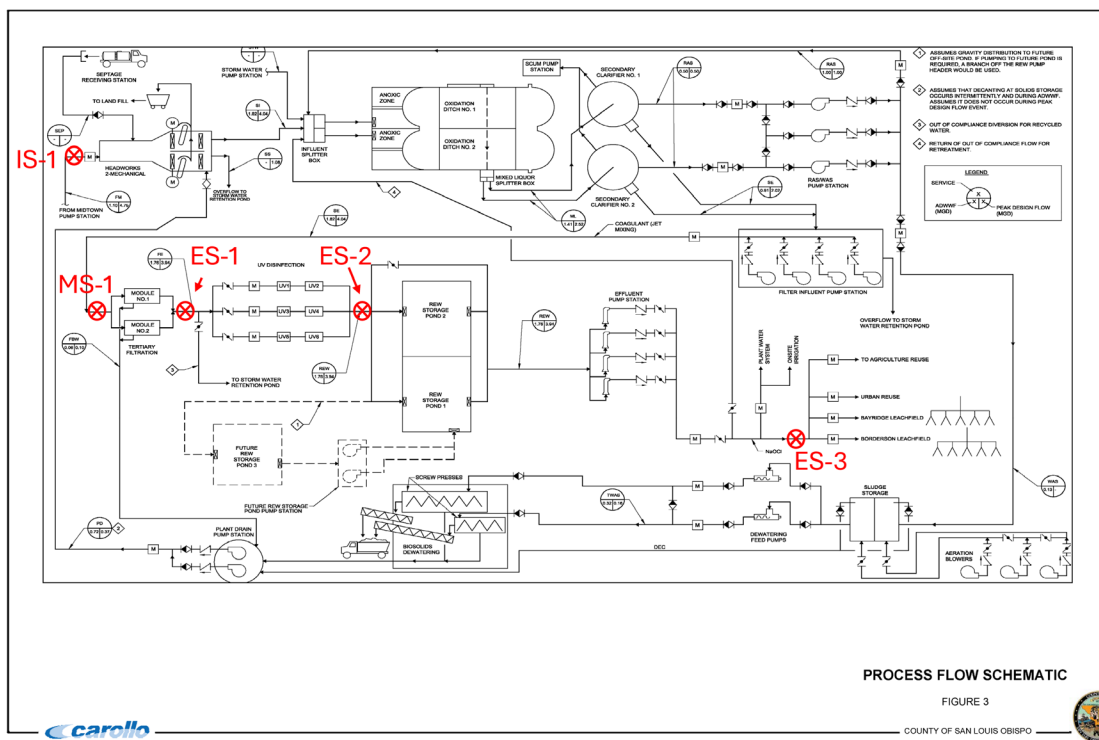


Figure 1. Process flow diagram with sampling locations that are referenced in Table 2. Adapted from the *San Luis Obispo County Los Osos Wastewater Project Development Water Recycling Facility Engineering Report*, 2013.


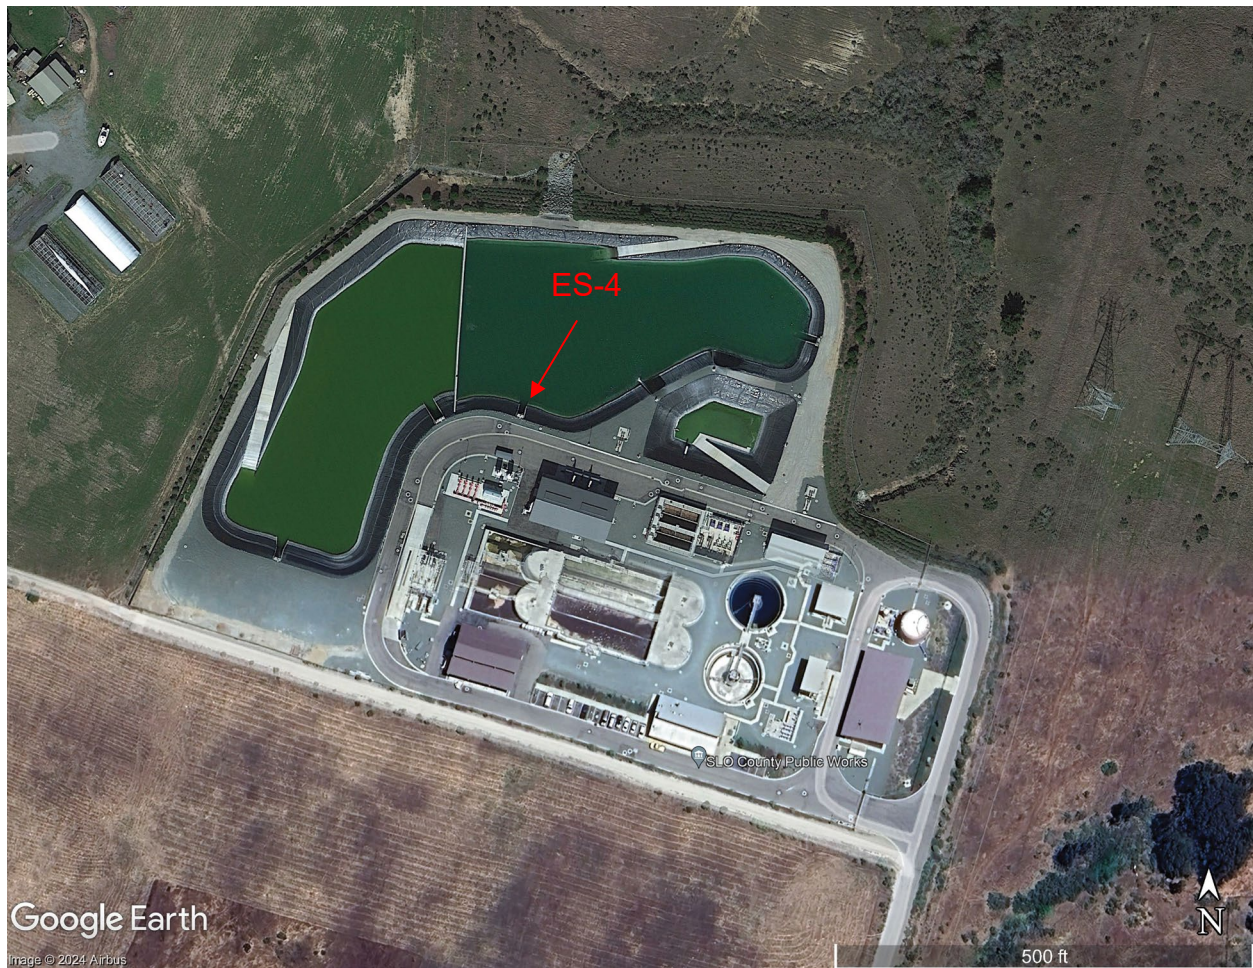


Figure 2. Recycled water storage pond monitoring location for constituents in Table 7. Image from Google Maps Data, ©2020 CNES/ Astrium, Maxar Technologies.



2. WATER SUPPLY MONITORING

Los Osos Water Recycling Facility wastewater customers receive potable water from one of three water purveyors, the Los Osos Community Services District, Golden State Water Company, or S&T Mutual Water Company. The County of San Luis Obispo must submit the most recent water quality data available from the State Water Board Division of Drinking Water's State Drinking Water Information System (SDWIS) for each purveyor and each purveyor well that serves residents who are wastewater customers. San Luis Obispo County must report the constituents in Table 3. The County of San Luis Obispo must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

The County of San Luis Obispo must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring

Constituent	Units^[1]	Sample Type	Sampling Frequency
Nitrate (as N)	mg/L	Grab	Annually
Total Dissolved Solids	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

[1] mg/L denotes milligrams per liter

3. INFLUENT AND EFFLUENT MONITORING

A. Influent and Effluent Flow Monitoring

The County of San Luis Obispo must monitor and report flow in gallons per day, as described in Table 4, with each monitoring report. See monitoring and reporting program section 7.B for supplemental volumetric annual reporting requirements established by the State Water Board.

Table 4. Influent and Effluent Flow Monitoring

	INFLUENT (IS-1)	INFLUENT (IS-1)	EFFLUENT (ES-1)	EFFLUENT (ES-1)
Parameter	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Daily Flow	Metered	Daily	Metered	Daily
Maximum Daily Flow ^[1]	Metered	Monthly	Metered	Monthly
Monthly Average Flow ^[2]	Calculated	Monthly	Calculated	Monthly

	INFLUENT (IS-1)	INFLUENT (IS-1)	EFFLUENT (ES-1)	EFFLUENT (ES-1)
Parameter	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Annual Average Flow ^[3]	Calculated	Annually	Calculated	Annually
Percent of Permitted Flow	N/A	N/A	Calculated	Quarterly

- [1] Maximum daily flow is the maximum daily flow that occurs during the calendar month
 [2] Monthly average flow is based on the sum of the daily flow that occurs each day in a calendar month, divided by the number of days in the month
 [3] Annual average flow is based on the sum of the daily flow that occurs each day in a year, divided by the number of days in the year

B. Influent and Effluent Wastewater Quality Monitoring

Representative samples of the County of San Luis Obispo's influent (raw wastewater) into the Wastewater System and effluent (treated wastewater and recycled water) discharged to land must be collected and analyzed in accordance with the tables below. See Figure 1 for the location of samples and GeoTracker field points.

At a minimum, influent and effluent constituent monitoring must be monitored as specified in Table 5.

Table 5. Influent and Effluent Monitoring for Oxidation Ditch

		INFLUENT (IS-1)	INFLUENT (IS-1)	EFFLUENT (ES-2)	EFFLUENT (ES-2)
Parameter/ Constituent	Units ^[2]	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
pH	units	Grab	Weekly	Grab	Weekly
Biochemical Oxygen Demand, 5-Day	mg/L	24-hour composite	Quarterly	Grab	Monthly
Total Suspended Solids	mg/L	24-hour composite	Quarterly	Grab	Monthly
Settleable Solids	ml/L	Not Applicable	Not Applicable	Grab	Weekly
Total Nitrogen ^[1]	mg/L	Calculated	Quarterly	Calculated	Monthly
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	24-hour composite	Quarterly	Grab	Monthly
Total Kjeldahl Nitrogen (as N)	mg/L	24-hour composite	Quarterly	Grab	Monthly

		INFLUENT (IS-1)	INFLUENT (IS-1)	EFFLUENT (ES-2)	EFFLUENT (ES-2)
Parameter/ Constituent	Units [2]	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Ammonia (as N)	mg/L	24-hour composite	Quarterly	Grab	Monthly
Total Dissolved Solids	mg/L	24-hour composite	Quarterly	Grab	Monthly
Chloride	mg/L	24-hour composite	Quarterly	Grab	Monthly
Sodium	mg/L	24-hour composite	Quarterly	Grab	Monthly
Sulfate	mg/L	24-hour composite	Quarterly	Grab	Monthly
Boron	mg/L	Not Applicable	Not Applicable	Grab	Monthly
Carbonate	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Bicarbonate	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Calcium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Potassium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Magnesium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually

[1] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

C. Effluent Monitoring for Non-Potable Recycled Water Producers

The County of San Luis Obispo is required to comply with the non-potable recycled wastewater monitoring requirements specified in Table 6 and the title 22 Engineering Report. If there is an overlap in constituent-specific monitoring, the title 22 Engineering Report governs. The recycled water storage pond must be monitored in accordance with Table 7.

Table 6. Effluent Monitoring for Non-Potable Recycled Wastewater

Constituent	Units	Sample Type	Sampling Frequency	Sampling Location
Total Coliform Organisms	MPN/100 mL	Grab	Daily	ES-2
Turbidity ^[1]	NTU	Metered	Continuously	MS-1, ES-1

Constituent	Units	Sample Type	Sampling Frequency	Sampling Location
Biochemical Oxygen Demand, 5-Day	mg/L	24-hour composite	Weekly	ES-2
Suspended Solids	mg/L	24-hour composite	Weekly	ES-2
pH	s.u.	Grab	Weekly	ES-2
Total Chlorine Residual	mg/L	Metered	Continuous	ES-2
Ultraviolet Disinfection System transmittance ^[2]	%	Metered	Continuous	UV Lamps
Ultraviolet Disinfection System dose ^[2]	mj/cm ²	Metered	Continuous	UV Lamps
Ultraviolet Disinfection System UV lamp age ^[2]	Hours	Metered	Continuous	UV Lamps
Total Trihalomethanes (TTHMs) – <i>Chloroform, Bromodichloromethane, Dibromochloromethane, Bromoform</i> ^[3]	µg/L	Grab	Monthly	ES-3
Haloacetic Acids (HAAs) <i>Monochloroacetic Acid, Dichloroacetic Acid, Trichloroacetic Acid, Monobromoacetic Acid, Dibromoacetic Acid</i> ^[3]	µg/L	Grab	Monthly	ES-3
Bromate	µg/L	Grab	Monthly	ES-3
Chlorite	µg/L	Grab	Monthly	ES-3

MPN/100mL – most Probable Number per 100 milliliters

s.u. – standard units

NTU - nephelometric Turbidity unit

mj/cm² - millijoules per square centimeter

µg/L – micrograms per liter

- [1] Recycled water shall be sampled for turbidity using a continuous meter and recorder following filtration.
- [2] UV lamp shall be inspected for signs of fouling and proper operation. These parameters are not required to be submitted to GeoTracker as field points. They are required to be included in monitoring reports submitted to GeoTracker.
- [3] If results of 12 consecutive months of sampling are below the MCL, the County of San Luis Obispo may request to reduce the sampling frequency to annually. If annual sampling is allowed, and subsequent annual sampling results are above the MCL, monthly sampling must resume again.

Table 7. Recycled Water Storage Pond Monitoring

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency	Sample Location
Freeboard	0.1 feet	Measured	Weekly	Entire pond
pH	s.u.	Grab	Weekly	ES-4
Dissolved Oxygen (in pond)	mg/L	Grab	Monthly	ES-4
Color	Not applicable	Observation	Monthly	Entire pond
Vegetation in and surrounding ponds	Not Applicable	Observation	Monthly	Entire pond
Berm condition	Not Applicable	Observation	Monthly	Entire pond
Sludge Depth	0.1 feet	Measured	Annually	Pond deepest point

4. WASTEWATER DISPOSAL MONITORING

The County of San Luis Obispo must monitor all wastewater disposal areas when wastewater or recycled water is applied. Inspections (observations) must be conducted as described in Table 8. Records of inspections must be maintained, and problems must be promptly corrected and recorded. Records of these inspections must be maintained onsite and made available to the Central Coast Water Board upon request. Observations do not need to be reported in the monitoring reports unless a violation of permit conditions or issues are observed. If violations are observed, planned and implemented mitigation measures to address the violations must be reported.

The County of San Luis Obispo must evaluate and summarize wastewater/recycled water disposal application rates, loading rates (pounds/acre/day), and violations found during the inspections with each monitoring report.

If wastewater and/or supplemental irrigation water is not discharged to land during a reporting period, the monitoring report must still be submitted and indicate that there was no discharge during the reporting period.

Table 8. Wastewater Disposal Monitoring

Constituent	Units	Sample Type	Monitoring Frequency
Application Rate per Use Area ^[1]	Gallons per day	Metered	Daily
Total Nitrogen Applied ^[2]	lbs/acre/day	Calculated	Monthly
Salts Applied ^[2] (total dissolved solids, sodium, chloride, sulfate, boron)	lbs/acre/day	Calculated	Monthly
Soil Saturation/Ponding	Not Applicable	Observation	Monthly
Nuisance Odors/Vectors	Not Applicable	Observation	Monthly
Discharge Offsite	Not Applicable	Observation	Monthly

- [1] Report how much recycled water goes to Broderson leachfield, Bayridge Estates leachfield, or non-potable reuse. Specifics of the non-potable reuse are to be included in the annual report for San Luis Obispo county's enrollment in the recycled water use general order, WQ 2016-0068-DWQ.
- [2] The total nitrogen, salts, and BOD applied loading rates must be calculated from wastewater flow volumes, applied acreage, and concentrations reported in effluent analytical testing as follows:

Total Nitrogen/Salts/BOD Applied (pounds/acre/ day) =

$$\frac{X \text{ [mg/L]} \times Q \text{ [million gallons per day]} \times 8.34 \text{ [(conversion from mg/L to pounds/million gallons per day)]}}{\text{Acreage Applied [acres]}}$$

Where X = Total nitrogen, salts, or BOD concentration

Where Q = Application Rate (often effluent flow rate)

5. GROUNDWATER MONITORING

Representative samples of groundwater shall be collected and analyzed from the following wells at the following frequencies:

A. Semiannual sampling:

MW-13G, MW-13H, MW-13L5, MW-13Q1, MW-17E9, MW-17F4, MW-17N4, MW-18E1, MW-18J6, MW-18L3, MW-18L4, MW-18N1, MW-18R1, and MW-24A.

B. Semiannual sampling for total trihalomethanes:

MW-24A, MW-18R1

C. Biennial sampling:

MW-7K3, MW-7L3, MW-7N1, MW-7Q1, MW-7R1, MW-8N2, MW-8Ma, MW-8Mb, MW-17D, MW-18A, MW-18B1, and MW-18C1.

San Luis Obispo County has reported that wells 18E and 18A1 are privately owned wells and permission to sample these wells was rescinded by the well owners. The County also reports that well 8Mb has always dry and as such, is an unusable well for water quality sampling. As of the date of this monitoring and reporting program, replacement wells have not been identified by San Luis Obispo County.

Permit Provision 11 requires San Luis Obispo County to install upgradient monitoring wells at the Broderson and Bayridge leachfields. Installation of these wells has not occurred as of the date of this monitoring and reporting program.

Additional wells may be added to the groundwater monitoring program as deemed appropriate by the Central Coast Water Board Executive Officer.

All monitoring wells included in the monitoring well network must be, at a minimum, sampled and analyzed as specified in Table 9 and the Central Coast Water Board approved sampling and analysis plan at the frequencies described in section 5.A, 5.B, and 5.C.

Prior to sampling, depth to groundwater must be measured and groundwater elevations must be calculated. The monitoring wells must be purged of at least three well volumes and until measurements of the following parameters have stabilized (i.e., are reproducible within 10 percent): pH, temperature, dissolved oxygen, electrical conductivity, and turbidity. No-purge, low-flow, or other sampling techniques are acceptable only if they are approved in advance by the Central Coast Water Board and described in an approved sampling and analysis plan. Once the groundwater level in each of the wells has recovered sufficiently to ensure the collection of representative groundwater samples, a qualified individual (e.g., consultant, technician) trained in using proper sampling methods must recover samples using approved USEPA methods. Laboratories analyzing groundwater samples must be accredited by the State Water Board Environmental Laboratory Accreditation Program, in accordance with California Water Code section 13176, and must include quality assurance/quality control data with their reports.

Table 9. Groundwater Monitoring

Constituent	Units	Type of Sample
Groundwater Elevation ^[1]	0.01 ft msl	Calculated
Depth to Groundwater ^[1]	0.01 ft bgs	Measurement
Gradient	feet/feet	Calculated
Groundwater Flow Direction ^[2]	degrees	Calculated
pH	pH Units	Metered
Dissolved Oxygen	mg/L	Metered
Electrical Conductivity	µS/cm ^[3]	Metered

Constituent	Units	Type of Sample
Oxidation Reduction Potential	mV ^[4]	Metered
Temperature	degrees Celsius	Metered
Total Nitrogen ^[5]	mg/L	Calculated
Nitrate (as N)	mg/L	Grab
Nitrite (as N)	mg/L	Grab
Total Kjeldahl Nitrogen (as N)	mg/L	Grab
Ammonia (as N)	mg/L	Grab
Total Dissolved Solids	mg/L	Grab
Chloride	mg/L	Grab
Sodium	mg/L	Grab
Total Trihalomethanes (TTHMs) ^[6] – <i>Chloroform, Bromodichloromethane, Dibromochloromethane, Bromoform</i>	µg/L	Grab

[1] ft.msl denotes feet above mean sea level and ft bgs denotes feet below ground surface.

[2] Calculations must be prepared by, or under the responsibility of, a California licensed professional.

[3] µS/cm denotes microsiemens per centimeter

[4] mV denotes millivolts

[5] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen

[6] Only required to be sampled from wells 24A and 18R1 on a semiannual basis

6. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

The County of San Luis Obispo must report the handling and disposal of all sludge/biosolids generated at the Wastewater System. Records must include the date removed from the Wastewater System if, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

The County of San Luis Obispo must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

If sludge/biosolids are not removed during the year, the County of San Luis Obispo must explain the absence of this monitoring in the annual report.

7. REPORTING REQUIREMENTS

A. Monthly, Quarterly, and Annual Monitoring Reports

Monthly, quarterly, and annual monitoring reports are due as described in Table 10.

Table 10. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
Monthly reports	First to last day of a month	10 th day of the second month after the monitoring period ends
First Quarter Monitoring Report	January 1 to March 31	June 1
Second Quarter Monitoring Report	April 1 to June 30	September 1
Third Quarter Monitoring Report	July 1 to September 30	December 1
Fourth Quarter Monitoring Report	October 1 to December 31	March 1
Annual Report	January 1 to December 31	March 1
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

1. **Monthly Monitoring Report** - Results of total coliform sampling at sample location ES-2 and turbidity monitoring at sample location MS-1 and ES-1 must be reported monthly.
2. **Quarterly Monitoring Reporting** – At a minimum, the quarterly reports must include:
 - i. Results of all required monitoring in tabular format.
 - ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
 - iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the Permit, and an explanation of any violation of those requirements. **The County of San Luis Obispo must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the Permit.** Data must be presented in tabular format.
 - iv. Copies of laboratory analytical report(s) and chain of custody form(s).

- v. An updated hydrogeologic conceptual site model with the groundwater monitoring reporting requirements based on new information generated from the monitoring well boring logs, groundwater elevation data, and water quality data.
 - vi. Copies of groundwater monitoring well field sheets with purge methods and data.
3. **Annual Reporting** – The County of San Luis Obispo must submit annual reports in compliance with Standard Provisions 2013¹, (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by Central Coast Water Board.

The current annual report template can be found here:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

In addition, the annual reports must include the results of groundwater monitoring including well locations and boring logs, groundwater elevation data, and water quality. Contour maps must be included that show groundwater elevations and flow direction, total dissolved solids concentrations, nitrate as N concentrations, and concentrations of any other constituent which may be relevant. Time series graphs must be included showing the concentration of nitrate, total dissolved solids, chloride, and sodium in each of the monitoring wells since the groundwater monitoring program was implemented.

B. State Water Board Volumetric Annual Reporting

The County of San Luis Obispo must electronically certify and submit a summary of the monthly influent and effluent flow volume by April 30th of each calendar year via the State Water Board's Internet GeoTracker database.²

The following information is required:

- i. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e. total monthly influent volume).
- ii. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.

¹ See Attachment E, Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

² See: <https://geotracker.waterboards.ca.gov/>

- iii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website³.

C. Non-compliance Reporting

The County of San Luis Obispo must notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, the conditionally accepted title 22 Engineering Report requirements, delivery of off-specification recycle water, and wastewater containment failure, pursuant to Standard Provisions⁴, C.3, C.4, and C.5 (and any updates to the Standard Provisions).

D. Electronic Geotracker Submittal

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permittting/docs/wdr-transmittal-sheet.pdf

The County of San Luis Obispo must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker^{5,6} database consistent with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System-specific global identification number WDR100039574 at:

<https://geotracker.waterboards.ca.gov/esi/login>

For general questions, please contact the GeoTracker Help Desk at:
Geotracker@waterboards.ca.gov.

Table 11 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board may request submittal of some documents on paper, particularly

³ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

⁴ Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

⁵ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

⁶ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

Table 11. GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your California ELAP-accredited laboratory staff to upload, all EDF laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.
Field Points, Location Data (Geo XY) ^[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data." These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.

Electronic Submittal	Description of Action	Action	Frequency
Elevation Data (Geo Z) ^[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Wastewater System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. The County of San Luis Obispo must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

8. TECHNICAL REPORTS

The technical reports are due as described in Table 12.

Table 12. Technical Report Submittal Due Dates

Report	Report Due Date
Operations and Maintenance Manual	July 1, 2025

A. Operations and Maintenance Manual

In addition to the required components specified in Standard Provisions⁷ A.12 and A.28 (and any updates to the Standard Provisions), the Operations and Maintenance Manual must contain the following components. Each component must contain an implementation schedule and identification of adequate funding to implement the component.

- i. **Sampling and Analysis Plan** – The County of San Luis Obispo’s Operation and Maintenance Manual must contain a sampling and analysis plan that meets the requirements specified herein. Anyone performing sampling on behalf of the County of San Luis Obispo must be familiar with the sampling

⁷ See Attachment E, Standard Provisions, 2013:
https://www.waterboards.ca.gov/centralcoast/board_decisions/decisions/wdr_standard_provisions_2013.pdf

and analysis plan. At a minimum, the sampling and analysis plan must contain the following:

- a. A wastewater treatment process flow schematic with the monitoring locations labeled and scaled Wastewater System maps with treatment components, discharge locations (both treated wastewater and non-potable recycled water), monitoring locations, groundwater wells, storage locations (e.g., chemical, sludge, emergency overflow ponds), and buildings. (if the County of San Luis Obispo needs to update Figure 1 or 2 to comply with this requirement, a copy of the updated process flow schematic will also be included with the annual report).
 - b. Sample identification details in tabular format. The table must include the sample titles, GeoTracker field point information, sample description(s), and sampling frequencies.
 - c. Sample chain-of-custody procedures and documentation.
 - d. Sample handling/preservation procedures.
 - e. A description of the analytical methods.
 - f. A description of sample containers, preservatives, and holding times.
 - g. For water supply monitoring, a description of the location and method of data collection (e.g., onsite well sampling, use of consumer confidence report).
 - h. For groundwater monitoring, a description of the well purging and field methods.
- i. **Sludge Management Plan** – The County of San Luis Obispo’s Operation and Maintenance Manual must contain a sludge management plan that is sufficient to ensure compliance with the terms of the Permit. At a minimum, the plan must describe the following:
- a. An estimated volume/amount and quality of sludge and scum that will be generated.
 - b. How sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.
 - c. If sludge will be subject to further treatment, describe the treatment and storage requirements.
 - d. Procedures for cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.
- ii. **Wastewater Disposal Management Plan** – The County of San Luis Obispo’s Operation and Maintenance Manual must contain a wastewater disposal management plan that is sufficient to ensure compliance with the terms of the Permit. At a minimum, the wastewater disposal management plan must include:

- a. A description of the wastewater disposal area and a map denoting acreage.
 - b. Loading calculations based on flow volumes, applied acreage, and biochemical oxygen demand, salts (total dissolved solids, sodium, chloride, sulfate, boron), and nitrogen analytical results.
 - c. A description of wastewater disposal and water quality protection practices.
- iii. **Spill Prevention and Emergency Response Plan** –The County of San Luis Obispo’s Operation and Maintenance Manual must contain a spill prevention and emergency response plan that is sufficient to ensure compliance with the terms of the Permit. The spill prevention and emergency response plan must describe operation and maintenance activities to prevent accidental releases of wastewater and to effectively respond to such releases and minimize the environmental impact. At a minimum, the spill prevention and emergency response plan must address the following:
 - a. Operation and Control of Wastewater System - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.
 - b. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.
 - c. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order WQ 2022-0103-DWQ, Statewide Waste Discharge Requirements General Order for Sanitary Sewer Systems (or its replacement), reports prepared to comply with State Water Board Order WQ 2022-0103-DWQ satisfy this requirement.
 - d. Emergency Response - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater treatment, storage, or disposal ponds or treated non-potable recycled water storage ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.
 - e. Finance - At a minimum, discuss current fees, projected fees, current budget for spill prevention and emergency response, projected budget for spill prevention and emergency response.

- f. Notification Procedures - Coordination procedures with fire, police, Governor's Office of Emergency Services (CalOES), Central Coast Water Board, and local county health department personnel.
- iv. **Training Records Log** – The County of San Luis Obispo's Operation and Maintenance Manual must contain updated training records logs.

9. LEGAL REQUIREMENTS

The Central Coast Water Board requires The County of San Luis Obispo to submit the technical and monitoring reports described in this monitoring and reporting program pursuant to [California Water Code section 13267](#). Failure to submit reports in accordance with the schedules established by the Permit or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject The County of San Luis Obispo to enforcement action pursuant to [California Water Code section 13268](#).

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the Permit and to protect water quality. The County of San Luis Obispo is required to submit this information because it is subject to the Permit and is responsible for the discharge.

The County of San Luis Obispo must implement the above monitoring program on July 1, 2024. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. The County of San Luis Obispo must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered By:

 Digitally signed by Jennifer Epp
Date: 2024.06.27 15:41:00
-07'00'
Water Boards

for Ryan E. Lodge
Executive Officer

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\San Luis Obispo Co\Los Osos\1_Recycled Water production\1- Permit\WDR Order No. R3-2011-0001 (active)\3 - Revised MRP 2024\MRP revision 2024\Revised MRP Los Osos WRF 2024_Final.docx