

716

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 88-104

WASTE DISCHARGE REQUIREMENTS
FOR
SANTA NELLA COUNTY WATER DISTRICT
MERCED COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Santa Nella County Water District (hereafter Discharger) submitted a Report of Waste Discharge, dated 23 September 1986, and a site evaluation report, dated 10 October 1986.
2. The Board, on 13 December 1969, adopted Resolution No. 69-86 which prescribed requirements for a discharge from a secondary treatment unit to stabilization ponds.
3. Present waste discharge requirements established by Resolution No. 69-86 are neither adequate nor consistent with plans and policies of the Board.
4. The Discharger currently discharges about 0.13 mgd from a package treatment plant and an aerated lagoon to three holding ponds and on to a privately owned 30-acre pasture area. The current design capacity for these facilities is 0.205 mgd.
5. The Discharger plans to purchase the 30-acre pasture area and an additional 70 acres for additional treatment and disposal capacity. The expanded facility will have a design capacity of 0.4 mgd and will consist of the current treatment facility (a package treatment plant and an aerated lagoon followed by three holding ponds) with additional treatment provided by three facultative lagoons. Effluent from all the treatment facilities will be combined prior to final disposal to a 90-acre pasture area.
6. The facilities are in the NW 1/4 of the NE 1/4 of Section 6, T10S, R9E, and the SE 1/4 of Section 31, T9S, R9E, MDB&M, with surface water drainage to the San Luis Wasteway and thence to the San Luis Holding Reservoir.
7. The beneficial uses of the San Luis Holding Reservoir are municipal and industrial supply; recreation; fresh water habitat; fish spawning; and wildlife habitat.
8. The beneficial uses of the ground water are domestic and agricultural supply.
9. The Board, on 25 July 1975, adopted a Water Quality Control Plan for the San Joaquin River Basin (5C) which contains water quality objectives. These requirements are consistent with that Plan.

WASTE DISCHARGE REQUIREMENTS
SANTA NELLA COUNTY WATER DISTRICT
MERCED COUNTY

-2-

10. Santa Nella County Water District has adopted a final negative declaration in accordance with the California Environmental Quality Act (Public Resources Code Section 21000, et seq.), and the State Guidelines.
11. The Board has reviewed the negative declaration and concurs there are no significant impacts on water quality.
12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Resolution No. 69-86 be rescinded and Santa Nella County Water District, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste is prohibited.

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a pollution or nuisance as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal area at all times.
4. The 30-day average daily dry weather discharge flow shall not exceed 0.4 million gallons.
5. The discharge shall not contain constituents in excess of the following concentrations:

WASTE DISCHARGE REQUIREMENTS
SANTA NELLA COUNTY WATER DISTRICT
MERCED COUNTY

-3-

<u>Constituents</u>	<u>Units</u>	<u>Monthly Average</u>	<u>Daily Maximum</u>
BOD ₅ ^{1/}	mg/l	40	80
Settleable Matter	ml/l	0.5	1.0

1/ Five-day, 20° Celsius Biochemical Oxygen Demand. BOD₅ limitation shall apply to discharge from the package treatment plant.

6. The dissolved oxygen content of holding ponds shall not be less than 1.0 mg/l for 16 hours in any 24-hour period.
7. There shall be no irrigation or impoundment of wastewater within 500 feet of any domestic water well and within 100 feet of any irrigation well unless it is demonstrated to the satisfaction of the Executive Officer that a lesser distance is justified.
8. The direct use of reclaimed wastewater is limited to surface irrigation of pasture area for non-dairy cattle.
9. Wastewater shall not be a source of water supply for beef cattle.
10. Cattle shall be precluded from the disposal area until the field is thoroughly dry.
11. There shall be no visible standing water in any disposal area for more than 48 consecutive hours.
12. Uses made of reclaimed wastewaters must comply with the provisions of Articles 2, 3, 4, and 5, Chapter 3, Division 4, Title 22, California Code of Regulations, and further, the landowner or operator must obtain written approval from the Executive Officer prior to use of reclaimed wastewater for uses other than those listed in Specification No. 8.
13. Public access to the treatment and disposal facilities shall be precluded through a satisfactory combination of signing and/or fencing, or some other equivalent alternative.
14. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.

C. Provisions:


1. The Discharger may be required to submit technical reports as directed by the Executive Officer.

WASTE DISCHARGE REQUIREMENTS
SANTA NELLA COUNTY WATER DISTRICT
MERCED COUNTY

-4-

2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 88-104.
3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 September 1985, which are a part of this Order.
4. The Discharger shall report promptly to the Board any material change or proposed change in the character, locations, or volume of the discharge.
5. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
6. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 24 June 1988.


WILLIAM H. CROOKS, Executive Officer

BY:bro:5/16/88

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 88-104

FOR
SANTA NELLA COUNTY WATER DISTRICT
MERCED COUNTY

INFLUENT MONITORING

Influent samples shall be collected at approximately the same time as effluent samples and shall be representative of the influent for the period sampled. The following shall constitute the influent monitoring program:

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Total Daily Flow	mgd	Continuous	Daily
BOD ₅ ^{1/}	mg/l	Grab	Monthly

1/ Five-day, 20° Celsius Biochemical Oxygen Demand.

EFFLUENT MONITORING

Effluent samples shall be collected downstream from the last connection through which wastes can be admitted into the outfall and prior to discharge to disposal sites. Effluent samples should be representative of the volume and nature of the discharge. Samples collected from the outlet structure of ponds will be considered adequately composited. Time of collection of a grab sample shall be recorded. The following shall constitute the effluent monitoring program:

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
BOD ₅ ^{1/}	mg/l	Grab	2/month
Dissolved Oxygen ^{2/}	mg/l	Grab	Weekly
Settleable Matter ^{3/}	ml/l	Grab	Weekly

1/ Five-day, 20° Celsius Biochemical Oxygen Demand. BOD₅ samples shall be collected at the outfall from the package treatment plant and at the outfall from final pond prior to disposal.

2/ Samples to be collected from opposite the inlet structure of each pond and lagoon between the hours of 0800 and 0900.

3/ The Settleable Matter shall be determined during periods when the pasture area is used for disposal.

MONITORING AND REPORTING PROGRAM
SANTA NELLA COUNTY WATER DISTRICT
MERCED COUNTY

-2-

If the discharge is intermittent rather than continuous, then on the first day of each such intermittent discharge, the Discharger shall monitor and record data for all of the constituents listed above, after which the frequencies of analysis given in the schedule shall apply for the duration of each such intermittent discharge. In no event shall the Discharger be required to monitor and record data more often than twice the frequencies listed in the schedule.

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the 15th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by 30 January of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring program on the effective date of this Order.

Ordered by William H. Crooks
WILLIAM H. CROOKS, Executive Officer

24 June 1988
(Date)

BY:bro

5/16/88

INFORMATION SHEET

SANTA NELLA COUNTY WATER DISTRICT MERCED COUNTY

The Santa Nella County Water District currently owns and operates a wastewater treatment facility 1/4 mile west of Highway 33 on San Luis Road in the NW 1/4 of the NE 1/4 of Section 6, T10S, R9E, MDB&M. This facility consists of a package treatment plant, an aerated lagoon and three holding ponds. Disposal is to a privately owned 30-acre pasture for beef cattle. Present design capacity is 0.205 mgd.

The Discharger plans to purchase the 30-acre pasture area and an additional 70 acres for expansion of the treatment and disposal facilities. The additional 100 acres are adjacent and to the north of the current facility in the SE 1/4 of Section 31, T9S, R9E, MDB&M. The expanded treatment facility will have, in addition to the current treatment facility, three facultative lagoons. Effluent from all the treatment facilities will be combined prior to final disposal to a 90-acre pasture for beef cattle. The design capacity of the expanded facility will be 0.4 mgd.

Resolution No. 69-86, which regulates the discharge from this facility, is neither adequate nor consistent with plans and policies of the Board.

Surface water drainage is to the San Luis Wasteway and thence to the San Luis Holding Reservoir. The beneficial uses of the San Luis Holding Reservoir are municipal and industrial supply, recreation, fresh water habitat, fish spawning, and wildlife habitat.

Ground water in the area is found at a depth of 12 to 16 feet with a specific electrical conductivity of about 880 umhos/cm.


Average precipitation and evaporation rates for the area are about 8 and 65 inches per year, respectively.

Soils in the area consist of "Westside" Alluvium of relatively low permeability.

Santa Nella County Water District has adopted a final negative declaration in accordance with the California Environmental Quality Act (Public Resources Code Section 21000, et.seq.), and the the State Guidelines.

BY:bro

5/16/88

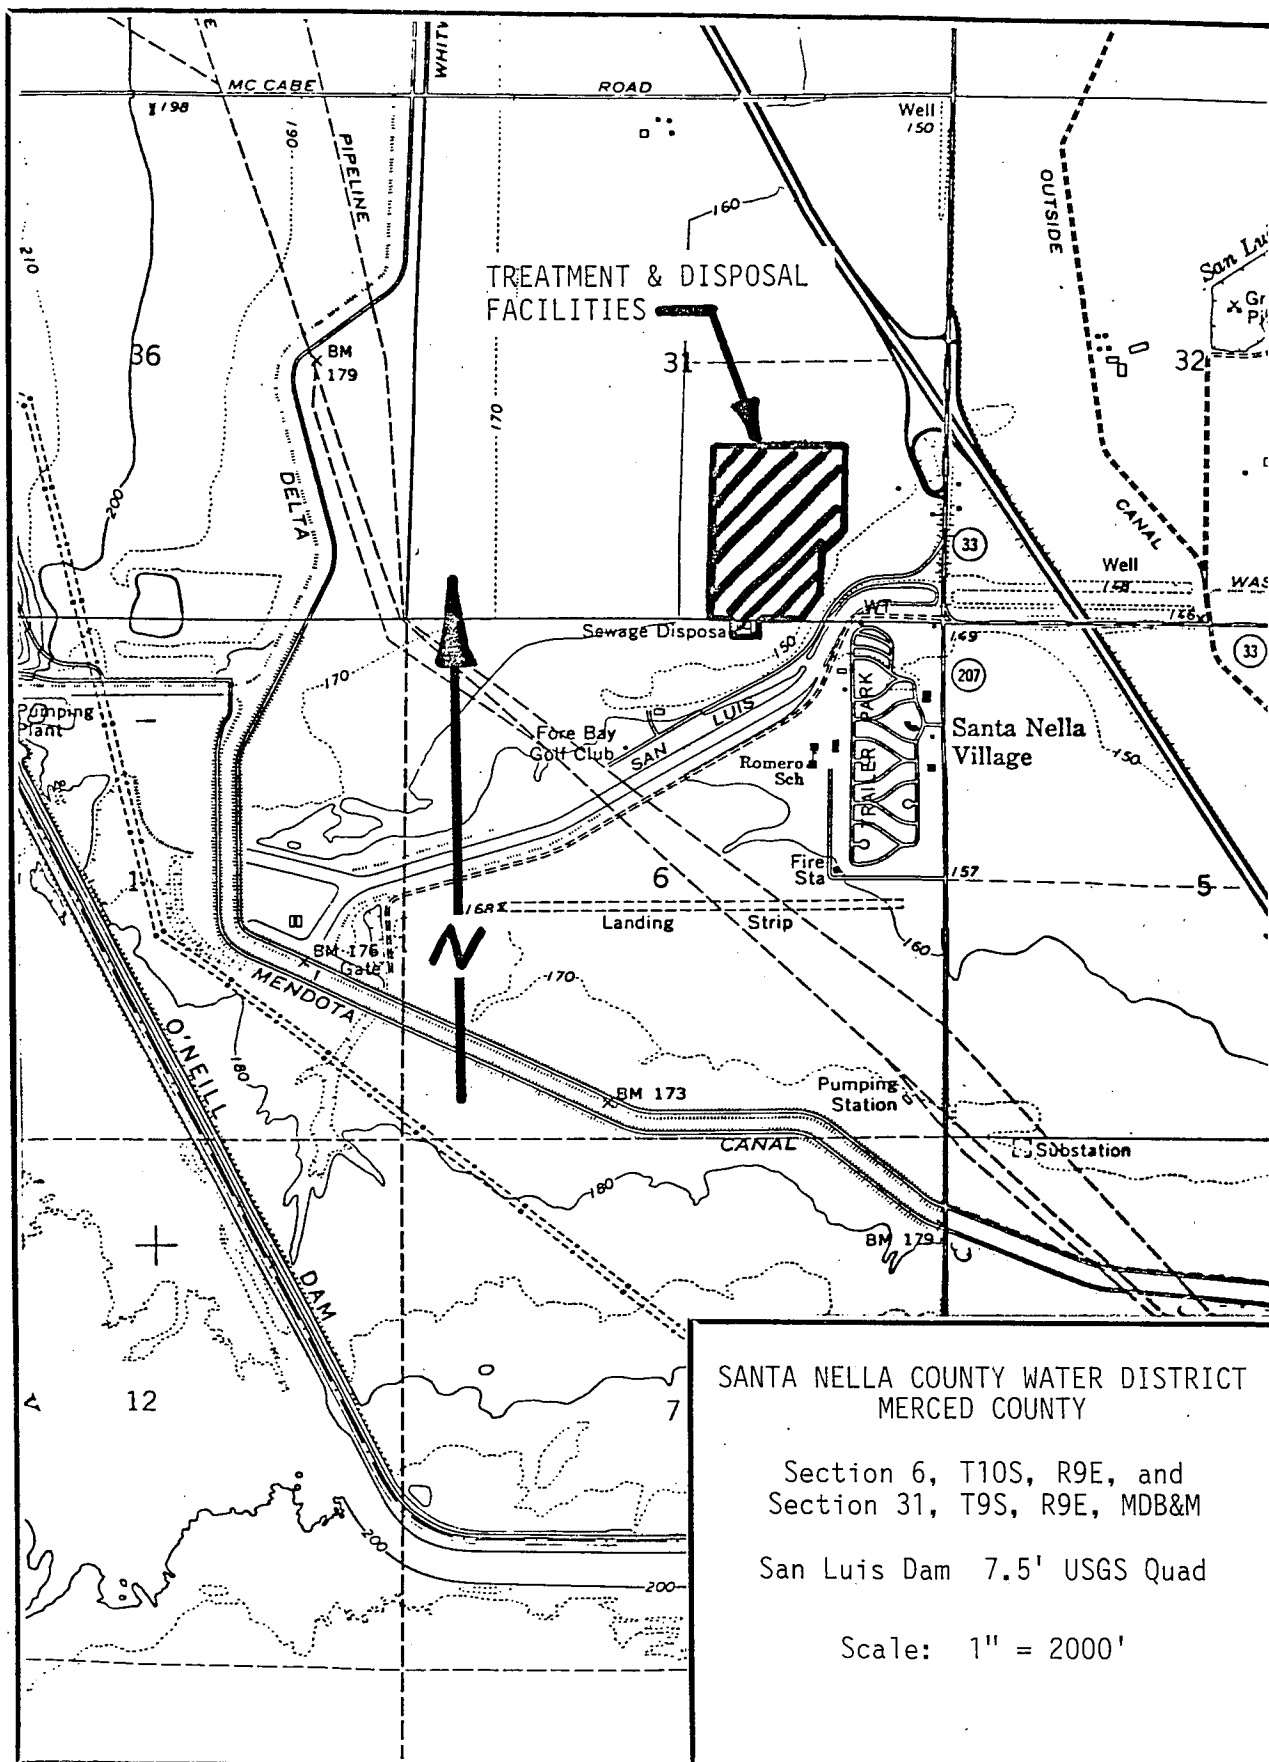

SANTA NELLA COUNTY WATER DISTRICT
MERCED COUNTY

Section 6, T10S, R9E, and
Section 31, T9S, R9E, MDB&M

San Luis Dam 7.5' USGS Quad

Scale: 1" = 2000'