

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 83-093

WASTE DISCHARGE REQUIREMENTS
FOR
UNITED STATES AIR FORCE
MATHER AIR FORCE BASE
SACRAMENTO COUNTY

*Approved by Board
Updating the Discharge
Requirements
4-11-83*

The California Regional Water Quality Control Board, Central Valley Region (hereafter Board), finds that:

1. Mather Air Force Base (hereafter Discharger) submitted a report of waste discharge and soil boring information dated 9 March 1983, to obtain requirements for temporary storage of raw sewage prior to discharge to the Sacramento County Regional Wastewater System.
2. The Board, on 28 July 1978, adopted Order No. 78-75 (NPDES No. CA0004278), which prescribed requirements for a discharge of domestic and industrial waste to Morrison Creek.
3. In December 1982, the Mather wastewater facility was connected to the Regional System, to which all wastewater generated on site now flows. A discharge of wastewater to surface waters or surface water drainage courses no longer occurs.
4. The Regional System can accept a maximum of 2.0 million gallons per day (mgd) from the Discharger. Historical flow records at Mather show that peak flows of 4.8 mgd occur, for periods of up to seven days. The Discharger has therefore calculated that 27 million gallons (83 acre-feet) of storage is required to contain peak flows until they can be diverted to the Regional System. This will be provided by two of the existing 8.5 acre ponds, each with an average depth of approximately four feet.
5. The soil boring information submitted by the Discharger shows several feet of clay strata beneath the ponds. Infiltration of wastewater to ground water, at a depth of about 130 feet, is expected to be minimal.
6. The Discharger proposes to discharge a maximum 3.8 mgd, for a total of 83 acre-feet per week of domestic wastewater to ponds for temporary storage, in Section 15, T8N, R6E, MDB&M, with surface water drainage to Morrison Creek.
7. Surface runoff from base housing, administration facilities and runways drains to Morrison Creek.
8. The beneficial uses of Morrison Creek are industrial and agricultural supply; recreation; esthetic enjoyment; ground water recharge; and preservation and enhancement of fish, wildlife and other aquatic resources.
9. The beneficial uses of the ground water are municipal and agricultural supply.

WASTE DISCHARGE REQUIREMENTS
UNITED STATES AIR FORCE
MATHER AIR FORCE BASE
SACRAMENTO COUNTY

-2-

10. The Board, on 25 July 1975, adopted a Water Quality Control Plan for the Sacramento-San Joaquin Delta Basin (5B) which contains water quality objectives. These requirements are consistent with that plan.
11. The action to adopt waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15101(I)(d), Title 14, California Administrative Code.
12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED, that Order No. 78-75 (NPDES No. CA0004278) be rescinded and United States Air Force, Mather Air Force Base, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste to surface waters or surface water drainage courses is prohibited.

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a pollution or nuisance as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal area (map attached) at all times.
4. The 7-day average discharge shall not exceed 3.8 million gallons per day (14,385 m³/d). The total amount of wastewater stored in ponds shall not exceed 83 acre-feet (102,340 m³).
5. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
6. The dissolved oxygen content of holding ponds shall not be less than 1.0 mg/l for 16 hours in any 24-hour period.

WASTE DISCHARGE REQUIREMENTS
UNITED STATES AIR FORCE
MATHER AIR FORCE BASE
SACRAMENTO COUNTY

-3-

7. The holding ponds shall have a minimum freeboard of 1.0 feet (0.3 m) at all times.

C. Provisions:

1. The Discharger may be required to submit technical or monitoring reports as directed by the Executive Officer.
2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 83-093.
3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 21 September 1979, which are a part of this Order.
4. The Discharger shall report promptly to the Board any material change or proposed change in the character, location, or volume of the discharge.
5. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
6. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 12 August 1983.



WILLIAM H. CROOKS, Executive Officer

CBM:dg
Revised 7/22/83

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 83-093

FOR
UNITED STATES AIR FORCE
MATHER AIR FORCE BASE
SACRAMENTO COUNTY

POND MONITORING

On the first day of each discharge to the ponds, the Discharger shall begin the monitoring and recording of data for all of the constituents listed below. The frequencies of analysis given in the schedule shall then apply, as long as the ponds contain wastewater.

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Influent Flow	mgd & AF Total	Continuous	Daily *
Effluent Flow	mgd & AF Total	Continuous	Daily *
Dissolved Oxygen	mg/l	Grab	Weekly
Freeboard	feet	Observation	Weekly

* Daily average flows (mgd) and total quantity (AF) for each discharge period.

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board quarterly, by the 15th day of the month following the end of the quarter.

The results of any monitoring done more frequently than required in this Monitoring and Reporting Program shall be reported to the Board.

The Discharger shall implement the above monitoring program on the effective date of this Order.

Ordered by



WILLIAM H. CROOKS, Executive Officer

12 August 1983

(Date)

INFORMATION SHEET


UNITED STATES AIR FORCE
MATHER AIR FORCE BASE
SACRAMENTO COUNTY

Mather Air Force Base submitted a Report of Waste Discharge for revised requirements, to reflect the connection of their wastewater facilities to the Sacramento Regional Wastewater Treatment Plant. In December 1982, Mather connected their facilities to the Regional System, and by June 1983 had ceased surface water discharges of wastewater from on-site.

The Regional System can accept a maximum of 2.0 mgd of wastewater from Mather. Since peak flows from the base in the past have reached 4.8 mgd over a seven day period, it was calculated that 27 million gallons (83 acre-feet) of temporary storage would be required on-site. Ponds No. 2 and 4 (see map), each with about 8.5 acres of surface area and an average depth of 4.0 feet will provide this storage. No surface water discharge will occur from the holding ponds - wastewater stored in them will flow to the Regional System when conditions permit.

Surface runoff from the base grounds, including runways, flows to Morrison Creek.

CBM:dg
Revised 7/22/83

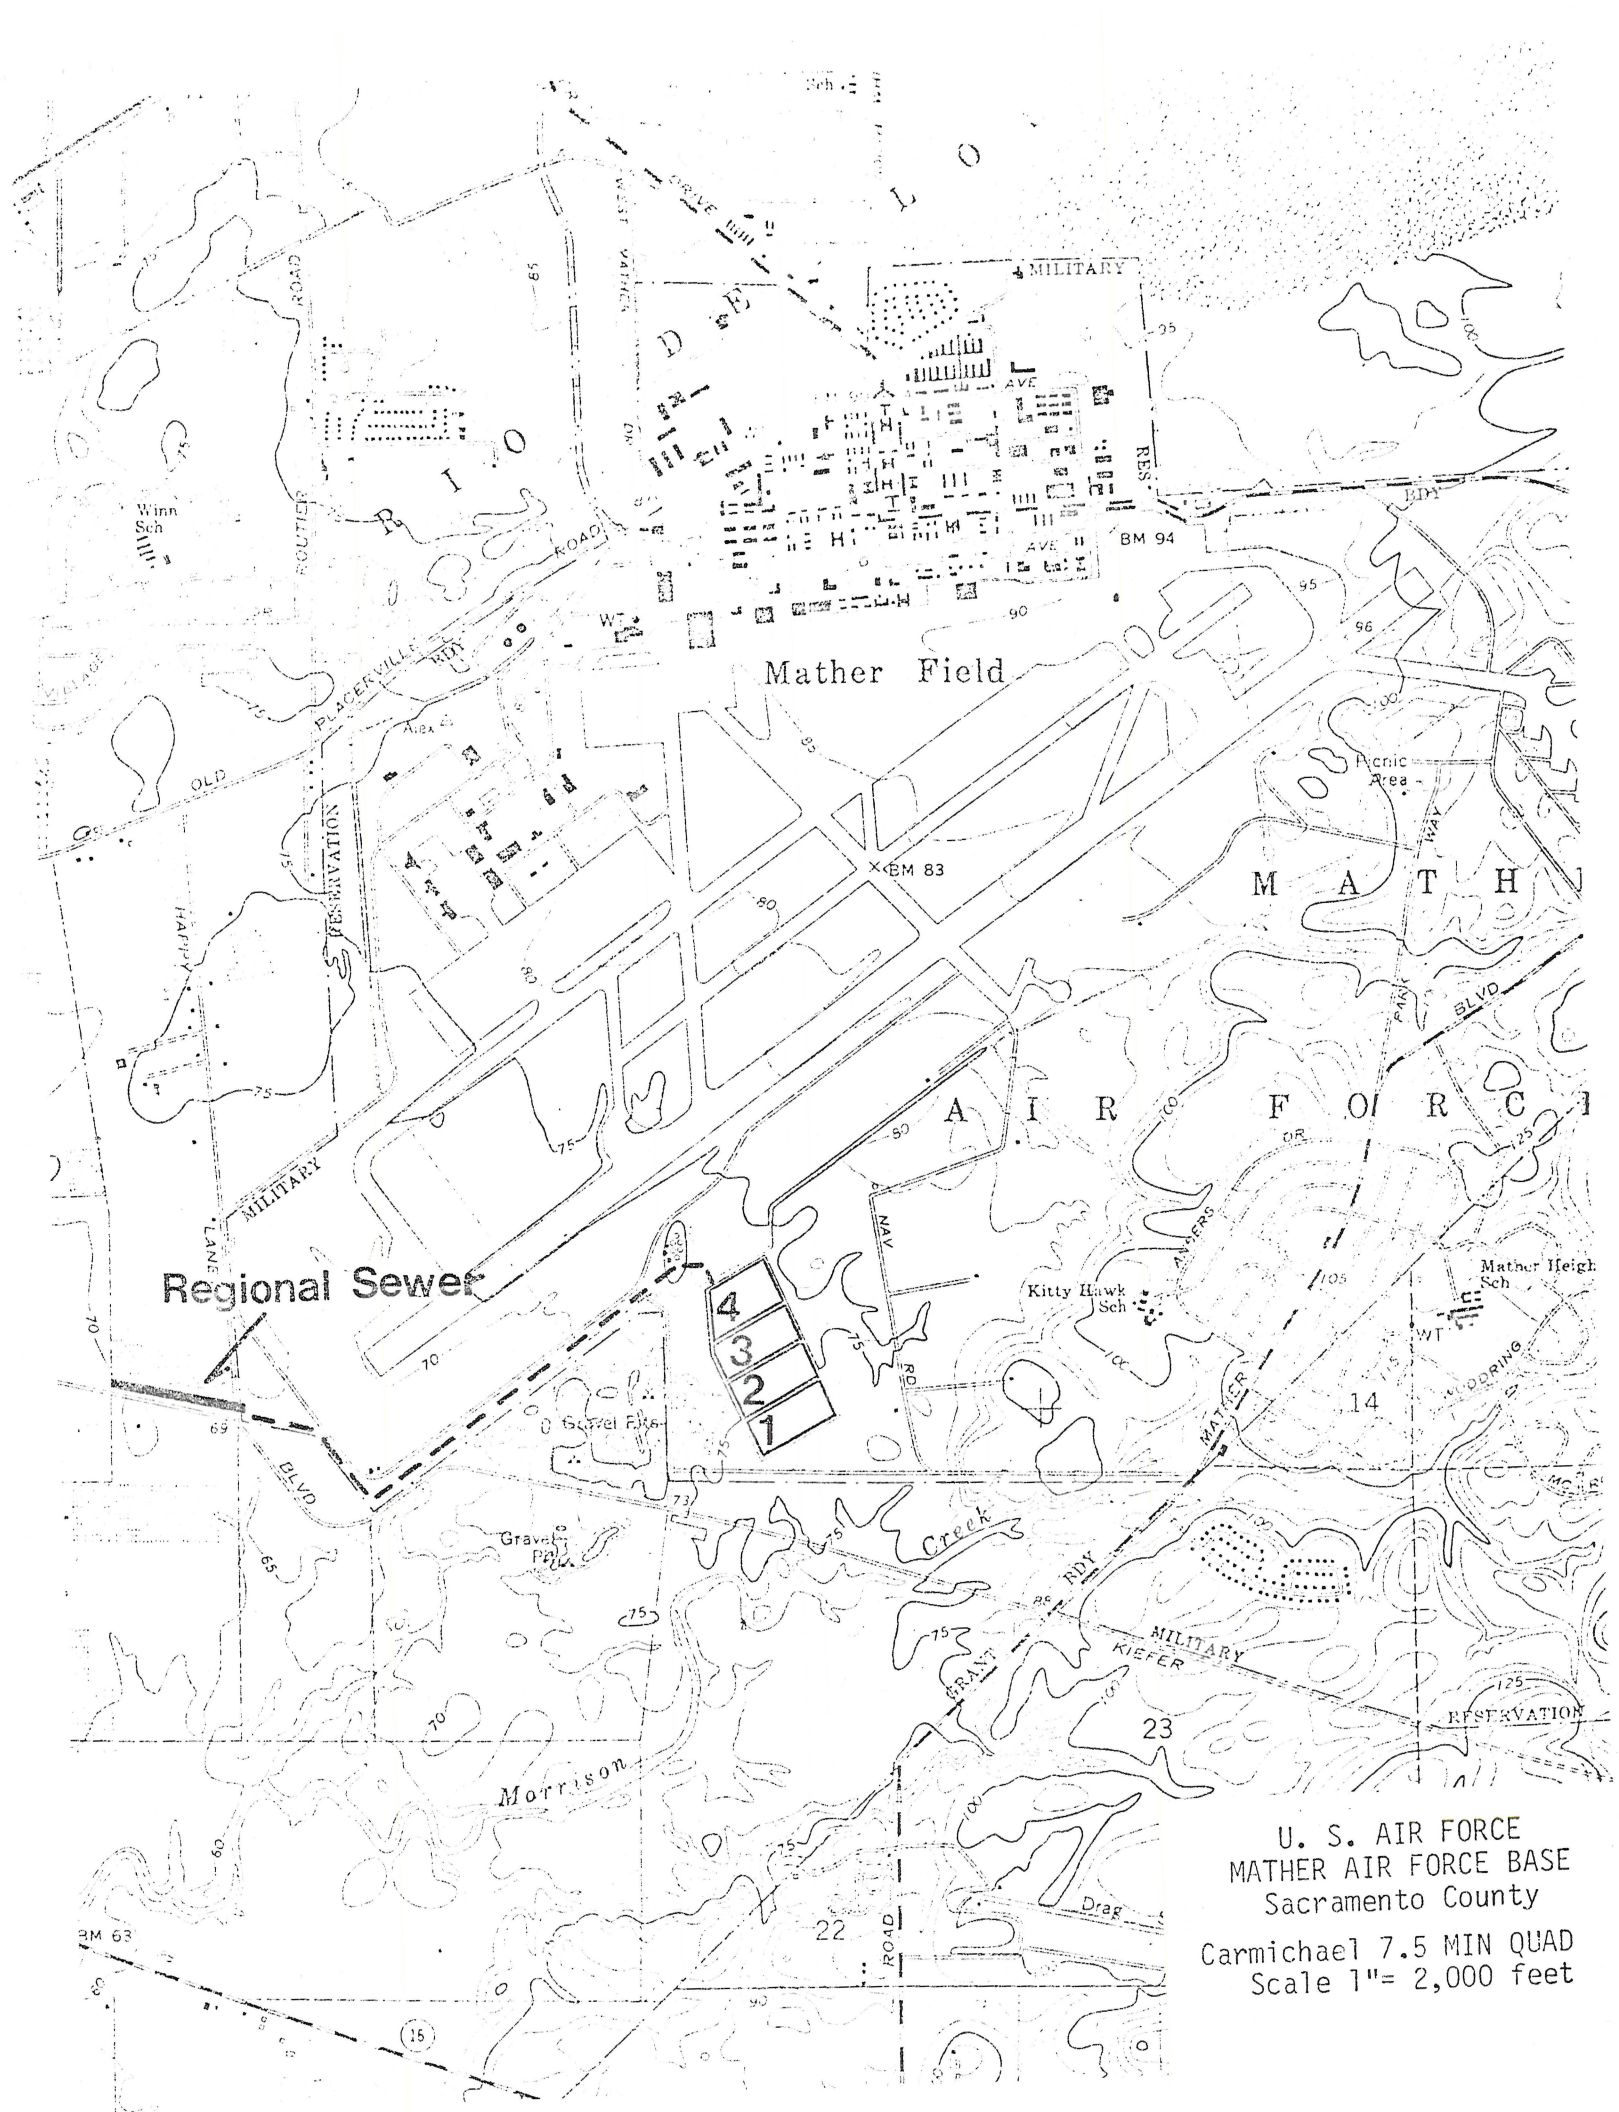

U. S. AIR FORCE
MATHER AIR FORCE BASE
Sacramento County
Carmichael 7.5 MIN QUAD
Scale 1"= 2,000 feet