

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 87-113

WASTE DISCHARGE REQUIREMENTS
FOR
LOST HILLS SANITARY DISTRICT
WASTEWATER TREATMENT FACILITY
KERN COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. The Lost Hills Sanitary District (hereafter Discharger) owns and operates the wastewater treatment and disposal facilities for the community of Lost Hills. The community of Lost Hills is 2 miles west of Interstate 5 along Highway 46.
2. The Board, on 24 October 1980, adopted Order No. 80-160 which prescribed requirements for a discharge of domestic waste from a wastewater treatment facility operated by the Discharger.
3. Present waste discharge requirements established by Order No. 80-160 are neither adequate nor consistent with plans and policies of the Board.
4. The treatment and disposal facilities consist of two, 4-acre stabilization ponds, one emergency overflow pond, and three, 8-acre evaporation/percolation fields.
5. The current average flow at the facility is about 46,000 gallons per day (gpd). The facility was designed for an average flow of 200,000 gpd and a peak wet weather flow of 800,000 gpd.
6. The treatment and disposal facilities are in Section 35, T26S, R21E, MDB&M, several miles from the nearest surface water.
7. The beneficial use of the ground water is agricultural supply.
8. The Board, on 25 July 1975, adopted a Water Quality Control Plan for the Tulare Lake Basin (5D) which contains water quality objectives. These requirements are consistent with that Plan.
9. The action to update waste discharge requirements for this existing facility is exempt from the provisions of the California Environmental Quality Act, in accordance with Section 15301, Title 14, California Administrative Code.
10. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.

WASTE DISCHARGE REQUIREMENTS
LOST HILLS SANITARY DISTRICT
WASTEWATER TREATMENT FACILITY
KERN COUNTY

-2-

11. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 80-160 be rescinded and the Lost Hills Sanitary District, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste is prohibited.

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a pollution or nuisance as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal area at all times.
4. The 30-day average daily dry weather discharge flow shall not exceed 0.20 million gallons.
5. The 30-day average of settleable solids shall not exceed 0.5 ml/l.
6. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
7. Reclaimed wastewater shall meet the criteria contained in Title 22, Division 4, California Administrative Code (Section 60301, et seq.).
8. The dissolved oxygen content of holding ponds shall not be less than 1.0 mg/l for 16 hours in any 24-hour period.
9. The maximum electrical conductivity (EC) of the discharge shall not exceed the average EC of the source water plus 500 micromhos/cm.
10. Public access shall be precluded from the treatment and disposal areas through a satisfactory combination of fencing and posting or an acceptable alternative.


WASTE DISCHARGE REQUIREMENTS
LOST HILLS SANITARY DISTRICT
WASTEWATER TREATMENT FACILITY
KERN COUNTY

-3-

C. Provisions:

1. The Discharger may be required to submit technical reports as directed by the Executive Officer.
2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 87-113.
3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 September 1985, which are a part of this Order.
4. The Discharger shall report promptly to the Board any material change or proposed change in the character, locations, or volume of the discharge.
5. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
6. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 26 June 1987.


WILLIAM H. CROOKS, Executive Officer

RWW:bro:4/22/87

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 87-113

FOR
LOST HILLS SANITARY DISTRICT
WASTEWATER TREATMENT FACILITY
KERN COUNTY

EFFLUENT MONITORING

Effluent samples shall be collected from the outfall from the final stabilization pond, prior to discharge to the evaporation/percolation fields, except as noted for dissolved oxygen. The following shall constitute the effluent monitoring program:

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Dissolved Oxygen ^{1/}	mg/l	Grab	Weekly
Settleable Solids	ml/l	Grab	Weekly
Mean Daily Flow	mgd	Continuous	Daily
Electrical Conductivity	umhos/cm	Grab	<u>2/</u>

1/ Dissolved oxygen samples shall be collected from each pond at a point near the outlet.

2/ Effluent wastewater shall be monitored monthly; source water shall be monitored annually.

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the 15th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by 30 January of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In

MONITORING AND REPORTING PROGRAM
LOST HILLS SANITARY DISTRICT
WASTEWATER TREATMENT FACILITY
KERN COUNTY

-2-

addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring program on the effective date of this Order.

Ordered by

William H. Crooks
WILLIAM H. CROOKS, Executive Officer

26 June 1987
(Date)

RWW:bro

4/22/87

INFORMATION SHEET

LOST HILLS SANITARY DISTRICT
WASTEWATER TREATMENT FACILITY
KERN COUNTY

Lost Hills is an unincorporated rural community in northwestern Kern County, in portions of Section 34, T26S, R21E, and Section 3, T27S, R21E, MDB&M. Lost Hills is 2 miles west of Interstate 5 along Highway 46. The population is approximately 900 people.

The Lost Hills Sanitary District owns and operates the wastewater treatment and disposal facilities in Section 35, T26S, R21E, MDB&M. The nearest surface water is several miles away.

The treatment and disposal facilities consist of two, 4-acre stabilization ponds, one emergency overflow pond, and three, 8-acre evaporation/percolation fields. The current average flow at the facility is approximately 46,000 gallons per day (gpd). The facility was designed for an average flow of 200,000 gpd and a peak wet weather flow of 800,000 gpd.

Soils in the area are classified as Milham Sandy loam. A hardpan layer exists throughout a major portion of the town at a depth of 3 to 7 feet and severely limits the drainage rate.


Unconfirmed ground water occurs at a depth of about 60 feet with total dissolved solids (TDS) values ranging from 5000 to 7000 mg/l. Depth to the confined aquifer is 80 feet at Lost Hills with TDS values of 6000 to 8000 mg/l. There are some beneficial uses of areal ground waters involving agricultural irrigation. Domestic water is supplied to Lost Hills by a private water company from wells 10 miles distant from the community.

The mean annual precipitation in the area is about 5 inches and the mean annual evaporation is about 67 inches.

The action to adopt waste discharge requirements for this existing facility is exempt from the provisions of the California Environmental Quality Act, in accordance with Section 15301, Title 14, California Administrative Code.

RWW:bro

4/22/87

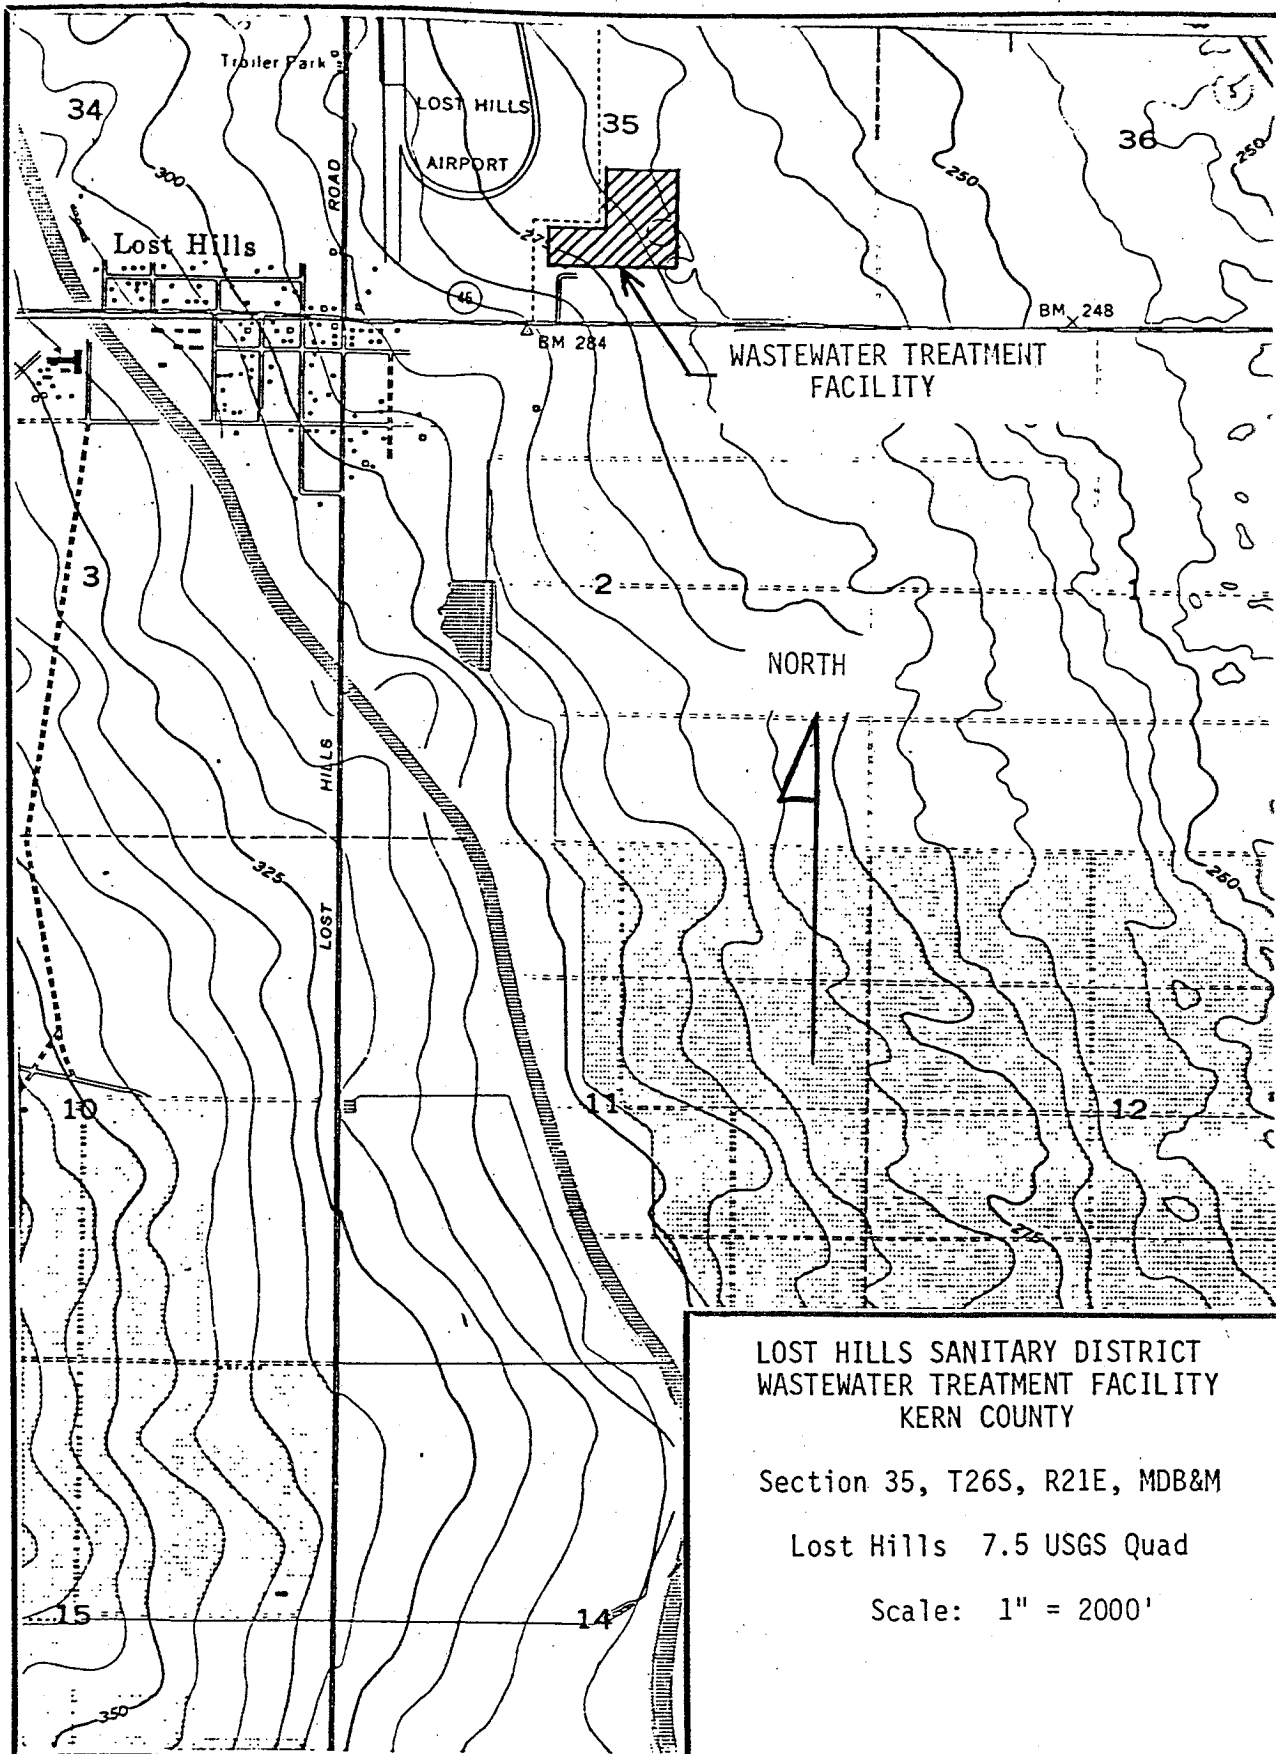

Handwritten text, likely a letter or document, written in cursive script. The text is extremely faint and illegible due to the quality of the scan. It appears to be a single page of writing, possibly a letter, with a date at the top right and a signature at the bottom right.