

~~BCW~~
mcw

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 88-106

WASTE DISCHARGE REQUIREMENTS
FOR
FOREST SPRINGS MOBILE HOME COMMUNITY
ALFRED F. TUCKER, JAMES H. TUCKER,
AND
JERALD A. TUCKER
DBA FOREST SPRINGS ASSOCIATES
NEVADA COUNTY

3B

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Forest Springs Associates. Alfred F. Tucker, James H. Tucker and Jerald A. Tucker, dba Forest Springs Associates (hereafter Discharger) submitted a Report of Waste Discharge, dated 22 January 1988, and a site evaluation report, dated April 1988, for revised waste discharge requirements (WDRs). The property (Assessor's Parcel Nos. 23-331-33 and 23-230-16) is owned by Forest Springs Associates.
2. The Board, on 28 September 1984, adopted Order No. 84-111, which prescribed requirements for a discharge of 55,000 gpd average dry weather flow from two parallel sets of two 1,500 gallon septic tanks and two aerated percolation ponds operated in series. Disposal is supplemented by 4.8 acres of spray fields. The present system serves 239 units.
3. The Discharger proposes to expand their existing wastewater treatment/disposal capacity by 30,000 gpd (120 units). System improvements include a measuring station, a 60,000 gallon dual chamber septic tank and two leachfields used on an alternating basis. The new leachfields will serve 72 new units, 46 existing units which presently discharge to the pond/spray field system, and a house (2 unit equivalent).
4. The Discharger proposes to develop a commercial area, adjacent to Highway 49, sometime in the future. Wastewater from the commercial area will be treated in the existing pond/spray field system. At the present, the exact nature of the commercial development is unknown.
5. Present waste discharge requirements established by Order No. 84-111 are neither adequate nor consistent with plans and policies of the Board.
6. The Discharger proposes to discharge approximately 85,000 gallons per day of domestic wastewater to land. Treatment is provided by either aeration ponds/spray fields, or a septic tank/leachfield system.
7. Forest Springs Mobile Home Community is in Sections 14 and 15, T15N, R5E, MDB&M, with surface water drainage to Rattlesnake Creek, tributary to Wolf Creek, tributary to the Bear River.

WASTE DISCHARGE REQUIREMENTS
FOREST SPRINGS MOBILE HOME COMMUNITY
ALFRED F. TUCKER, JAMES H. TUCKER,
AND JERALD A. TUCKER
dba FOREST SPRINGS ASSOCIATES
NEVADA COUNTY

-2-

8. The beneficial uses of Rattlesnake Creek and downstream waters are municipal, industrial, and agricultural supply; recreation; esthetic enjoyment; navigation; ground water recharge; fresh water replenishment; and preservation and enhancement of fish, wildlife and other aquatic resources.
9. The beneficial use of the ground water is municipal supply.
10. The Board, on 25 July 1975, adopted a Water Quality Control Plan for the Sacramento River Basin (5A), which contains water quality objectives. These requirements are consistent with that Plan.
11. Nevada County has adopted a Negative Declaration, in accordance with the California Environmental Quality Act, (Public Resources Code Section 21000, et seq.), and the State Guidelines. The Board has reviewed the Negative Declaration and concurs there are no significant impacts on water quality.
12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 84-111 be rescinded and Forest Springs Mobile Home Community, Alfred F. Tucker, James H. Tucker, and Jerald A. Tucker, dba Forest Springs Associates, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste is prohibited.
3. Public contact with effluent in reservoirs or spray fields is prohibited.
4. Resurfacing of wastewater percolating from the reservoirs or irrigation areas is prohibited.
5. The discharge of industrial waste or any waste which is classified as 'hazardous waste' under California Code of Regulations (CCR), Title 22, Chapter 30, or a 'designated waste' under CCR, Title 23, Subchapter 15, is specifically prohibited.

WASTE DISCHARGE REQUIREMENTS
FOREST SPRINGS MOBILE HOME COMMUNITY
ALFRED F. TUCKER, JAMES H. TUCKER,
AND JERALD A. TUCKER
dba FOREST SPRINGS ASSOCIATES
NEVADA COUNTY

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a pollution or nuisance as defined by the California Water Code.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal area at all times.
4. All treatment ponds and storage reservoirs shall have a minimum freeboard of 14 inches.
5. The Discharger may not spray dispose of effluent during periods of precipitation which will result in significant runoff, or for at least 24 hours after cessation of such events.
6. Effluent discharged to the spray fields shall be managed to minimize erosion, runoff, and aerosol movement from the disposal area.
7. The 30-day average daily dry weather discharge flow to the aeration ponds/spray fields system shall not exceed .055 million gallons per day.
8. The 30-day average daily dry weather discharge flow to the septic tank/leachfield system shall not exceed .030 million gallons per day.
9. Collected screening, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
10. Reclaimed wastewater shall meet the criteria contained in Title 22, Division 4, CCR (Section 60301, et seq.)
11. The dissolved oxygen content of holding ponds shall not be less than 1.0 mg/l for 16 hours in any 24-hour period.
12. Prior to the discharge of wastewater from the commercial area to the pond system, the Discharger shall obtain written permission from Regional Board staff.

C. Provisions:


1. The Discharger may be required to submit technical reports as directed by the Executive Officer.
2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 88-106.

WASTE DISCHARGE REQUIREMENTS
FOREST SPRINGS MOBILE HOME COMMUNITY
ALFRED F. TUCKER, JAMES H. TUCKER,
AND JERALD A. TUCKER
cba FOREST SPRINGS ASSOCIATES
NEVADA COUNTY

-4-

3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 September 1985, which are a part of this Order.
4. The Discharger shall report promptly to the Board any material change or proposed change in the character, location, or volume of the discharge.
5. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
6. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 24 June 1988.


WILLIAM H. CROOKS, Executive Officer

Amended:6/24/88:BCN:gs

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION
REVISED MONITORING AND REPORTING PROGRAM
ORDER NO. 88-106

FOR
FOREST SPRINGS MOBILE HOME COMMUNITY
NEVADA COUNTY

This revised monitoring and reporting program (MRP) incorporates requirements for the monitoring of the wastewater treatment ponds, septic tank/leach field systems and groundwater monitoring wells pursuant to Water Code Section 13267. The Discharger shall not implement any changes to this MRP unless a revised MRP is issued by the Executive Officer.

Sample collection stations shall be established such that the samples collected are representative of the nature and volume of the material(s) sampled. The date, time and person conducting the monitoring shall be recorded for each monitoring event.

POND MONITORING

The following shall constitute the monitoring program for both sets of pond systems:

<u>Constituents</u>	<u>Units</u>	<u>Sample Type</u>	<u>Sampling Frequency</u>	<u>Reporting Frequency</u>
Influent Flow	gpd	Continuous	Continuous	Quarterly
Freeboard	($\pm$ 0.1) Feet	Measured	Monthly	Quarterly
pH ¹	pH units	Grab	Monthly	Quarterly
Dissolved Oxygen ¹	mg/L	Grab	Monthly	Quarterly
Specific Conductivity ¹	μ mhos/cm	Grab	Monthly	Quarterly

¹ A hand held field unit may be used.

In conducting the pond monitoring, a monthly log shall be kept of the aeration ponds conditions. Attention shall be given to the presence or absence of:

- a. Floating or suspended matter
- b. Discoloration
- c. Bottom deposits
- d. Aquatic life
- e. Odors
- f. Erosion, seeps in dykes

REVISED MONITORING AND REPORTING PROGRAM NO. 88-106
FOREST SPRINGS MOBILE HOME COMMUNITY
NEVADA COUNTY

SPRAY DISPOSAL FIELD MONITORING

During periods of spray disposal, a monthly log shall be kept of the condition of the disposal facilities. Attention shall be given to the presence or absence of:

- a. Seeps, springs, etc.
- b. Erosion
- c. Effluent runoff
- d. Residual solids
- e. Vegetation stress or dieback

SEPTIC TANK SOLIDS MONITORING

The septic tank shall be inspected and pumped as described below. An inspection and monitoring is not required during the year a septic tank is pumped.

<u>Parameter</u>	<u>Units</u>	<u>Type of Measurement</u>	<u>Minimum Inspection Frequency</u>
Sludge depth and scum thickness in each compartment of the septic tank	Feet	Staff Gauge	Annually (by April of each year)
Distance between bottom of scum layer and bottom of outlet device	Inches	Staff Gauge	Annually (by April of each year)
Distance between top of sludge layer and bottom of outlet device	Inches	Staff Gauge	Annually (by April of each year)

In lieu of septic tank measuring, the septic tank may be pumped annually. In any event, septic tanks shall be pumped when any one of the following conditions exist or may occur before the next inspection:

- a. The combined thickness of sludge and scum exceeds one-third of the tank depth of the first compartment; or,
- b. The scum layer is within three inches of the outlet device; or,
- c. The sludge layer is within eight inches of the outlet device.

REVISED MONITORING AND REPORTING PROGRAM NO. 88-106
 FOREST SPRINGS MOBILE HOME COMMUNITY
 NEVADA COUNTY

A report on all septic tank monitoring and/or pumping shall be submitted to the Board annually.

SEPTIC TANK/LEACH FIELD MONITORING

Monthly monitoring of the discharge from the septic tank to the leachfields shall be as follows:

<u>Constituents</u>	<u>Units</u>	<u>Sample Type</u>	<u>Sampling Frequency</u>	<u>Reporting Frequency</u>
Influent Flow	gpd	Continuous	Continuous	Quarterly
Effluent pH ¹	pH units	Grab	Quarterly	Quarterly
Effluent Specific Conductivity ¹	µmhos/cm	Grab	Quarterly	Quarterly

¹ A hand held field unit may be used.

The Discharger shall maintain monthly records of the condition of the ground in and around the leachfields. Excessive vegetation shall be maintained to allow access to the leach fields as well as to protect the integrity if the leach field system. The presence or absence of the following shall be recorded:

- a. Odors
- b. Surfacing effluent, seeps, wet spots
- c. Excessive vegetation growth

GROUNDWATER MONITORING

Monitoring of the four-groundwater monitoring wells (MW-1 through MW-4) installed in the leachfield shall be as follows:

<u>Constituents</u>	<u>Units</u>	<u>Sample Type</u>	<u>Sampling Frequency</u>	<u>Reporting Frequency</u>
pH ¹	pH units	Grab	Quarterly	Quarterly
Specific Conductivity ¹	µmhos/cm	Grab	Quarterly	Quarterly
Total Dissolved Solids	mg/L	Grab	Quarterly	Quarterly
Nitrates	mg/L	Grab	Quarterly	Quarterly
Total Coliform	MPN/100 mL	Grab	Quarterly	Quarterly
Fecal Coliform	MPN 100/mL	Grab	Quarterly	Quarterly
Depth to Water	Feet (± 0.1)	Measured	Quarterly	Quarterly
Elevation	Feet (± 0.1)	Calculated	Quarterly	Quarterly

REVISED MONITORING AND REPORTING PROGRAM NO. 88-106
 FOREST SPRINGS MOBILE HOME COMMUNITY
 NEVADA COUNTY

<u>Constituents</u>	<u>Units</u>	<u>Sample Type</u>	<u>Sampling Frequency</u>	<u>Reporting Frequency</u>
Gradient ²	feet/feet	Calculated	Quarterly	Quarterly
Gradient Direction ²	Degrees	Calculated	Quarterly	Quarterly

¹ A hand held field unit may be used.

² The elevation shall be used to determine the direction and gradient of groundwater flow.

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program, shall be reported to the Board.

The Discharger shall implement the above monitoring program as of the date of this Order.

B. Quarterly Monitoring Reports

Quarterly monitoring reports shall be submitted to the Regional Board by the 1st day of **February, May, August, and November** (i.e. the October, November, December Quarterly Monitoring Report will be due February 1st). The Quarterly Report shall include the results of all regular monthly monitoring data. At a minimum, the report shall contain:

1. A narrative description of all preparatory, monitoring, sampling, and analytical testing activities. The narrative shall be sufficiently detailed to verify compliance with the WDRs, this MRP, and the Standard Provisions and Reporting Requirements. The narrative shall be supported by field logs for each well documenting depth to groundwater; parameters measured before, during, and after purging; method of purging; calculation of the casing volume; and total volume of water purged.
2. Calculation of groundwater elevations, an assessment of the groundwater flow direction and gradient on the date of measurement, comparison to previous flow direction and gradient data, and discussion of seasonal trends, if any.

REVISED MONITORING AND REPORTING PROGRAM NO. 88-106
FOREST SPRINGS MOBILE HOME COMMUNITY
NEVADA COUNTY

3. A narrative discussion of the analytical results for all media and locations monitored, including spatial and temporal trends, with reference to summary data tables, graphs, and appended analytical reports (as applicable).
4. A comparison of monitoring data to the discharge specifications, groundwater limitations, and surface water limitations, and explanation of any violation of those requirements.
5. Summary data tables of historical and current water table elevations and analytical results.
6. A scaled map showing relevant structures and features of the facility, the locations of monitoring wells and other sampling stations, and groundwater elevation contours referenced to mean sea level datum.
7. Copies of laboratory analytical report(s).

B. Annual Report

An Annual Report shall be prepared as the fourth quarter monitoring report and submitted to the Regional Board by 1 February. The Annual Report will include all monitoring data required in the monthly/quarterly schedule. In addition to the data normally presented, the Annual Report shall include the following:

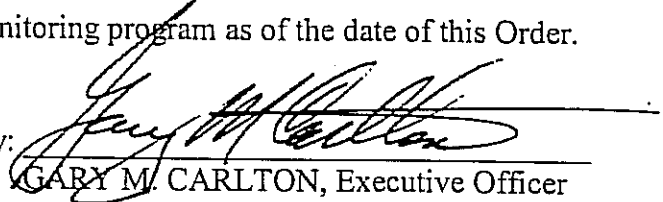
1. If requested by Staff, tabular and graphical summaries of all data collected during the year.
2. An evaluation of the performance of the industrial process wastewater system, as well as a forecast of the flows anticipated in the next year.
3. An evaluation of the groundwater quality at the wastewater treatment facility.
4. A summary data table of water levels and freeboard in the tanks and settling pond (if used).
5. A discussion of compliance and the corrective action taken, as well as any planned or proposed actions needed to bring the discharge into full compliance with the waste discharge requirements.

Based on results of the groundwater monitoring program after a minimum of one year, the Discharger may request a reduction in the constituents monitored and/or sample frequency. If such reductions are warranted, this MRP may be revised by the Executive Officer.

REVISED MONITORING AND REPORTING PROGRAM NO. 88-106
FOREST SPRINGS MOBILE HOME COMMUNITY
NEVADA COUNTY

The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered by:


GARY M. CARLTON, Executive Officer

7 May 2001

(Date)

MMH: 5/3/01