

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 88-170

WASTE DISCHARGE REQUIREMENTS
FOR
CAMP COLOMA
MELVIN A. HAMILTON
EL DORADO COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Camp Coloma and Melvin A. Hamilton (hereafter Discharger) submitted a Report of Waste Discharge, dated 15 August 1988, and a site evaluation report, dated 15 August 1988. The property (Assessor's Parcel No. 06-231-13) is owned by Melvin A. Hamilton.
2. Camp Coloma is a summer resort consisting of 115 campsites, six cabins, two employee mobile homes, an office, a general store, a swimming pool with related facilities, and the owner's home.
3. The Board, on 25 August 1972, adopted Order No. 73-61, which prescribed requirements for a discharge from the resort to land.
4. Present waste discharge requirements established by Order No. 73-61 are neither adequate nor consistent with plans and policies of the Board.
5. The sewage disposal system consists of a pump station equipped with an emergency overflow tank, one aerated disposal pond covering about 1/3 acre, and a second overflow disposal pond covering about 1/4 acre.
6. The Discharger discharges approximately 3,600 gallons per day to the ponds during the summer season, and about 500 gallons per day during the off season.
7. Camp Coloma is in Sections 17 & 20, T11N, R10E, MDB&M, with surface water drainage to the South Fork American River.
8. The beneficial uses of the South Fork American River and downstream waters, including Folsom Lake, are municipal, industrial, and agricultural supply; recreation; esthetic enjoyment; navigation; ground water recharge; fresh water replenishment; hydroelectric power generation; and preservation and enhancement of fish, wildlife and other aquatic resources.
9. The Board, on 25 July 1975, adopted a Water Quality Control Plan for the Sacramento River Basin (5A), which contains water quality objectives. These requirements are consistent with that Plan.

WASTE DISCHARGE REQUIREMENTS
CAMP COLOMA
MELVIN A. HAMILTON
EL DORADO COUNTY

-2-

10. The action to adopt waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301, Title 14, California Code of Regulations.
11. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
12. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 73-61 be rescinded and Camp Coloma and Melvin A. Hamilton in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste is prohibited.
3. Resurfacing of wastewater from the ponds is prohibited.

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a pollution or nuisance as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal area at all times.
4. The 30-day average daily dry weather discharge flow shall not exceed 3,600 gallons.
5. Collected screening, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
6. The dissolved oxygen content of holding ponds shall not be less than 1.0 mg/l for 16 hours in any 24-hour period.


WASTE DISCHARGE REQUIREMENTS
CAMP COLOMA
MELVIN A. HAMILTON
EL DORADO COUNTY

-3-

C. Provisions:

1. The Discharger may be required to submit technical reports as directed by the Executive Officer.
2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 88-170.
3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 September 1985, which are a part of this Order.
4. The Discharger shall report promptly to the Board any material change or proposed change in the character, location, or volume of the discharge.
5. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
6. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 23 September 1988.


WILLIAM H. CROOKS, Executive Officer

9/1/88:RJB:gs

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 88-170

FOR
CAMP COLOMA
MELVIN A. HAMILTON
EL DORADO COUNTY

The Discharger shall submit an annual status report which shall include, as a minimum, the following:

1. Monthly tabulation of minimum freeboard for each pond.
2. The dates, duration, and volume of any accidental overflows from the stabilization ponds.
3. The dates and duration of any events regarding septic conditions (brown, grey, or black colored water) in any pond. The monitoring shall include weekly dissolved oxygen testing of all ponds that have turned septic.
4. The dates and duration of any nuisance odor events.
5. Any other significant events or changes which may have water quality implications.

The annual report shall be submitted to the Board by 30 January of each year.

The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered by: William H. Crooks
WILLIAM H. CROOKS, Executive Officer

23 September 1988


(Date)

INFORMATION SHEET

CAMP COLOMA
MELVIN A. HAMILTON
EL DORADO COUNTY

Camp Coloma is between Highway 49 and the South Fork American River just south of Coloma in El Dorado County. It is a summer resort consisting of 115 campsites, six cabins, two employee mobile homes, an office, a general store, a swimming pool, and a home that the camp owners live in year round. The sewage treatment facilities consist of a pump station equipped with a 10,000 gallon emergency overflow tank, an aerated disposal pond, and a second pond which receives overflow from the aerated pond during extremely wet conditions. Surface water drainage is to the South Fork American River.

9/1/88:RJB:gs

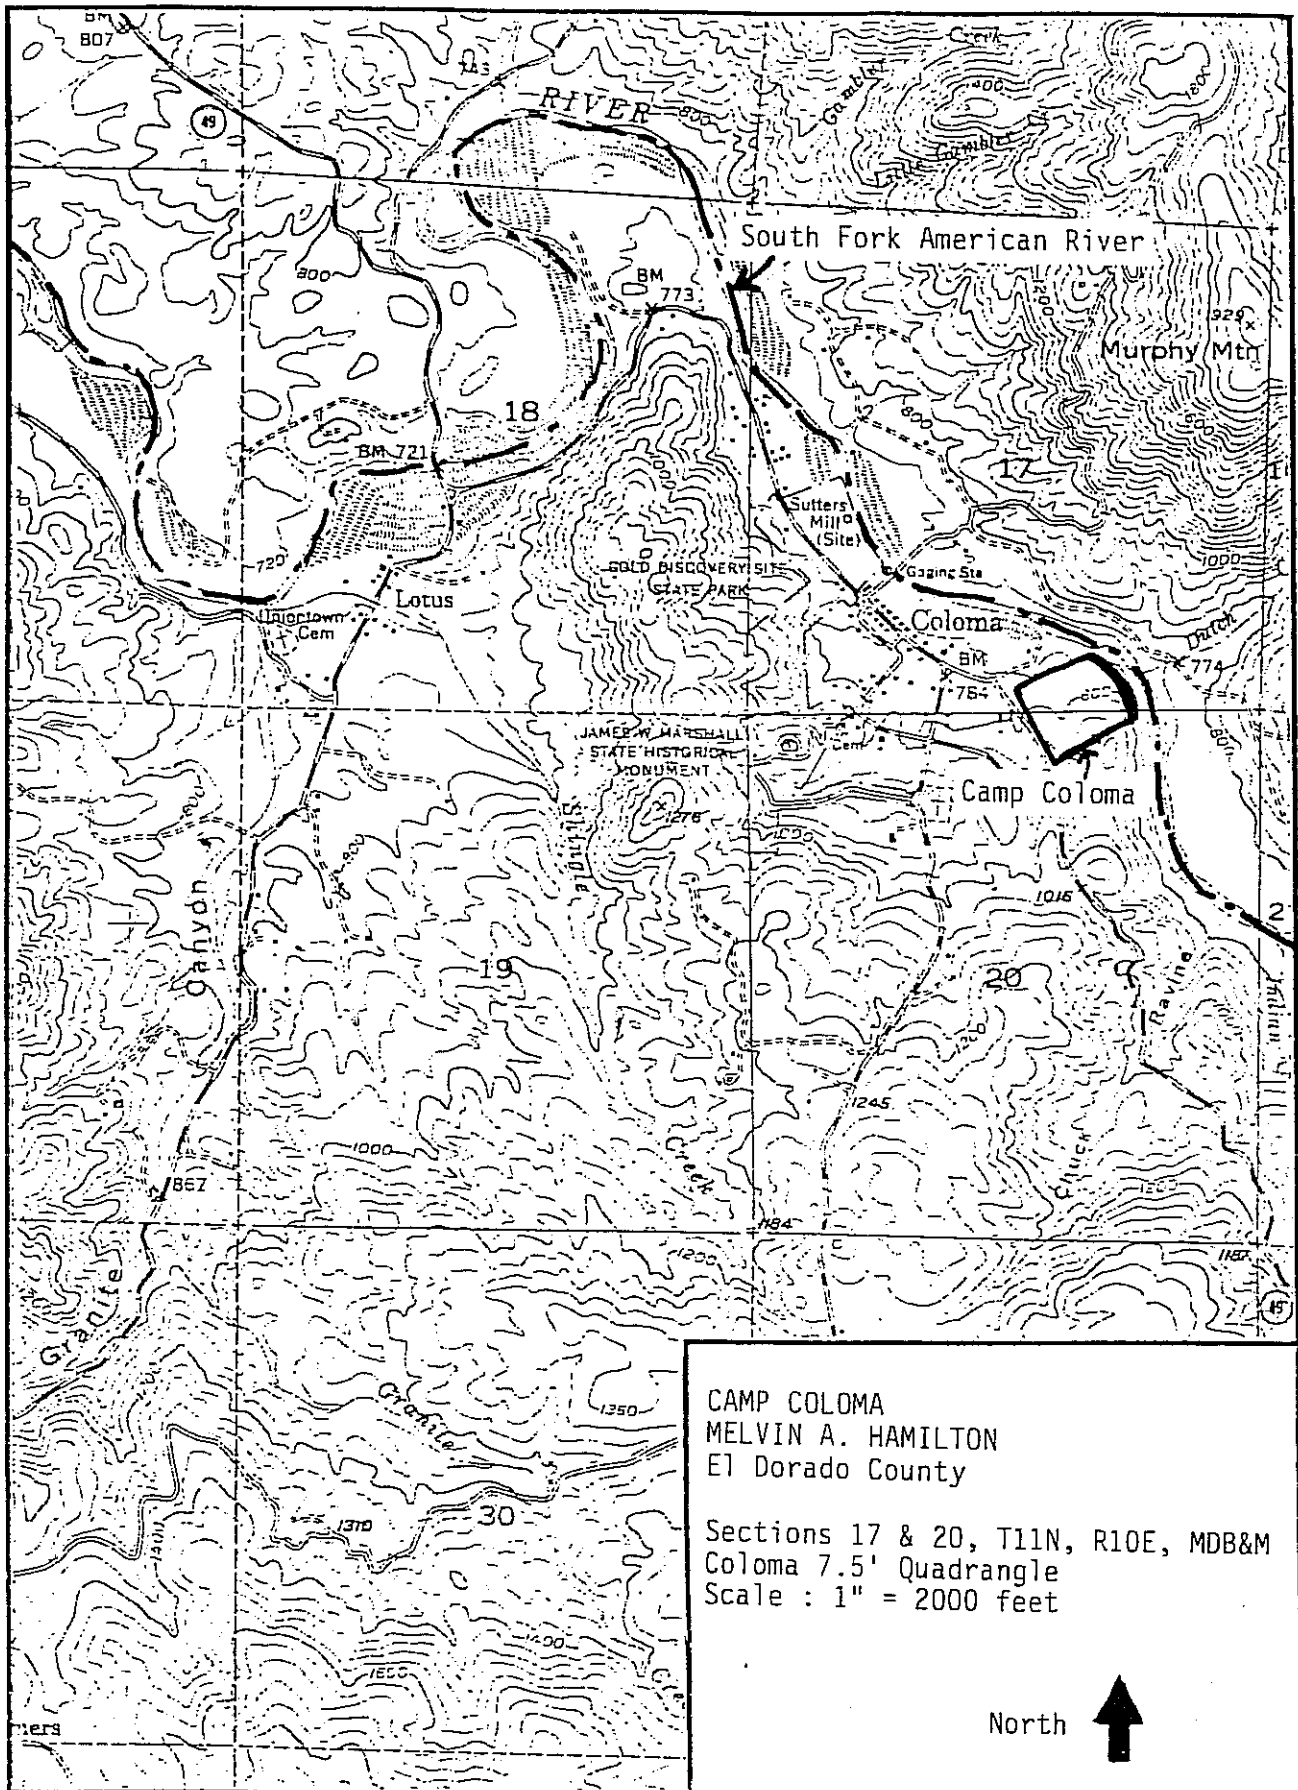

CAMP COLOMA
MELVIN A. HAMILTON
El Dorado County

Sections 17 & 20, T11N, R10E, MDB&M
Coloma 7.5' Quadrangle
Scale : 1" = 2000 feet

North



Order # 83-170

Camp Coloma WWTP
~~AMERICAN RIVER RESORT~~
 WASTEWATER OPERATION REPORT
 Melvin Hamilton

EL Dorado

WAC
 642 ✓ EAH

DATE	11/29/98
TIME	1800
MAIN LIFT PUMP	CHECKED
BACKUP CENTRIFUGAL PUMP	CHECKED
COMPRESSOR	CHECKED
WET WELL FLOATS	CHECKED
OVERFLOW TANK, DEPTH OF LIQUID	N.A.
OVERFLOW RETURN PUMP	CHECKED
TREATMENT POND FREEBOARD, INCHES	6"
RECAPTURE POND DEPTH, INCHES	24"
WATER TEMPERATURE, DEG. F.	—
DISSOLVED OXYGEN, MG/L	—
pH, UNITS	—
AERATOR RUN, HOURS	4
POND CONDITION: CLEAR SURFACE, NO WEEDS OR INSECTS NO ODORS PRESENT	

Additional Comments:

INSPECTED BY: Richard Beckley

Cert. No. V1102

Richard Beckley

98 DEC 1 PM 2:12

RECEIVED
 SACRAMENTO
 CVRWOCB

