

722

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 91-098

WASTE DISCHARGE REQUIREMENTS
FOR
MOKELUMNE HILL SANITARY DISTRICT
MOKELUMNE HILL SEWAGE TREATMENT PLANT
CALAVERAS COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Mokelumne Hill Sanitary District and Mokelumne Hill Sewage Treatment Plant (hereafter Discharger) submitted a Report of Waste Discharge, dated 20 April 1990. The property is owned by Mokelumne Hill Sanitary District.
2. The Board, on 24 September 1970, adopted Resolution No. 71-65 which prescribed requirements for a discharge from the Mokelumne Hill Sewage Treatment Plant to 10 acres of spray disposal.
3. The wastewater treatment facilities include two aerated lagoons, a chlorination tank, a storage pond, and a spray disposal field used for cattle grazing.
4. Present waste discharge requirements established by Resolution No. 71-65 are neither adequate nor consistent with current plans and policies of the Board.
5. The Discharger discharges an average of 0.06 million gallons per day (mgd) to a 10-acre spray disposal field.
6. The facility is in Section 12, T6N, R12E, MDB&M, with surface water drainage to the Mokelumne River, as shown in Attachment A, which is attached hereto and part of this Order.
7. The beneficial uses of the Mokelumne River are municipal, industrial, and agricultural supply; recreation; esthetic enjoyment; navigation; ground water recharge; fresh water replenishment; hydropower generation; and preservation and enhancement of fish, wildlife, and other aquatic resources.
8. The beneficial uses of the ground water are municipal, industrial, and agricultural supply.
9. The Board has adopted a Water Quality Control Plan, Second Edition, for the Sacramento-San Joaquin Delta Basin (5B), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.
10. The project is an existing facility and is categorically exempt from the development of an environmental impact report (EIR), pursuant to Section 2714(a)(2), Chapter 3, Title 23, of the California Code of Regulations (CCR).

WASTE DISCHARGE REQUIREMENTS
MOKELUMNE HILL SANITARY DISTRICT
MOKELUMNE HILL SEWAGE TREATMENT PLANT
CALAVERAS COUNTY

2-

11. Section 2511(a), Title 23 of the CCR exempts this discharge from the requirements of Chapter 15.
12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 71-65 be rescinded and Mokelumne Hill Sanitary District and Mokelumne Hill Sewage Treatment Plant, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Effluent Limitations - Spray Irrigation Field:

1. The discharge of an effluent in excess of the following limits is prohibited:

<u>Constituents</u>	<u>Units</u>	<u>Monthly Average</u>	<u>Daily Maximum</u>
20°C BOD ₅	mg/l	40	80
Settleable Matter	ml/l	0.5	1.0
Flow	mgd	0.15	

B. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. By-pass or overflow of untreated or partially treated waste is prohibited.

C. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a nuisance or condition of pollution as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal area at all times.
4. Collected screening, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
5. A 2.0-foot freeboard shall be maintained in all pond at all times.

WASTE DISCHARGE REQUIREMENTS
MOKELUMNE HILL SANITARY DISTRICT
MOKELUMNE HILL SEWAGE TREATMENT PLANT
CALAVERAS COUNTY


3-

6. Reclaimed wastewater shall meet the criteria contained in Title 22, Division 4, CCR (Section 60301, et seq.).
7. The discharge of waste containing any carcinogen or reproductive toxin listed by the Governor pursuant to Health and Safety Code Sections 25249.5 through 25249.13, the Safe Drinking Water and Toxic Enforcement Act of 1986 (Proposition 65), where such chemical passes or probably will pass into any source of drinking water, is prohibited.
8. The dissolved oxygen content of holding ponds shall not be less than 1.0 mg/l for 16 hours in any 24-hour period.

D. Provisions:

1. The Discharger may be required to submit technical reports as directed by the Executive Officer.
2. The Discharger shall comply with the Monitoring and Reporting Program No. 91-098.
3. The Discharger shall comply with the "Standard Provisions and Reporting Requirements", dated 1 March 1991, which are made a part of this Order.
4. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
5. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
6. The Board will review this Order periodically and will revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 26 April 1991.

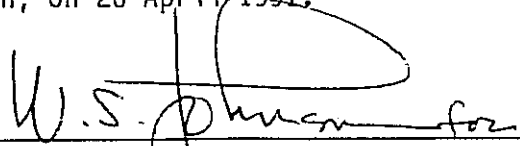
WILLIAM H. CROOKS, Executive Officer

3/6/91:TLL:gs


Attachments

ATTACHMENT A

MOKELUMNE HILL SANITARY DISTRICT
MOKELUMNE HILL SEWAGE TREATMENT
PLANT
Calaveras County

Section 12, T6N, R12E, MDB&M

Scale: 1 inch = 1 mile

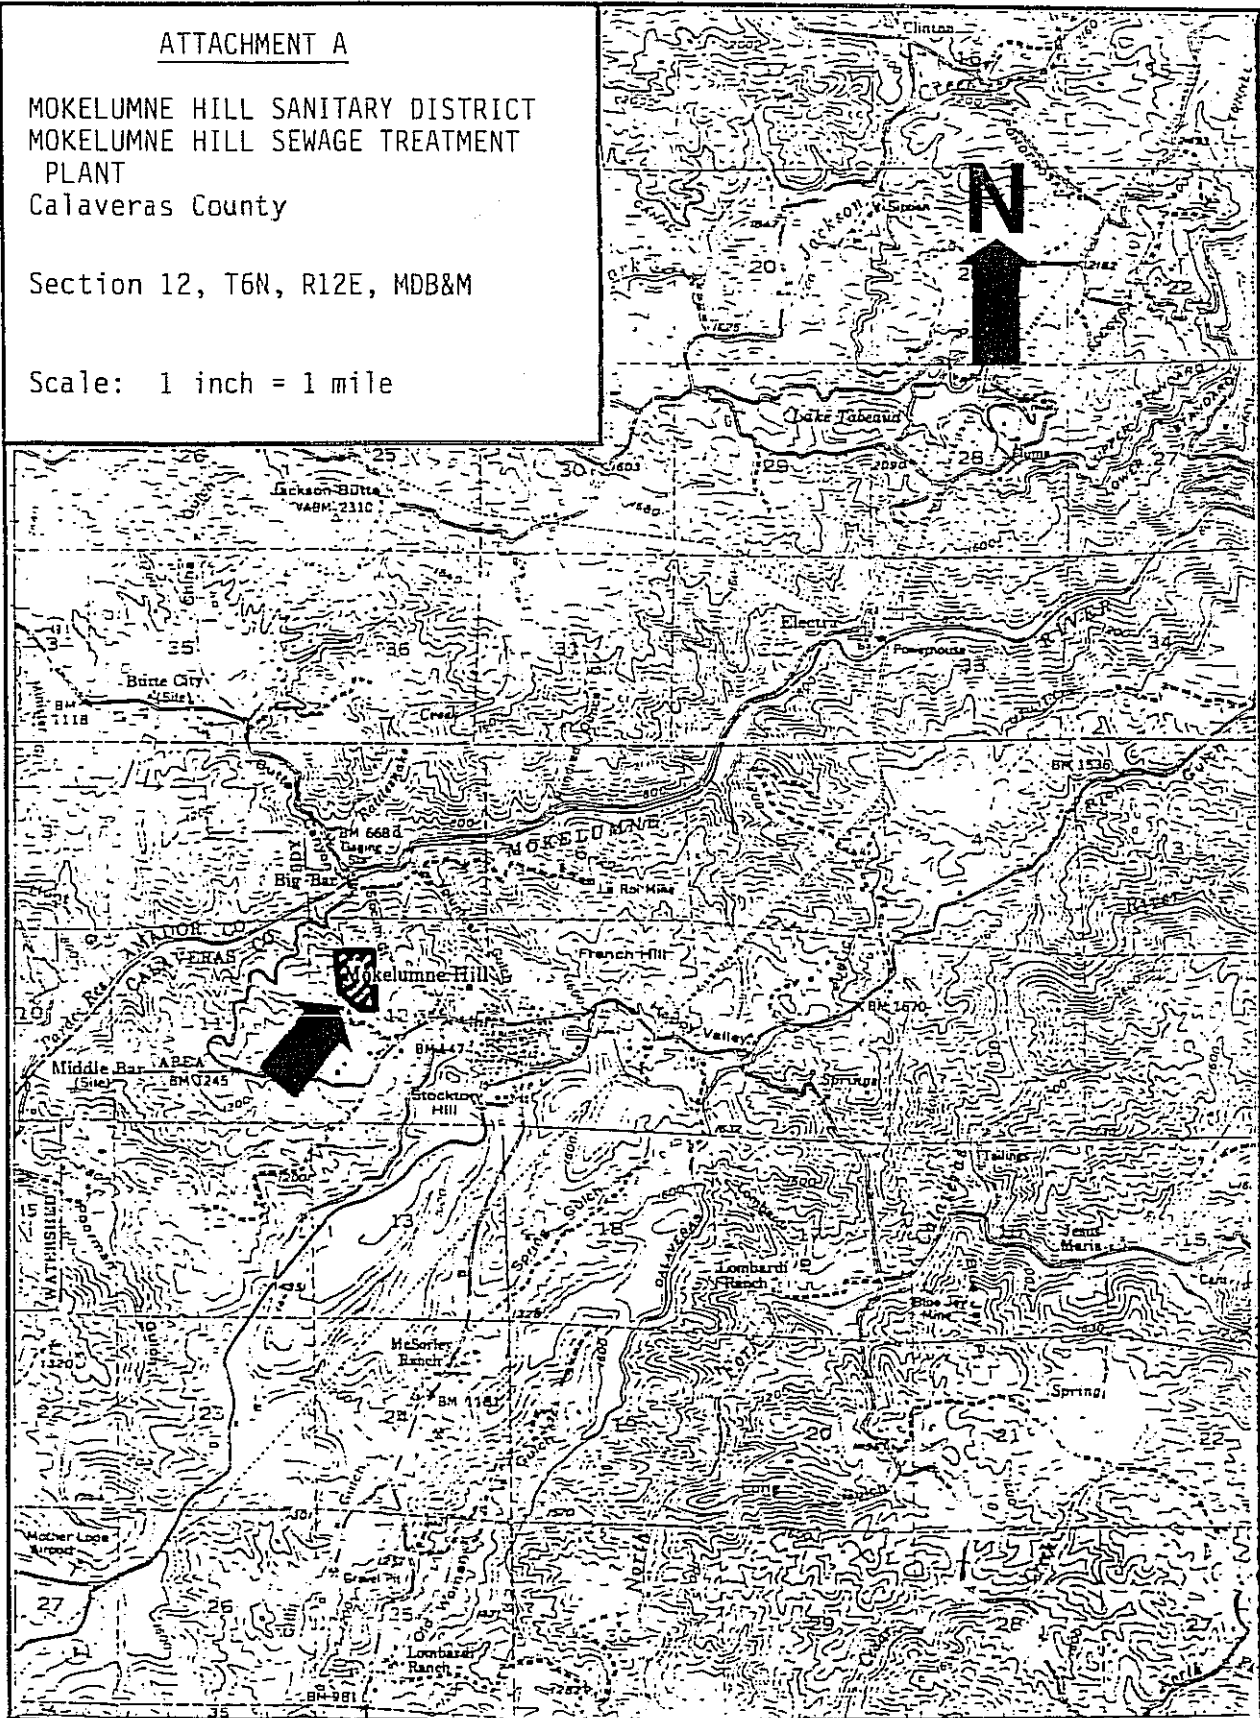

INFORMATION SHEET

**MOKELUMNE HILL SANITARY DISTRICT
MOKELUMNE HILL SEWAGE TREATMENT PLANT
CALAVERAS COUNTY**

Mokelumne Hill Sanitary District operates a sewage treatment plant in Mokelumne Hill. The average flow is 60,000 gpd. Design capacity is 150,000 gpd. Wastewater treatment facilities include two aerated lagoons, a chlorination tank, a storage pond, and a spray disposal field.

Effluent is stored in the storage pond until summer, when it is used to irrigate the spray disposal field for cattle grazing. The field is 20 acres, but only 10 acres are used. The storage pond is drawn down to the outlet structure prior to October.

TLL