

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 93-087

WASTE DISCHARGE REQUIREMENTS
FOR

WESTLEY COMMUNITY SERVICES DISTRICT AND
STANISLAUS COUNTY HOUSING AUTHORITY
WESTLEY, STANISLAUS COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Westley Community Services District and Stanislaus County Housing Authority (hereafter Discharger) jointly constructed the wastewater treatment plant at Westley. Westley Community Services District owns the wastewater treatment plant. The Housing Authority operates the plant. The land (Assessor's Parcel Nos. 86-018/16-20-03-960) is owned by the Housing Authority.
2. Waste Discharge Requirements Order No. 72-298, adopted by the Board on 23 June 1972, prescribes requirements for a discharge from the oxidation pond to eight disposal beds (irrigation checks). The disposal beds are not used for pasture or crops.
3. Order No. 72-298 is neither adequate nor consistent with current plans and policies of the Board.
4. The Discharger discharges an average flow in winter 45,000 to 50,000 gpd. The average summer flow is 85,000 to 90,000 gpd when additional families use the farm labor camp. Design flow is 110,000 gpd.
5. Treatment consists of a 60,000 gallon aeration pond with two 5 HP aerators followed by a 1.5 acre oxidation pond. Treated wastewater is disposed of on 8.5 acres divided into 8 disposal beds.
6. The facility is in the NW¼ of Section 33, T4S, R7E, MDB&M, with surface water drainage to the San Joaquin River, as shown in Attachment A, which is attached hereto and part of the Order by reference.
7. The Board adopted a Water Quality Control Plan, Second Edition, for the Sacramento-San Joaquin Basin (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.

WASTE DISCHARGE REQUIREMENTS
WESTLEY COMMUNITY SERVICES DISTRICT AND
STANISLAUS COUNTY HOUSING AUTHORITY
WESTLEY, STANISLAUS COUNTY

-2-

8. The beneficial uses of the San Joaquin River are municipal, industrial, and agricultural supply; recreation; esthetic enjoyment; navigation; and preservation and enhancement of fish, wildlife, and other aquatic resources.
9. The beneficial uses of underlying ground water are domestic and agricultural supply.
10. The action to update waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act (CEQA) in accordance with Title 14, California Code of Regulations (CCR), Section 15301.
11. This discharge is exempt from the requirements of Title 23, CCR, Section 2510, et seq. (hereafter Chapter 15). The exemption, pursuant to Section 2511(b), is based on the following:
 - a. The Board is issuing waste discharge requirements, and
 - b. The discharge complies with the Basin Plan, and
 - c. The wastewater does not need to be managed according to 22 CCR, Division 4, Chapter 30, as a hazardous waste.
12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 72-298 is rescinded and Westley Community Services District and Stanislaus County Housing Authority, Westley, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Bypass or overflow of untreated or partially treated waste is prohibited.

WASTE DISCHARGE REQUIREMENTS
WESTLEY COMMUNITY SERVICES DISTRICT AND
STANISLAUS COUNTY HOUSING AUTHORITY
WESTLEY, STANISLAUS COUNTY

-3-

3. Discharge of waste classified as 'hazardous' or 'designated', as defined in Sections 2521(a) and 2522(a) of Chapter 15, is prohibited.

B. Discharge Specifications:

1. The monthly average dry weather discharge flow shall not exceed 110,000 gallons/day.
2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment and disposal areas.
3. As a means of discerning compliance with Discharge Specification No. 2, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
4. The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
5. Ponds and disposal beds shall be managed to prevent breeding of mosquitos. In particular,
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
6. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
7. Ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the nonirrigation season. Design seasonal precipitation shall be based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns. Pond freeboard shall never be less than two feet (measured vertically).

WASTE DISCHARGE REQUIREMENTS
WESTLEY COMMUNITY SERVICES DISTRICT AND
STANISLAUS COUNTY HOUSING AUTHORITY
WESTLEY, STANISLAUS COUNTY

-4-

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15 and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice shall be reported to the Executive Officer at least 90 days in advance of the change.
3. Use and disposal of sewage sludge shall comply with existing federal and state laws and regulations, including 40 CFR 503, "Standards for Use or Disposal of Sewage Sludge."
4. The Discharger is encouraged to comply with the State Guidance Manual issued by the Department of Health Services titled *Manual of Good Practice for Landspreading of Sewage Sludge*.

D. Ground Water Limitations:

The discharge, in combination with other sources, shall not cause underlying ground water to:

1. Contain waste constituents in concentrations statistically greater than background water quality.
2. Contain chemicals, heavy metals, or trace elements in concentrations that adversely affect beneficial uses or exceed maximum contaminant levels specified in 22 CCR, Division 4, Chapter 15.
3. Exceed a most probable number of total coliform organisms of 2.2/100 ml over any seven-day period.
4. Exceed concentrations of radionuclides specified in 22 CCR, Division 4, Chapter 15.
5. Contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.
6. Contain concentrations of chemical constituents in amounts that adversely affect agricultural use.

WASTE DISCHARGE REQUIREMENTS
WESTLEY COMMUNITY SERVICES DISTRICT AND
STANISLAUS COUNTY HOUSING AUTHORITY
WESTLEY, STANISLAUS COUNTY

-5-

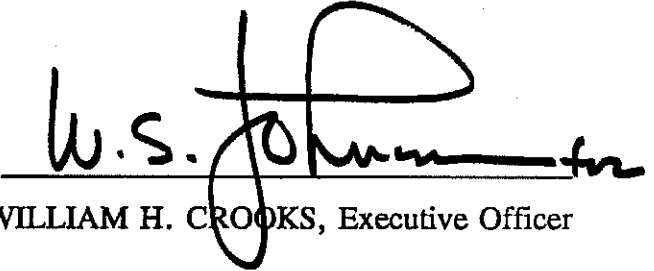
E. Provisions:

1. The Discharger shall comply with the Monitoring and Reporting Program No. 93-087, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
4. The Discharger shall use the best practicable cost-effective control technique currently available to limit mineralization to no more than a reasonable increment.
5. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
6. Westley Community Services District and Stanislaus County Housing Authority, Westley, is ultimately responsible for ensuring compliance with these requirements.
7. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
8. If reclaimed water is used for construction purposes, it shall comply with the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes". Other uses of reclaimed water not specifically authorized herein shall be subject to the approval of the Executive Officer and shall comply with 22 CCR, Division 4.
9. The Board will review this Order periodically and will revise requirements when necessary.

WASTE DISCHARGE REQUIREMENTS
WESTLEY COMMUNITY SERVICES DISTRICT AND
STANISLAUS COUNTY HOUSING AUTHORITY
WESTLEY, STANISLAUS COUNTY

-6-

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 25 June 1993.


WILLIAM H. CROOKS, Executive Officer

28 June 1993/SPD:dlk

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 93-087

FOR

WESTLEY COMMUNITY SERVICES DISTRICT AND
STANISLAUS COUNTY HOUSING AUTHORITY
WESTLEY, STANISLAUS COUNTY

Specific sample station locations shall be established under direction of the Board's staff and a description of the stations shall be attached to this Order.

EFFLUENT MONITORING

Effluent samples shall be collected just prior to discharge to the disposal facility. Effluent samples should be representative of the volume and nature of the discharge. Samples collected from the outlet structure of ponds will be considered adequately composited. Time of collection of a grab sample shall be recorded. Effluent monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
20°C BOD ₅	mg/l	Grab	Monthly
Settleable Matter	ml/l	Grab	Monthly
Nitrates as NO ₃	mg/l	Grab	Quarterly
Total Dissolved Solids	mg/l	Grab	Quarterly
Specific Conductivity	μmhos/cm	Grab	Quarterly
Flow	gallons/day	Cumulative	Daily

SLUDGE MONITORING

A composite sample of sludge shall be collected prior to sludge reuse or disposal in accordance with EPA's *POTW Sludge Sampling and Analysis Guidance Document, August 1989*, and tested for the following metals:

Arsenic	Mercury
Cadmium	Molybdenum
Chromium	Nickel
Copper	Selenium
Lead	Zinc

MONITORING AND REPORTING PROGRAM
WESTLEY COMMUNITY SERVICES DISTRICT AND
STANISLAUS COUNTY HOUSING AUTHORITY
WESTLEY, STANISLAUS COUNTY

-2-

Sampling records shall be retained for a minimum of five years. A log shall be kept of sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log should be complete enough to serve as a basis for part of the sludge reuse or disposal report.

WATER SUPPLY MONITORING

A sampling station shall be established where a representative sample of the municipal water supply can be obtained. Water supply monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Sampling Frequency</u>
Electrical Conductivity @ 25°C	μmhos/cm	Yearly
Total Dissolved Solids	mg/l	Yearly

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the 20th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

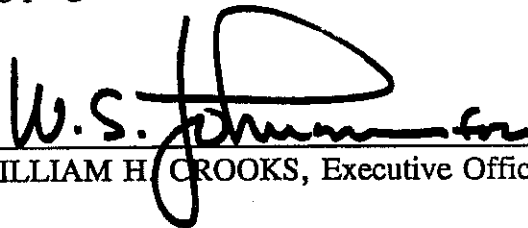
Upon written request of the Board, the Discharger shall submit a report to the Board by 30 January of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

MONITORING AND REPORTING PROGRAM
WESTLEY COMMUNITY SERVICES DISTRICT AND
STANISLAUS COUNTY HOUSING AUTHORITY
WESTLEY, STANISLAUS COUNTY

-3-

The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered by:


WILLIAM H. CROOKS, Executive Officer

25 June 1993

(Date)

28 June 1993/SPD:dlk

INFORMATION SHEET

WESTLEY COMMUNITY SERVICES DISTRICT AND STANISLAUS COUNTY HOUSING AUTHORITY AT WESTLEY, STANISLAUS COUNTY

The Westley treatment facility consists of a 60,000 gallon aeration pond with two 5 HP aerators, followed by a 1.5 acre oxidation pond which is 3.5 feet deep. Treated wastewater is disposed of on 8.5 acres divided into 8 disposal beds (irrigation checks). The disposal beds are not used for pasture or crops. Disposal beds are rotated, dried and disced between use to incorporate any solids into the soil and to promote percolation. The treatment facility is completely fenced.

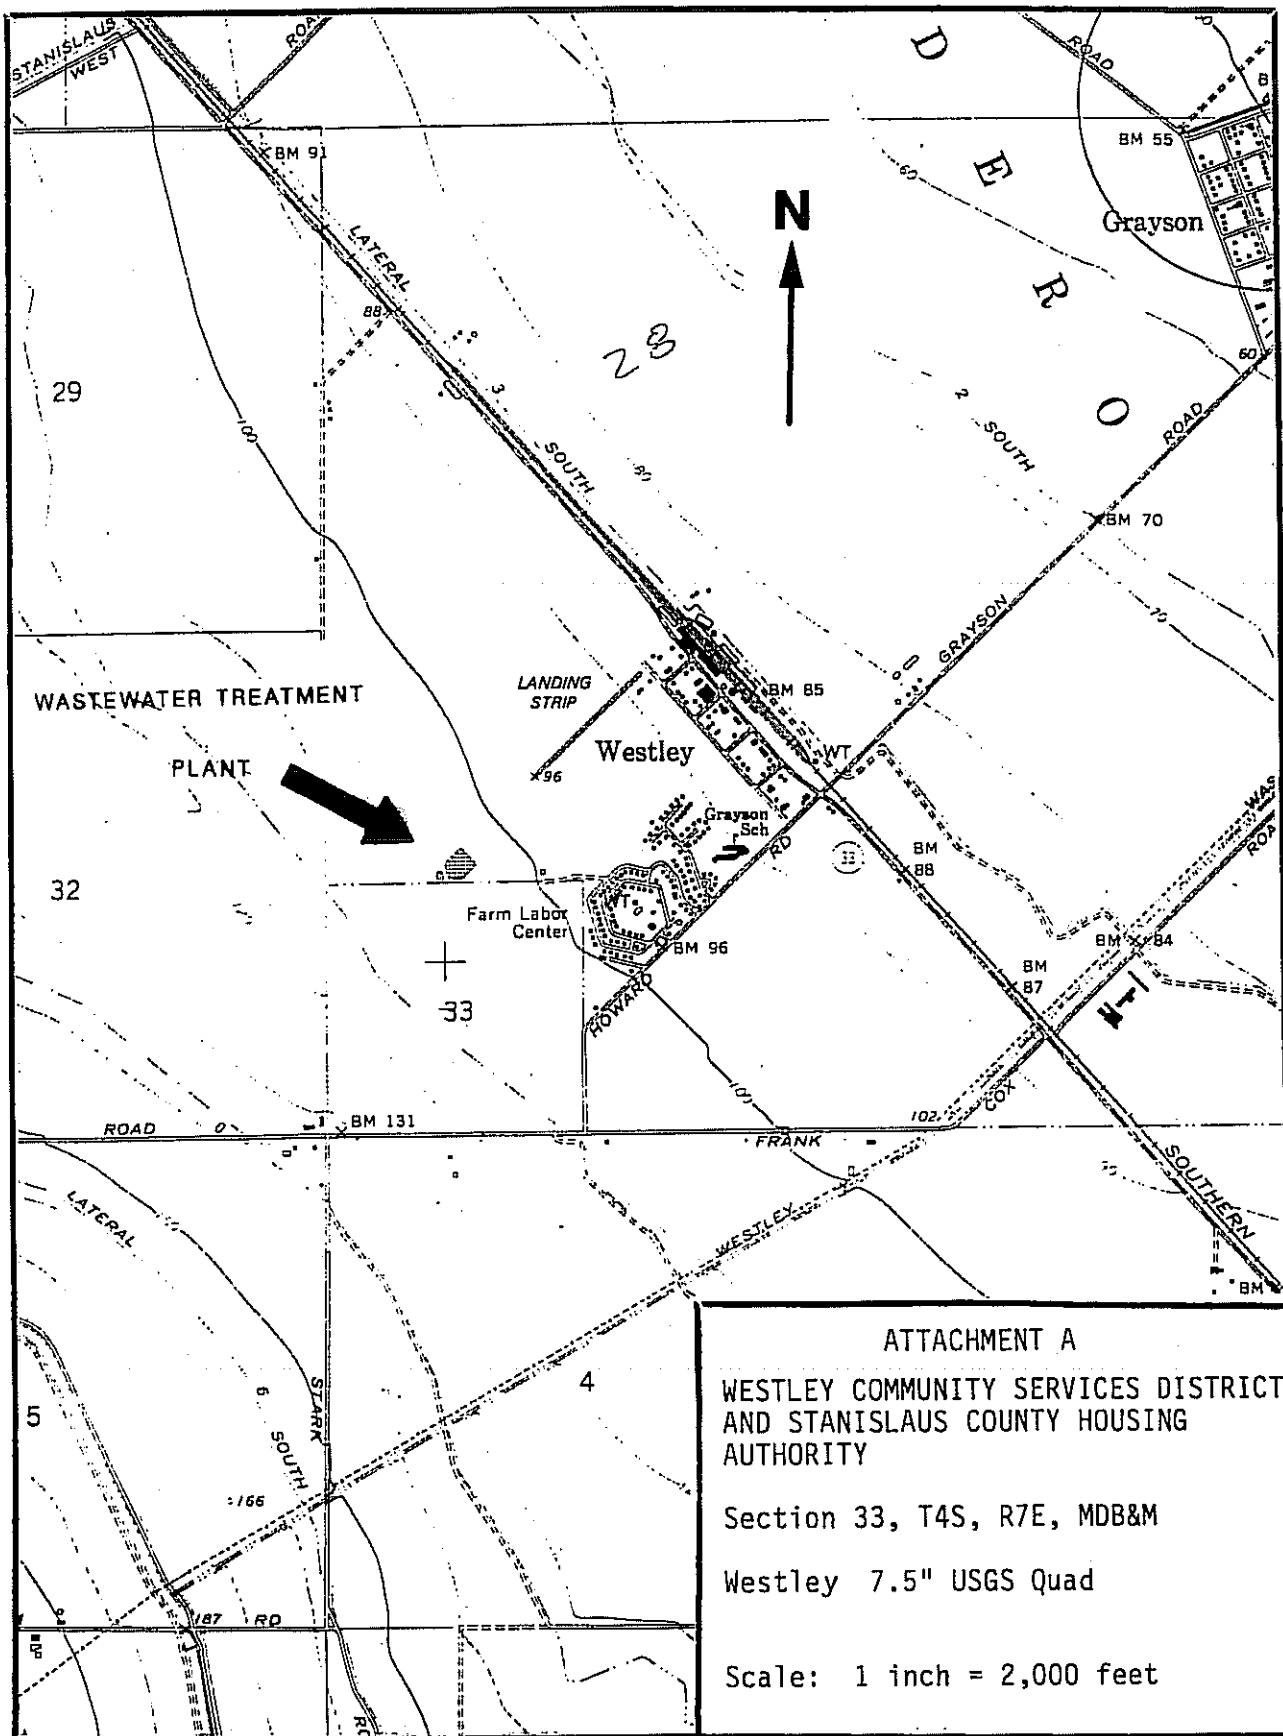
Westley Community Services District and Stanislaus County Housing Authority jointly constructed the wastewater treatment plant at Westley. Westley Community Services District owns the treatment plant. The Housing Authority operates the plant. The land is owned by the Housing Authority.

The facility serves about 30 services in Westley and 219 units in Hillview Homes (Stanislaus County Housing Authority) farm labor camp. Average winter flow from November through April is 45,000 to 50,000 gpd. Average summer flow is 85,000 to 90,000 gpd. Design flow is 110,000 gpd. There are 125 families in the farm labor camp year around. Ninety-four additional families use the labor camp in the summer.

Depth to ground water was 50 feet in 1990 and 105 feet in 1992. Surface water drainage is to the San Joaquin River.

As a means of discerning compliance with the Discharge Specification of no objection odors beyond the treatment plant, a minimum dissolved oxygen requirement of 1.0 mg/l in the ponds is included.

Public access to plant is precluded by fencing. Domestic wastewater only is received into the facility.



ATTACHMENT A

WESTLEY COMMUNITY SERVICES DISTRICT
AND STANISLAUS COUNTY HOUSING
AUTHORITY

Section 33, T4S, R7E, MDB&M

Westley 7.5" USGS Quad

Scale: 1 inch = 2,000 feet

(1)

(2)

(3)