

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION**

ORDER NO. 94-100

**WASTE DISCHARGE REQUIREMENTS
FOR
CITY OF RIVERBANK
WASTEWATER TREATMENT PLANT
STANISLAUS COUNTY**

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. The City of Riverbank (hereafter Discharger) owns and operates the wastewater treatment facility. The property (Assessor's Parcel Nos. 247-25004, 247-26002, 249-07022 and 249-06009 is owned by the City of Riverbank.
2. Waste Discharge Requirements Order No. 85-189, adopted by the Board on 28 June 1985, prescribes requirements for a discharge from the plant to evaporation/percolation ponds.
3. Order No. 85-189 is neither adequate nor consistent with current plans and policies of the Board.
4. The Discharger discharges 1.3 million gallons per day of domestic waste, and discharges seasonally 4.0 million gallons per day of cannery waste to evaporation and percolation ponds. Future cannery waste is not expected to exceed 5.0 million gallons per day.
5. The City of Riverbank wastewater treatment plant is in Section 23, T2S, R9E, MDB&M, with surface water drainage to the Stanislaus River, as shown in Attachment A, which is attached hereto and part of the Order by reference.
6. The Board adopted a Water Quality Control Plan, Second Edition, for the Sacramento-San Joaquin Basin (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.
7. The beneficial uses of the Stanislaus River are municipal, industrial, and agricultural supply; recreation; esthetic enjoyment; ground water recharge; fresh water replenishment; and preservation and enhancement of fish, wildlife, and other aquatic resources.
8. The beneficial uses of underlying ground water are domestic, industrial, and agricultural supply.

WASTE DISCHARGE REQUIREMENTS
CITY OF RIVERBANK
WASTEWATER TREATMENT PLANT
STANISLAUS COUNTY

-2-

9. The action to update waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act (CEQA), in accordance with Title 14, California Code of Regulations (CCR), Section 15301.
10. This discharge is exempt from the requirements of Title 23, CCR, Section 2510, et seq. (hereafter Chapter 15). The exemption, pursuant to Section 2511(b), is based on the following:
 - a. The Board is issuing waste discharge requirements, and
 - b. The discharge complies with the Basin Plan, and
 - c. The wastewater does not need to be managed according to 22 CCR, Division 4, Chapter 30, as a hazardous waste.
11. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
12. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 85-189 is rescinded and the City of Riverbank, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Bypass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous' or 'designated', as defined in Sections 2521(a) and 2522(a) of Chapter 15, is prohibited.

WASTE DISCHARGE REQUIREMENTS
CITY OF RIVERBANK
WASTEWATER TREATMENT PLANT
STANISLAUS COUNTY

-3-

B. Discharge Specifications:

1. The monthly average dry weather discharge flow shall not exceed 7.9 million gallons/day.
2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of property owned by the Discharger.
3. As a means of discerning compliance with Discharge Specification No. 2, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
4. The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
5. Ponds shall be managed to prevent breeding of mosquitos. In particular,
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
6. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
7. Ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the nonirrigation season. Design seasonal precipitation shall be based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historial rainfall patterns.

WASTE DISCHARGE REQUIREMENTS
CITY OF RIVERBANK
WASTEWATER TREATMENT PLANT
STANISLAUS COUNTY

-4-

Freeboard shall never be less than one foot (measured vertically to the lowest point of overflow) in the Summer Pond No. 1.

Freeboard shall never be less than two feet (measured vertically to the lowest point of overflow) in the Summer Aeration Cell, Summer Ponds No. 2 and No. 3 and the Winter Pond. Freeboard shall never be less than two feet (measured vertically) on the outside levee (the south levee) of the Domestic Percolation Ponds (Attachment B).

8. On or about 1 October of each year, available pond storage capacity shall at least equal the volume necessary to comply with Discharge Specification 7.

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15, Division 3, Title 23, of the California Code of Regulations and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice from a previously approved practice shall be reported to the Executive Officer and U.S. Environmental Protection Agency (EPA) Regional Administrator at least 90 days in advance of the change.
3. Use and Disposal of sewage shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.

If the State Water Resources Control Board and the Regional Water Quality Control Boards are given the authority to implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR 503 whether or not they have been incorporated into this Order.

4. The Discharger is encouraged to comply with the State Guidance Manual issued by the Department of Health Services titled *Manual of Good Practice for Landspreading of Sewage Sludge*.

WASTE DISCHARGE REQUIREMENTS
CITY OF RIVERBANK
WASTEWATER TREATMENT PLANT
STANISLAUS COUNTY

-5-

D. Ground Water Limitations:

The discharge shall not cause underlying ground water to:

1. Be degraded.
2. Contain chemicals, heavy metals, or trace elements in concentrations that adversely affect beneficial uses or exceed maximum contaminant levels specified in 22 CCR, Division 4, Chapter 15.
3. Exceed a most probable number of total coliform organisms of 2.2/100 ml over any seven-day period.
4. Exceed concentrations of radionuclides specified in 22 CCR, Division 4, Chapter 15.
5. Contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.
6. Contain concentrations of chemical constituents in amounts that adversely affect agricultural use.

E. Provisions:

1. The Discharger shall comply with the Monitoring and Reporting Program No. 94-100, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.

WASTE DISCHARGE REQUIREMENTS
CITY OF RIVERBANK
WASTEWATER TREATMENT PLANT
STANISLAUS COUNTY

-6-

4. At least **90 days** prior to termination or expiration of any lease, contract, or agreement involving disposal or reclamation areas or off-site reuse of effluent, used to justify the capacity authorized herein and assure compliance with this Order, the Discharger shall notify the Board in writing of the situation and of what measures have been taken or are being taken to assure full compliance with this Order.
5. The Discharger shall use the best practicable cost-effective control technique currently available to limit mineralization to no more than a reasonable increment.
6. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
7. The City of Riverbank, as owner of the real property at which the discharge will occur, is responsible for ensuring compliance with these requirements.
8. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
9. If reclaimed water is used for construction purposes, it shall comply with the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes". Other uses of reclaimed water not specifically authorized herein shall be subject to the approval of the Executive Officer and shall comply with 22 CCR, Division 4.
10. The Board will review this Order periodically and will revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 22 April 1994.



WILLIAM H. CROOKS, Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 94-100

FOR
CITY OF RIVERBANK
WASTEWATER TREATMENT PLANT
STANISLAUS COUNTY

Specific sample station locations shall be established under direction of the Board's staff and a description of the stations shall be attached to this Order.

INFLUENT MONITORING

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
20°C BOD ₅	mg/l	Grab	Monthly ¹
Suspended Solids	mg/l	Grab	Monthly ¹
Flow	mg/d	---	Weekly

¹ During the canning season (July through October).

POND MONITORING

<u>Constituents</u>	<u>Units</u>	<u>Types of Sample</u>	<u>Sampling Frequency</u>	<u>Location</u>
Dissolved Oxygen	mg/l	Grab	Weekly	Each Pond
20°C BOD ₅	mg/l	Grab	Monthly	Pond No. 1
Pond Freeboard	Feet	---	Monthly	Each Pond

GROUND WATER MONITORING

Ground water in the existing monitoring wells (MW-1 through MW-4) shall be sampled quarterly. In addition, an upgradient monitoring well shall be constructed north or north east of the ponds. Prior to construction, plans and specifications for the upgradient groundwater monitoring well shall be submitted to Board staff for review and approval.

MONITORING AND REPORTING PROGRAM
CITY OF RIVERBANK
WASTEWATER TREATMENT PLANT
STANISLAUS COUNTY

-2-

The following constitutes the ground water monitoring program:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Nitrates	mg/l	Grab	Quarterly
Electrical Conductivity	μmhos/cm	Grab	Quarterly
Total Coliform Organisms	MPN/100ml	Grab	Quarterly
Water Table Elevation	Feet (MSL) --- & hundredths		Quarterly

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Quarterly monitoring reports shall be submitted to the Regional Board by the 20th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by 30 January of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered By: _____

WILLIAM H. CROOKS, Executive Officer

22 April 1994

(Date)

INFORMATION SHEET

CITY OF RIVERBANK WASTEWATER TREATMENT PLANT STANISLAUS COUNTY

The City of Riverbank wastewater treatment plant is adjacent to the Stanislaus River in the SE 1/4 of Section 23, T2S, R9E, MDB&M. The City discharges 1.3 million gallons per day of domestic waste and discharges seasonally 4.0 million gallons per day of cannery waste to evaporation/percolation ponds. Future cannery waste is not expected to exceed 5.0 million gallons per day.


The cannery processes tomatoes from July through October. Industrial and domestic waste is combined for treatment. Treatment consists of aeration and ponding. Aeration is accomplished in the Summer Aeration Cell with 11 aerators, 75 h.p. each and in Summer Pond No. 1 with 5 aerators, 50 h.p. each. Total area for ponding including aeration ponds is 112 acres.


Ground water monitoring is done with four existing monitoring wells. An upgradient monitoring well will be constructed.

Soil is sand and gravel river deposits. Depth to ground water is about 14 feet.

The requirements are being updated in accordance with Regional Board policies.

SPD:ldj

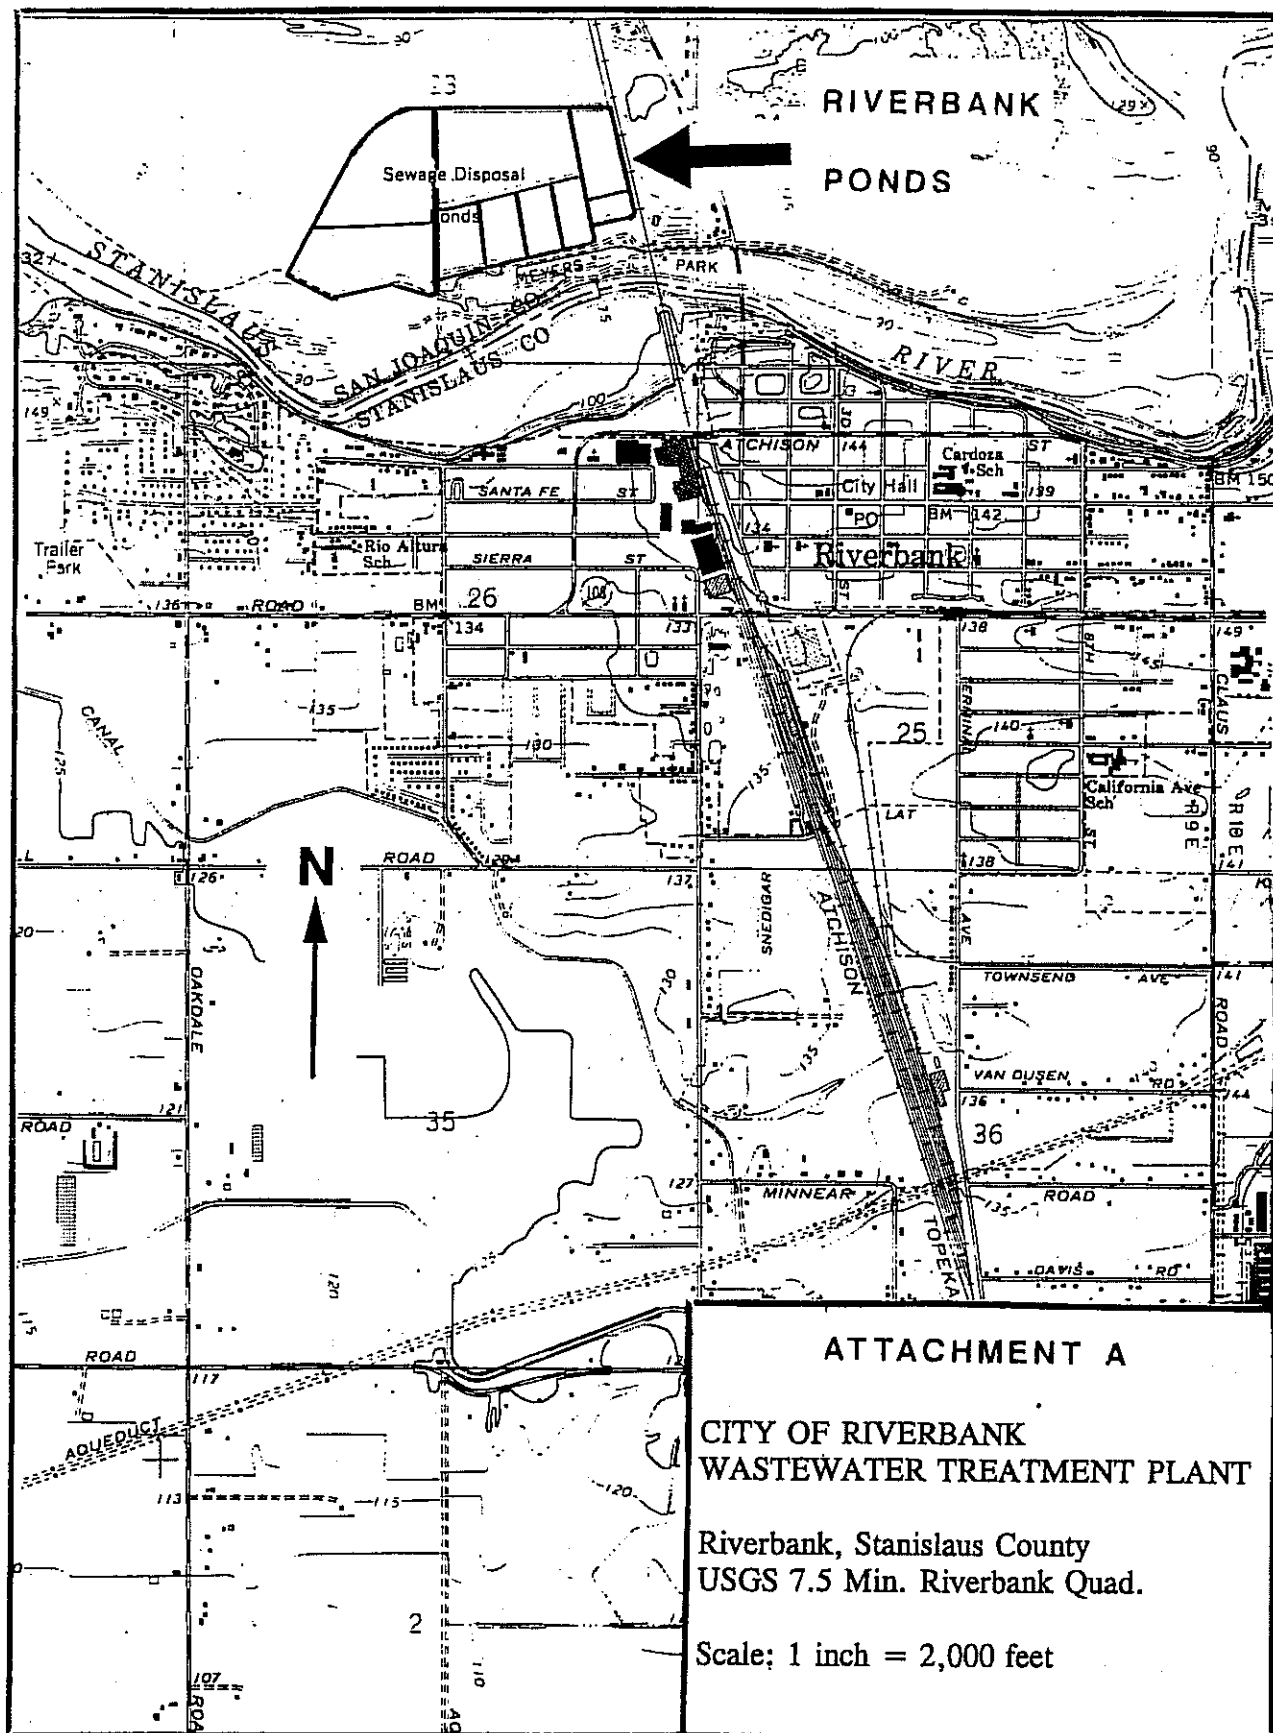

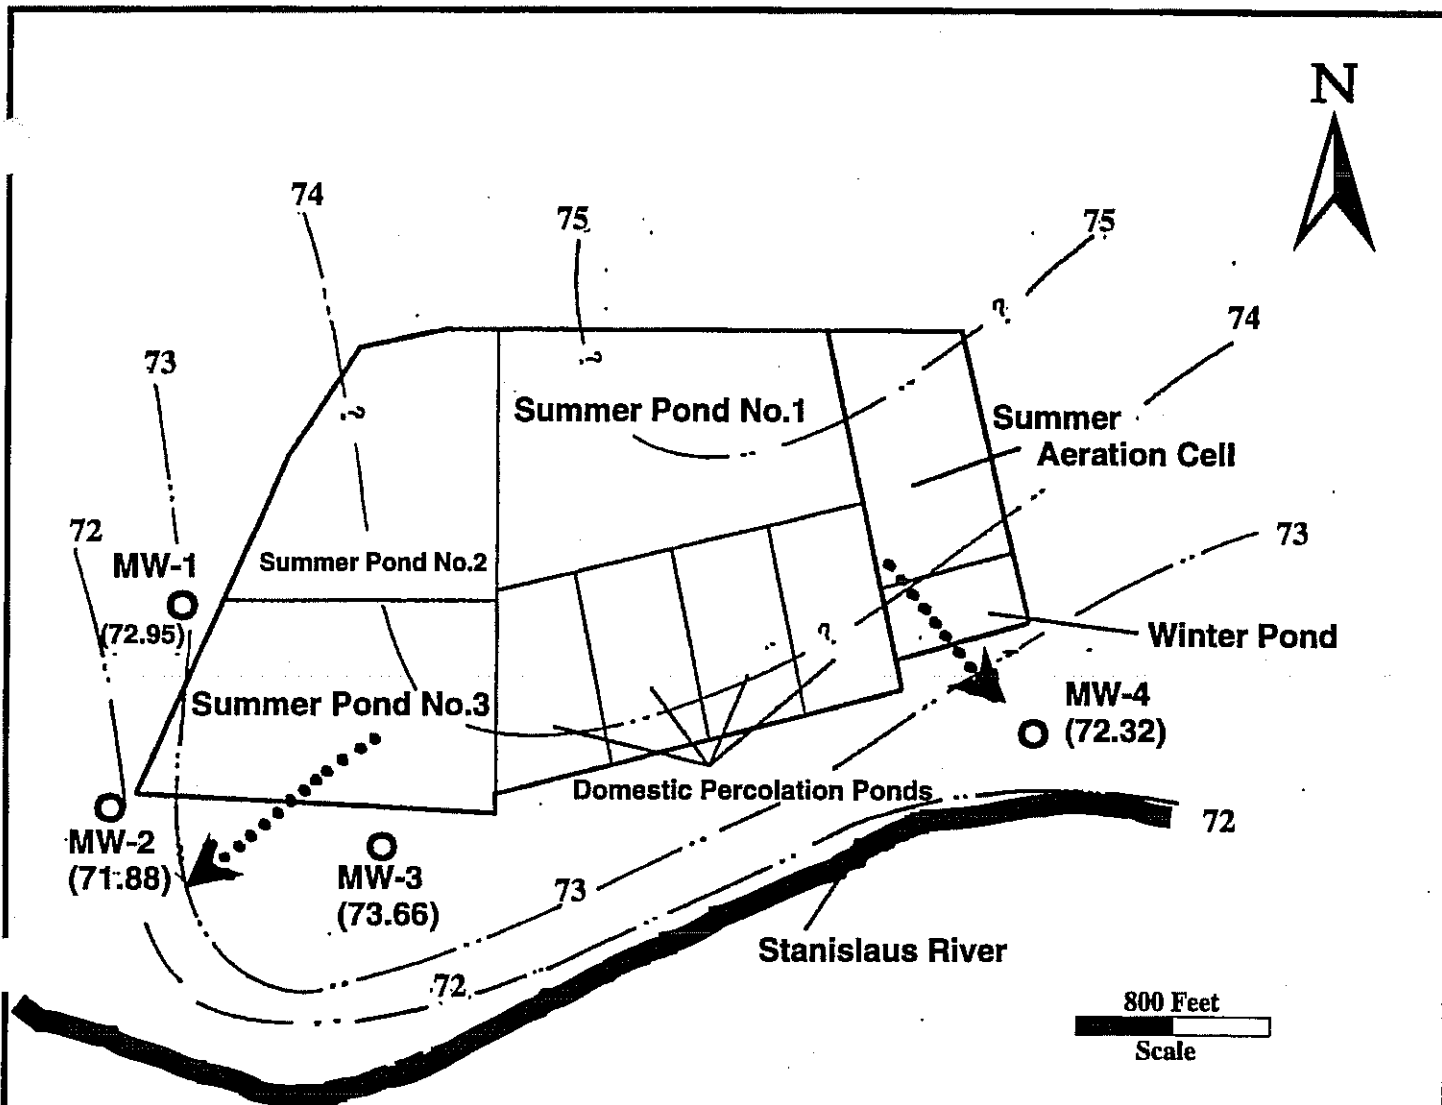

LEGEND:

- Monitoring Well
- Ground Water Contours
-➤ Ground Water Flow

NOTES:

1. Scale is approximate.
2. Ground water contours based on MW static water levels.
3. Ground water contours are preliminary and subject to change based on future data.
4. Figures in brackets represent static GW level at the MW location.

ATTACHMENT B

RIVERBANK PONDS AND MONITORING WELL LOCATIONS

Source: SERT Environmental/Geotechnical

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

REVISED MONITORING AND REPORTING PROGRAM NO. 94-100
FOR
CITY OF RIVERBANK
RIVERBANK WASTEWATER TREATMENT PLANT
STANISLAUS COUNTY

This monitoring and reporting program (MRP) incorporates requirements for monitoring of the treatment process, effluent disposal ponds and groundwater. This MRP is issued pursuant to Water Code Section 13267. The Discharger shall not implement any changes to this MRP unless and until a revised MRP is issued by the Executive Officer. Specific sample station locations shall be approved by Regional Board staff prior to implementation of sampling activities.

INFLUENT MONITORING

Samples of influent wastewater shall be collected at approximately the same time as effluent samples and should be representative of the influent at the plant headworks prior to treatment. The time, date, and location of each grab sample shall be recorded on the sample chain of custody form. At a minimum, influent monitoring shall consist of the following:

<u>Constituent/Parameter</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>	<u>Reporting Frequency</u>
Flow	mgd	Observation	Continuous	Monthly
BOD ₅ at 20° C	mg/l	Grab	Weekly	Monthly
Suspended Solids	mg/l	Grab	Weekly	Monthly
Electrical Conductivity	µmhos/cm	Grab	Weekly	Monthly

EFFLUENT MONITORING

Samples of effluent shall be taken at the point of discharge from the aeration cell in use on the date of sampling (i.e., the Summer Aeration Cell or the Winter Aeration Cell). The time, date, and location of each grab sample shall be recorded on the sample chain of custody form. At a minimum, influent monitoring shall consist of the following:

<u>Constituent/Parameter</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>	<u>Reporting Frequency</u>
Electrical Conductivity	µmhos/cm	Grab	Weekly	Monthly
BOD ₅ at 20° C	mg/L	Grab	Weekly	Monthly
Fixed Dissolved Solids	mg/L	Grab	Monthly	Monthly
Volatile Dissolved Solids	mg/L	Grab	Monthly	Monthly
Ammonia (as nitrogen)	mg/L	Grab	Monthly	Monthly
Nitrate (as nitrogen)	mg/L	Grab	Monthly	Monthly

POND MONITORING

All wastewater treatment and disposal ponds shall be monitored as follows. Monitoring is only required for those ponds that contain effluent.

<u>Constituent/Parameter</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>	<u>Reporting Frequency</u>
Freeboard ¹	Feet (+/- 0.1')	Observation	Weekly	Monthly
Dissolved Oxygen	mg/L	Grab	Weekly	Monthly

¹ For each pond, report beginning and ending dates of discharge, freeboard at the beginning and ending of discharge, and total volume discharged into the pond prior to switching discharge to the next pond (as applicable)

GROUNDWATER MONITORING

Prior to construction of any new groundwater monitoring wells, the Discharger shall submit plans and specifications to the Board for review and approval. All wells shall be sampled and analyzed quarterly. Prior to sampling, the groundwater elevation shall be measured at each well, and each well shall be purged of at least three well volumes until measurements of pH and electrical conductivity have stabilized. Depth to groundwater shall be measured to the nearest 0.01 feet. Water table elevations shall be calculated and used to determine the groundwater gradient and direction of flow. Groundwater samples shall be analyzed as follows:

<u>Constituent/Parameter</u>	<u>Units</u>	<u>Sampling and Reporting Frequency</u>
Groundwater elevation	feet (MSL datum)	Quarterly
pH	pH units	Quarterly
Electrical Conductivity	µmhos/cm	Quarterly
Fixed Dissolved Solids	mg/L	Quarterly
Volatile Dissolved Solids	mg/L	Quarterly
Ammonia (as nitrogen)	mg/L	Quarterly
Nitrate (as nitrogen)	mg/L	Quarterly
Total Coliform Organisms	MPN/100 ml	Quarterly

REPORTING

In reporting monitoring data, the Discharger shall arrange the data in tabular form so that the date, sample type (e.g., influent, effluent, etc.), and reported analytical result for each sample are readily discernible. The data shall be summarized in such a manner to clearly illustrate compliance with waste discharge requirements and spatial or temporal trends, as applicable. The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Regional Board.

As required by the California Business and Professions Code Sections 6735, 7835, and 7835.1, All groundwater monitoring reports shall be prepared under the direct supervision of a registered professional engineer or geologist and signed by the registered professional.

A. Monthly Monitoring Reports

Monthly Monitoring Reports for influent, effluent, and pond monitoring shall be submitted to the Regional Board by the 20th day of the following month.

B. Quarterly Monitoring Reports

The Discharger shall establish a quarterly groundwater sampling schedule such that samples are obtained approximately every three months. Quarterly Monitoring Reports shall be submitted to the Regional Board by the 20th day of January, April, July, and October each year. The Quarterly Report shall include the following:

1. A brief narrative description of all preparatory, monitoring, sampling, and analytical testing activities. The narrative shall be sufficiently detailed to verify compliance with applicable portions of the WDRs, this MRP, and the Standard Provisions and Reporting Requirements. The narrative shall be supported by field logs for each well documenting depth to groundwater; parameters measured before, during, and after purging; method of purging; calculation of the casing volume; and total volume of water purged.
2. A scaled map showing relevant structures and features of the facility, and the locations of monitoring wells and any other sampling stations.
3. Calculation of groundwater elevations.
4. A tabulated analytical results.
5. A comparison of monitoring data to the discharge specifications and groundwater limitations, and explanation of any violation of those requirements.
6. Copies of laboratory analytical report(s).

C. Annual Monitoring Report

The Fourth Quarter Report (due by **20 January** of each year) shall also serve as an Annual Monitoring Report. At a minimum, the Annual Monitoring Report shall include the following:

1. The contents of a regular Quarterly Report (i.e., monitoring results for the last groundwater monitoring event of the previous calendar year).

REVISED MONITORING AND REPORTING PROGRAM NO. 94-100
CITY OF RIVERBANK
WASTEWATER TREATMENT PLANT
STANISLAUS COUNTY

-4-

2. If requested by staff, tabular and graphical summaries of all monitoring data obtained during the previous year (including influent, effluent, pond and groundwater).
3. A narrative discussion of historical and current groundwater analytical results, including spatial and temporal trends, with reference to summary data tables and graphs (as applicable).
4. Tables of historical and current water table elevations.
5. A groundwater contour map for each quarter of the year.
6. A discussion of long-term groundwater quality trends at the facility.
7. A discussion of compliance and the corrective action taken, as well as any planned or proposed actions needed to bring the discharge into full compliance with the waste discharge requirements.
8. A discussion of data gaps and potential deficiencies in the monitoring system, as applicable.

The Discharger shall implement the above monitoring program as of the date of this Order.

ORDERED BY:

GARY M. CARLTON, Executive Officer

10 July 2000

(Date)

ALO

INFORMATION SHEET

PATTERSON FROZEN FOODS, INC. STANISLAUS COUNTY

Patterson Frozen Foods, Inc., is a frozen food, vegetable processing plant. Processing of various vegetables takes place at the Patterson facility throughout the year.

Process water is conveyed to a 2 acre (10 acre-feet) surge/silt removal pond with a 2 day detention time. Flow proceeds to a 9 acre (75 acre-feet) holding pond with a 15-16 day detention time. Flow is then directed to a 6 acre (30-35 acre-feet) percolation pond and then to the irrigation areas. The Discharger has approximately 650-700 acres designated for land disposal by ponding and flood irrigation. Tailwater is managed by the discharger and returned to the surge/silt removal pond.

The processing plant is on First Avenue in Patterson. The land disposal and reclamation areas are approximately three miles north west of Patterson near the intersection of Rogers Road and Donkin Road. Wastewater is conveyed to the disposal area via pipeline. Surface water drainage in the area is to Del Puerto Creek.

MKK

