

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 94-101

WASTE DISCHARGE REQUIREMENTS

FOR
HOUSING AUTHORITY OF THE COUNTY OF SAN JOAQUIN
HOUSING AUTHORITY THORNTON SEWER PLANT
SAN JOAQUIN COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. The Housing Authority of the County of San Joaquin (hereafter Discharger) submitted a Report of Waste Discharge, dated 8 February 1994, for their wastewater treatment and disposal facility. The property is owned by the Housing Authority of the County of San Joaquin.
2. Waste Discharge Requirements Resolution No. 58-568, adopted by the Board on 21 November 1958, prescribes requirements for a discharge from a wastewater treatment facility to land.
3. Resolution No. 58-568 is neither adequate nor consistent with current plans and policies of the Board.
4. The Housing Authority Thornton Sewer Plant serves a farm labor community of approximately 300 persons. The Discharger disposes of 0.0294 mgd of domestic sewage to land. The facility consists of a Imhoff tank (flow chamber capacity, 820 cu. ft., and sludge chamber capacity, 1390 cu. ft.) and evaporation / percolation ponds (2.98 million gallons capacity). The sludge is drained from the chamber once per month and dried on-site. The wastewater treatment facility is properly fenced.
5. The sewer ponds were relocated in 1978 west of the Interstate 5 Freeway. The relocated ponds were designed by the California Department of Transportation. In 1983, the ponds' depths were increased to two feet. During the heavy rainy season, the facility has encountered a rise in ground water, which prevents the wastewater from percolating properly. The ponds' freeboard is monitored daily.
6. The Housing Authority Thornton Sewer Plant is in Section 10, T4N, R5E, MDB&M, with surface water drainage to Beaver Slough, as shown in Attachment A, which is attached hereto and part of the Order by reference.
7. The Board adopted a Water Quality Control Plan, Second Edition, for the Sacramento-San Joaquin Basin (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.

WASTE DISCHARGE REQUIREMENTS
HOUSING AUTHORITY OF THE COUNTY OF SAN JOAQUIN
HOUSING AUTHORITY THORNTON SEWER PLANT
SAN JOAQUIN COUNTY

-2-

8. The beneficial uses of Beaver Slough are, industrial, and agricultural supply; recreation; aesthetic enjoyment; navigation; fresh water replenishment; and preservation and enhancement of fish, wildlife, and other aquatic resources.
9. The beneficial uses of underlying ground water are domestic, industrial, and agricultural supply.
10. The action to adopt waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act (CEQA), in accordance with Title 14, California Code of Regulations (CCR), Section 15301.
11. This discharge is exempt from the requirements of Title 23, CCR, Section 2510, et seq. (hereafter Chapter 15). The exemption, pursuant to Section 2511(b), is based on the following:
 - a. The Board is issuing waste discharge requirements, and
 - b. The discharge complies with the Basin Plan, and
 - c. The wastewater does not need to be managed according to 22 CCR, Division 4, Chapter 30, as a hazardous waste.
12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Resolution No. 58-568 is rescinded and the Housing Authority of the County of San Joaquin, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Bypass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous' or 'designated', as defined in Sections 2521(a) and 2522(a) of Chapter 15, is prohibited.

WASTE DISCHARGE REQUIREMENTS
HOUSING AUTHORITY OF THE COUNTY OF SAN JOAQUIN
HOUSING AUTHORITY THORNTON SEWER PLANT
SAN JOAQUIN COUNTY

-3-

B. Discharge Specifications:

1. The monthly average dry weather discharge flow shall not exceed 0.115 million gallons/day.
2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment and disposal areas.
3. As a means of discerning compliance with Discharge Specification No. 2, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
4. Ponds shall not have a pH less than 6.5 or greater than 8.5.
5. Ponds shall be managed to prevent breeding of mosquitos. In particular:
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
6. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
7. Ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the nonirrigation season. Freeboard shall never be less than two feet measured vertically to the lowest point of overflow.
8. On or about **1 October** of each year, available pond storage capacity shall at least equal the volume necessary to comply with Discharge Specification 7.

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15, Division 3, Title 23, of the California Code of Regulations and approved by the Executive Officer.

WASTE DISCHARGE REQUIREMENTS
HOUSING AUTHORITY OF THE COUNTY OF SAN JOAQUIN
HOUSING AUTHORITY THORNTON SEWER PLANT
SAN JOAQUIN COUNTY

-4-

2. Any proposed change in sludge use or disposal practice from a previously approved practice shall be reported to the Executive Officer and U.S. Environmental Protection Agency (EPA) Regional Administrator at least 90 days in advance of the change.
3. Use and Disposal of sewage sludge shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.

If the State Water Resources Control Board and the Regional Water Quality Control Boards are given the authority to implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR 503 whether or not they have been incorporated into this Order.

4. Within 60 days after the adoption of this Order, the Discharger shall submit a sludge disposal plan describing the annual volume of sludge generated by the plant and specifying the disposal practices.

D. Ground Water Limitations:

The discharge shall not cause underlying ground water to:

1. Contain waste constituents in concentrations statistically greater than receiving water limits, where specified below, or background water quality where not specified.
2. Contain chemicals, heavy metals, or trace elements in concentrations that adversely affect beneficial uses or exceed maximum contaminant levels specified in 22 CCR, Division 4, Chapter 15.
3. Exceed a most probable number of total coliform organisms of 2.2/100 ml over any seven-day period.
4. Exceed concentrations of radionuclides specified in 22 CCR, Division 4, Chapter 15.
5. Contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.
6. Contain concentrations of chemical constituents in amounts that adversely affect agricultural use.

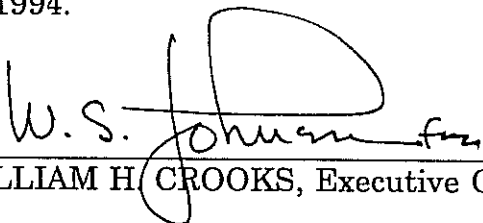
WASTE DISCHARGE REQUIREMENTS
HOUSING AUTHORITY OF THE COUNTY OF SAN JOAQUIN
HOUSING AUTHORITY THORNTON SEWER PLANT
SAN JOAQUIN COUNTY

-5-

E. Provisions:

1. The Discharger shall comply with the Monitoring and Reporting Program No. 94-101, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
4. At least **90 days** prior to termination or expiration of any lease, contract, or agreement involving disposal or reclamation areas or off-site reuse of effluent, used to justify the capacity authorized herein and assure compliance with this Order, the Discharger shall notify the Board in writing of the situation and of what measures have been taken or are being taken to assure full compliance with this Order.
5. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
6. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
7. The Board will review this Order periodically and will revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 22 April 1994.


WILLIAM H. CROOKS, Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 94-101

FOR
HOUSING AUTHORITY OF THE COUNTY OF SAN JOAQUIN
HOUSING AUTHORITY THORNTON SEWER PLANT
SAN JOAQUIN COUNTY

EFFLUENT MONITORING

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Flow	mgd	Cumulative	Daily

PONDS

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Pond Freeboard	feet	visual	Daily

WATER SUPPLY MONITORING

A sampling station shall be established where a representative sample of the municipal water supply can be obtained. Water supply monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Sampling Frequency</u>
Standard Minerals	mg/l	Annually

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the **20th day** of the following month.

MONITORING AND REPORTING PROGRAM
HOUSING AUTHORITY OF THE COUNTY OF SAN JOAQUIN
HOUSING AUTHORITY THORNTON SEWER PLANT
SAN JOAQUIN COUNTY

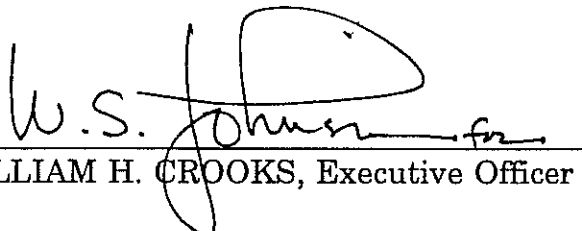
-2-

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by **30 January** of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring program as of the date of this Order.

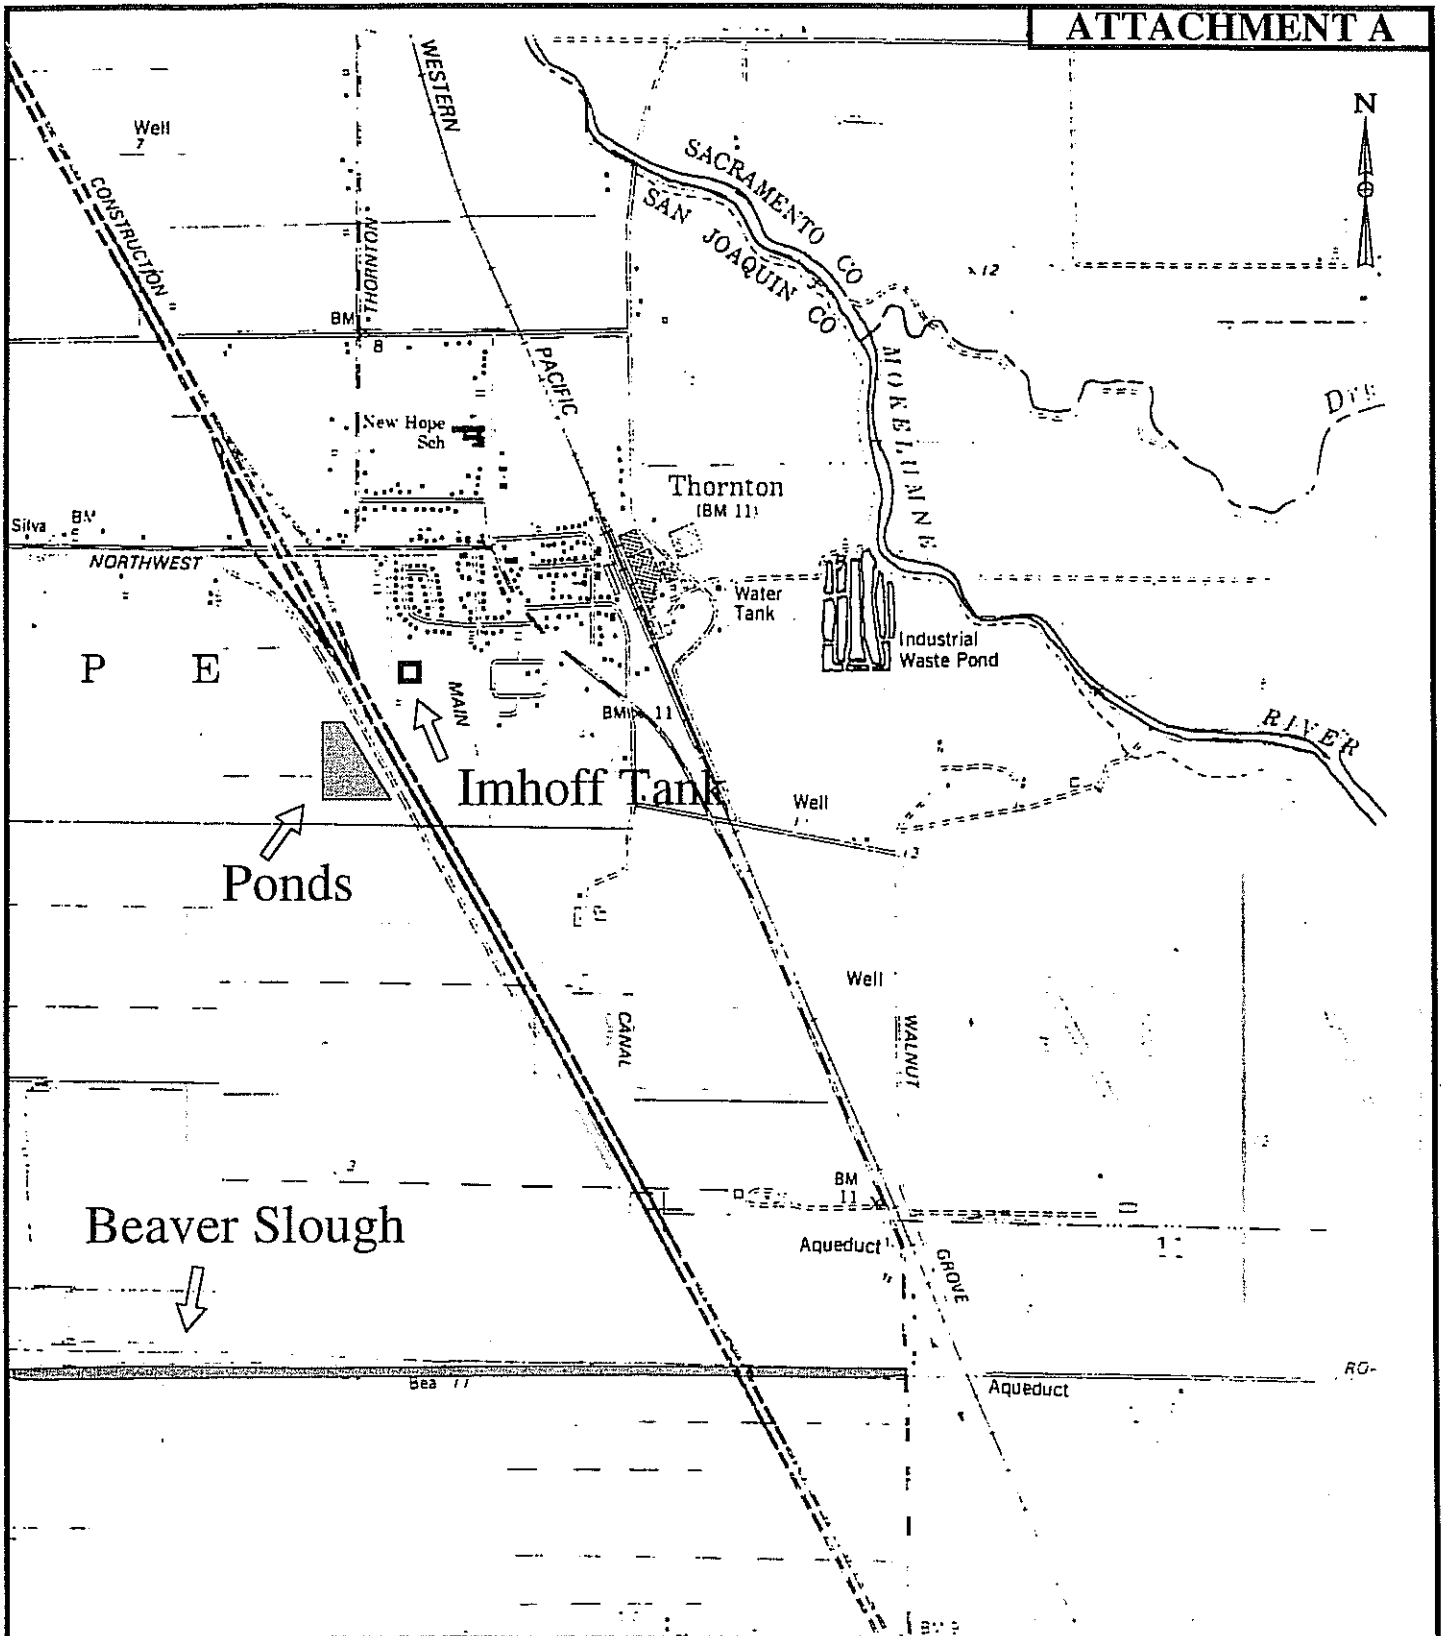
Ordered by:


WILLIAM H. CROOKS, Executive Officer

22 April 1994

(Date)

IK:ik



HOUSING AUTHORITY SEWER PLANT
 USGS THORNTON QUAD., 7.5 MIN
 1 Inch = 2000 Feet

INFORMATION SHEET

HOUSING AUTHORITY OF THE COUNTY OF SAN JOAQUIN HOUSING AUTHORITY THORNTON SEWER PLANT SAN JOAQUIN COUNTY

The Housing Authority of the County of San Joaquin Thornton Sewer Plant serves a farm labor community of approximately 300 persons. The Discharger disposes of 0.0294 mgd of domestic sewage to land. The facility consists of a Imhoff tank (flow chamber capacity, 820 cu. ft., and sludge chamber capacity, 1390 cu. ft.) and evaporation/ percolation ponds (2.98 million gallons capacity). The sludge is drained from the chamber once per month and dried on-site. The wastewater treatment facility is properly fenced.

The sewer ponds were relocated in 1978 west of the Interstate 5 Freeway. The relocated ponds were designed by the California Department of Transportation. In 1983, the ponds' depths were increased to two feet. During the heavy rainy season, the facility has encountered a rise in ground water, which prevents the wastewater from percolating properly. The ponds' freeboard is monitored daily.

IK:ik