

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 94-273

WASTE DISCHARGE REQUIREMENTS
FOR
CITY OF WATERFORD
WASTEWATER TREATMENT FACILITY
STANISLAUS COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. The City of Waterford (hereafter Discharger) submitted a Report of Waste Discharge, dated 27 June 1994, for its wastewater treatment and disposal facility. The property (Assessor's Parcel Nos. 080-4105 and 080-09-01) is owned by the City of Waterford.
2. Waste Discharge Requirements Order No. 85-190, adopted by the Board on 28 June 1985, prescribes requirements for a discharge from the sewage treatment plant to evaporation/percolation ponds.
3. Order No. 85-190 is neither adequate nor consistent with current plans and policies of the Board.
4. The Discharger discharges 0.45 mgd of domestic sewage to the treatment plant. The plant is being enlarged to a design flow of 1.0 mgd.
5. Wastewater treatment at the expanded plant will consist of complete mixing by floating aerators in two lagoons, and partial mixing in by floating aerators in three lagoons. Effluent will then pass through an eight inch pipe under the Tuolumne River to four evaporation/percolation ponds approximately 500 feet south of the river.
6. The facility is in Section 33, T3S, R11E, MDB&M, with surface water drainage to the Tuolumne River as shown in Attachment A, which is attached hereto and part of the Order by reference.
7. The Board adopted a Water Quality Control Plan, Second Edition, for the San Joaquin River Basin (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.

WASTE DISCHARGE REQUIREMENTS
CITY OF WATERFORD
WASTEWATER TREATMENT FACILITY
STANISLAUS COUNTY

-2-

8. The beneficial uses of the Tuolumne River are municipal, industrial, and agricultural supply; recreation; esthetic enjoyment; and preservation and enhancement of fish, wildlife, and other aquatic resources.
9. The beneficial uses of underlying ground water are domestic, industrial, and agricultural supply.
10. The City of Waterford has passed and approved a negative declaration and mitigation monitoring program in accordance with the California Environmental Quality Act (CEQA), (Public Resources Code Section 21000, et seq.) and the State CEQA Guidelines. The project as approved will not have a significant effect on water quality.
11. The Board has reviewed the negative declaration and mitigation monitoring program and concurs there are no significant impacts on water quality.
12. This discharge is exempt from the requirements of Title 23, CCR, Section 2510, et seq. (hereafter Chapter 15). The exemption, pursuant to Section 2511(b), is based on the following:
 - a. The Board is issuing waste discharge requirements, and
 - b. The discharge complies with the Basin Plan, and
 - c. The wastewater does not need to be managed according to 22 CCR, Division 4, Chapter 30, as a hazardous waste.
13. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
14. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 85-190 is rescinded and the City of Waterford, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

WASTE DISCHARGE REQUIREMENTS
CITY OF WATERFORD
WASTEWATER TREATMENT FACILITY
STANISLAUS COUNTY

-3-

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Bypass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous' or 'designated', as defined in Sections 2521(a) and 2522(a) of Chapter 15, is prohibited.

B. Discharge Specifications:

1. The monthly average dry weather discharge flow shall not exceed 1.0 million gallons/day.
2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of property owned by the Discharger.
3. As a means of discerning compliance with Discharge Specification No. 2, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
4. The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
5. Ponds shall be managed to prevent breeding of mosquitos. In particular,
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.

WASTE DISCHARGE REQUIREMENTS
CITY OF WATERFORD
WASTEWATER TREATMENT FACILITY
STANISLAUS COUNTY

-4-

6. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
7. Ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the nonirrigation season. Design seasonal precipitation shall be based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns. Freeboard shall never be less than two feet (measured vertically to the lowest point of overflow).
8. On or about **1 October** of each year, available pond storage capacity shall at least equal the volume necessary to comply with Discharge Specification 7.

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15, Division 3, Title 23, of the California Code of Regulations and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice from a previously approved practice shall be reported to the Executive Officer and U.S. Environmental Protection Agency (EPA) Regional Administrator at least 90 days in advance of the change.
3. Use and disposal of sewage shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.

If the State Water Resources Control Board and the Regional Water Quality Control Boards are given the authority to implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR 503 whether or not they have been incorporated into this Order.

WASTE DISCHARGE REQUIREMENTS
CITY OF WATERFORD
WASTEWATER TREATMENT FACILITY
STANISLAUS COUNTY

-5-

4. By 13 October 1994, the Discharger shall submit a sludge disposal plan describing the annual volume of sludge generated by the plant and specifying the disposal practices.

D. Ground Water Limitations:

The discharge shall not cause underlying ground water to:

1. Contain waste constituents in concentrations statistically greater than background water quality. (For purposes of comparison, background water quality shall be determined when background monitoring provides sufficient data. Quality determined in this manner establishes "water quality protection standards.")
2. Contain chemicals, heavy metals, or trace elements in concentrations that adversely affect beneficial uses or exceed maximum contaminant levels specified in 22 CCR, Division 4, Chapter 15.
3. Exceed a most probable number of total coliform organisms of 2.2/100 ml over any seven-day period.
4. Exceed concentrations of radionuclides specified in 22 CCR, Division 4, Chapter 15.
5. Contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.
6. Contain concentrations of chemical constituents in amounts that adversely affect agricultural use.

E. Provisions:

1. The Discharger shall comply with the Monitoring and Reporting Program No. 94-273, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.

WASTE DISCHARGE REQUIREMENTS
CITY OF WATERFORD
WASTEWATER TREATMENT FACILITY
STANISLAUS COUNTY

-6-


2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
4. At least **90 days** prior to termination or expiration of any lease, contract, or agreement involving disposal or reclamation areas or off-site reuse of effluent, used to justify the capacity authorized herein and assure compliance with this Order, the Discharger shall notify the Board in writing of the situation and of what measures have been taken or are being taken to assure full compliance with this Order.
5. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
6. The City of Waterford, as owner of the real property at which the discharge will occur, is responsible for ensuring compliance with these requirements.
7. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
8. If reclaimed water is used for construction purposes, it shall comply with the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes". Other uses of reclaimed water not specifically authorized herein shall be subject to the approval of the Executive Officer and shall comply with 22 CCR, Division 4.

WASTE DISCHARGE REQUIREMENTS
CITY OF WATERFORD
WASTEWATER TREATMENT FACILITY
STANISLAUS COUNTY

-7-

9. The Board will review this Order periodically and will revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 16 September 1994.

A handwritten signature in cursive script, reading "William H. Crooks", is written over a horizontal line.

WILLIAM H. CROOKS, Executive Officer

SPD:ldj

A short horizontal line is drawn on the page.

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 94-273

FOR
CITY OF WATERFORD
WASTEWATER TREATMENT FACILITY
STANISLAUS COUNTY

Specific sample station locations shall be established under direction of the Board's staff and a description of the stations shall be attached to this Order.

FLOW

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Inflow to Plant	MGD	---	Average Daily

POND MONITORING

Each pond shall be monitored as follows:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Dissolved Oxygen	mg/l	Grab	Weekly
Pond Freeboard	Feet	---	Monthly

PIPE CROSSING MONITORING

Monitoring of the pipe crossing shall include:

- Monthly testing in the sump for leakage.
- Annual pressure testing of the inner pipe for leakage.

WATER SUPPLY MONITORING

A sampling station shall be established where a representative sample of the municipal water supply can be obtained. Water supply monitoring shall include at least the following:

MONITORING AND REPORTING PROGRAM
CITY OF WATERFORD
WASTEWATER TREATMENT FACILITY
STANISLAUS COUNTY

-2-

<u>Constituents</u>	<u>Units</u>	<u>Sampling Frequency</u>
Electrical Conductivity @ 25°C	μmhos/cm	Yearly

GROUND WATER MONITORING

Ground water upgradient and downgradient of the evaporation/percolation ponds shall be sampled quarterly. The following constitutes the ground water monitoring program:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Nitrates as NO ₃	mg/l	Grab	Quarterly
Electrical Conductivity	μ mhos/cm	Grab	Quarterly
Total Coliform Organisms	MPN/100 ml	Grab	Quarterly
Water Table Elevation	Feet (MSL) and Hundreths	---	Quarterly

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the **20th day** of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by **30 January** of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

MONITORING AND REPORTING PROGRAM
CITY OF WATERFORD
WASTEWATER TREATMENT FACILITY
STANISLAUS COUNTY

-3-

The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered By: William H. Crooks
WILLIAM H. CROOKS, Executive Officer


16 September 1994

(Date)

SPD:ldj

ATTACHMENT A
CITY OF WATERFORD
WASTEWATER TREATMENT PLANT
WATERFORD, STANISLAUS COUNTY
USGS 7.5 MIN. QUAD.

SCALE: 1 INCH = 2000 FEET

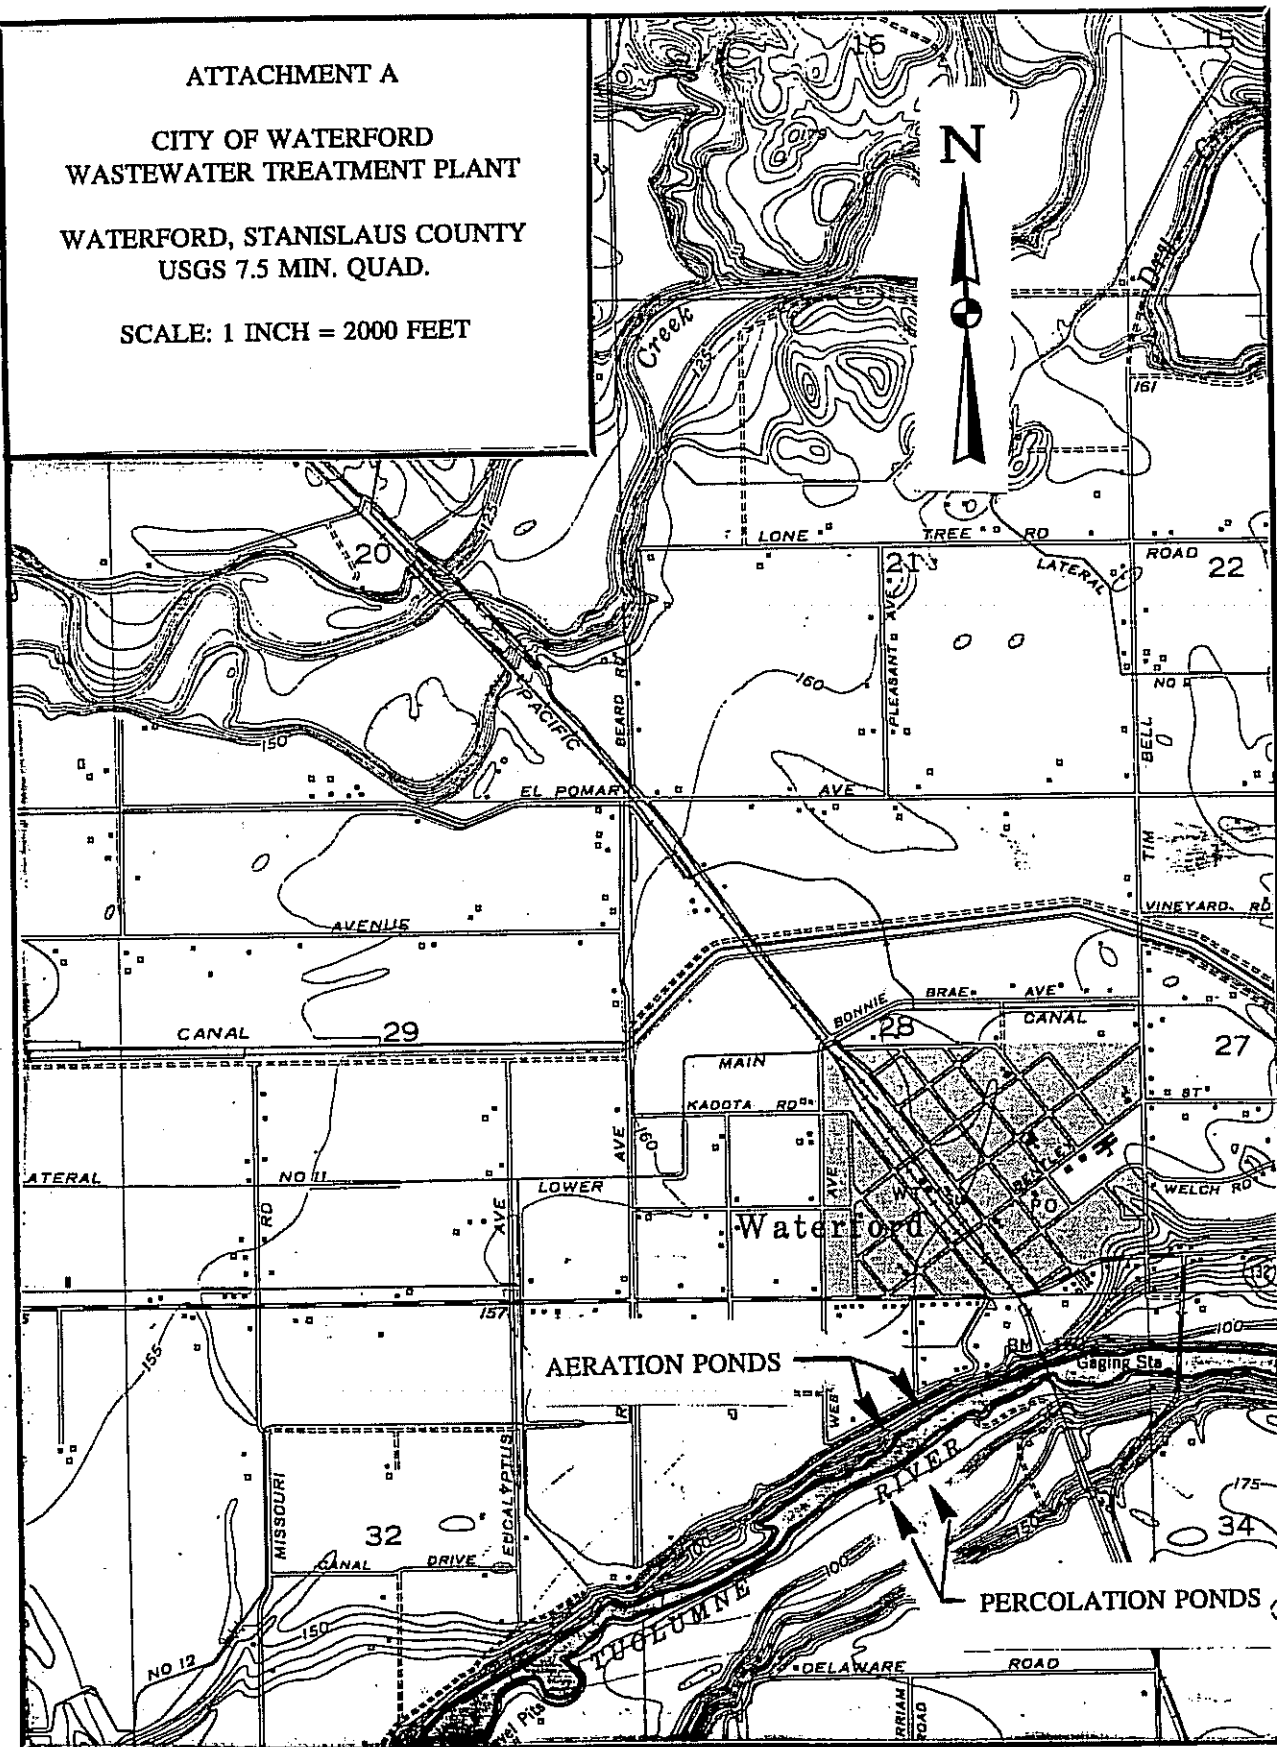

INFORMATION SHEET

CITY OF WATERFORD WASTEWATER TREATMENT FACILITY STANISLAUS COUNTY

The City of Waterford is expanding their wastewater treatment plant from the present flow of 0.45 mgd to a design flow of 1.0 mgd. Treatment at the expanded plant will consist of complete mixing by floating aerators in two lagoons and partial mixing by floating aerators in three lagoons. Effluent will then pass through a 14-inch pipe under the Tuolumne River to four evaporation/percolation ponds 500 feet south of the river.

Soils in the evaporation/percolation pond area are classified as loamy sand and sandy loam. Ground water occurs at a depth of twenty feet from the surface; moves towards the river and recharges it. Annual average rainfall is approximately 13 1/2 inches.

The City of Waterford has passed and approved a negative declaration and mitigation monitoring program. Mitigation involves replacement of elderberry bushes under the direction of the U.S. Fish and Wildlife Service for protection of the valley elderberry longhorn beetle. There are no significant impacts on water quality.

Surface water drainage is to the Tuolumne River.

SPD:ldj\26 September 1994