

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 90-186

WASTE DISCHARGE REQUIREMENTS
FOR
CITY OF ISLETON
WASTEWATER TREATMENT FACILITY
SACRAMENTO COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. The Board, on 31 May 1985, adopted Order No. 85-104 which prescribed requirements for a discharge from the Isleton Municipal Wastewater Treatment facility (hereafter Discharger) to Evaporation/Percolation Ponds.
2. Present waste discharge requirements established by 85-104 are neither adequate nor consistent with plans and policies of the Board.
3. The City of Isleton, presently discharges 117,000 gallons per day and has the capacity to treat a maximum of 0.43 mgd of domestic waste in a seven acre, three stage aeration stabilization lagoon system, and dispose of the effluent in a 24.2 acre system of percolation/evaporation beds. The lagoons are adjacent to Georgiana Slough with surface water drainage to toe drains that are pumped to the Slough.
4. The Isleton domestic waste treatment plant is about 3/4 mile east of the City of Isleton adjacent to the west bank of Georgiana Slough in Section 36, T4N, R3E, MDB&M upstream of the confluence of Georgiana Slough with the Mokelumne River, with surface drainage to the Mokelumne River as shown on Attachment A, a part of this Order.
5. The beneficial uses of the Mokelumne River are domestic and agricultural supply; recreation; aesthetic enjoyment; navigation; ground water recharge; fresh water replenishment; and preservation and enhancement of fish, wildlife, and other aquatic resources. The following marinas are known to have domestic water supply intakes on the Mokelumne River downstream of its confluence with Georgiana Slough: Light House Resort, Rancho Marina, Spindrift Marina, Willow Berm Marina, and Moore's River Boat Marina. The City of Antioch has a water supply intake downstream of the Isleton facility.
6. The beneficial uses of the ground water are municipal, industrial, and agricultural supply.
7. The Board has adopted a Water Quality Control Plan, Second Edition, for the Sacramento-San Joaquin River Basin (5B) which contains water quality objectives for all waters of the Basin. These requirements are consistent with that Plan.
8. The action to update waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act, in accordance with Section 15301, Title 14, California Code of Regulations (CCR).

9. This discharge is exempt from the requirements of Section 2511(b), Subchapter 15, Chapter 3, Title 23, of the CCR. The exemption is based on the following:
 - a. The Board has issued waste discharge requirements.
 - b. The discharge is in compliance with the applicable Water Quality Control Plan, and
 - c. The wastewater does not need to be managed according to Chapter 30 of Division 4, Title 22, CCR, as a hazardous waste.
10. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
11. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 85-104 be rescinded and the City of Isleton, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste is prohibited.
3. The discharge of industrial brine waste to the sewage treatment system is prohibited.

B. Discharge Specifications:

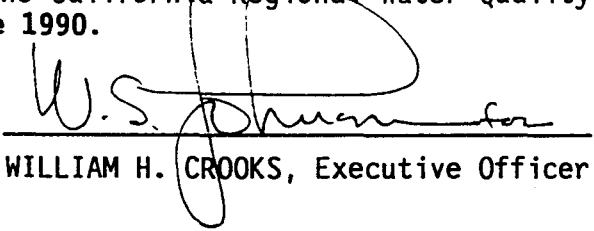
1. Neither the treatment nor the discharge shall cause a nuisance or condition of pollution as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal area at all times.
4. The 30-day average daily dry weather discharge flow shall not exceed 0.43 million gallons.
5. Collected screening, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
6. A 1.0 foot freeboard shall be maintained in all ponds at all times.

7. Reclaimed wastewater shall meet the criteria contained in Title 22, Division 4, CCR (Section 60301, et seq.).
8. The dissolved oxygen content of holding ponds shall not be less than 1.0 mg/l for 16 hours in any 24-hour period.

C. Provisions:

1. The Discharger may be required to submit technical reports as directed by the Executive Officer.
2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 90-186.
3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 February 1990, which are a part of this Order.
4. By the effective date of this Order, the Discharger shall provide certified wastewater treatment plant operators in accordance with regulations adopted by the State Water Resources Control Board.
5. The Discharger shall report promptly to the Board any material change or proposed change in the character, location, or volume of the discharge.
6. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
7. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 22 June 1990.


WILLIAM H. CROOKS, Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 90-186

FOR
CITY OF ISLETON
WASTEWATER TREATMENT PLANT
SACRAMENTO COUNTY

INFLUENT MONITORING

Effluent samples shall be collected from the final outfall prior to discharge to the evaporation/percolation ponds. Effluent samples should be representative of the volume and nature of the discharge. The following shall constitute the effluent monitoring program.

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Total Daily Flow	gpd	Estimate	Monthly

HOLDING POND MONITORING

The freeboard shall be monitored on all evaporation/percolation ponds. The following shall constitute the monitoring program:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Freeboard	feet	Observation	Weekly
Dissolved Oxygen	mg/l	Grab	Weekly

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Board by the 15th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

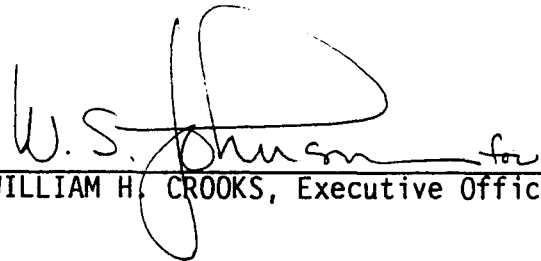
MONITORING AND REPORTING PROGRAM
CITY OF ISLETON
WASTEWATER TREATMENT PLANT
SACRAMENTO COUNTY

-2-

Upon written request of the Board, the Discharger shall submit a report to the Board by **30 January** of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered by


WILLIAM H. CROOKS, Executive Officer

22 June 1990

(Date)

JJH:ej 6/1/90

