



Central Valley Regional Water Quality Control Board

13 November 2023

Craig Wagner
Madera County Public Works
Engineering Services
200 W. 4th Street, Suite 3100
Madera, CA 93637

CERTIFIED MAIL
7021 1970 0001 5446 5600

NOTICE OF APPLICABILITY (NOA); STATE WATER RESOURCES CONTROL BOARD ORDER WQ 2014-0153-DWQ; GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS; COUNTY OF MADERA; TEAFORD MEADOW LAKES WASTEWATER TREATMENT FACILITY; MADERA COUNTY

On July 26, 2023, Madera County Public Works, Engineering Services, submitted a Report of Waste Discharge (RWD), seeking coverage under State Water Resources Control Board's (State Water Board) Water Quality Order 2014-0153-DWQ, *General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Order) for the Teaford Meadow Lakes Wastewater Treatment Facility (Facility). The County of Madera (County or Discharger) was issued Notice of Applicability (NOA) 97-10-DWQ-R5163 on 15 May 2014 enrolling the Facility under State Water Resources Control Board's Water Quality Order No. 97-10-DWQ, *General Waste Discharge Requirements for Discharges to Land by Small Domestic Wastewater Treatment Systems*.

Based on the information provided, the system treats and disposes of less than 100,000 gallons per day (gpd) of domestic wastewater and is therefore eligible for coverage under the general and specific conditions of the General Order. This letter serves as formal notice that the General Order is applicable to your system and the wastewater discharge described below. You are hereby assigned enrollee number **2014-0153-DWQ-R5401** for your system. This letter and coverage under the General Order supersedes NOA 97-10-DWQ-R5163.

You should familiarize yourself with the General Order and its attachments enclosed with this letter, which describe mandatory discharge and monitoring requirements. Sampling, monitoring, and reporting requirements applicable to your treatment and disposal methods must be completed in accordance with the appropriate treatment systems sections of the General Order and the attached **Monitoring and Reporting Program (MRP) No. 2014-0153-DWQ-R5401**. This MRP was developed after

MARK BRADFORD, CHAIR | PATRICK PULUPA, ESQ., EXECUTIVE OFFICER

1685 E Street, Fresno, CA 93706 | www.waterboards.ca.gov/centralvalley

consideration of your waste characterization and site conditions described in the attached memorandum.

DESCRIPTION OF DISCHARGE

The Facility is located in Madera County, southwest of Bass Lake, CA and South of Oakhurst, CA off of Teaford Saddle Road (Road 223) (37.2692°, -119.5727°). The Facility receives wastewater from approximately 66 households and treats the domestic wastewater using an activated sludge treatment system. At the Facility, the domestic wastewater gravity flows from the collection system through a manual bar screen into the aeration basin. Solids collected from the manual bar screen are collected during normal operations and deposited into a disposal container. Once full, the container is disposed of at an approved landfill.

Wastewater is then treated in an extended aeration basin and the aeration blower is stopped to allow sludge to settle at the bottom. A contractor pulls sludge from the aeration basin once per quarter. This sludge is taken to the nearby Oakhurst Wastewater Treatment Plant for processing, dewatering, and disposal. The secondary treatment occurs at the aeration basin with a positive displacement blower that supplies air to diffusers in the aeration basin. After this, the wastewater is sent through a clarifier and then disinfected with 12.5% sodium hypochlorite in a contact tank.

From the contact tank, the treated wastewater is sent to two spray field zones, Spray Field Zones 1 and 2. Spray Field Zone 1 is approximately 100 feet up hill from Little Fine Gold Creek (37.2695°, -119.5733°). Spray Field Zone 2 is east of Little Fine Gold Creek and the WWTF (37.2691°, -119.5722°). There is an unlined emergency pond connected at the Facility that is primarily used to capture any runoff from the spray fields. The average effluent flow from the WWTF is approximately 3,600 gallons per day (gpd).

FACILITY SPECIFIC REQUIREMENTS

The Discharger shall maintain exclusive control over the discharge and shall comply with terms and conditions of this NOA, General Order 2014-0153-DWQ, with all attachments and MRP No. 2014-0153-R5401. In accordance with Section B.1.a of the General Order, influent flow shall not exceed a **monthly average daily discharge of 22,000 gpd** (as described in the MRP).

The General Order states in Section D that the discharge shall not exceed the applicable effluent limitations as described in Table 4 of the General Order. Table 1 below summarizes the applicable biochemical oxygen demand (BOD) and total suspended solids (TSS) effluent limitation for the facility's discharge to the land application area (e.g., spray fields) as specified in Section D.1.a of the General Order for activated sludge. Compliance with this limitation shall be monitored at the Facility's discharge point to the land application area.

Table 1 - Effluent Limitation

Constituent	Units	Limit	Limit
BOD ₅	mg/L	30 (Monthly Average)	45 (7-day Average)
TSS	mg/L	30 (Monthly Average)	45 (7-day Average)

The General Order states in Section B.1.I that the Discharger shall comply with the setbacks as described in Table 3. This table summarizes different setback requirements for wastewater system equipment, activities, land application areas (spray field), and storage and/or treatment ponds from sensitive receptors and property lines where applicable. The Discharger shall comply with the applicable setback requirements, as summarized in the following table:

Table 2 - Setback Requirements

Equipment or Activity	Domestic Well	Flowing Stream/Ephemeral Stream Drainage	Property Line	Lake or Reservoir
Septic Tank, Aerobic Treatment Unit, Treatment System, or Collection System	150 ft	50 ft	5 ft	200 ft
Land Application Area (i.e., spray field)	100 ft	50 ft	100 ft	200 ft

The Discharger shall comply with all applicable sections of the General Order, including:

1. Activated Sludge Systems requirements in Section B.4. of the General Order;
2. Pond Systems requirements in Section B.5 of the General Order;
3. Land Application System and/or Recycled Water System requirements in Section B.7 of the General Order;
4. Sludge/Solids/Biosolids Disposal requirements in Section B. 8 of the General Order; and
5. Groundwater and Surface Water Limitations specified in Section C of the General Order

Provision E.1 of the General Order requires dischargers enrolled under the General Order to prepare and implement the following reports within **90 days** of the issuance of the NOA.

- Spill Prevention and Emergency Response Plan (Provision E.1.a),
- Sampling Analysis Plan (Provision E.1.b),

- Sludge Management Plan (Provision E.1.c).

A copy of the Spill Prevention and Emergency Response Plan and the Sampling and Analysis Plan shall be maintained at the treatment facility and shall be presented to the Regional Water Board staff upon request. The sludge management plan shall be submitted to the Central Valley Water Board **by 11 February 2024**.

As stated in Section E.2.w., in the event any change in control or ownership of the Facility or wastewater disposal areas, the Discharger must notify the succeeding owner or operator of the existence of this General Order by letter, a copy of which shall be immediately forwarded to the Central Valley Water Board Executive Officer.

Failure to comply with the requirements in this NOA, General Order 2014-0153-DWQ, with all attachments, and MRP No. 2014-0153-DWQ-R5401 could result in an enforcement action as authorized by provisions of the California Water Code. Discharge of wastes other than those described in this NOA is prohibited. If the method of waste disposal changes from that described in this NOA, you must submit a new Report of Waste Discharge describing the new operation.

The required annual fee specified in the annual billing from the State Water Board shall be paid until this NOA is officially terminated. You must notify this office in writing if the discharge regulated by the General Order ceases, so that we may terminate coverage and avoid unnecessary billing.

On 31 May 2018, the Central Valley Water Board adopted Basin Plan amendments incorporating new strategies for addressing ongoing salt and nitrate accumulation in the Central Valley as part of the Central Valley Salinity Alternatives for Long-Term Sustainability (**CV-SALTS**) initiative. Further details of these strategies are discussed in the enclosed memorandum. As these strategies are implemented, the Central Valley Water Board may find it necessary to modify the requirements of this NOA to ensure the goals of the Salt and Nitrate Control Programs are met.

All regulatory documents, submissions, materials, data, monitoring reports, and correspondence should be converted to a searchable Portable Document Format (PDF) and submitted electronically. Documents that are less than 50 MB should be emailed to: centralvalleyfresno@waterboards.ca.gov. Documents that are 50 MB or larger should be transferred to a disk and mailed to the Central Valley Water Board office at 1685 E Street, Fresno, CA 93706. To ensure that your submittals are routed to the appropriate staff, the following information block should be included in any email used to transmit documents to this office:


Program: Non-15,
Place ID: 201070,
Facility Name: Teaford Meadow Lakes WWTF,
Order: 2014-0153-DWQ-R5401

All documents, including responses to inspections and written notifications, submitted to comply with this NOA shall be directed, via the paperless office system, to the Compliance and Enforcement Unit, attention to Omar Mostafa. Mr. Mostafa can be reached at (559) 445-5197 or Omar.Mostafa@waterboards.ca.gov. Questions regarding the permitting aspects of the NOA, and notification for termination of coverage under the Small Domestic General Order, shall be directed, via the paperless office system, to the WDR Permitting Unit, attention Salvador Vargas. Salvador Vargas can be reached at (559) 444-2488 or by email at salvador.vargas@waterboards.ca.gov.

Any person aggrieved by this action of the Central Valley Water Board may petition the State Water Resources Control Board to review the action in accordance with California Water Code section 13320 and California Code of Regulations, title 23, sections 2050 and following. The State Water Resources Control Board must receive the petition by 5:00 p.m., 30 days after the date of this NOA, except that if the thirtieth day following the date of this Order falls on a Saturday, Sunday, or state holiday, the petition must be received by the State Water Resources Control Board by 5:00 p.m. on the next business day. Copies of the law and regulations applicable to filing petitions may be found on the internet at [Copies of the laws and regulations applicable to filing petitions](https://www.waterboards.ca.gov/public_notices/petitions/water_quality) (https://www.waterboards.ca.gov/public_notices/petitions/water_quality) or will be provided upon request.

In order to conserve paper and reduce mailing costs, a paper copy of General Order WQO 2014-0153-DWQ has been sent only to the Discharger. Others are advised that the [General Order](#) is available on the State Water Board's website (http://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf).

If you have any questions regarding this matter, please contact Salvador Vargas by phone at (559) 444-2488, or by email at salvador.vargas@waterboards.ca.gov.

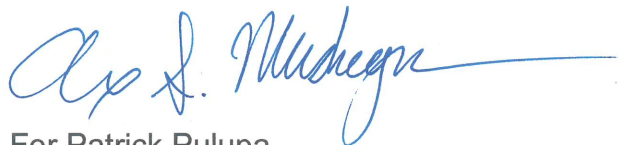

For Patrick Pulupa
Executive Officer

(see next page for Attachments, Enclosures, and cc's)

Attachments:


- Attachment A – Vicinity Map
- Attachment B – Site Map
- Attachment C – Process Flow Diagram

Enclosures:

- Monitoring and Reporting Program 2014-0153-DWQ-R5401
- Staff Review Memorandum for Madera County MD #24 Teaford Meadow Lakes WWTF
- State Water Resources Control Board Order WQ 2014-0153-DWQ (Discharger only)


cc's:

- Christopher Moskal, State Water Resources Control Board, OCC, Sacramento (via email)
- Kennedy Knight, State Water Resources Control Board, OCC, Sacramento (via email)
- Laurel Warddrip, State Water Resources Control Board, DWQ, Sacramento (via email)
- Tricia Wathen, State Water Resources Control Board, Division of Drinking Water (via email)
- RB5S-cvsalts@waterboards.ca.gov
- Omar Mostafa, Central Valley Water Board, Fresno (via email)
- Madera County Public Works Department, Madera, CA
- Madera County Environmental Health Division
- Criag Wagner, Supervising Civil Engineer, Madera County Public Works, Engineering Services (via email)
- Debbie Webster, CVCWA (via email)

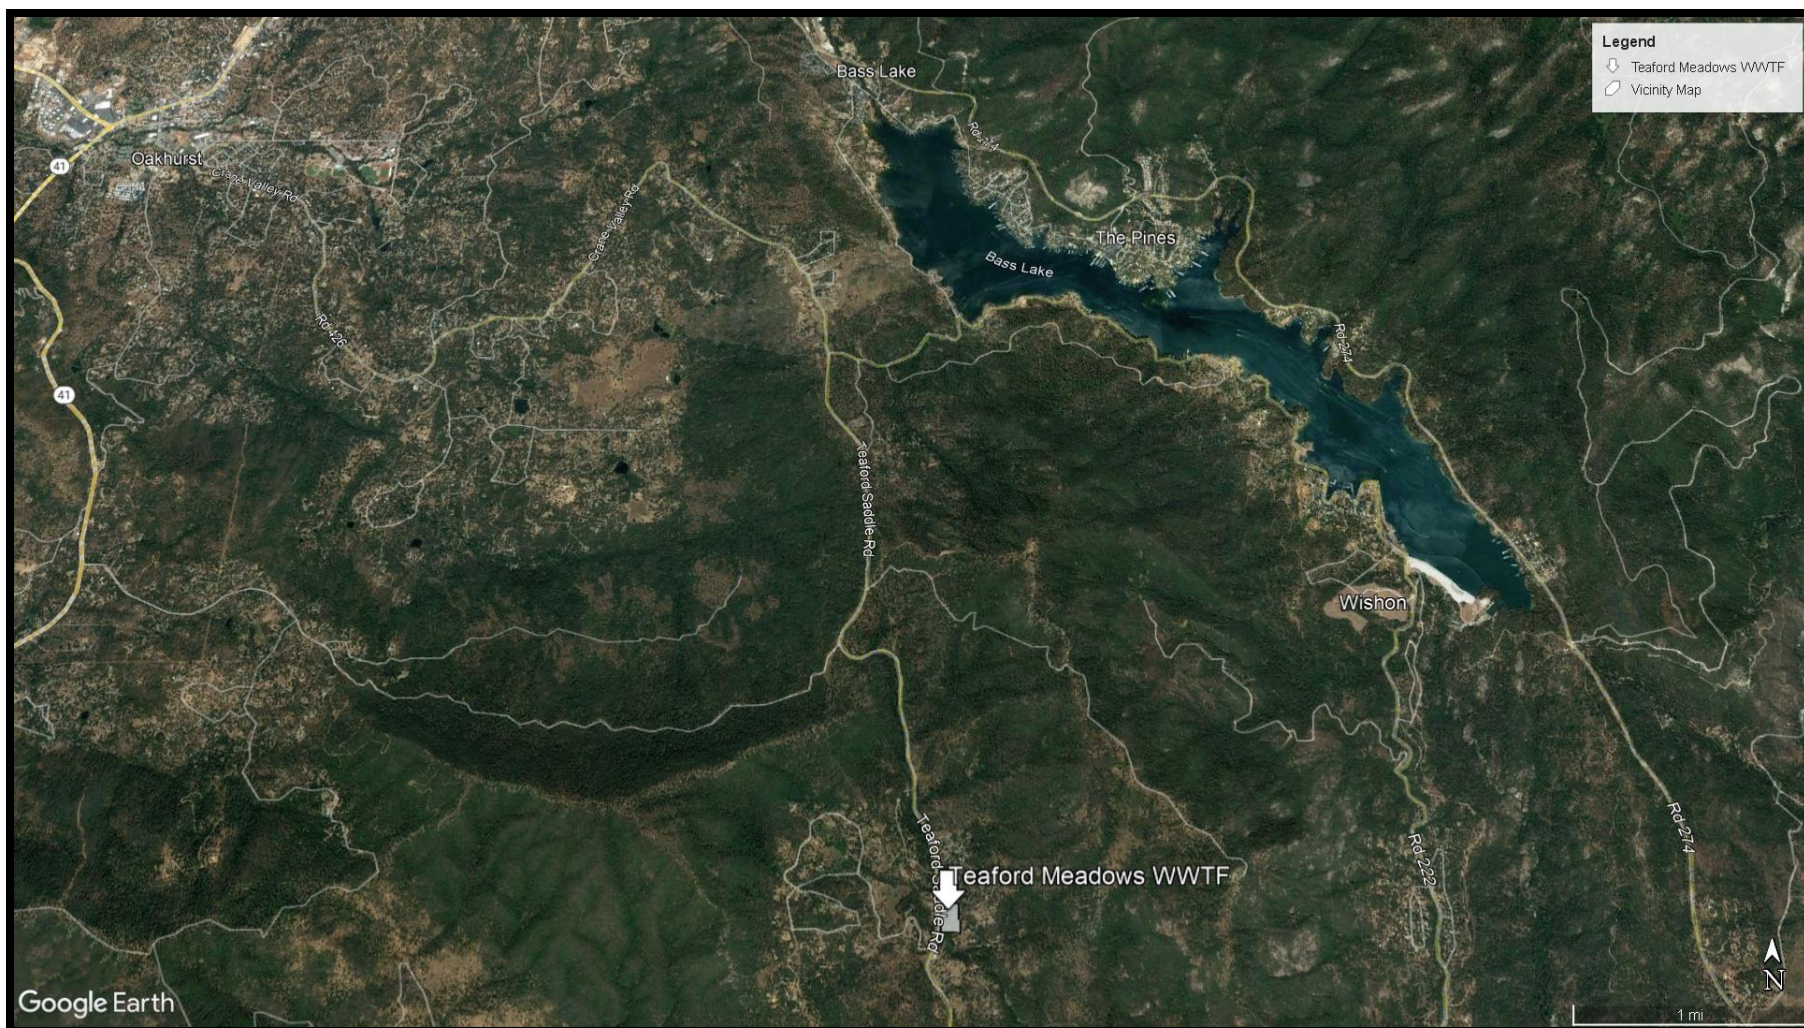

ATTACHMENT A – VICINITY MAP


NOTICE OF APPLICABILITY 2014-0153-DWQ-R5401
Drawing Reference: Google Earth

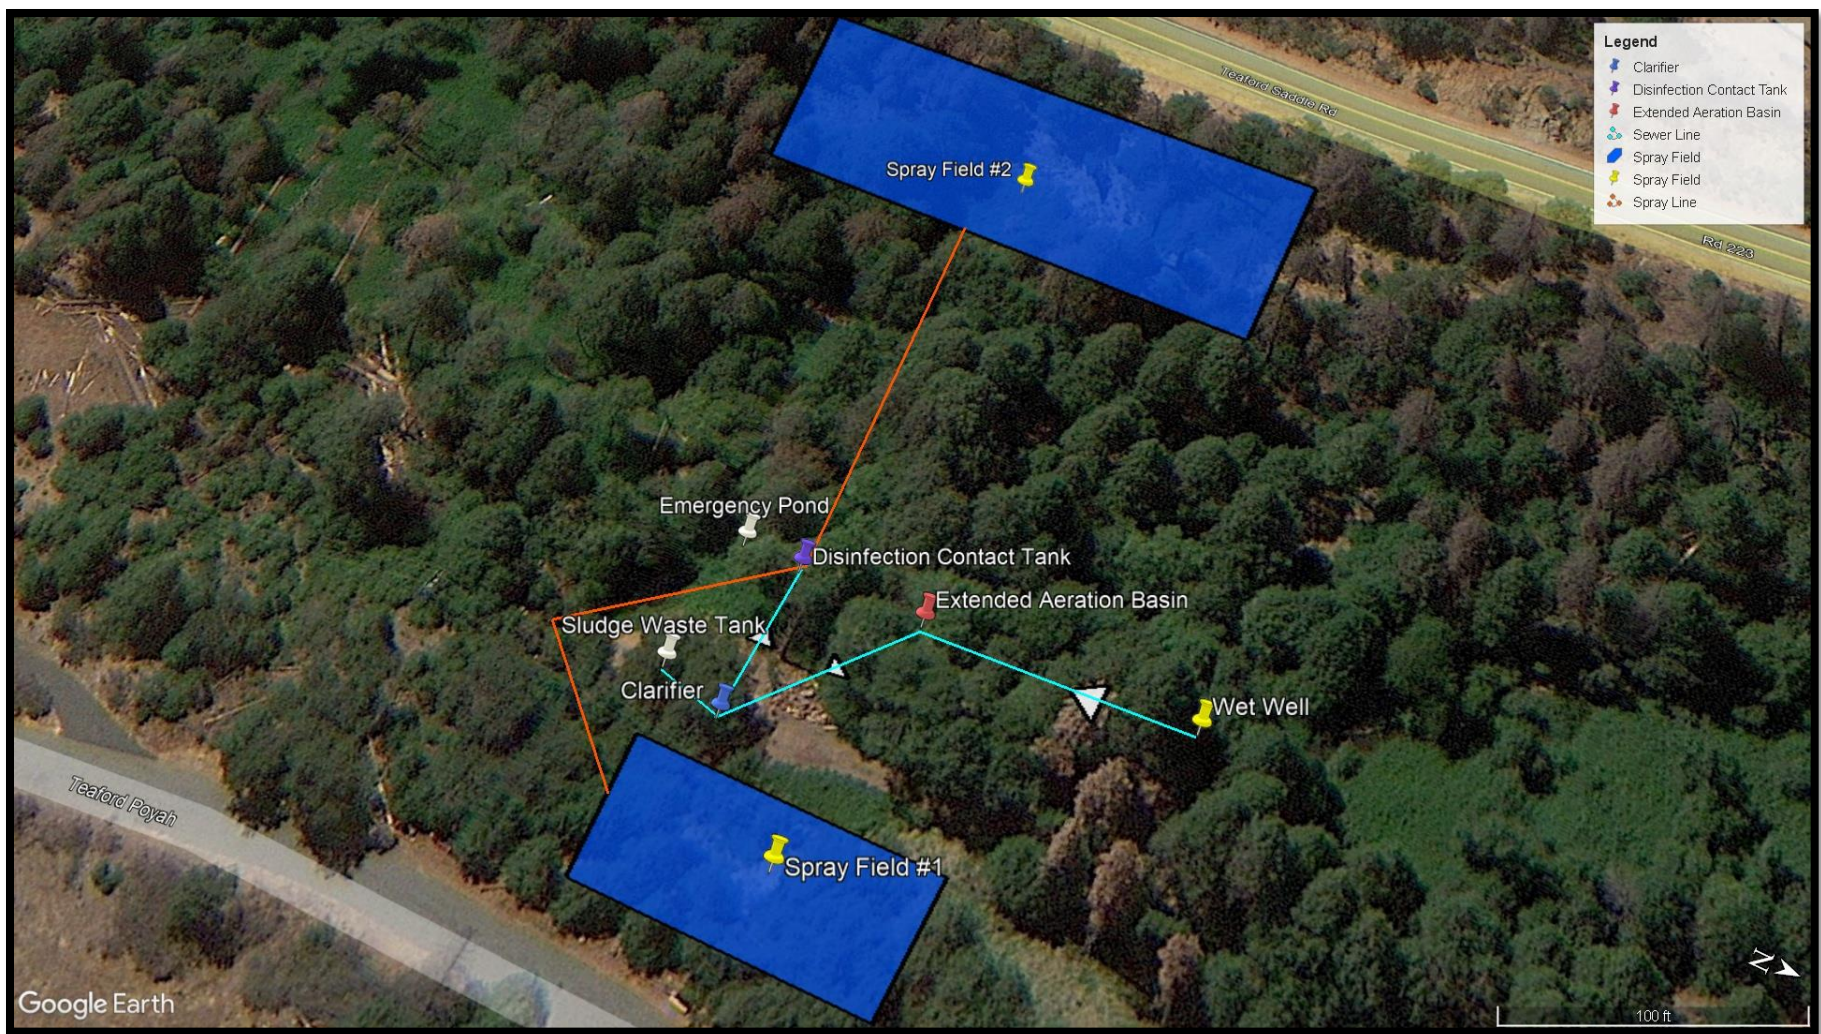

ATTACHMENT B – SITE MAP

NOTICE OF APPLICABILITY 2014-0153-DWQ-R5401

Drawing Reference: Google Earth

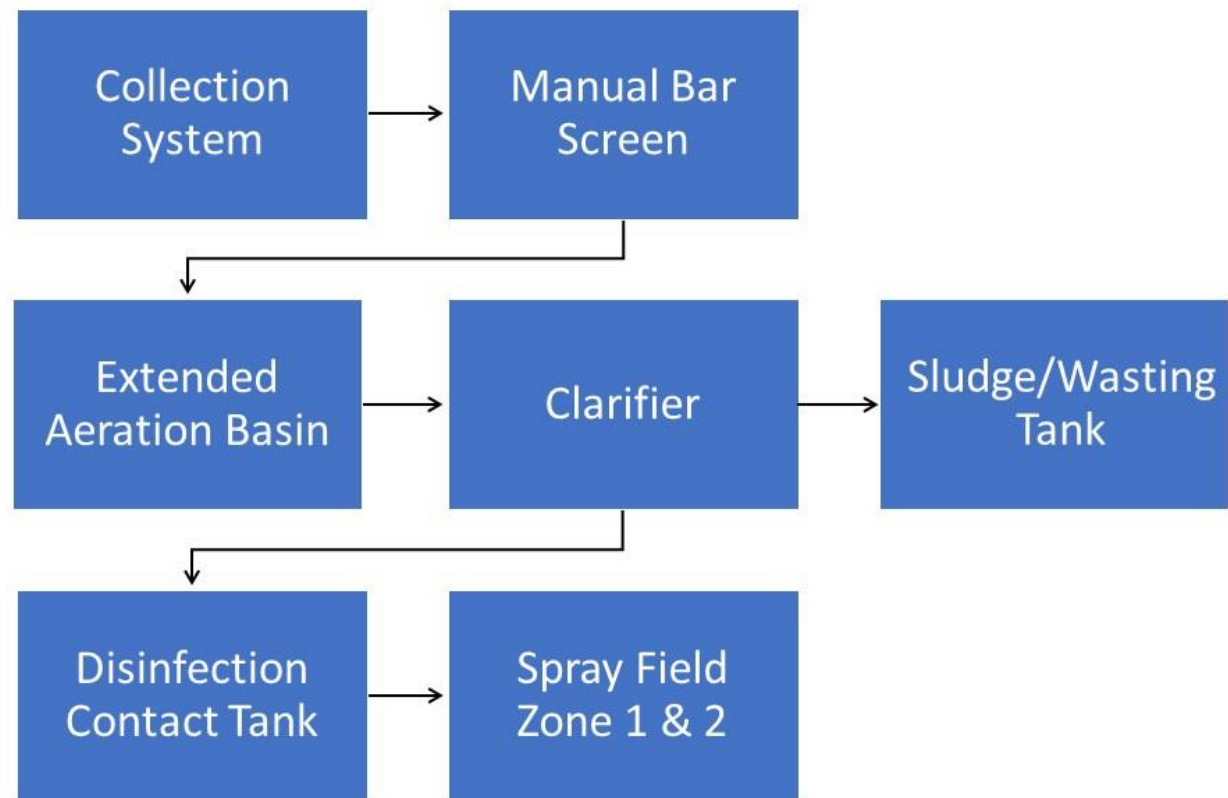

ATTACHMENT C – PROCESS FLOW DIAGRAM
NOTICE OF APPLICABILITY 2014-0153-DWQ-R5401

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION**

**MONITORING AND REPORTING PROGRAM NO. 2014-0153-DWQ-R5401
FOR
COUNTY OF MADERA
TEAFORD MEADOW LAKES WASTEWATER TREATMENT FACILITY
MADERA COUNTY**

This Monitoring and Reporting Program (MRP) describes requirements for monitoring a wastewater treatment system. This MRP is issued pursuant to Water Code section 13267. Madera County (Discharger) shall not implement any changes to this MRP unless and until a revised MRP is issued by the Regional Water Quality Control Board, Central Valley Region (Central Valley Water Board) or Executive Officer.

Section 13267 of the California Water Code states, in part:

“In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports and shall identify the evidence that supports requiring that person to provide the reports.”

Section 13268 of the California Water Code states, in part:

“(a) Any person failing or refusing to furnish technical or monitoring program reports as required by subdivision (b) of Section 13267 or failing or refusing to furnish a statement of compliance as required by subdivision (b) of Section 13399.2, or falsifying and information provided therein, is guilty of a misdemeanor and may be liable civilly in accordance with subdivision (b).

(b)(1) Civil liability may be administratively imposed by a regional board in accordance with Article 2.5 (commencing with section 13323) of Chapter 5 for a violation of subdivision (a) in an amount which shall not exceed one thousand dollars (\$1,000) for each day in which the violation occurs.”

The Discharger owns and operates the Teaford Meadow Lakes Wastewater Treatment Facility (Facility) that is subject to Notice of Applicability (NOA) 2014-0153-DWQ-R5401. The NOA enrolls the Facility under State Water Resources Control Board Order WQ 2014-0153-DWQ, *General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Order). The reports required in this MRP are

necessary to ensure that the Discharger complies with the NOA and General Order. Pursuant to Water Code section 13267, the Discharger shall implement this MRP and shall submit the monitoring reports described herein.

All samples shall be representative of the volume and nature of the discharge or matrix of material sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by Central Valley Water Board staff.

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board, Environmental Laboratory Accreditation Program (ELAP) certified laboratory, or:

1. The user is trained in proper use and maintenance of the instruments.
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer.
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

ACTIVATED SLUDGE TREATMENT SYSTEM MONITORING

Effluent Monitoring

Samples of effluent shall be taken at an area that represents the effluent quality distributed to the spray fields. At a minimum, effluent monitoring shall consist of the following:

Table 1 - Effluent Monitoring

Constituent	Units	Sample Type	Sample Frequency	Reporting Frequency
Flow Rate	gpd	Meter	Continuous	Quarterly
Biochemical Oxygen Demand (BOD)	mg/L	Grab	Monthly	Quarterly
Total Suspended Solids (TSS)	mg/L	Grab	Monthly	Quarterly
Electrical Conductivity (EC)	µmhos/cm	Grab	Monthly	Quarterly
Total Nitrogen	mg/L	Grab	Monthly	Quarterly

Emergency Wastewater Pond Monitoring

Influent samples shall be taken from any wastewater or runoff discharged into the Emergency Pond. At a minimum, influent monitoring shall consist of the following:

Table 2 – Emergency Wastewater Pond Monitoring

Constituent	Units	Sample Type	Sample Frequency	Reporting Frequency
Dissolved Oxygen (DO)	mg/L	Grab	Monthly	Quarterly
Freeboard	0.1 ft	Measurement	Monthly	Quarterly
Odors	N/A	Observation	Monthly	Quarterly
Berm Condition	N/A	Observation	Monthly	Quarterly
Flow Rate	gpd	Meter	Continuous	Quarterly

Note: Flow may be metered or estimated. If flows are estimated, the monitoring report shall provide calculations showing how the Discharger estimated flows to the emergency pond.

At a minimum, the total flow shall be measured monthly to calculate the average daily flow for the month.

DISINFECTION SYSTEM MONITORING

Disinfection shall be monitored as specified in Table 3 below. Samples shall be collected immediately downstream of the disinfection system.

Table 3 - Disinfection System Monitoring

Constituent	Units	Sample Type	Sample Frequency	Reporting Frequency
Total Coliform Organisms	MPN/100 mL	Grab	Monthly	Quarterly
Chlorine Residual	mg/L	Grab	3/Week	Quarterly
Contact Time	mg-min/L	Calculate	3/Week	Quarterly

Note: MPN/100 mL denotes most probable number per 100mL sample. NTU denotes nephelometric turbidity unit.

LAND APPLICATION AREA MONITORING

The Discharger shall monitor the spray fields (i.e., land application areas or LAA) when wastewater and/or supplemental irrigation water is applied. If wastewater/supplemental irrigation water is not applied during a reporting period, the monitoring report shall so state. LAA monitoring shall include the following:

Table 4 - LAA Monitoring

Constituent	Units	Sample Type	Sampling Frequency	Reporting Frequency
Supplemental Irrigation	gpd	Meter	Monthly	Quarterly
Wastewater Flow	gpd	Meter	Monthly	Quarterly
Local Rainfall	Inches	Weather Station	Monthly	Quarterly
Application Rate	gal/acre/mo	Calculated	Monthly	Quarterly
Soil Erosion Evidence	--	Observation	Monthly	Quarterly
Containment Berm Condition	--	Observation	Monthly	Quarterly
Soil Saturation/ Ponding	--	Observation	Monthly	Quarterly
Nuisance Odors/Vectors	--	Observation	Monthly	Quarterly
Discharge Off-Site	--	Observation	Monthly	Quarterly

Note: gpd denotes gallons per day

1. Meter requires meter reading, a pump run time meter, or other approved method.
2. Weather station may be site-specific station or nearby governmental weather reporting station.
3. Acreage applied denotes the acreage to which wastewater is applied.

SLUDGE/BIOSOLIDS MONITORING

The Discharger shall report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, etc.) generated at the wastewater system. Records shall include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records shall be submitted as part of the annual monitoring report.

REPORTING

In reporting monitoring data, the Discharger shall arrange the data in tabular form so that the date, sample type (e.g., effluent, solids, etc.), and reported analytical or visual inspection results are readily discernible. The data shall be summarized to clearly illustrate compliance with the General Order and NOA as applicable. The results of any monitoring done more frequently than required at the locations specified in the MRP shall be reported in the next regularly scheduled monitoring report and shall be included in calculations as appropriate.

All regulatory documents, submissions, materials, data, monitoring reports, and correspondence should be converted to a searchable Portable Document Format (PDF) and submitted electronically. Documents that are less than 50MB should be emailed to: centralvalleyfresno@waterboards.ca.gov. Documents that are 50MB or larger should be

transferred to a disk and mailed to the appropriate Regional Water Board office, in this case 1685 E Street, Fresno, CA 93706.

To ensure that your submittals are routed to the appropriate staff, the following information block should be included in any email used to transmit documents to this office:

Program: Non-15,
Place ID: 201070,
Facility Name: Teaford Meadow Lakes Wastewater Treatment Facility,
Order: 2014-0153-DWQ-R5401

A. Quarterly Monitoring Reports

Quarterly reports shall be submitted to the Regional Water Board on the **first day of the second month after the quarter ends** (e.g., the January-March Quarterly Report is due by May 1st). The reports shall bear the certification and signature of the Discharger's authorized representative. At a minimum, the quarterly reports shall include:

1. Results of all required monitoring.
2. A comparison of monitoring data to the discharge specifications, applicable effluent limits, disclosure of any violations of the NOA and/or General Order, and an explanation of any violation of those requirements. (Data shall be presented in tabular format.)
3. If requested by staff, copies of laboratory analytical report(s) and chain of custody form(s).

B. Annual Report

Annual Reports shall be submitted to the Regional Water Board by **March 1st following the monitoring year**. The Annual Report shall include the following:

1. Tabular and graphical summaries of all monitoring data collected during the year.
2. An evaluation of the performance of the wastewater treatment facility, including discussion of capacity issues, nuisance conditions, system problems, and a forecast of the flows anticipated in the next year. A flow rate evaluation as described in the General Order (Provision E.2.c) shall also be submitted.
3. A discussion of compliance and the corrective action taken, as well as any planned or proposed actions needed to bring the discharge into compliance with the NOA and/or General Order.

4. A discussion of any data gaps and potential deficiencies/redundancies in the monitoring system or reporting program.
5. The name and contact information for the wastewater operator responsible for operation, maintenance, and system monitoring.

A letter transmitting the monitoring reports shall accompany each report. The letter shall report violations found during the reporting period, and actions taken or planned to correct the violations and prevent future violations. The transmittal letter shall contain the following penalty of perjury statement and shall be signed by the Discharger or the Discharger's authorized agent:

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment."

The Discharger shall implement the above monitoring program beginning
1 December 2023.

Ordered by: _____

PATRICK PULUPA, Executive Officer

(Date)



Central Valley Regional Water Quality Control Board

TO: Alexander S. Mushegan
Supervising Water Resource Control Engineer

FROM: Salvador Vargas
Water Resource Control Engineer

DATE: 13 November 2023

APPLICABILITY OF COVERAGE UNDER STATE WATER RESOURCES CONTROL BOARD ORDER WQ 2014-0153-DWQ; GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS; MADERA COUNTY; TEAFORD MEADOW LAKES WASTEWATER TREATMENT FACILITY; MADERA COUNTY

On 26 July 2023, Madera County (Discharger) submitted a Report of Waste Discharge (RWD) for Teaford Meadow Lakes Wastewater Treatment Facility (Facility). The July 2023 RWD was prepared by California Rural Water Association and signed and stamped by Craig R. Wagner (RCE 41221) with the Madera County Public Works, Engineering Services Department. This memorandum provides a summary of Central Valley Water Board's staff's review of the July 2023 RWD, and the subsequent materials, and the applicability of the Facility's discharge to be covered under State Water Resources Control Board Order WQ 2014-0153-DWQ, *General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Order).

BACKGROUND INFORMATION

The Facility is in Madera County, located south of Oakhurst, CA and southwest of Bass Lake, CA (37.2698°, -119.5726°), as shown in Attachment A of the Notice of Applicability (NOA). The Facility is currently enrolled under 97-10-DWQ-R5163, *General Waste Discharge Requirements for Discharges to Land by Small Domestic Wastewater Systems*. The Assessor's Parcel Number (APN) for components of the wastewater system is 064-430-020.

Attachment C of the NOA is a process flow diagram, which provides a schematic overview of the Facility's wastewater system. The Facility receives domestic wastewater from 66 homes. The Facility treats domestic wastewater through an activated sludge treatment process. The wastewater is gravity fed to the Facility's wet well. From the wet well, the wastewater is screened by a manual bar, conveyed to the extended aeration basin where solids are allowed to settle at the bottom of the basin. From the extended aeration basin, wastewater is treated in a clarifier and then receives chlorine disinfection in a contact tank. NOA 97-10-DWQ-R5163 mentions an emergency pond, but that

emergency pond was not mentioned in the July 2023 RWD. Staff confirmed the emergency pond is still at the Facility and is only used when there is run off from the spray fields. The effluent of the disinfection contact tank gets distributed to two spray fields (Spray Field Zones 1 and 2). Both Spray zones are located within the property of the Facility. According to the RWD, the Spray Fields are only used for disposal of wastewater and no crop is grown on the spray fields. Spray fields consist of pine and cedar trees with native grasses and maintenance is done as needed.

POTENTIAL THREAT TO WATER QUALITY

The Discharger meters the Facility's influent flow. Monthly average influent flows from January 2020 to December 2022 are summarized in Table 1 below. For this date range, the average wastewater flow was 5,000 gallons per day (gpd) and ranged from 2,000 gpd to 18,000 gpd. The design flow of the Facility per NOA 97-10-DWQ-R5163 is 22,000 gallons per day (gpd).

Table 1 - Monthly Average Wastewater Flows (2020-2022)

Month	2020 (GPD)	2021 (GPD)	2022 (GPD)
Jan	5,000	3,000	8,000
Feb	6,000	4,000	5,000
Mar	8,000	2,000	5,000
Apr	9,000	4,000	6,000
May	6,000	4,000	5,000
Jun	6,000	5,000	6,000
Jul	5,000	4,000	6,000
Aug	5,000	3,000	6,000
Sep	3,000	3,000	6,000
Oct	4,000	3,000	6,000
Nov	4,000	6,000	5,000
Dec	5,000	7,000	6,000
Avg. Annual Flow	5,500	4,000	5,800

Monthly average effluent 5-day biochemical oxygen demand (BOD₅) concentrations for 2020 through 2022 are summarized in Table 2 below. Based on the reported data, the Facility appears to be able to comply with the BOD effluent limitations of monthly average of 30 mg/L and the 7-day average of 45 mg/L. The monthly average

concentrations for BOD were 7.1 mg/L for 2020, 11.9 mg/L for 2021, and 15.9 mg/L for 2022.

Table 2 - Effluent BOD₅ Data (2020-2022)

Month	2020 (mg/L)	2021 (mg/L)	2022 (mg/L)
Jan	3.9	11	13.8
Feb	1.5	3.4	10.1
Mar	>2	25.5	22.7
Apr	>2	14	16.5
May	5.5	13.8	25.5
Jun	6.4	6.6	27
Jul	6.9	4.9	7.5
Aug	2.8	14	8.7
Sep	>2	6.1	18.5
Oct	4.8	19.5	10.3
Nov	9.3	19	16
Dec	38.3	5.1	15
Annual Average	7.1	11.9	15.9

Monthly average effluent total suspended solids (TSS) concentrations for 2020 through 2022 are summarized in Table 3 below. Based on the reported data, the Facility appears to be able to comply with the TSS effluent limitations of monthly average of 30 mg/L and the 7-day average of 45 mg/L. The monthly average concentrations for TSS were 8.3 mg/L for 2020, 14.6 mg/L for 2021, and 16.6 mg/L for 2022.

Table 3 - Effluent TSS Data (2020-2022)

Month	2020 (mg/L)	2021 (mg/L)	2022 (mg/L)
Jan	>4	2.2	51.9
Feb	>4	31	6
Mar	2.2	49	48.7
Apr	>4	12.5	2.5
May	4.3	31.4	32
Jun	5.5	6.7	8.3
Jul	18.6	9.1	7.2
Aug	15	>4	4.6
Sep	>4	2	6.5
Oct	>4	18	19.5

Month	2020 (mg/L)	2021 (mg/L)	2022 (mg/L)
Nov	2	4.4	6
Dec	32.3	5.3	6
Annual Average	8.3	14.6	16.6

According to the US Department of Agriculture Soil Conservation Service (USDA) the ground soil in the area is mostly classified as coarse sandy loam. The topsoil classified as coarse sandy loam is estimated at an infiltration rate of 0.4 in/hr. Groundwater in the area according to the Discharger's onsite wells (Wells #2 and #4) is about 375 feet below ground surface (bgs).

The Discharger provided source water quality data in the submitted self-monitoring reports as well as the ROWD for 2021 (shown in Table 4 below). Teaford Meadows WWTF has three active wells to supply the Facility, Well #3 is used only as an emergency backup, Wells #2, and #4 are approximately between 200-550 feet below ground surface.

Table 4 - Influent Groundwater Quality Data (Source Water Well)

Sample Date	BOD (mg/L)	TSS (mg/L)
01/13/21	300	220
02/10/21	330	230
03/10/21	300	290
04/07/21	590	2000
05/05/21	400	320
06/02/21	870	1500
07/14/21	260	240
08/18/21	1500	3400
09/01/21	270	620
10/13/21	230	130
11/10/21	140	110
12/08/21	240	190

NITROGEN LIMIT EVALUATION

Attachment 1 of the General Order includes five site-specific considerations (Step A) that shall be considered when evaluating a discharge and the need for nitrogen effluent limits. These five site-specific considerations include: flow, groundwater depth, percolation rate, wastewater strength, and if nitrogen is of concern in the area. The Wastewater Treatment Facility only receives domestic wastewater and the nitrogen effluent monthly average for 2020 was 15.4 mg/L, monthly average for 2021 was 26.5 mg/L, and monthly average for 2022 was 40.3 mg/L. Based on 1) a design flow of 22,000 gpd, 2) typical discharge flows well below 20,000 gpd, 3) all wastewater is discharged to spray field area, and 4) the Facility does not receive high-strength

wastewater, the discharge is not expected to significantly impact underlying groundwater with regards to nitrate. Therefore, nitrogen limits are not necessary at this time.

MONITORING REQUIREMENTS

Monitoring requirements included in the following sections from Attachment C of the General Order are appropriate for this discharge:

- Pond System Monitoring
- Activated Sludge Monitoring
- Disinfection System Monitoring
- Land Application Monitoring
- Solids Disposal

SALT AND NITRATE CONTROL PROGRAMS

The Central Valley Water Board adopted Basin Plan amendments incorporating new programs for addressing ongoing salt and nitrate accumulation in the Central Valley at its 31 May 2018 Board Meeting (Resolution R5-2018-0034). The Basin Plan amendments became effective on 17 January 2020 and were revised by the Central Valley Water Board in 2020 with [Resolution R5-2020-0057](https://www.waterboards.ca.gov/centralvalley/board_decisions/adopted_orders/resolutions/r5-2020-0057_res.pdf) (https://www.waterboards.ca.gov/centralvalley/board_decisions/adopted_orders/resolutions/r5-2020-0057_res.pdf). Pursuant to the Basin Plan amendments, the Discharger was sent a Notice to Comply on 5 January 2021 (**CV SALTS ID: 1738**) with instructions and obligations for the Salt Control Program within one year of the effective date of the amendments. The Discharger enrolled in the Path 2 Prioritization and Optimization (P&O) Study for the Salt Control Program. The Discharger provided Central Valley Regional Water Board staff with documents stating that the 2020-2022 P&O Study fee was paid.

The Facility is located in the foothills of the Sierra Nevadas; therefore, the Facility is not within an identified groundwater basins or sub-basins. The Nitrate Control Program will apply when the Central Valley Water Board's Executive Officer determines it is necessary and appropriate to address nitrate discharges to localized groundwater.

[More information on the Salt and Nitrate Control Program](https://cvssalinity.or/public-info) may be found on the internet (<https://cvssalinity.or/public-info>).