



GAVIN NEWSOM
GOVERNOR



YANA GARCIA
SECRETARY FOR
ENVIRONMENTAL PROTECTION

**State of California
Regional Water Quality Control Board**

**APPLICATION/REPORT OF WASTE DISCHARGE
GENERAL INFORMATION FORM FOR
WASTE DISCHARGE REQUIREMENTS OR NPDES PERMIT**

I. FACILITY INFORMATION

A. FACILITY:

Name McCabe Union School District
Address 701 W. McCabe Road
City/County/State/Zip Code El Centro, CA. 92243
Contact Person Frank Cornejo - WWTP Plant Operator
Telephone Number 760-457-9064 Email jclabs72@gmail.com

B. FACILITY OWNER:

Name McCabe Union School District
Address 701 W. McCabe Road
City/State/Zip Code El Centro, CA. 92243
Contact Person Mary Monson - Superintendent
Telephone Number (760) 335-5200 Email mary.monson@muesd.net
Federal Tax ID 95-6002038

Owner Type (*Mark one*):

- ☐ Individual ☐ Corporation ☐ Governmental Agency ☐ Partnership
☒ Other: School District

C. FACILITY OPERATOR (*The agency or business, not the person*):

Name same as owner
Address _____
City/State/Zip Code _____
Contact Person _____
Telephone Number _____ Email _____

Operator Type (*Mark one*):

- ☐ Individual ☐ Corporation ☐ Governmental Agency ☐ Partnership
☐ Other: _____

D. OWNER OF THE LANDName same as owner

Address _____

City/State/Zip Code _____

Contact Person _____

Telephone Number _____ Email _____

Owner Type (*Mark one*):☐ Individual ☐ Corporation ☐ Governmental Agency ☐ Partnership☐ Other: _____**E. ADDRESS WHERE LEGAL NOTICE MAY BE SERVED**Address same as owner

City/State/Zip Code _____

Contact Person _____

Telephone Number _____ Email _____

F. BILLING ADDRESSAddress 701 W. McCabe RoadCity/State/Zip Code El Centro, California 92243Contact Person Rosanna Perez; Accounts Payable | Nick Curry; Maintenance ManagerTelephone Number 760-335-5200 Email rosanna.perez@muesd.net & nick.curry@muesd.net**II. TYPE OF DISCHARGE***Check Type of Discharge(s) Described in this Application:*☒ **Waste Discharge to Land**☐ **Waste Discharge to Surface Water***Check all that apply:*☐ Animal or Aquacultural Wastewater☐ Land Treatment Unit☐ Animal Waste Solids☐ Landfill (*see instructions*)☐ Biosolids/Residual☐ Mining☐ Cooling Water☐ Storm Water☒ Domestic/ Municipal Wastewater
Treatment and Disposal☐ Surface Impoundment☐ Dredge Material Disposal☐ Waste Pile☐ Hazardous Waste (*see instructions*)☐ Wastewater Reclamation☐ Industrial Process Wastewater☐ Other, *please describe* _____

III. LOCATION OF THE FACILITY

Describe the physical location of the facility:

1. Assessor's Parcel Number(s)

Facility: 052-400-027 and 052-400-034

Discharge Point: 052-400-034 (location of disposal ponds)

2. Latitude

Facility: North 32° 45' 08"

Discharge Point: North 32° 44' 58" (location of disposal ponds)

3. Longitude

Facility: West 115° 35' 50"

Discharge Point: West 115° 35' 51" (location of disposal ponds)

IV. REASON FOR FILING

Check all that apply:

- ☐ New Discharge or Facility
- ☐ Change in Design or Operation
- ☐ Change in Quantity/Type of Discharge
- ☐ Changes in Ownership/Operator (see instructions)
- ☒ Waste Discharge Requirements Update or NPDES Permit Reissuance
- ☐ Other: _____

V. CALIFORNIA ENVIRONMENTAL QUALITY ACT (CEQA)

Name of Lead Agency blank - update of WDR

Has a public agency determined that the proposed project is exempt from CEQA?

☐ Yes ☐ No

If yes, state the basis for the exemption and the name of the agency supplying the exemption on the line below:

Has a "Notice of Determination" been filed under CEQA?

☐ Yes ☐ No

If Yes, enclose a copy of the CEQA document, Environmental Impact Report (EIR), or Negative Declaration. If No, identify the expected type of CEQA document and expected date of completion.

Expected CEQA Documents: ☐ EIR ☐ Negative Declaration

Expected CEQA Completion Date: _____

VI. OTHER REQUIRED INFORMATION

Please provide a COMPLETE characterization of your discharge. A complete characterization includes, but is not limited to, design and actual flows, a list of constituents and the discharge concentration of each constituent, a list of other appropriate waste discharge characteristics, a description and schematic drawing of all treatment processes, a description of any Best Management Practices (BMPs) used, and a description of disposal methods.

Also include a site map showing the location of the facility and, if you are submitting this application for an NPDES permit, identify the surface water to which you propose to discharge. Please try to limit your maps to a scale of 1:24,000 (7.5' USGS Quadrangle) or a street map, if more appropriate.

VII. OTHER

Attach additional sheets to explain any responses which need clarification. List attachments with titles and dates below:

Attached are the Characterization of wastewater and discharge

You will be notified by a representative of the RWQCB within 30 days of receipt of your application. The notice will state if your application is complete or if there is additional information you must submit to complete your Application/Report of Waste Discharge, pursuant to Division 7, Section 13260 of the California Water Code.

VIII. CERTIFICATION

"I certify under penalty of law that this document, including all attachments and supplemental information, were prepared under my direction and supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment."

Print Name Mary Kay Monson

Title Superintendent

Signature Digital I.D.

 Digitally signed by Digital I.D.
Date: 2025.11.06 09:08:27 -08'00'

Date October 30, 2025

FOR OFFICE USE ONLY

Date Form 200 Received:	Letter to Discharger:	Fee Amount Received:	Check #:
----------------------------	--------------------------	-------------------------	----------

McCabe Union School District's McCabe Municipal Wastewater Treatment Plant
701 West McCabe Road, El Centro, CA 92243
Wastewater Treatment Plant and Disposal Ponds
Renewal of Report of Waste Discharge,
Update of Waste Discharge Requirements, Order R7-2015-0050
RE: Characterization to attach to Form 200.
Date: October 30, 2025.

Wastewater Treatment Plant Flows:

The current total design capacity of the wastewater treatment plant is 15,000 GPD (0.015 MGD). The actual flow capacity is approximately 3,000 GPD.

Wastewater Treatment Plant Description:

The treatment system consists of a lift station and two distinct packaged treatment units that operate in series. The first packaged treatment unit includes flow equalization, an aeration tank, and secondary clarification. The second packaged treatment unit includes dual media filtration and UV disinfection. Wastewater enters the lift station's wet well. Wastewater is pumped from the lift station via one of two (2) 3-inch diameter submersible sewage pumps into a 5,000-gallon flow equalization tank. Wastewater is mixed within the equalization tank with return activated sludge under anoxic conditions to encourage denitrification. The blended wastewater is then transferred via an airlift pipe into a 15,592-gallon extended aeration tank, where nitrification takes place. Following aeration, the stabilized wastewater (mixed liquor) then flows into a 3,758-gallon circular secondary clarifier, where the mixed liquor suspended solids are settled and recirculated back to the flow equalization tank. The wastewater effluent flows over the clarifier's weirs for treatment by two dual media (sand/anthracite) gravity filters, which are stationed in parallel. Filtered effluent then passes through an ultraviolet light disinfection system, which is comprised of two separate modules (one is used as a lead unit and the other is available as a standby unit).

Biosolids are dried in drying beds prior to disposal. Clear wastewater effluent is discharged to one of three evaporation/percolation ponds located south of the campus.

The WWTP's treatment process is illustrated in the Process Flow Schematic diagram as attached.

The WWTP's site plan is illustrated is attached. A vicinity map illustrating the location of the WWTP is attached.

Wastewater Constituents include the following:



1. Effluent discharged to the evaporation / percolation ponds for disposal shall not exceed the following effluent limits:


Constituent	Units	Monthly Average	Weekly Average
20° C BOD ₅	mg/L ²	30	45
Total Suspended Solids	mg/L	30	45

2. The 30-day monthly average daily discharge from the WWTP shall not exceed 0.015 MGD.
3. Effluent from the WWTP shall not have a pH below 6.0 or above 9.0.
4. The geometric mean Escherichia coli (E. coli) density based on a minimum of not less than five samples equally spaced over a 30-day period shall not exceed a Most Probable Number (MPN) of 126 MPN per 100 milliliters, nor shall any sample exceed the maximum allowable bacterial density of 400 MPN per 100 milliliters.
5. The evaporation/percolation ponds shall be maintained so they will be kept in aerobic conditions. The dissolved oxygen content in the upper zone (one foot) of the evaporation/infiltration ponds shall not be less than 1.0 mg/L.

Discharge Specifications include the following:

1. A minimum depth of two (2) feet of freeboard shall be maintained at all times in the evaporation/percolation ponds.
2. All treatment, storage, and disposal areas shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
3. The evaporation/percolation ponds shall have sufficient capacity to accommodate allowable wastewater flow, design seasonal precipitation, ancillary inflow, and infiltration during the non-irrigation season. Design seasonal precipitation shall be based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns.
4. Public contact with non-disinfected wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives. The non-disinfected wastewater is not approved for off-site distribution. Conspicuous signs shall be posted in a prominent location in each area where non-disinfected wastewater is stored on-site. Each sign or label with "Non-disinfected wastewater - No body contact or drinking" wording shall be displayed as well as the international warning symbol.
5. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment and disposal area.

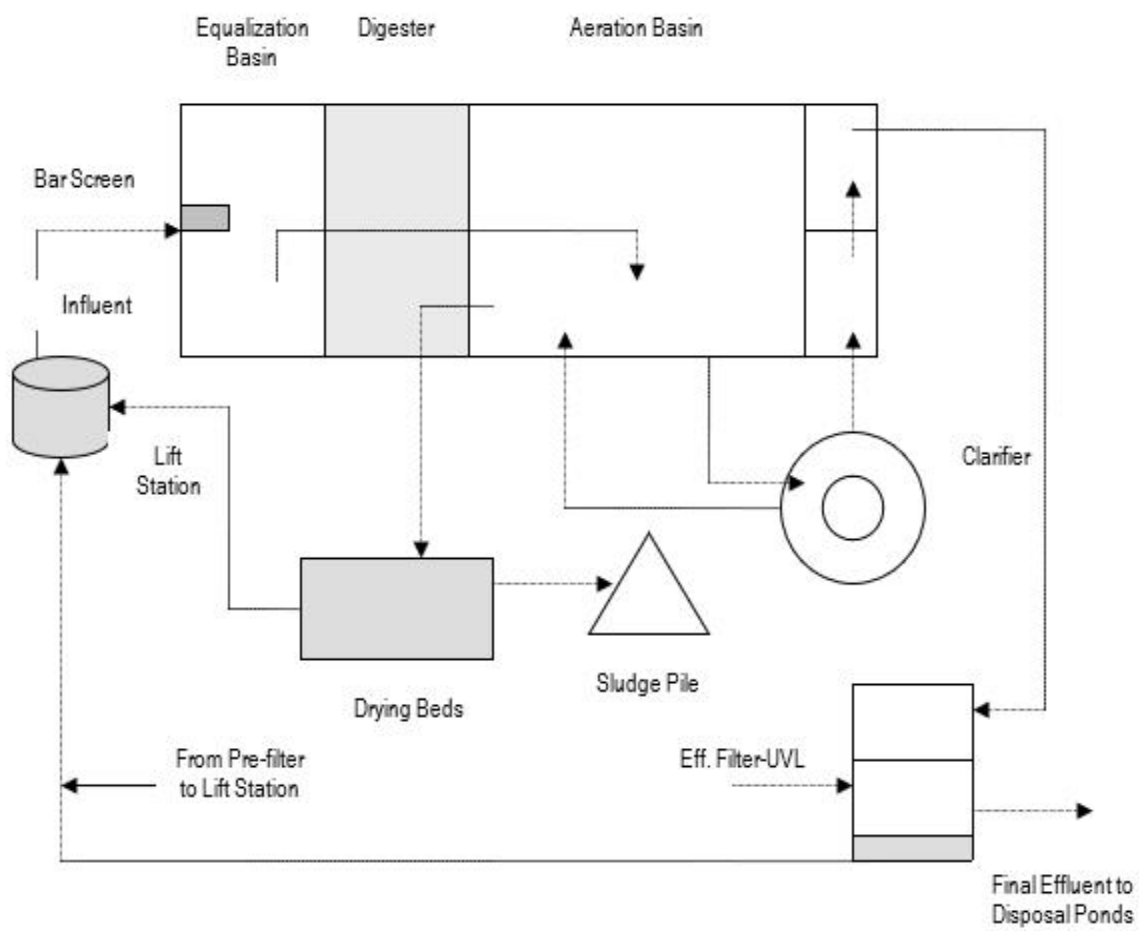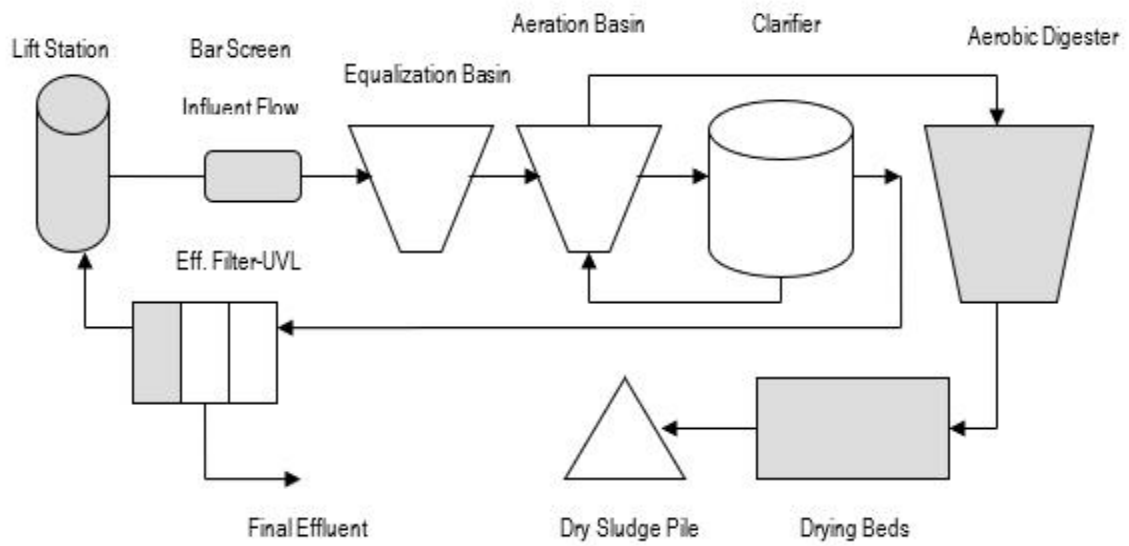

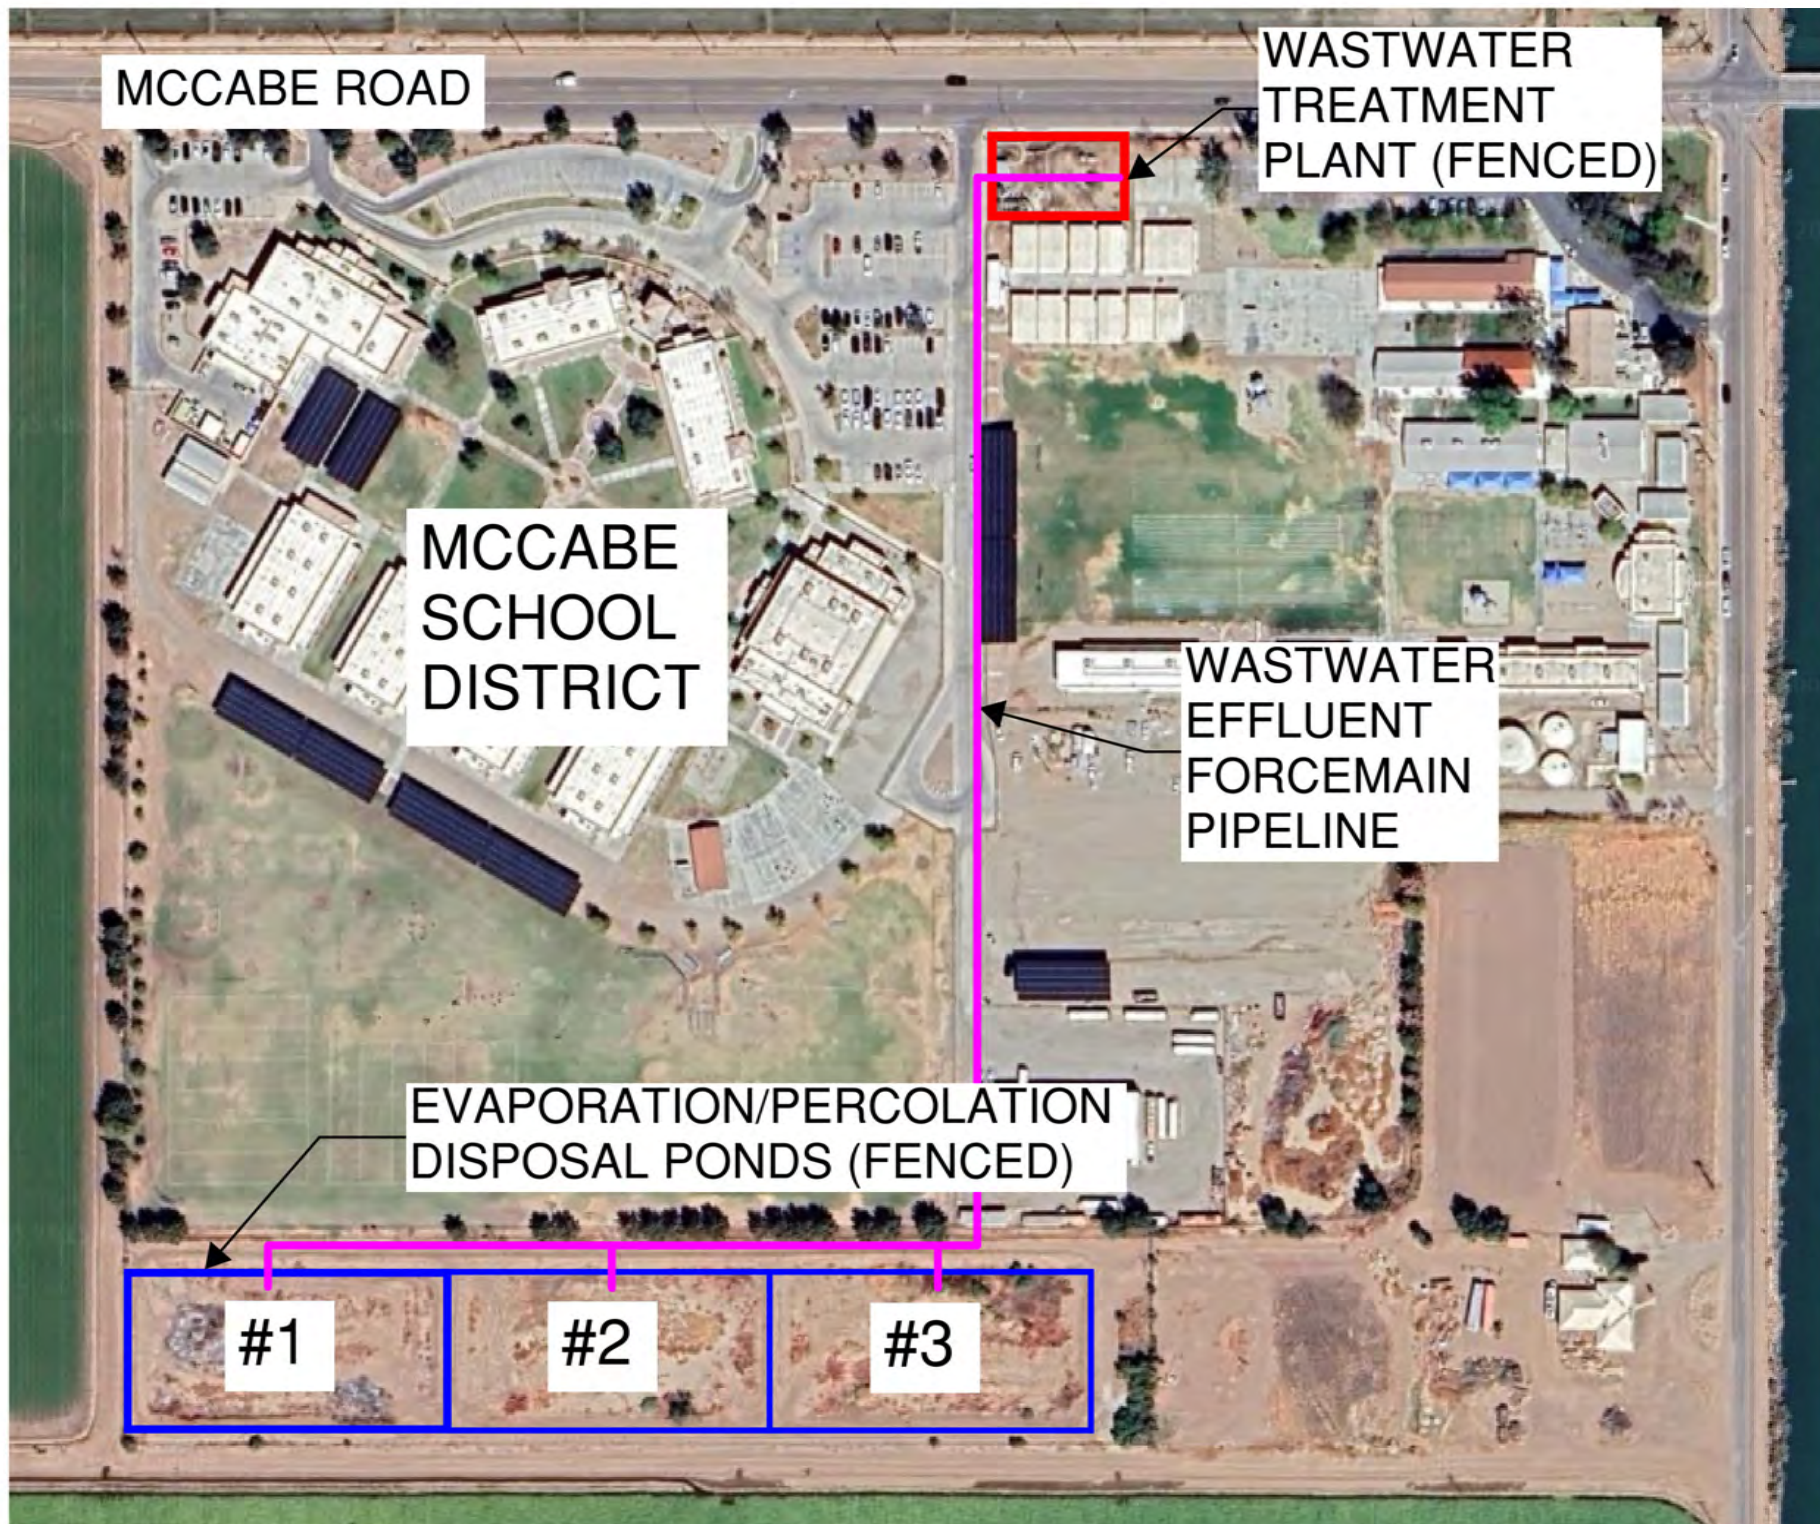

MCCABE ROAD

WASTWATER
TREATMENT
PLANT (FENCED)

MCCABE
SCHOOL
DISTRICT

WASTWATER
EFFLUENT
FORCEMAIN
PIPELINE

EVAPORATION/PERCOLATION
DISPOSAL PONDS (FENCED)

#1

#2

#3

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

Location of Wastewater Treatment Facilities and Discharges:
Northwest ¼ of Section 23, T16S, R13E, SBB&M

