



## Central Coast Regional Water Quality Control Board

September 27, 2024

**Sent Via Electronic Mail**

Todd Bodem, City Administrator  
City of Guadalupe  
918 Obispo Street  
Guadalupe, CA 93434  
e-mail: [tbodem@ci.guadalupe.ca.us](mailto:tbodem@ci.guadalupe.ca.us)

Dear Todd Bodem:

**CITY OF GUADALUPE WASTEWATER TREATMENT PLANT, 5125 WEST MAIN STREET, GUADALUPE, CA 93434, SANTA BARBARA COUNTY:**

- **REVISED NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER NO. R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY;**
- **REVISED MONITORING AND REPORTING PROGRAM NO. R3-2023-0014**

The City of Guadalupe's domestic wastewater treatment facility (Wastewater System) located at 5125 West Main Street in Guadalupe, California, owned by the City of Guadalupe is currently regulated pursuant to General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day (General Permit).

This letter serves as a **revised** notice of applicability and monitoring and reporting program for the City of Guadalupe's enrollment in the General Permit. Revisions to the notice of applicability and monitoring and reporting program support an additional disposal area. It includes revised information about site specific requirements and facility information (Attachment 1), revised figures (Attachment 2), and the revised monitoring and reporting program requirements (Attachment 3).

The original notice of applicability and monitoring program was issued on May 30, 2023. This revised notice of applicability and monitoring and reporting program is effective immediately and supersedes and replaces all previous versions of notice of applicability and monitoring and reporting program. This revised notice of applicability and monitoring and reporting program includes the following key revisions:

---

JANE GRAY, CHAIR | RYAN E. LODGE, EXECUTIVE OFFICER

- Addition of a temporary land application area that may be used for wastewater disposal under certain conditions.
- Addition to monitoring and reporting program Table 7 to include the land application area.
- Addition of weekly reporting for the temporary land application area.

The **revised** notice of applicability and monitoring and reporting program will also be available electronically on our GeoTracker website:

[https://geotracker.waterboards.ca.gov/profile\\_report?global\\_id=WDR100031582](https://geotracker.waterboards.ca.gov/profile_report?global_id=WDR100031582)

The City of Guadalupe must comply with the following:

1. **General Permit** – The City of Guadalupe must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

[https://www.waterboards.ca.gov/centralcoast/board\\_decisions/adopted\\_orders/2020/r32020\\_0020.pdf](https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf)

2. **Monitoring and Reporting Program** – The City of Guadalupe must comply with the requirements of the monitoring and reporting program enclosed with this letter (revised monitoring and reporting program R3-2023-0014, Attachment 3). Due dates have not changed from the original monitoring and reporting program issued on May 30, 2023. The City of Guadalupe must start implementing the monitoring on **July 1, 2023**. The first quarterly monitoring report was due **November 1, 2023** and the first annual report was due **March 1, 2024**. The City of Guadalupe is also required to comply with annual volumetric reporting requirements<sup>1</sup> established by the State Water Resources Control Board (State Water Board), due annually to the GeoTracker database on April 30<sup>th</sup>.

Quarterly monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

[https://www.waterboards.ca.gov/centralcoast/water\\_issues/programs/wastewater\\_permitting/docs/transmittal\\_sheet.pdf](https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf)

All annual reports must be formatted and completed as specified in the annual report template found at the following link:

[https://www.waterboards.ca.gov/centralcoast/board\\_decisions/adopted\\_orders/2020/wdr\\_annual\\_report\\_format.pdf](https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf)

---

<sup>1</sup> See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

The City of Guadalupe must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker<sup>2,3</sup> database with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System – specific global identification number WDR100031582 over the internet at:

<https://geotracker.waterboards.ca.gov/esi/login.asp>

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements. The Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

3. **Fees** – The City of Guadalupe must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board's fee program and cover the state fiscal year of July 1 through June 30. Your current annual fee is \$28,205. The City of Guadalupe's Wastewater System is currently assigned a threat and complexity rating of 2B. A copy of the current state fee schedule is available electronically at the following link:

[https://www.waterboards.ca.gov/resources/fees/water\\_quality/#wdr](https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr)

4. **Notification** – The Central Coast Water Board was notified of the City of Guadalupe's enrollment at a regularly scheduled public meeting on August 24-25, 2023. Details about that meeting are available on our website at:

[https://www.waterboards.ca.gov/centralcoast/board\\_info/agendas/](https://www.waterboards.ca.gov/centralcoast/board_info/agendas/)

5. **Future Discharge Modifications** – Pursuant to California Water Code section 13260, the City of Guadalupe must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, the City of Guadalupe must notify the Central Coast Water Board immediately of such changes.
6. **Responsible Party** – The City of Guadalupe is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a

---

<sup>2</sup> Information for first-time GeoTracker users is available at:

[https://www.waterboards.ca.gov/ust/electronic\\_submittal/](https://www.waterboards.ca.gov/ust/electronic_submittal/)

<sup>3</sup> Additional information available at: <http://geotracker.waterboards.ca.gov/>

violation of the California Water Code, and subjects the City of Guadalupe to enforcement action, and termination of enrollment under this General Permit.

7. **Change in Ownership** - In the event of any change in control or ownership of the property, the City of Guadalupe must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board so that the new owner or operator can be enrolled in the General Permit and the City of Guadalupe's enrollment in the General Permit can be terminated.
8. **Certified Operator** – The City of Guadalupe is required to comply with the operator certification requirements<sup>4</sup> administered by the State Water Board's Office of Operator Certification, which currently requires a Grade III certified operator onsite to maintain and operate the Wastewater System.
9. **Disposal Area** - Wastewater discharge to areas other than the designated disposal areas shown in Figures 2, 3 and 4 of Attachment 2 is prohibited.

Application to the land application area identified in Figure 4 of Attachment 2 is temporary until December 31, 2024. Use beyond that time or for other periods in the future requires additional authorization from the Central Coast Water Board and must meet the following conditions:

- a. Application must not occur within three days prior to any day for which the National Weather Service has predicted a 25% or more chance of at least 0.2-inch rain in 24 hours.
- b. The City of Guadalupe must restrict all public access to application areas.
- c. The application system must be designed and operated to prevent any overspray or runoff from entering the channel bed. Overspray or runoff entering into the channel bed is prohibited. All applied wastewater disposal must infiltrate above the toe of the berm.
- d. If overspray or runoff reaches the channel bed, application must cease. Wastewater disposal must not recommence until corrections have been implemented that prevent overspray or runoff from reaching the channel bed. The City of Guadalupe must notify the Central Coast Water Board immediately if irrigation overspray or runoff reaches the channel bed.
- e. The City of Guadalupe must monitor for overspray and runoff during the entire duration of the initial irrigation event. The initial irrigation event must be representative of planned irrigation events in terms of volume of irrigation water and duration of irrigation. The City of Guadalupe must inspect the irrigation for overspray or runoff weekly thereafter.
- f. The City of Guadalupe must submit weekly reports each Monday to the Central Coast Water Board identifying irrigation events and duration,

---

<sup>4</sup> Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

[https://www.waterboards.ca.gov/water\\_issues/programs/operator\\_certification/docs/ocr\\_clean.pdf](https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf)

inspections conducted, and inspection findings for the prior week for times when the temporary application area is used.

If you have any questions, please contact **Cecile Blancarte at (805) 542-4782 or by email at [cecile.blancarte@waterboards.ca.gov](mailto:cecile.blancarte@waterboards.ca.gov)** or Jennifer Epp at (805) 594-6181 or by email at [jennifer.epp@waterboards.ca.gov](mailto:jennifer.epp@waterboards.ca.gov).

Sincerely,

for Ryan E. Lodge  
Executive Officer

Attachments:

Attachment 1: Site-Specific Requirements and Facility Information

Attachment 2: Figures

Attachment 3: Revised Monitoring and Reporting Program Order R3-2022-0023

cc:

Jeff van den Eikhof, [jeff@eikhofdesigngroup.com](mailto:jeff@eikhofdesigngroup.com)

David Miklas, City of Guadalupe, [dmiklas@ci.guadalupe.ca.us](mailto:dmiklas@ci.guadalupe.ca.us)

Devin Valdivia, City of Guadalupe, [dvaldivia@ci.guadalupe.ca.us](mailto:dvaldivia@ci.guadalupe.ca.us)

Mike Nunley, MKN Associates, [mnunley@mknassociates.us](mailto:mnunley@mknassociates.us)

Jon Handlon, MKN Associates, [jhanlon@mknassociaes.us](mailto:jhanlon@mknassociaes.us)

Jason Johnston, Santa Barbara County, [jason.johnston@sbcphd.org](mailto:jason.johnston@sbcphd.org)

Seth Shank, Santa Barbara County, [sshank@countyofsb.org](mailto:sshank@countyofsb.org)

Walter Rubalcava, Santa Barbara County, [wrubalc@countyofsb.org](mailto:wrubalc@countyofsb.org)

Andrew Raaf, Santa Barbara County, [ASRAAF@countyofsb.org](mailto:ASRAAF@countyofsb.org)

Jennifer Epp, Central Coast Water Board, [Jennifer.Epp@Waterboards.ca.gov](mailto:Jennifer.Epp@Waterboards.ca.gov)

Jesse Woodward, Central Coast Water Board, [Jesse.Woodard@Waterboards.ca.gov](mailto:Jesse.Woodard@Waterboards.ca.gov)

April Woods, Central Coast Water Board, [April.Woods@waterboards.ca.gov](mailto:April.Woods@waterboards.ca.gov)

Phil Hammer, Central Coast Water Board, [Phillip.Hammer@waterboards.ca.gov](mailto:Phillip.Hammer@waterboards.ca.gov)

Cecile Blancarte, Central Coast Water Board, [Cecile.Blancarte@Waterboards.ca.gov](mailto:Cecile.Blancarte@Waterboards.ca.gov)

WDR Program, GeoTracker [RB3-WDR@Waterboards.ca.gov](mailto:RB3-WDR@Waterboards.ca.gov)

ECM/CIWQS = CW-228104

GeoTracker No. = GT- WDR100031582

Rev 10/6/2022

City of Guadalupe  
NOA

September 27, 2024

ECM Subject Name = City of Guadalupe Wastewater Treatment Plant NOA for R3-2020-0020 REV

R:\RB3\Shared\WDR\WDR Facilities\Santa Barbara Co\Guadalupe City  
WWTP\1\_Permit\Existing Permit\GUAD R3-2020-0020\_NOA\_2024 REV.docx

## ATTACHMENT 1

### WASTEWATER SYSTEM OPERATION SUMMARY, SPECIFIC REQUIREMENTS, AND LIMITATIONS

#### 1. OWNERSHIP AND WASTEWATER SYSTEM INFORMATION

Ownership and wastewater system information submitted by the City of Guadalupe to the Central Coast Water Board is shown in Table 1.

**Table 1. Ownership and Wastewater System Information**

|                                            |                                                                               |                              |
|--------------------------------------------|-------------------------------------------------------------------------------|------------------------------|
| Name                                       | City of Guadalupe Wastewater Treatment Plant                                  |                              |
| Physical Address                           | 5125 West Main Street<br>The City of Guadalupe, CA 93434                      |                              |
| Lattitude                                  | 34.966232                                                                     |                              |
| Longitude                                  | -120599357                                                                    |                              |
| Mailing Address                            | 918 Obispo Street, Guadalupe, CA 93434                                        |                              |
| Owner                                      | The City of Guadalupe                                                         |                              |
| Operator                                   | Dave Miklas<br>phone: 805-356-5091<br>e-mail: dmiklas@ci.guadalupe.ca.us      |                              |
| Legally Responsible Official               | Shannon Sweeney<br>phone: 805-356-3910<br>e-mail: ssweeney@ci.guadalupe.ca.us |                              |
| Raw Wastewater Sources                     | Sewer Connections:<br>Population Served:<br>Domestic (%):<br>Industrial (%):  | 2,333<br>8,293<br>60%<br>40% |
| Design Average Monthly Flow in gpd         | Biolac® <sup>5</sup> :<br>Ponds 2 & 4<br>AIWPS <sup>6</sup> :                 | 1,500,000                    |
| Baseline Flow (average annual flow) in gpd | 800,000                                                                       |                              |
| Threat to Water Quality                    | 2                                                                             |                              |
| Complexity                                 | B                                                                             |                              |
| For Internal Use                           |                                                                               |                              |
| Fee Code                                   | 58                                                                            |                              |
| Primary Place Type                         | Wastewater Treatment Facility                                                 |                              |
| Facility Type                              | Municipal/Domestic                                                            |                              |
| Facility Waste Type                        | Domestic Wastewater                                                           |                              |
| Regulatory measure Type                    | Enrollee - WDR                                                                |                              |

<sup>5</sup> Biolac® <https://www.parkson.com/products/biolac>

<sup>6</sup> Advanced Integrated Wastewater Pond System

|                             |            |
|-----------------------------|------------|
| <b>Reclamation Included</b> | <b>Yes</b> |
|-----------------------------|------------|

## 2. WASTEWATER SYSTEM OPERATION SUMMARY

The City of Guadalupe wastewater treatment facility (Wastewater System) is a Class III wastewater system. The City of Guadalupe must staff a Grade III chief plant operator for proper operation of the Wastewater System.

The Wastewater System receives septage from third party septic tank hauling companies and domestic and industrial wastewater from the City of Guadalupe. The Wastewater System is capable of treating up to 660,000 gallons per day (gpd) of wastewater to a secondary treatment level and up to 960,000 gpd to undisinfected secondary recycled<sup>7</sup> water quality. The Wastewater System consists of the treatment technologies and treatment capabilities shown in Table 2.

**Table 2. Treatment Technology and Capacity**

|                                                 |                                                                                                                                                                                                                                                                                                                         |
|-------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Headworks/<br/>Preliminary<br/>Treatment</b> | The headworks consists of one mechanically cleaned bar screen, a bar rack, washer/compactor system, flow meter, a non-functioning grit chamber and inactive screw grit classifier. The influent flow meter measures a combined flow of raw wastewater inflow, sludge drying basin leachate, and dewatering return flow. |
|                                                 | The City of Guadalupe has reported that they expect to have the grit chamber and screw grit classifier in operating order by June 2023.                                                                                                                                                                                 |
|                                                 | Headworks capacity (gpd): 2,880,000                                                                                                                                                                                                                                                                                     |
| <b>Primary<br/>Treatment</b>                    | N/A                                                                                                                                                                                                                                                                                                                     |
|                                                 | Primary treatment capacity (gpd): N/A                                                                                                                                                                                                                                                                                   |

---

<sup>7</sup> As of the date of this notice of applicability, recycled water production is pending approval by the Division of Drinking Water.



|                                               |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
|-----------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p><b>Secondary Treatment Train No. 1</b></p> | <p>Treatment train no. 1 is a Swanson advanced integrated wastewater pond system (AIWPS) that consists of one primary facultative pond (Pond 2, volume = 5.2 million gallons) and one secondary aerobic pond (Pond 4, volume = 2.2 million gallons). Pond 4 can recirculate about 25 percent of the daily inflow back to Pond 2 in the AIWPS system during daylight hours. A 5HP recirculation pump operating at 415 gallons per minute achieves this design parameter. Pond 2 must be equipped with 50 HP of surface aeration (two at 15HP and one at 20 HP) and Pond 4 must be equipped with 10 HP of surface aeration (one at 10HP). The AIWPS is designed to produce effluent concentration of 5-day biochemical oxygen demand (BOD) at 25 milligrams per liter (mg/L) and total suspended solids at 100 mg/L, when operating in stabilized mode. Pond aeration is required to maintain a dissolved oxygen level at about 2.0 mg/L to suppress odors. This treatment train produces a much higher quality of effluent than a typical primary wastewater treatment system and is considered secondary treatment but it <b>is not designed</b> to produce a level of secondary treated wastewater as defined in the Code of Federal Regulations title 40, chapter I, subchapter D, part 133 section 133.102<sup>8</sup>.</p> |
| <p><b>Secondary Treatment Train No. 2</b></p> | <p>Treatment train no. 2 consists of a Parkson Biolac® Wave-Ox activated sludge with extended aeration system and two integral clarifiers. Alternating anoxic and oxic zones within the bubbled basin are created by controlling the fine bubbles emanating from the floating aeration chains, therefore achieving nitrification and denitrication. Airlift pumps collect and return activated sludge (a.k.a. RAS) to the front of the aeration basin. The Biolac® is designed to produce an effluent concentration of 5-day BOD at 10 mg/L, total suspended solids at 12 mg/L, ammonia as nitrogen at 1 mg/L, total nitrogen removal of 80-90% and less than 8 mg/L, and total phosphorus at 2 mg/L. This Wastewater System treatment train no. 2 is designed to treat up to 0.96 MGD of undisinfected secondary recycled<sup>9</sup> water as defined by California Code of Regulations title 22, section 60301.900<sup>10</sup>.</p>                                                                                                                                                                                                                                                                                                                                                                                        |

<sup>8</sup> <https://www.ecfr.gov/current/title-40/chapter-I/subchapter-D/part-133>

<sup>9</sup> As of the date of this notice of applicability, recycled water production is pending approval by the Division of Drinking Water.

<sup>10</sup> <https://casetext.com/regulation/california-code-of-regulations/title-22-social-security/division-4-environmental-health/chapter-3-water-recycling-criteria/article-1-definitions/section-60301900-undisinfected-secondary-recycled-water>

|                                                                          |                                                                                                                                                                                                                                        |                                                                             |
|--------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------|
| <b>Average Dry Weather Design (ADWD) Flow and Daily Peak Design Flow</b> | Treatment train no. 1<br>ADWD = 0.60 million gallons per day (MGD).<br>Daily Peak Design = 0.66 MGD                                                                                                                                    |                                                                             |
|                                                                          | Treatment train no. 2<br>ADWD = 0.96 MGD<br>Daily Peak Design = 2.88 MGD                                                                                                                                                               |                                                                             |
| <b>Wet Weather Pond</b>                                                  | A wet weather percolation pond is located after the secondary treatment trains. It has a storage capacity of approximately 43.7 <sup>11</sup> million gallons located on 85 acres. Percolation rate is unknown.                        |                                                                             |
| <b>Tertiary Treatment</b>                                                | N/A                                                                                                                                                                                                                                    |                                                                             |
|                                                                          | Tertiary treatment capacity (gpd): N/A                                                                                                                                                                                                 |                                                                             |
| <b>Disinfection</b>                                                      | N/A                                                                                                                                                                                                                                    |                                                                             |
|                                                                          | Disinfection Capacity (gpd): N/A                                                                                                                                                                                                       |                                                                             |
| <b>Wastewater Disposal Method</b>                                        | Disposal method is to:<br>Pond A with a 2 MG holding capacity.<br>Pond B with a 2.5 MG holding capacity.<br>Pond C with a 6 MG holding capacity.<br>Temporary Santa Barbara County Flood Control District Berm – Land Application Area |                                                                             |
|                                                                          | Recycled water reuse:<br>Spray irrigation to approximately 71 acres for cattle grazing.<br><br>***Ponds and spray irrigation area are within the Santa Maria River FEMA 100-year floodplain.                                           |                                                                             |
|                                                                          | Recycled Water Reuse capacity over 60 acres (gpd):<br>7,800,000 <sup>12</sup>                                                                                                                                                          |                                                                             |
| <b>Biosolids/Sludge Production and Handling</b>                          | The solids handling technology is sludge dewatering via a screw press. There are four alternate sludge drying beds and an emergency sludge storage basin (formerly Pond 1 of the AIWPS system).                                        |                                                                             |
|                                                                          | Annual production of biosolids: 750 tons                                                                                                                                                                                               |                                                                             |
|                                                                          | Produced biosolids are hauled off to Engel & Gray located at 745 Betteravia Road, Santa Maria, California.                                                                                                                             |                                                                             |
| <b>Non-Potable Recycled Water</b>                                        | Non-potable recycled water produced onsite:                                                                                                                                                                                            | Yes, this wastewater system produces undisinfected secondary recycled water |

<sup>11</sup> July 1, 1992 Guadalupe Wastewater Treatment Plant Revised Flood Contingency Plan. Metcalf & Eddy.

<sup>12</sup> March 9, 1990 Feasibility Study for the Northside Spray Irrigation Area, Wastewater Treatment Facility, The City of Guadalupe, California. Job No. PG-6458-S01 Pacific Geoscience, Inc.

|  |                                                    |                                                                                                         |
|--|----------------------------------------------------|---------------------------------------------------------------------------------------------------------|
|  | Recycled water usage areas:                        | Recycled water is used to irrigate approximately 71 acres of adjacent land reserved for cattle grazing. |
|  | Enrolled in WQ 2016-0068-DDW:                      | No                                                                                                      |
|  | Recycled water production design max volume (gpd): | 960,000                                                                                                 |

A summary of historic and recent average effluent concentrations are included in Table 3, which were reported in the City of Guadalupe quarterly monitoring reports. This General Permit establishes effluent limits based on title 22 treatment levels for undisinfected secondary recycled water and groundwater basin water quality objectives as adopted in the Water Quality Control Plan for the Central Coastal Basin (Basin Plan). Effluent limits are presented in section 3, Wastewater System Specific Requirements and Limitations.

**Table 3. Recorded Effluent Water Quality for Select Constituents**

| Constituents                     | Units               | Historical Average <sup>[3]</sup> | Annual Average for 2021 <sup>[4]</sup> |
|----------------------------------|---------------------|-----------------------------------|----------------------------------------|
| Biochemical Oxygen Demand, 5-Day | mg/L <sup>[1]</sup> | 85                                | 59                                     |
| Settleable Solids                | ml/L <sup>[2]</sup> | 4.87                              | 2.98                                   |
| Total Suspended Solids           | mg/L                | 97                                | 73                                     |
| Total Dissolved Solids           | mg/L                | 895                               | 1035                                   |
| Chloride                         | mg/L                | 127                               | 130                                    |
| Sodium                           | mg/L                | 133                               | 160                                    |
| Total Nitrogen                   | mg/L                | 8.5                               | 7                                      |

[1] mg/L denotes milligrams per liter

[2] ml/L denotes milliliters per liter

[3] From water quality data reported by The City of Guadalupe in the 2019 through 2021 self-monitoring annual reports.

[4] From water quality data reported by The City of Guadalupe in the 2021 self-monitoring annual report.

### 3. WASTEWATER SYSTEM SPECIFIC REQUIREMENTS AND LIMITATIONS

The City of Guadalupe must operate the Wastewater System in accordance with the General Permit and this notice of applicability. The City of Guadalupe must comply with the wastewater specific limitations specified in Table 4 through Table 9.

Interim effluent limitations are shown in Table 5 and apply until May 30, 2025. Beginning May 31, 2025, effluent limitations shown in Table 6 and Table 7 apply.

**A. Flow Limitations:**

**Table 4. Flow Limitations**

| <b>Treatment Level</b>                                                    | <b>Units</b> | <b>Average Monthly Limit</b> | <b>Point of Compliance</b> |
|---------------------------------------------------------------------------|--------------|------------------------------|----------------------------|
| Raw Wastewater Plus Recirculated Treated Water from Treatment Train No. 2 | gpd          | 1,500,000                    | Influent IS-1              |
| Treatment Train No. 1 Secondary Treated Wastewater                        | gpd          | 600,000                      | Effluent ES-1              |
| Treatment Train No. 2 Undisinfected Secondary Recycled Water              | gpd          | 960,000                      | Effluent ES-2              |

**B. Effluent Limitations:**

Based on reported water quality data, effluent water quality for 5-day Biochemical Oxygen Demand (BOD<sub>5</sub>) and Total Suspended Solids (TSS) (see Table 3) exceed the General Permit effluent limits for undisinfected secondary recycled water. Therefore, pursuant to the General Permit, the City of Guadalupe can comply with their individual permit No. R3-2005-0015 BOD and TSS limits for two years.

**Table 5. Interim Effluent Limitations Until May 30, 2025<sup>[1]</sup>**

| <b>Constituent</b>               | <b>Units</b>   | <b>30-Day Average</b> | <b>Sample Maximum</b> |
|----------------------------------|----------------|-----------------------|-----------------------|
| Settleable Solids                | mL/L           | 0.2                   | 0.5                   |
| Biochemical Oxygen Demand, 5-Day | mg/L           | 60                    | 100                   |
| Total Suspended Solids           | mg/L           | 60                    | 100                   |
| Total Dissolved Solids           | mg/L           | 1,500                 | Not Applicable        |
| Sodium                           | mg/L           | 230                   | Not Applicable        |
| Chloride                         | mg/L           | 230                   | Not Applicable        |
| pH                               | Standard Units | Between 6.5 and 8.4   | Not Applicable        |

[1] In addition, pursuant to title 22 recycled water standards, the City of Guadalupe must meet the existing permit's effluent limitations for undisinfected secondary recycled water to allow the grazing of animals not producing milk for human consumption. The monitoring and reporting program and this notice of applicability will be revised based on the Division of Drinking Water approved title 22 engineering report.

**Table 6. Effluent Limitations Beginning May 31, 2025<sup>[2][3][4][5][6]</sup>**

**Based on - Santa Maria River Valley Upper Guadalupe**

| <b>Constituents</b>    | <b>Units</b> | <b>25-Month Rolling Median<sup>[1]</sup></b> |
|------------------------|--------------|----------------------------------------------|
| Total Dissolved Solids | mg/L         | 1,000                                        |
| Chloride               | mg/L         | 165                                          |
| Sodium                 | mg/L         | 230                                          |
| Sulfate                | mg/L         | 500                                          |
| Boron                  | mg/L         | 0.5                                          |
| Total Nitrogen         | mg/L         | 10                                           |

[1] Rolling Median is the median from all data collected over the most recent 25 months.

[2] Basin Plan

[3] Water Quality for Agriculture, published by the Food and Agriculture Organization of the United Nations in 1985, contains criteria protective of various agricultural uses of water, including irrigation of various types of crops and stock watering.

[4] California Division of Drinking Water primary MCL.

[5] If a Discharger can demonstrate nitrogen loading associated with discharge to a land application area is reduced through agronomic uptake, the Central Coast Water Board Executive Officer may approve an adjustment to the nitrogen effluent limits.

[6] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

**Table 7. Effluent Limitations Beginning May 31, 2025 for Undisinfected Secondary Non-Potable Recycled Water Producers<sup>[1][2][3]</sup>**

| Constituents                                                                               | Units          | 30-Day Average            | 7-Day Average  | Sample Maximum |
|--------------------------------------------------------------------------------------------|----------------|---------------------------|----------------|----------------|
| Dissolved Oxygen                                                                           | mg/L           | Not Applicable            | 2.0            | Not Applicable |
| Settleable Solids                                                                          | mL/L           | 0.1                       | 0.3            | 0.5            |
| Biochemical Oxygen Demand, 5-Day                                                           | mg/L           | 30<br>and<br>≥85% Removal | 45             | Not Applicable |
| Total Suspended Solids                                                                     | mg/L           | 30<br>and<br>≥85% Removal | 45             | Not Applicable |
| pH                                                                                         | Standard Units | Between 6.5 and 8.4       | Not Applicable | Not Applicable |
| Other constituents or operational requirements identified in a title 22 Engineering Report | [4]            | [4]                       | [4]            | [4]            |

[1] Basin Plan. For pH, the effluent limitation values shown are a range, not an average or maximum.

[2] USEPA Office of Wastewater Management, Water Permits Division, State and Regional Branch, EPA 833-K-10-001, September 2010.

[3] USEPA, Code of Federal Regulations, title 40, part 133.102, Secondary Treatment Standards, Technology-Based Effluent Limits.

[4] As specified in State Water Board's Division of Drinking Water title 22 conditional acceptance letter.

### **C. Groundwater Limitations:**

Based on review of historical effluent water quality (see Table 3), the City of Guadalupe is able to consistently comply with the General Permit effluent limitations for total dissolved solids, chloride, sodium, sulfate, boron, and total nitrogen, thus the point of compliance for these constituents is at the point of discharge. Groundwater monitoring is not required at this time.

**Table 8. Groundwater Limitations<sup>[1]</sup>  
for Designated Groundwater Basin - *Santa Maria River Valley Upper Guadalupe***

| <b>Constituents</b>    | <b>Units</b> | <b>25-Month Rolling Median<sup>[2]</sup></b> |
|------------------------|--------------|----------------------------------------------|
| Total Dissolved Solids | mg/L         | 1,000                                        |
| Chloride               | mg/L         | 165                                          |
| Sodium                 | mg/L         | 230                                          |
| Sulfate                | mg/L         | 500                                          |
| Boron                  | mg/L         | 0.5                                          |
| Total Nitrogen         | mg/L         | 1.4                                          |

[1] Basin Plan.

[2] Rolling Median is the median from all data collected over the most recent 25 months.

**D. Organic Loading Limitations:**

The City of Guadalupe land applies treated wastewater and thus organic loading limitations specified in Table 9 apply.

**Table 9. Organic Loading Limitations**

| <b>Constituents</b>                     | <b>Units</b>    | <b>30-Day Average</b> | <b>Maximum</b> |
|-----------------------------------------|-----------------|-----------------------|----------------|
| Biochemical<br>Oxygen Demand, 5-<br>Day | Pounds/acre/day | 100                   | 300            |

## ATTACHMENT 2 FIGURES

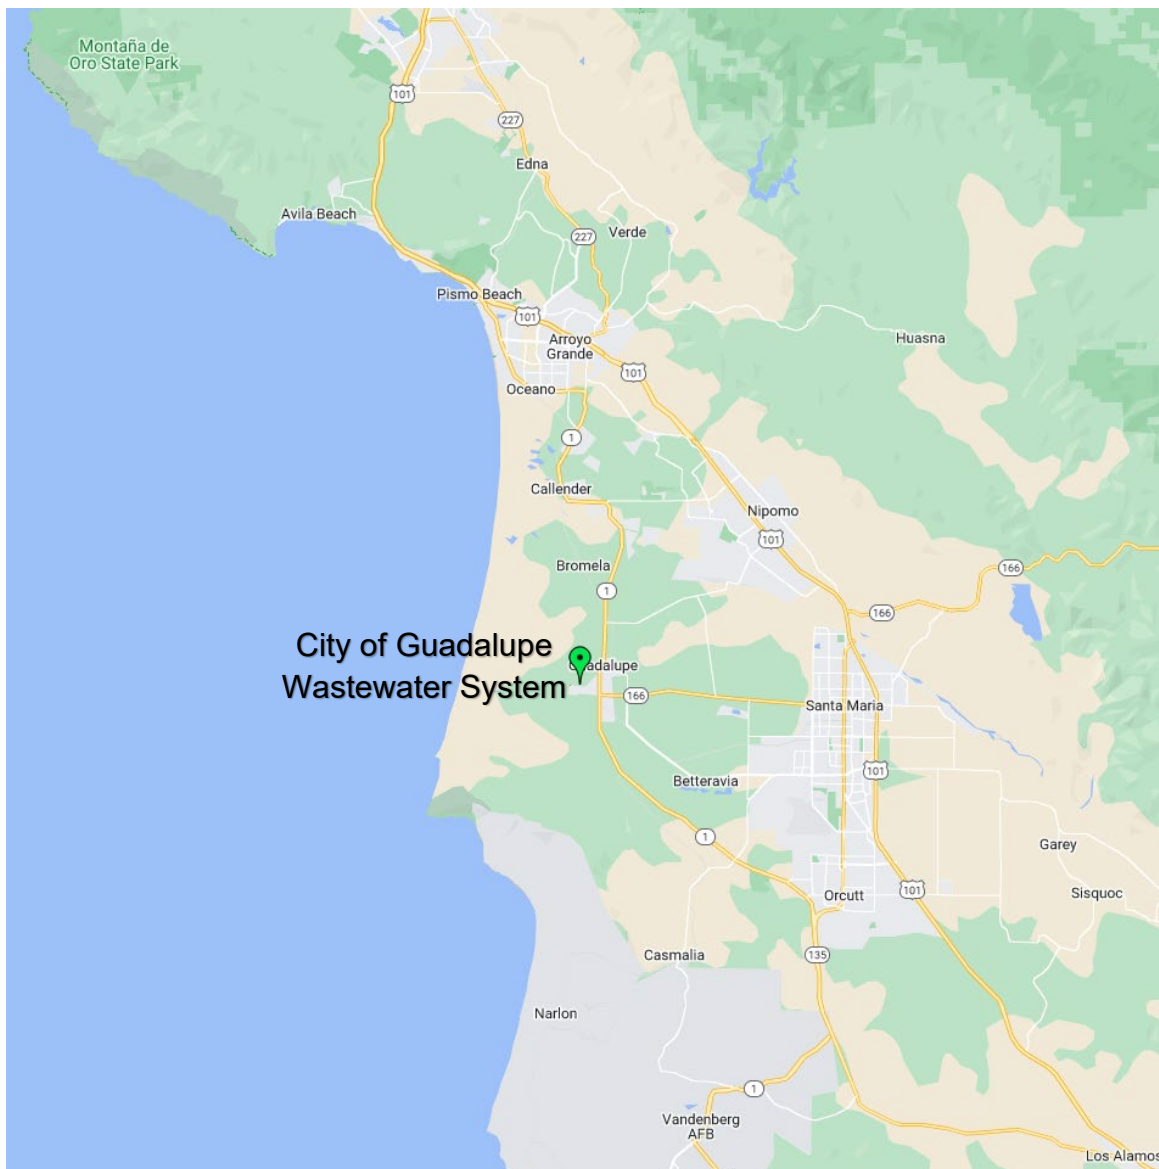


Figure 1- The City of Guadalupe Wastewater System Vicinity Map



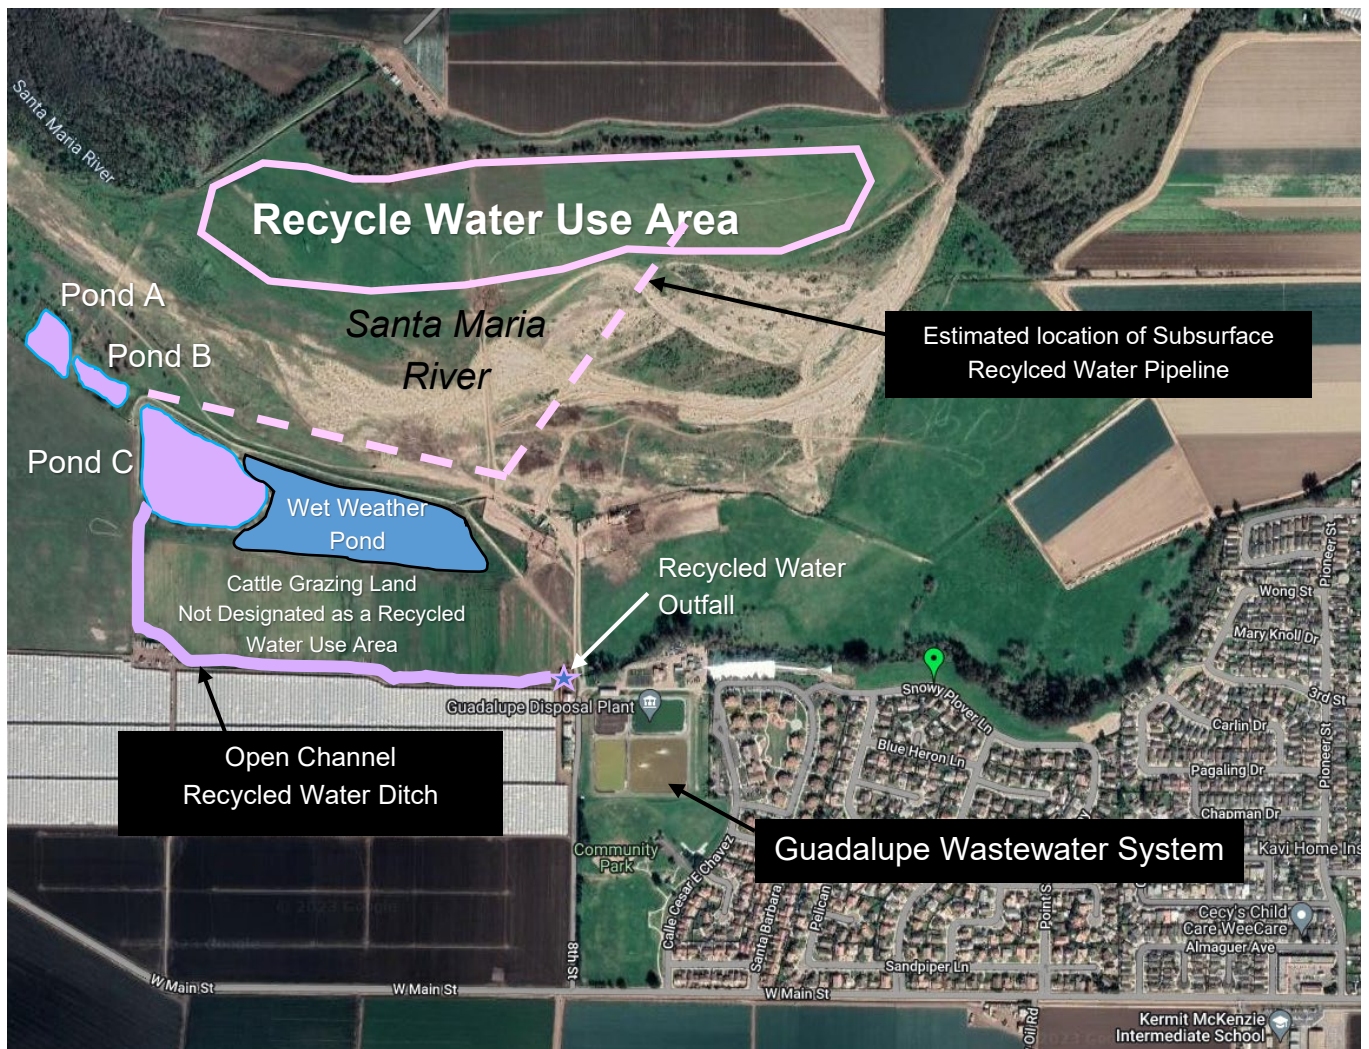


Figure 2- Guadalupe Wastewater System Site Map



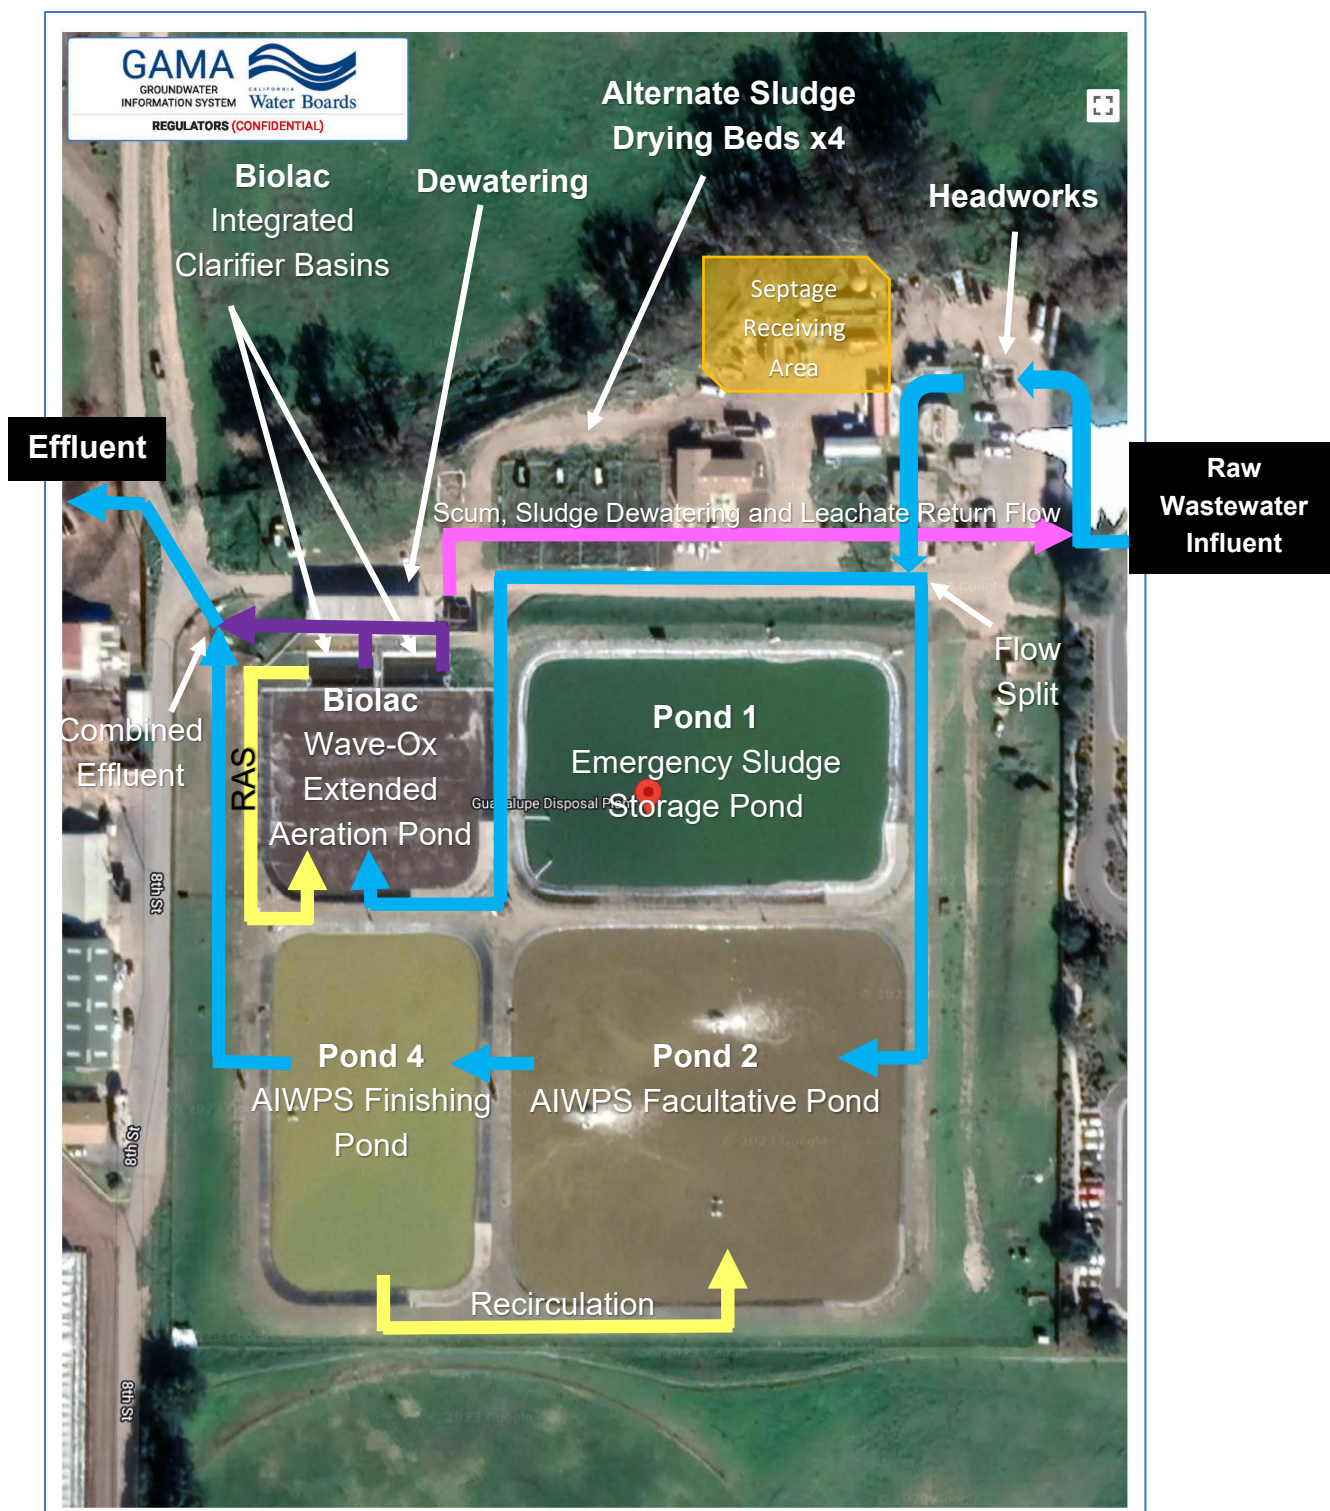


Figure 3 - Guadalupe Wastewater Treatment Plant

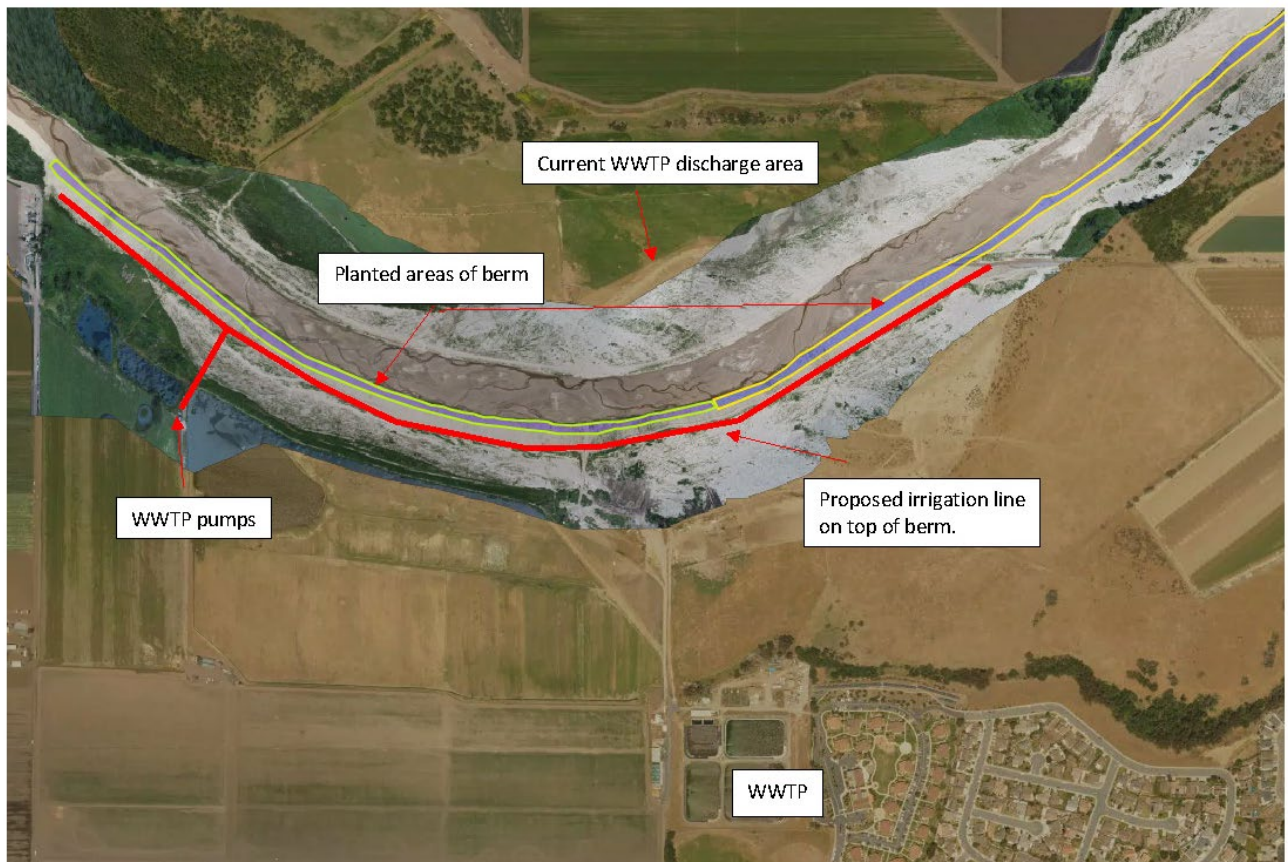


Figure 4 - Temporary Berm Land Application Area. Land Application Areas Identified as "Planted Areas of Berm"

City of Guadalupe Wastewater Treatment Plant Schematic

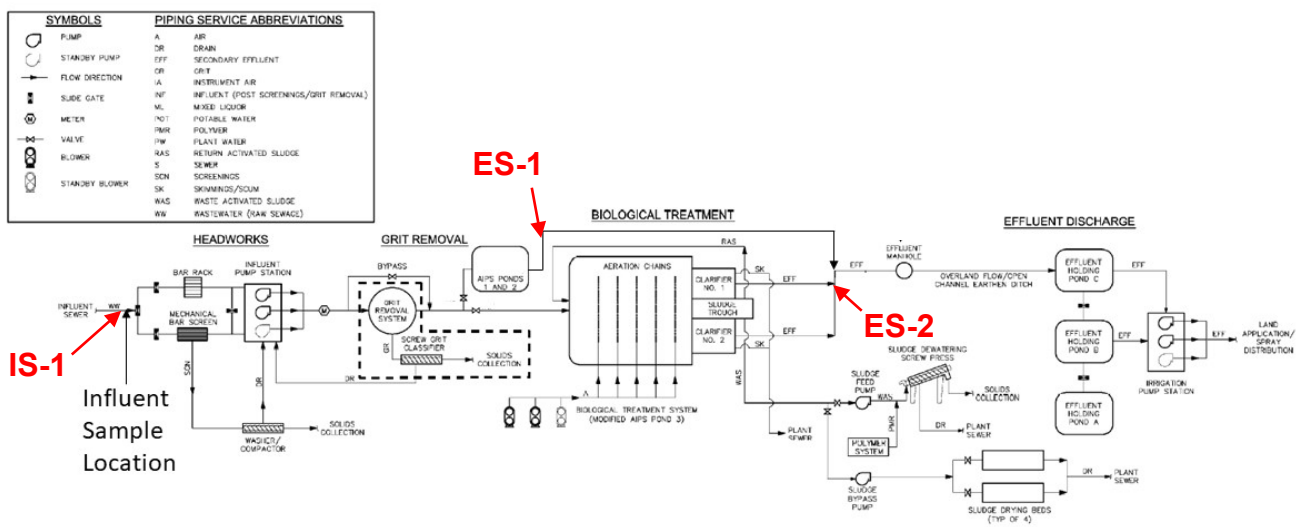


Figure 5- Process Flow Diagram and Sample Locations

**ATTACHMENT 3**  
**CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD**  
**MONITORING AND REPORTING PROGRAM NO. R3-2023-0014**  
**REVISED SEPTEMBER 27, 2024**  
**MODIFICATION OF MONITORING AND REPORTING PROGRAM NO. R3-2020-0020**  
**FOR**  
**CITY OF GUADALUPE WASTEWATER SYSTEM**  
**GUADALUPE, SANTA BARBARA COUNTY**

This Monitoring and Reporting Program applies to the monitoring and reporting requirements for City of Guadalupe Wastewater Facility (Wastewater System) enrolled in *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

The City of Guadalupe owns and operates the Wastewater System that is subject to the General Permit and notice of applicability. The City of Guadalupe must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Regional Water Quality Control Board (Central Coast Water Board).

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The monitoring and reporting program directs the City of Guadalupe to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board's GeoTracker database (see monitoring and reporting program section VII.C).

**I. SAMPLING AND ANALYSIS**

The City of Guadalupe must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Water Board. All samples (e.g., wastewater, groundwater, soil, sludge) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the



Operations and Maintenance Manual for Central Coast Water Board review and approval.

- A. Sampling Schedule** – Unless otherwise specified below, sampling must be performed in accordance with Table 1.

**Table 1. Sampling Schedule**

| Monitoring Period | Sample Collection Time            |
|-------------------|-----------------------------------|
| Quarterly         | January, April, July, and October |
| Semiannual        | April and October                 |
| Annual            | October                           |

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

- B. Monitoring Location Descriptions** – All samples including influent samples (IS), effluent samples (ES), groundwater monitoring well (MW). must be collected at the locations described in Table 2. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. **The City of Guadalupe must upload the GeoTracker field point information for each sampling location in the GeoTracker database once, prior to uploading laboratory data (see Table 2 and Table 9).**

**Table 2. Sample Identification Details**

| GeoTracker Field Point Class | GeoTracker Field Point Name (Sample ID) | GeoTracker Field Point Description                                                                                                       |
|------------------------------|-----------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------|
| Influent Sample              | IS-1                                    | Raw wastewater sample collected at the headworks                                                                                         |
| Effluent Sample              | ES-1                                    | Treated wastewater sample collected downstream of the last AIWPS treatment pond No. 4 and prior to mixing with Biolac® treated effluent. |

| <b>GeoTracker Field Point Class</b> | <b>GeoTracker Field Point Name (Sample ID)</b> | <b>GeoTracker Field Point Description</b>                                                                            |
|-------------------------------------|------------------------------------------------|----------------------------------------------------------------------------------------------------------------------|
| Effluent Sample                     | ES-2                                           | Treated wastewater sample collected after the Biolac® clarifiers and prior to mixing with the AIPS treated effluent. |
| First Monitoring Well               | MW-5                                           | Spray field groundwater monitoring well named MW-5                                                                   |
| Second Monitoring Well              | MW-6R                                          | Spray field groundwater monitoring well named MW-6R                                                                  |
| Third Monitoring Well               | MW-7                                           | Spray field groundwater monitoring well named MW-7                                                                   |
| Fourth Monitoring Well              | MW-8                                           | Spray field groundwater monitoring well named MW-8                                                                   |
| Fifth Monitoring Well               | MW-9                                           | Spray field groundwater monitoring well named MW-9                                                                   |
| Sixth Monitoring Well               | MW-10                                          | Spray field groundwater monitoring well named MW-10                                                                  |

## II. WATER SUPPLY MONITORING

Representative samples of the City of Guadalupe's raw water supply (sampled before use or treatment) must be collected and analyzed, at a minimum, for constituents specified in Table 3.

In lieu of the required water supply sampling, the City of Guadalupe may request Central Coast Water Board approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county, provided, at a minimum, all of the required constituents are sampled at the frequency specified in Table 3. The City of Guadalupe must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 3. The City of Guadalupe must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

The City of Guadalupe must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

**Table 3. Water Supply Monitoring**

| <b>Constituent</b>     | <b>Units<sup>[1]</sup></b> | <b>Sample Type</b> | <b>Sampling Frequency</b> |
|------------------------|----------------------------|--------------------|---------------------------|
| Nitrate (as N)         | mg/L                       | Grab               | Annually                  |
| Total Dissolved Solids | mg/L                       | Grab               | Annually                  |

| Constituent | Units <sup>[1]</sup> | Sample Type | Sampling Frequency |
|-------------|----------------------|-------------|--------------------|
| Chloride    | mg/L                 | Grab        | Annually           |
| Sodium      | mg/L                 | Grab        | Annually           |
| Sulfate     | mg/L                 | Grab        | Annually           |
| Boron       | mg/L                 | Grab        | Annually           |
| Carbonate   | mg/L                 | Grab        | Annually           |
| Bicarbonate | mg/L                 | Grab        | Annually           |
| Calcium     | mg/L                 | Grab        | Annually           |
| Potassium   | mg/L                 | Grab        | Annually           |
| Magnesium   | mg/L                 | Grab        | Annually           |

[1] mg/L denotes milligrams per liter

### III. INFLUENT AND EFFLUENT MONITORING


**A. Influent and Effluent Flow Monitoring** – The City of Guadalupe must monitor and report flow in gallons per day, as described in Table 4, with each monitoring report. See monitoring and reporting program section VII.A.3 for supplemental volumetric annual reporting requirements established by the State Water Board.

**Table 4. Influent and Effluent Flow Monitoring**

|                                                                                    | INFLUENT<br>IS-1 | INFLUENT<br>IS-1      | EFFLUENT<br>ES-1 and ES-2 | EFFLUENT<br>ES-1 and ES-2 |
|------------------------------------------------------------------------------------|------------------|-----------------------|---------------------------|---------------------------|
| Parameter                                                                          | Sample<br>Type   | Sampling<br>Frequency | Sample Type               | Sampling<br>Frequency     |
| Daily Flow <sup>[1]</sup>                                                          | Metered          | Daily                 | Metered                   | Daily                     |
| Operating<br>Capacity <sup>[1]</sup><br>(Percent of<br>Monthly permitted<br>flows) | Calculated       | Monthly               | Calculated                | Monthly                   |
| Maximum Daily Flow                                                                 | Metered          | Monthly               | Metered                   | Monthly                   |
| Mean Daily Flow                                                                    | Calculated       | Monthly               | Calculated                | Monthly                   |

[1] The General Permit notice of applicability specifies the Wastewater System's permitted flows in Table 4. In the monitoring reports, the City of Guadalupe must evaluate and provide a comparison of monitored flows to the permitted flows.

**B. Wastewater System Monitoring** – Representative samples of the City of Guadalupe's influent (raw wastewater) into the Wastewater System and effluent (treated wastewater) discharged to land must be collected and analyzed in accordance with the treatment technology-based monitoring requirements (including sample type and frequency) summarized in the tables below. See Figure 1 for the location of samples and GeoTracker field points.

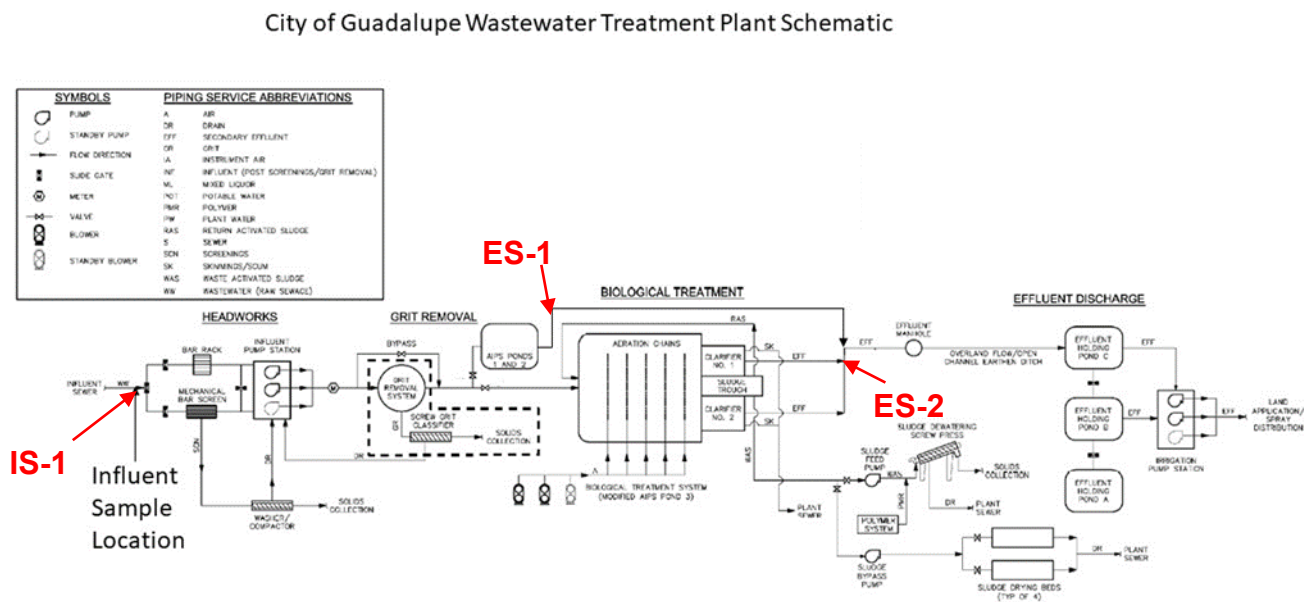

**Figure 1. Process Flow Diagram and Sample Locations Referenced in Table 2**

## 1. Pond System Monitoring

- i. **Required Pond Monitoring** – All wastewater treatment and treated wastewater storage/disposal ponds (lined and unlined) must be monitored as specified in Table 5. Sampling for pH and dissolved oxygen must be a grab sample taken from 1 foot below pond surface.

Observations do not need to be reported in the monitoring reports unless a violation, significant change, or treatment issue is observed. Photos of the pond(s) verifying the observations must be collected annually and included in the annual report, with the date and location of the photo clearly marked. Observations must be noted in a logbook or database and made available to the Central Coast Water Board upon request. Any problems must be promptly corrected and recorded.



**Table 5. Wastewater Treatment/Storage/Disposal Pond Monitoring**

| Parameter/<br>Constituent                         | Units                  | Sample Type             | Sampling/Monitoring<br>Frequency        |
|---------------------------------------------------|------------------------|-------------------------|-----------------------------------------|
| Freeboard                                         | 0.1 feet               | Measured                | Weekly                                  |
| pH                                                | pH Units               | Grab                    | Weekly                                  |
| Dissolved Oxygen<br>(in pond)                     | mg/L                   | Grab                    | Monthly                                 |
| Color                                             | Not<br>applicable      | Observation             | Monthly                                 |
| Vegetation inside<br>and surrounding<br>the pond. | Not<br>Applicable      | Observation             | Monthly                                 |
| Sludge Depth                                      | 0.1 feet               | Measured                | Annually                                |
| Berm condition                                    | Not<br>Applicable      | Observation             | Monthly                                 |
| Precipitation                                     | inches/day<br>and date | Measured <sup>[1]</sup> | Each precipitation event <sup>[2]</sup> |

[1] The City of Guadalupe may use a rain gauge or use a National Oceanic and Atmospheric Administration, United States Geological Survey, or California Irrigation Management Information System weather station, such as <http://scacis.rcc-acis.org/>.

[2] A precipitation event is one producing precipitation of ½ inch or more.

- ii. **Influent and Effluent Monitoring** – At a minimum, influent and effluent constituent monitoring for AIWPS and the Biolac® extended aeration activated sludge wastewater treatment system must be monitored as specified in Table 6.

**Table 6. Influent and Effluent Monitoring for AIWPS and Biolac®**

|                                        |                         | INFLUENT<br>(IS-1)   | INFLUENT<br>(IS-1)    | EFFLUENT<br>(ES-1 and<br>ES-2) | EFFLUENT<br>(ES-1 and<br>ES-2) |
|----------------------------------------|-------------------------|----------------------|-----------------------|--------------------------------|--------------------------------|
| Parameter/<br>Constituent              | Units<br><sup>[2]</sup> | Sample<br>Type       | Sampling<br>Frequency | Sample<br>Type                 | Sampling<br>Frequency          |
| pH                                     | units                   | Grab                 | Weekly                | Grab                           | Weekly                         |
| Biochemical<br>Oxygen Demand,<br>5-Day | mg/L                    | 24-hour<br>composite | Monthly               | 24-hour<br>composite           | Weekly                         |
| Total Suspended<br>Solids              | mg/L                    | 24-hour<br>composite | Monthly               | 24-hour<br>composite           | Weekly                         |
| Settleable Solids                      | ml/L                    | Not<br>Applicable    | Not<br>Applicable     | Grab                           | Daily                          |
| Total Nitrogen <sup>[1]</sup>          | mg/L                    | Calculated           | Quarterly             | Calculated                     | Quarterly                      |

|                                                           |                      | <b>INFLUENT<br/>(IS-1)</b> | <b>INFLUENT<br/>(IS-1)</b>    | <b>EFFLUENT<br/>(ES-1 and<br/>ES-2)</b> | <b>EFFLUENT<br/>(ES-1 and<br/>ES-2)</b> |
|-----------------------------------------------------------|----------------------|----------------------------|-------------------------------|-----------------------------------------|-----------------------------------------|
| <b>Parameter/<br/>Constituent</b>                         | <b>Units<br/>[2]</b> | <b>Sample<br/>Type</b>     | <b>Sampling<br/>Frequency</b> | <b>Sample<br/>Type</b>                  | <b>Sampling<br/>Frequency</b>           |
| Nitrate (as N) +<br>Nitrite (as N) or<br>separate species | mg/L                 | 24-hour<br>composite       | Quarterly                     | Grab                                    | Quarterly                               |
| Total Kjeldahl<br>Nitrogen (as N)                         | mg/L                 | 24-hour<br>composite       | Quarterly                     | Grab                                    | Quarterly                               |
| Ammonia (as N)                                            | mg/L                 | 24-hour<br>composite       | Quarterly                     | Grab                                    | Quarterly                               |
| Total Dissolved<br>Solids                                 | mg/L                 | 24-hour<br>composite       | Quarterly                     | Grab                                    | Quarterly                               |
| Chloride                                                  | mg/L                 | 24-hour<br>composite       | Quarterly                     | Grab                                    | Quarterly                               |
| Sodium                                                    | mg/L                 | 24-hour<br>composite       | Quarterly                     | Grab                                    | Quarterly                               |
| Sulfate                                                   | mg/L                 | 24-hour<br>composite       | Quarterly                     | Grab                                    | Quarterly                               |
| Boron                                                     | mg/L                 | Not<br>Applicable          | Not<br>Applicable             | Grab                                    | Quarterly                               |
| Total<br>Trihalomethanes<br>(TTHMs) [3]                   | µg/L                 | Not<br>Applicable          | Not<br>Applicable             | Grab                                    | Monthly                                 |
| Haloacetic Acids<br>(HAAs) [3]                            | µg/L                 | Not<br>Applicable          | Not<br>Applicable             | Grab                                    | Monthly                                 |
| Carbonate                                                 | mg/L                 | Not<br>Applicable          | Not<br>Applicable             | Grab                                    | Semiannually                            |
| Bicarbonate                                               | mg/L                 | Not<br>Applicable          | Not<br>Applicable             | Grab                                    | Semiannually                            |
| Calcium                                                   | mg/L                 | Not<br>Applicable          | Not<br>Applicable             | Grab                                    | Semiannually                            |
| Potassium                                                 | mg/L                 | Not<br>Applicable          | Not<br>Applicable             | Grab                                    | Semiannually                            |
| Magnesium                                                 | mg/L                 | Not<br>Applicable          | Not<br>Applicable             | Grab                                    | Semiannually                            |

[1] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

[2] ml/L denotes milliliters per liter

[3] Disinfection byproducts from the fruit and vegetable processing plant industrial wastewater.

**C. Effluent Monitoring for Non-Potable Recycled Water Producers – Reserved for future title 22 recycled water requirements.**

#### IV. WASTEWATER DISPOSAL AND LAND APPLICATION AREA MONITORING – EXCLUDES AREA OF RECYCLED WATER USE

The City of Guadalupe must monitor all wastewater disposal areas (e.g., land application areas, percolation ponds) when wastewater is applied. This section applies to the disposal areas that are not recycled water use areas. Inspections (observations) must be conducted as described in Table 7. Notations must be made in a bound logbook and problems must be promptly corrected and recorded. A log of these inspections must be maintained onsite and made available to Central Coast Water Board upon request. Observations do not need to be reported in the monitoring reports unless a violation of permit conditions or issues are observed. If violations are observed, planned and implemented mitigation measures to address the violations must be reported.

The City of Guadalupe must evaluate and summarize wastewater disposal application rates, loading rates (pounds/acre/day), violations found during the inspections, with each monitoring report.

If wastewater is not discharged to land during a reporting period, the monitoring report must still be submitted and indicate that there was no discharge during the reporting period.

**Table 7. Wastewater Disposal and Land Application Area Monitoring**

| Constituent                                                                                            | Units           | Sample Type                      | Monitoring Frequency     |
|--------------------------------------------------------------------------------------------------------|-----------------|----------------------------------|--------------------------|
| Wastewater Disposal                                                                                    | Gallons per day | Metered/Estimated <sup>[1]</sup> | Daily                    |
| Local Precipitation                                                                                    | Inches/day      | Weather Station <sup>[2]</sup>   | Each precipitation event |
| Acreage Applied <sup>[3]</sup>                                                                         | Acres           | Measured                         | Daily                    |
| Application Rate                                                                                       | Gallons per day | Metered/Estimated <sup>[1]</sup> | Daily                    |
| Average Monthly Biochemical Oxygen Demand, 5-Day (BOD) Applied <sup>[4]</sup> <sup>[5]</sup>           | lbs/acre/day    | Calculated                       | Monthly                  |
| Maximum Daily BOD <sub>5</sub> Applied <sup>[5]</sup>                                                  | lbs/acre/day    | Calculated                       | Weekly                   |
| Total Nitrogen Applied <sup>[4]</sup> <sup>[5]</sup>                                                   | lbs/acre/day    | Calculated                       | Quarterly                |
| Salts Applied <sup>[4]</sup> <sup>[5]</sup> (total dissolved solids, sodium, chloride, sulfate, boron) | lbs/acre/day    | Calculated                       | Quarterly                |

| Constituent                | Units          | Sample Type | Monitoring Frequency |
|----------------------------|----------------|-------------|----------------------|
| Soil Erosion Evidence      | Not Applicable | Observation | Monthly              |
| Containment Berm Condition | Not Applicable | Observation | Monthly              |
| Soil Saturation/Ponding    | Not Applicable | Observation | Monthly              |
| Nuisance Odors/Vectors     | Not Applicable | Observation | Monthly              |
| Discharge Offsite          | Not Applicable | Observation | Monthly              |

- [1] Requires meter reading, a pump run time meter, or other approved method. If the flow is estimated, the City of Guadalupe is required to provide an explanation (e.g., no meter- estimated using pump operations including rate and time) with each monitoring report.
- [2] The City of Guadalupe must have a rain gauge or use a NOAA or USGS rain station, such as <http://scacis.rcc-acis.org/>.
- [3] Acreage applied denotes the acreage to which wastewater is applied.
- [4] The total nitrogen, salts, and BOD applied loading rates must be calculated from wastewater flow volumes, applied acreage, and concentrations reported in effluent analytical testing as follows:

**Total Nitrogen/Salts/BOD Applied (pounds/acre/ day) =**

$$\frac{X \text{ [mg/L]} \times Q \text{ [million gallons per day]} \times 8.34 \text{ [(conversion from mg/L to pounds/million gallons per day)]}}{\text{Acreage Applied [acres]}}$$

Where X = Total nitrogen, salts, or BOD concentration

Where Q = Application Rate (often effluent flow rate)

- [5] Frequencies of analytical testing are defined in the influent and effluent monitoring tables (Table 6).

## V. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

The City of Guadalupe must report the handling and disposal of all sludge/biosolids generated at the Wastewater System. Records must include the date removed from the Wastewater System, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

The City of Guadalupe must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

If sludge/biosolids are not removed during the year, the City of Guadalupe must explain the absence of this monitoring in the annual report.

## VI. GROUNDWATER MONITORING

**A. Option 1: No Groundwater Monitoring Program** – The City of Guadalupe has chosen General Permit Option 1 for groundwater monitoring. Under this option, the City of Guadalupe must demonstrate the quality of effluent discharged from the Wastewater System meets effluent limitations specified in Table 6 of the General Permit. The City of Guadalupe must evaluate and provide a comparison of their effluent to the effluent limitations in the monitoring reports. The City of Guadalupe must demonstrate within 24 months of issuance of the notice of applicability that the quality of effluent discharged from the Wastewater System meets effluent limitations specified in Table 6 of the General Permit. If the City of Guadalupe is unable to comply with the effluent limitations within 24 months, the City of Guadalupe may be required to implement the groundwater monitoring program as described in Option 2, section VI.B of Attachment D of the General Permit- General Monitoring and Reporting Program R3-2020-0020<sup>1</sup>.

## VII. REPORTING REQUIREMENTS

### A. QUARTERLY AND ANNUAL MONITORING REPORTS

Quarterly and annual monitoring reports are due as described in Table 8.

**Table 8. Quarterly and Annual Monitoring Reporting**

| Report                                        | Monitoring Period        | Report Due Date |
|-----------------------------------------------|--------------------------|-----------------|
| First Quarter Monitoring Report               | January 1 to March 31    | May 1           |
| Second Quarter Monitoring Report              | April 1 to June 30       | August 1        |
| Third Quarter Monitoring Report               | July 1 to September 30   | November 1      |
| Fourth Quarter Monitoring Report              | October 1 to December 31 | February 1      |
| Annual Report                                 | January 1 to December 31 | March 1         |
| State Water Board Volumetric Annual Reporting | January 1 to December 31 | April 30        |

- 1. Quarterly Monitoring Reporting** – At a minimum, the quarterly reports must include:

---

<sup>1</sup> General Monitoring and Reporting Program R3-2020-0020 can be accessed on the Internet via the following link:  
[https://www.waterboards.ca.gov/centralcoast/board\\_decisions/adopted\\_orders/2020/r32020\\_0020mrp.pdf](https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020mrp.pdf)

- i. Results of all required monitoring in tabular format.
    - ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
    - iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. **The City of Guadalupe must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.
    - iv. Copies of laboratory analytical report(s) and chain of custody form(s).
    - v. When groundwater monitoring is required, an updated hydrogeologic conceptual site model with the groundwater monitoring reporting requirements based on new information generated from the monitoring well boring logs, groundwater elevation data, and water quality data.
    - vi. Copies of groundwater monitoring well field sheets with purge methods and data.
  2. **Annual Reporting** – The City of Guadalupe must submit annual reports in compliance with Standard Provisions 2013<sup>2</sup>, (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by Central Coast Water Board. In addition, the annual report must include a copy of any lease agreements for the application of wastewater on parcels not owned by the City of Guadalupe.
- The current annual report template can be found here:
- [https://www.waterboards.ca.gov/centralcoast/board\\_decisions/adopted\\_orders/2020/wdr\\_annual\\_report\\_format.pdf](https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf)
3. **State Water Board Volumetric Annual Reporting** – The City of Guadalupe must electronically certify and submit a summary of the monthly influent and effluent flow volume by April 30<sup>th</sup> of each calendar year via the State Water Board's Internet GeoTracker database.<sup>3</sup>

---

<sup>2</sup> See Attachment E, Standard Provisions, 2013:

[https://www.waterboards.ca.gov/centralcoast/board\\_decisions/docs/wdr\\_standard\\_provisions\\_2013.pdf](https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf)

<sup>3</sup> See: <https://geotracker.waterboards.ca.gov/>

The following information is required:

- i. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e. total monthly influent volume).
- ii. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.
- iii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website<sup>4</sup>.

## **B. WEEKLY REPORTS DURING USE OF TEMPORARY LAND APPLICATION AREA**

The City of Guadalupe must submit weekly reports each Monday to GeoTracker identifying irrigation events and duration, inspections conducted, and inspection findings for the prior week.

## **C. NON-COMPLIANCE REPORTING:**

The City of Guadalupe must notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, the conditionally accepted title 22 Engineering Report requirements, delivery of off-specification recycled water, and wastewater containment failure, pursuant to General Permit section VI.C.2.

## **D. ELECTRONIC GEOTRACKER SUBMITTAL**

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

[https://www.waterboards.ca.gov/centralcoast/water\\_issues/programs/wastewater\\_permi tting/docs/transmittal\\_sheet.pdf](https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permi tting/docs/transmittal_sheet.pdf)

---

<sup>4</sup> See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)



The City of Guadalupe must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker<sup>5,6</sup> database consistent with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System-specific global identification number **WDR100031582** at:

<https://geotracker.waterboards.ca.gov/esi/login>

For general questions, please contact the GeoTracker Help Desk at:

[Geotracker@waterboards.ca.gov](mailto:Geotracker@waterboards.ca.gov).

Table 9 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

**Table 9. GeoTracker Electronic Submittal Information Data Requirements**

| <b>Electronic Submittal</b> | <b>Description of Action</b>                                                                                                                                                     | <b>Action</b>                                                                                                                 | <b>Frequency</b>                                                                                                                   |
|-----------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------|
| Reports and Documents       | Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.                      | Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.           | On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board. |
| Laboratory Data             | All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge. | Upload, or direct your California ELAP-accredited laboratory staff to upload, all EDF laboratory data directly to GeoTracker. | On or before the due date of the required monitoring report.                                                                       |
| Depth to Groundwater        | Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.                                             | Upload depth-to-water information to the GeoTracker GEO_WELL file.                                                            | On or before the due date of the required monitoring report.                                                                       |

---

<sup>5</sup> Information for first-time GeoTracker users is available at:

[https://www.waterboards.ca.gov/ust/electronic\\_submittal/docs/beginnerguide2.pdf](https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf)

<sup>6</sup> Additional information available at:

<https://geotracker.waterboards.ca.gov/>

| Electronic Submittal                                | Description of Action                                                                                                                                                                                                                                                                                              | Action                                                                                                      | Frequency                                                                      |
|-----------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------|
| Boring Logs and Well Screen Intervals               | Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).                                                                                                                                                                             | Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled. | Every time a new boring is drilled.                                            |
| Field Points, Location Data (Geo XY) <sup>[1]</sup> | Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.” These data points are required prior to laboratory data uploads. | Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.                         | Every time a permanent monitoring point is established.                        |
| Elevation Data (Geo Z) <sup>[2]</sup>               | Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.                                                                                                                                          | Upload the survey data to the GeoTracker GEO_Z file.                                                        | One-time, for all groundwater monitoring wells.                                |
| Geo Map                                             | Site layout, map of facilities, Wastewater System including treatment and disposal area(s).                                                                                                                                                                                                                        | Upload the Site layout PDF to the GeoTracker site plan file.                                                | Year one and every five years thereafter and when the facilities are modified. |

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. The City of Guadalupe must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

## VIII. TECHNICAL REPORTS

The technical reports are due as described in Table 10. Note these dates are unchanged from the original monitoring and reporting program issued on May 30, 2023

**Table 10. Technical Report Submittal Due Dates**

| <b>Report</b>                     | <b>Report Due Date</b> |
|-----------------------------------|------------------------|
| Pretreatment Program Plan         | Not Applicable         |
| Operations and Maintenance Manual | May 30, 2024           |
| Climate Change Adaptation Plan    | May 30, 2025           |
| Salt and Nutrient Management Plan | Not Applicable         |
| Time Schedule Compliance Plan     | May 30, 2024           |
| Capital Improvements Plan         | May 30, 2026           |

1. **Pretreatment Program Plan** – A Pretreatment Program is not required at this time. If the Central Coast Water Board notifies the City of Guadalupe that development of a Pretreatment Program Plan is required, submit a plan that meets the requirements specified in General Permit section IV.F.2.i and General Permit section VI.A.1. The plan must contain an implementation schedule and identification of adequate funding to implement the plan.
2. **Operations and Maintenance Manual** – In addition to the required components specified in Standard Provisions<sup>7</sup> A.12 and A.28 (and any updates to the Standard Provisions) and General Permit section VI.A.2, the Operations and Maintenance Manual must contain the following components. Each component must contain an implementation schedule and identification of adequate funding to implement the component.
  - i. **Sampling and Analysis Plan** – The City of Guadalupe's Operation and Maintenance Manual must contain a sampling and analysis plan that meets the requirements specified herein. Anyone performing sampling on behalf of the City of Guadalupe must be familiar with the sampling and analysis plan. At a minimum, the sampling and analysis plan must contain the following:
    - a. A wastewater treatment process flow schematic with the monitoring locations labeled and scaled Wastewater System maps with treatment components, discharge locations (both treated wastewater and non-potable recycled water), monitoring locations, groundwater wells, storage locations (e.g., chemical, sludge, emergency overflow ponds),

---

<sup>7</sup> See Attachment E, Standard Provisions, 2013:  
[https://www.waterboards.ca.gov/centralcoast/board\\_decisions/decisions/wdr\\_standard\\_provisions\\_2013.pdf](https://www.waterboards.ca.gov/centralcoast/board_decisions/decisions/wdr_standard_provisions_2013.pdf)

- and buildings. (if the City of Guadalupe needs to update Figure 1 to comply with this requirement, a copy of the updated process flow schematic will also be included with the annual report).
- b. Sample identification details in tabular format. The table must include the sample titles, GeoTracker field point information, sample description(s), and sampling frequencies.
  - c. Sample chain-of-custody procedures and documentation.
  - d. Sample handling/preservation procedures.
  - e. A description of the analytical methods.
  - f. A description of sample containers, preservatives, and holding times.
  - g. For water supply monitoring, a description of the location and method of data collection (e.g., onsite well sampling, use of consumer confidence report).
  - h. For groundwater monitoring, a description of the well purging and field methods.
- ii. **Sludge Management Plan** – The City of Guadalupe’s Operation and Maintenance Manual must contain a sludge management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the plan must describe the following:
- a. An estimated volume/amount and quality of sludge and scum that will be generated.
  - b. How sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.
  - c. If sludge will be subject to further treatment, describe the treatment and storage requirements.
  - d. Procedures for cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.
- iii. **Wastewater Disposal Management Plan** – The City of Guadalupe’s Operation and Maintenance Manual must contain a wastewater disposal management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the wastewater disposal management plan must include:
- a. A description of the wastewater disposal area and a map denoting acreage.

- b. Loading calculations based on flow volumes, applied acreage, and biochemical oxygen demand, salts (total dissolved solids, sodium, chloride, sulfate, boron), and nitrogen analytical results.
  - c. A description of wastewater disposal and water quality protection practices.
- iv. **Spill Prevention and Emergency Response Plan** –The City of Guadalupe’s Operation and Maintenance Manual must contain a spill prevention and emergency response plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. The spill prevention and emergency response plan must describe operation and maintenance activities to prevent accidental releases of wastewater and to effectively respond to such releases and minimize the environmental impact. At a minimum, the spill prevention and emergency response plan must address the following:
  - a. Operation and Control of Wastewater System - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.
  - b. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.
  - c. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order No. 2006-0003-DWQ, Statewide General Waste Discharge Requirements for Sanitary Sewer Systems (or its replacement), reports prepared to comply with State Water Board Order No. 2006-0003-DWQ satisfy this requirement.
  - d. Emergency Response - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater treatment, storage, or disposal ponds or treated non-potable recycled water storage ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.
  - e. Finance - At a minimum, discuss current fees, projected fees, current budget for spill prevention and emergency response, projected budget for spill prevention and emergency response.
  - f. Notification Procedures - Coordination procedures with fire, police, Governor’s Office of Emergency Services (CalOES), Central Coast Water Board, and local county health department personnel.

- v. **Training Records Log** – The City of Guadalupe’s Operation and Maintenance Manual must contain updated training records logs that demonstrates the City of Guadalupe is complying with General Permit section VI.B.3.
3. **Climate Change Adaptation** –The Climate Change Adaptation Plan must, at a minimum, include the following components:
- i. Hazards and Vulnerabilities – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using up-to-date tools, data, and guidance from the State of California (e.g., Cal-Adapt<sup>8</sup>, Sea-Level Rise Guidance from Ocean Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California Climate Assessment Regional Reports), assess the Wastewater System’s vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities.
    - a. Sea Level Rise – Saltwater intrusion, flooding and inundation, and increased coastal erosion.
    - b. Precipitation Pattern Changes.
      - I. Drought – Decreased influent quantity and quality.
      - II. Peak Events – Flooding and increased influent quantity.
    - c. Temperature fluctuations and extremes.
    - d. Increased wildfires.
    - e. Increased power outages.
  - ii. Resiliency Actions – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.

---

<sup>8</sup> Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor’s Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

- iii. Adaptation Strategy – For Wastewater Systems with design flows over 1,000,000 gallons per day, develop and implement a strategy to complete resiliency actions, at a minimum encompassing the following:
  - a. Prioritization – Prioritized resiliency actions based on risks to water quality, but also accounting for costs and benefits.
  - b. Schedule and Milestones – Timeframes to complete prioritized resiliency actions and/or climate change hazard triggers to inform when the City of Guadalupe must implement actions. Milestones to complete critical steps for prioritized resiliency actions, designed to demonstrate measurable progress at a steady, or accelerated, completion pace over the established timeframes.
  - c. Financial Planning – Projected costs necessary to implement and sustain resiliency actions and strategy to procure funds.
- iv. Recycled Water Feasibility Plan – Dischargers with Wastewater System design flows over 1,000,000 gallons per day must include a recycled water feasibility plan.

The recycled water feasibility plan will assess the viability of using the Wastewater System's treated wastewater effluent for beneficial reuse including, but not limited to the following:

- a. Beneficial Reuse Options – Identification of reuse opportunities for the City of Guadalupe's treated effluent that would achieve the highest beneficial impact and best uses possible of non-potable recycled water. Include assessment of the following non-potable recycled water benefits identified in the State Water Board Recycled Water Policy: providing safe alternatives to fresh water or potable water for approved uses; supporting sustainable groundwater and surface water uses with the intent of substituting use of treated effluent for use of fresh water or potable water; and diversifying community water supplies and mitigating for the impacts of climate change.<sup>9</sup>
- b. Viable Users – Identification and viability evaluation of all potential users of the Wastewater System's treated effluent associated with identified beneficial reuse options. The City of Guadalupe must demonstrate it engaged potential water purveyors and customers about the viability of reusing the Wastewater System's treated effluent.
- c. Infrastructure Upgrades – Assessment of infrastructure needs to produce non-potable recycled water for identified beneficial reuses and convey non-potable recycled water to beneficial reuse locations.

---

<sup>9</sup> [Water Quality Control Policy for Recycled Water](#), State Water Board, adopted December 11, 2018, page 1.



- d. Fiscal Analysis – Cost estimates for identified reuse options, at a minimum including project development, construction, and long-term maintenance and lifecycle costs. This analysis shall also include identification and evaluation of the following: 1) funding options, including at a minimum, revenues from recycled water sales, grant and loan funding opportunities, and financing from other benefitting parties and 2) funding limitations.
  - e. Schedule and Milestones for Next Steps – Timeframes to assess the feasibility of identified beneficial reuse options and to identify proposed beneficial reuse options based on prioritized water recycling and reuse opportunities, feasibility assessments, and other factors identified by the City of Guadalupe.
  - f. Identification of implementation schedule and adequate funding to implement the plan.
- 4. **Salt and Nutrient Management Plan** – If directed by the Central Coast Water Board pursuant to California Water Code section 13267, the City of Guadalupe must prepare and submit a Salt and Nutrient Management Plan to ensure that the overall impact of treated wastewater and/or non-potable water recycling projects does not degrade groundwater resources. At a minimum, the salt and nutrient management plan must address the following:
  - i. An outline and description of an implementable salt and nutrient management program to reduce mass loading of salts and nutrients (with an emphasis on nitrogen species) in treated effluent to a level that will ensure compliance with effluent limitations and protect beneficial uses of groundwater.
    - a. A description of salt reduction measures that identify and focus on all potential salt contributors to the collection system (e.g., water supply, commercial, industrial, residential) and wastewater treatment process.
    - b. A description of nutrient reduction measures that focus on source control and optimizing wastewater treatment processes for nitrogen removal.
- 5. **Time Schedule Compliance Plan** - As set forth in General Permit sections V.A and VI.A.5, if the City of Guadalupe anticipates that additional time is needed to achieve compliance with the effluent limitations, the City of Guadalupe must prepare and submit for Central Coast Water Board review and approval, a time schedule compliance plan. At a minimum, the time schedule compliance plan must address the following:
  - i. Comparison of the current effluent quality to the effluent and groundwater limitations in General Permit Tables 3-6.
  - ii. A detailed description and chronology of efforts, since issuance of the notice of applicability, to reduce wastes.

- iii. Justification of the need for additional time to achieve the effluent limitations in General Permit Tables 3-6.
  - iv. A detailed time schedule of specific actions the City of Guadalupe will take to achieve the effluent limitations.
  - v. A demonstration that the time schedule requested is as short as possible, considering the technological, operation, and economic factors that affect the design, development, and implementation of the measures that are necessary to comply with the effluent limitation(s).
  - vi. If the requested time schedule exceeds one year, the proposed schedule shall include interim requirements and the date(s) for their achievement. The interim requirements shall include both of the following:
    - a. Effluent limitation(s) for the pollutant(s) of concern.
    - b. Actions, measurable milestones, and tangible products leading to compliance with the effluent limitation(s).
6. **Capital Improvements Plan** – The City of Guadalupe must prepare and submit a Capital Improvements Plan (CIP). The CIP must contain all significant capital projects, equipment purchases, and major studies for operating the City of Guadalupe’s Wastewater Reclamation System. In general, the CIP will include the following elements:
- i. Estimated Overall Cost of Each Project
  - ii. Estimated Operational & Maintenance Cost for Each Project
  - iii. Estimated Project Timelines
  - iv. Funding Sources
  - v. Project Prioritization

## IX. LEGAL REQUIREMENTS

The Central Coast Water Board’s requirements that the City of Guadalupe submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject the City of Guadalupe to enforcement action pursuant to section 13268 of the California Water Code. Pursuant to [section 13268 of the Water Code](#), a violation of a request made pursuant to section 13267 may subject the City of Guadalupe to civil liability assessment of up to \$1,000 per day in which the violation occurs.

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. The City of Guadalupe is

required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

The City of Guadalupe must implement the above monitoring program as of September 27, 2024. The Central Coast Water Board may rescind or modify this monitoring and reporting program at any time.

Ordered By:

*for* Ryan E. Lodge  
Executive Officer

R:\RB3\Shared\WDR\WDR Facilities\Santa Barbara Co\Guadalupe City  
WWTP\1\_Permit\Existing Permit\GUAD\_MRP\_R3-2023-0014 2024 REV.docx