
Central Coast Regional Water Quality Control Board

April 28, 2023

Sent Via Electronic Mail

Suzzi Clark
San Ardo Water District
34 Main St
P.O. Box 238
San Ardo, CA 93450
Email: sanardowaterdistrict@yahoo.com

Dear Suzzi Clark,

SAN ARDO WASTEWATER TREATMENT PLANT, CATTLEMAN ROAD, SAN ARDO, CA 93450, MONTEREY COUNTY:

- **NOTICE OF APPLICABILITY FOR SAN ARDO WATER DISTRICT'S ENROLLMENT IN *ORDER WQ 2014-0153-DWQ, GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS***
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2023-0021**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER NO. R3-89-147**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the Notice of Intent (received on August 26, 2022), and available documents associated with the domestic wastewater treatment system at San Ardo Wastewater Treatment Plant owned by the San Ardo Water District. The wastewater system is currently regulated pursuant to Order No. 89-147. On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order No. 89-147.

This letter serves as a notice of applicability for the San Ardo Water District's enrollment in the General Permit for the discharge of wastewater from San Ardo Wastewater Treatment Plant.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

JANE GRAY, CHAIR | MATTHEW T. KEELING, EXECUTIVE OFFICER

The San Ardo Water District must comply with the following:

1. **General Permit** – The San Ardo Water District must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. **Monitoring and Reporting Program** – San Ardo Water District must comply with the requirements of Monitoring and Reporting Program No. R3-2023-0021, enclosed with this letter (Attachment 3). Your first semiannual report is due on **August 1, 2023**.

Monitoring reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

San Ardo Water District must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{1,2} database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system-specific global identification number **WDR100035633** at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

3. **Fees** – San Ardo Water District paid an annual fee on December 27, 2022 for coverage in the existing individual permit, Order No. 89-147. This payment covers permit fees for the 2022-2023 fiscal year.

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

² Additional information available at: <http://geotracker.waterboards.ca.gov/>

San Ardo Water District must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee program and cover the state fiscal year of July 1 through June 30. Your annual fee is currently \$7,770.00. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 3B.

A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on June 22-23, 2023. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.
6. **Responsible Party** – San Ardo Water District is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects San Ardo Water District to enforcement action and termination of enrollment under this General Permit.
7. **Change in Ownership** – In the event of any change in control or ownership of the property, San Ardo Water District must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.
8. **Certified Operator** – San Ardo Water District is required to comply with the operator certification requirements³ administered by the State Water Board's

³ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

Office of Operator Certification, which currently requires a Class I certified operator onsite to maintain and operate the treatment system.

If you have any questions, please contact **Kathy Truong at (805) 549-3293 or by email at Kathy.Truong@waterboards.ca.gov** , or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

Jennifer Epp
Digitally signed by Jennifer Epp
Date: 2023.04.28 13:38:27
-07'00'
Water Boards

for Matthew T. Keeling
Executive Officer

Attachments:

- Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations
- Attachment 2: Figures
- Attachment 3: Monitoring and Reporting Program No. R3-2023-0021

cc:

Ed Alexander, Contract Operator, ewardc@gmail.com
Jujhar Kaur Khalsa, [Operator-In-Training, fallingskyfresh@yahoo.com](mailto:Operator-In-Training_fallingskyfresh@yahoo.com)
Nicole Fowler, Monterey County, fowlerne@co.monterey.ca.us
Kathy Truong, Kathy.truong@waterboards.ca.gov
Kristina Olmos, Kristina.Olmos@Waterboards.ca.gov
Jesse Woodard, Jesse.Woodard@waterboards.ca.gov
Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov
WDR Program, RB3-WDR@Waterboards.ca.gov GeoTracker
ECM/CIWQS = CW-255190
GeoTracker No. = GT- WDR100035633
Rev 8/18/22
Subject Name = San Ardo Water District New Permit

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\Monterey Co\San Ardo WWTP\2023 Permit Update\San Ardo NOA and MRP_final.docx

ATTACHMENT 1

**WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC
REQUIREMENTS AND LIMITATIONS**

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by San Ardo Water District to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	San Ardo Wastewater Treatment Plant
Facility Address	Cattleman Road, San Ardo, CA 93450
Parcel Numbers	237-071-002-000
Latitude/Longitude	36.017170, -120.915471
Owner of Facility	San Ardo Water District
Legally Responsible Official of Owner	Suzzi Clark
Owner Mailing Address	P.O. Box 238 San Ardo CA 93450
Billing Address	P.O. Box 238 San Ardo CA 93450
Permitted Design Flow, Maximum Daily (gallons per day, gpd)	Maximum daily capacity 90,000
Baseline Flow (average annual flow) in gpd	26,000
Operators	Ed Alexander, Plant Operator, Grade 4
Waste type and Service Area	Domestic wastewater from 500 residents in the San Ardo Community
Threat to Water Quality	3
Complexity	B
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR

The Salinas River is the nearest surface water located approximately 75 feet northeast of Pond 3 (emergency overflow pond). First-encountered groundwater is at approximately 10-60 feet below ground surface.

2. WASTEWATER SYSTEM OPERATION SUMMARY

The treatment system is composed of a lift station, oxidation ponds (Pond 1 and Pond 2), and an emergency overflow pond (Pond 3). A summary of the system is included in Table 2 below. A facility site map and dispersal system layout are shown in Attachment 2.

Table 2. Permitted Pond Treatment & Disposal Technologies and Capacity

Permitted Design Flows	Design Influent Maximum Daily Flow 90,000 gallons per day
Treatment / Disposal	Wastewater flows from collection system to the lift station in San Ardo. From the lift station, wastewater flows across the Cattleman Road bridge via the sewer line and enters the ponds. San Ardo Water District has two treatment/disposal oxidation ponds (Pond 1 and Pond 2) for wastewater percolation and evaporation. [1] Depth of ponds, total disposal capacity, and percolation information is unknown.
Emergency Overflow	Pond 3 is used for emergency overflow.
Sludge Production and Handling	Sludge is dried within an empty pond during dry months and disposed offsite.

[\[1\]](#) The 89-147 permit indicated that the ponds were clay lined. However, wastewater appears to be percolating at a fast rate and Water District staff has not confirmed whether the ponds are lined.

3. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

San Ardo Water District must operate the facility in accordance with the General Permit⁴ and this notice of applicability.⁵ The facility includes two treatment ponds and an emergency overflow pond. San Ardo Water District must operate the pond system to comply with the effluent limits below.

A. Effluent limits

⁴ General Permit sections B.2,B.3, B.4, B.6 and B.7 are not applicable for this facility.

⁵ General Permit section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Permit, effluent limits in the General Permit, and compliance with site-specific limits set forth in this notice of applicability.

San Ardo Water District must comply with the site-specific limits listed in Table 3.

Table 3. Wastewater Limits for Pond Systems

Constituent	Unit	Limit	Point of Compliance ¹
Flow	gpd	26,000 (average annual) 90,000 (maximum daily flow)	Influent (IS-1)
Five-Day Biochemical Oxygen Demand (BOD ₅)	mg/L	90	Effluent (ES-1)
Total N	% Influent versus Effluent	50% Removal	Effluent (ES-1)

¹ Refer to monitoring and reporting program for sampling locations

4. GROUNDWATER LIMITS

As stated in the General Permit, Section C, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, San Ardo Water District must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).⁶ These objectives include:

- 1) General objectives for taste and odors and radioactivity for all groundwaters.
- 2) Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15 2.
- 3) Specific objectives for the groundwater basin where the discharge occurs. This facility discharges into the Salinas Valley Upper Valley Aquifer, and those Basin Plan's groundwater objectives are included in Table 4.

Table 4. Basin Plan, Median Groundwater Objectives (mg/L)

Constituent	Median Groundwater Objective for Upper Valley Aquifer
Total Dissolved Solids (TDS)	600
Sodium	70

⁶ Current edition, June 2019 is available at:

https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

Chloride	150
Sulfate	150
Boron	0.5
Total Nitrogen as N	5

mg/L = milligrams per liter

The Central Coast Water Board does not require first-encountered groundwater monitoring wells at this time but may require installation of groundwater monitoring wells in the future. If effluent water quality indicates exceedances of the Basin Plan groundwater objectives, the Central Coast Water Board may require installation of groundwater monitoring wells in the future.

ATTACHMENT 2
FIGURES



Figure 1. Site Location Map (Photo Source: Google Earth)



Figure 2. Site Map (Photo Source: Google Earth)



Figure 3. Overview map of San Ardo created by Water Board staff

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION**

MONITORING AND REPORTING PROGRAM NO. R3-2023-0021

for

**SAN ARDO WATER DISTRICT
MONTEREY COUNTY**

April 28, 2023

This monitoring and reporting program describes requirements for monitoring the San Ardo Wastewater Treatment Plant owned by the San Ardo Water District, located at Cattleman Road, in San Ardo, CA 93450.

San Ardo Water District owns and operates the wastewater system that is subject to the notice of applicability dated April 28, 2023, for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;

2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2.

In lieu of the required water supply sampling, San Ardo Water District may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. San Ardo Water District must report the results of any constituent monitored more frequently than is required by this monitoring and reporting. San Ardo Water District must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling Frequency	Reporting Frequency
TDS	mg/L	Grab	Annually	Annually
Nitrate and Nitrite (as N)	mg/L	Grab	Annually	Annually

mg/L denotes milligrams per liter

3. MONITORING LOCATIONS

Monitoring location information, including nomenclature that must be used when reporting data to the GeoTracker database (described below), is shown in Table 3.

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code	Sample Description
Influent Sample – 1	IS-1	Representative grab sample at headworks screen
Effluent Sample –1	ES-1	Representative grab sample from treatment Pond 1 valve ^[1]
Effluent Sample –2	ES–2	Representative grab sample from treatment Pond 2 valve ^[1]

Effluent Sample –3	ES–3	Representative grab sample from emergency overflow Pond 3 effluent at the valve in the pond ^[1]
--------------------	------	--

[1] Effluent sample must be taken at all ponds that are in service, or have standing water, at the time of sampling. See Figure 1 for locations.

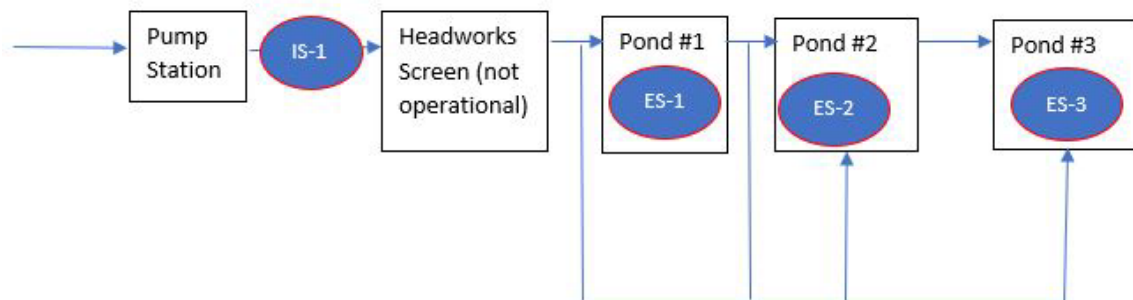


Figure 1. Process Flow Diagram with Sampling Locations



Figure 2. Sampling Locations on Aerial Map

4. POND SYSTEM TREATMENT UNIT MONITORING

4.1 Flow Monitoring

San Ardo Water District must monitor and report flow, as described in Table 4, with each monitoring report. Flow is monitored at sample location IS-1 prior to treatment.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Sampling Frequency
Daily Flow	Gallons per day	Metered	Daily
Maximum Daily Flow	Gallons per day	Metered	Monthly
Average Daily Flow	Gallons per day	Calculated	Monthly

4.2 Influent and Effluent Constituent Monitoring

Representative samples of San Ardo Water District's influent (raw wastewater) into the wastewater system and discharged to pond must be collected and analyzed as follows. All samples must be grab.

Table 5. Influent and Effluent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1, ES-2 and/or ES-3) ^[1] Sampling Frequency
Biochemical Oxygen Demand, 5-Day	mg/L	Not Required	Monthly
Total Suspended Solids	mg/L	Monthly	Monthly
pH	pH units	Not Required	Monthly
Total Nitrogen	mg/L	Quarterly	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species ¹	mg/L	Quarterly	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Quarterly
Total Dissolved Solids	mg/L	Not Required	Semi-annually
Chloride	mg/L	Not Required	Semi-annually
Sodium	mg/L	Not Required	Semi-annually
Sulfate	mg/L	Not Required	Semi-annually

mg/L = milligram per liter MPN = most probably number

[1] Effluent samples must be taken at all ponds that are in service, or have standing water, at the time of sampling. For example, if Pond 1 is the only pond with wastewater, only one effluent sample from ES-1 is required.

- [2] Nitrate and nitrite sample may be combined
[3] using a minimum of 15 tubes or three dilutions

5. WASTEWATER POND MONITORING

Wastewater ponds must be inspected at least as frequently as described in Table 6.

Table 6. Wastewater Pond Measurements

Parameter	Units	Measurement Type	Inspection/Reporting Frequency
Dissolved Oxygen	mg/L	Grab	Quarterly
Freeboard	0.1 Feet	Measurement	Quarterly
Odors	NA	Observation	Quarterly
Berm Condition	NA	Observation and photograph	Quarterly
Pond Color	NA	Observation and photograph	Quarterly

6. SOLIDS DISPOSAL MONITORING

San Ardo Water District must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

7. COLLECTION SYSTEM MAINTENANCE

San Ardo Water District must submit records of any maintenance performed on the sewer collection system within the past year.

8. REPORTING

The semiannual monitoring reports must be submitted in accordance with Table 7.

Table 7. Semiannual Monitoring Reports

Report	Monitoring Period	Report Due Date
First Semiannual Report	January 1 to June 30	August 1
Second Semiannual Report	July 1 to December 31	February 1

At a minimum, the semiannual reports must include:

- **Facility Information and Description** -- Briefly describe your facility, treatment process, and disposal process with references to figures.
- **Data Tables** -- Tabular summaries of all monitoring data (water supply, influent, effluent, and groundwater) compared to effluent limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program.
- **Compliance and Performance Discussion** –
 - Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Permit requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.
 - An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (BOD₅, TSS, Total Nitrogen) over time, nuisance conditions, system problems, etc.
 - A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.

Pond System Monitoring- Photos that document the color of the pond, freeboard markers, and berm condition. Description of pond color, berm condition, and note of any issues with significant odors.

- **Solids Disposal** -- If solids are disposed of offsite, comply with the reporting in Section 6.
- **Operator Information** -- List the name and contact information for the wastewater operators responsible for operation, maintenance, and/or system monitoring.
- **Flow Evaluation** -- A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.
- **Figures** -- A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).
- **Laboratory Sheets** -- Copies of laboratory analytical report(s) and chain of custody form(s).

9. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permittng/docs/transmittal_sheet.pdf

San Ardo Water District must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{7,8} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number **WDR100035633** at:

<https://geotracker.waterboards.ca.gov/esi/login>

Table 8 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

Table 8. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report

⁷ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

⁸ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Electronic Submittal	Description of Action	Action	Frequency
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports)	Upload boring logs (in searchable PDF format) to GeoTracker whenever a new boring is drilled.	Every time a new boring is drilled.
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.”	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Elevation Data (Geo Z)	Mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z File.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

10. TECHNICAL REPORTS

San Ardo Water District must submit to GeoTracker the reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 9. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

Table 9. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	July 28, 2023
Sampling and Analysis Plan	July 28, 2023

Report	Report Due Date
Sludge Management Plan	July 28, 2023
Climate Change Adaptation Plan ^[1]	12 months (April 28, 2024)

^[1] This plan is due no later than 12 months, and must be completed prior to any plans to upgrade the wastewater treatment plant (e.g. feasibility study for clean water State Revolving Fund Grant).

1. **Climate Change Adaptation** –The Climate Change Adaptation Plan must, at a minimum, include the following components:
 - i. Hazards and Vulnerabilities – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using up-to-date tools, data, and guidance from the State of California (e.g., Cal-Adapt⁹, Sea-Level Rise Guidance from Ocean Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California Climate Assessment Regional Reports), assess the Wastewater System’s vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities.
 - a. Precipitation Pattern Changes.
 - I. Peak Events – Flooding and increased influent quantity.
 - II. Drought – Decreased influent quantity and quality.
 - b. Temperature fluctuations and extremes.
 - c. Increased wildfires.
 - ii. Resiliency Actions – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.
 - iii. Adaptation Strategy –Develop and implement a strategy to complete resiliency actions, at a minimum encompassing the following:

⁹ Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor’s Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

- a. Prioritization – Prioritized resiliency actions based on risks to water quality, but also accounting for costs and benefits.
- b. Schedule and Milestones – Timeframes to complete prioritized resiliency actions and/or climate change hazard triggers to inform when San Ardo Water District must implement actions. Milestones to complete critical steps for prioritized resiliency actions, designed to demonstrate measurable progress at a steady, or accelerated, completion pace over the established timeframes.
- c. Financial Planning – Projected costs necessary to implement and sustain resiliency actions and strategy to procure funds.

11. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that San Ardo Water District submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject San Ardo Water District to enforcement action pursuant to [section 13268 of the Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. San Ardo Water District is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained.

San Ardo Water District must implement the above monitoring program on April 28, 2023. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. San Ardo Water District must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered by:

Jennifer Epp Digitally signed by Jennifer Epp
Date: 2023.04.28 13:39:41 -07'00'
Water Boards

for Matthew T. Keeling
Executive Officer