
Central Coast Regional Water Quality Control Board

September 20, 2017

Vivian Vickery
Office Administrator
Cuyama Community Services District
4853 Primero Street
New Cuyama, CA 93254

Sent via Electronic Mail

E-mail: ccsd@inreach.com

Dear Ms. Vickery:

**NOTICE OF APPLICABILITY FOR ENROLLMENT IN STATE WATER RESOURCES
CONTROL BOARD ORDER WQ 2014-0153-DWQ, GENERAL WASTE
REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS
- CUYAMA COMMUNITY SERVICES DISTRICT, NEW CUYAMA, SANTA BARBARA
COUNTY**

Thank you for submitting a Report of Waste Discharge (ROWD) for enrollment in the General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems for Cuyama Community Services District (Cuyama CSD). Based upon your submitted information, we understand the following:

1. Cuyama CSD wastewater treatment plant (WWTP) is located west of the community of Cuyama, northwest of the intersection of State Route 166 and Perkins Road, Santa Barbara County, California, 93254 (Attachment A).
2. The WWTP treats municipal wastewater from domestic sources. The service area consists of 215 sanitary sewer connections with an existing service population of approximately 600 people. The service area includes single-family residential, parks, commercial, industrial/recreational (airport), and public/institutional schools.
3. The WWTP average daily flow for 2013-2014 was 0.031 million gallons per day (MGD) or 51 gallons per capita per day (gpcd).
4. **Cuyama CSD wastewater system treatment** - The WWTP has a design capacity (dry weather flow) of 150,000 gallons per day (gpd). The treatment processes include influent screening (mechanical bar screen with a standby manual bar screen), activated sludge with extended aeration, and secondary clarification facilities. Effluent flow measurement is accomplished with a new flow

meter being installed in the new pump station valve vault. Sludge processing consists of aerobic digestion and sludge drying beds. Biosolids are stored on-site at the WWTP and have not been hauled off-site since 1993. A process flow diagram of the WWTP is presented in Attachment B.

The WWTP includes three evaporation ponds (Attachment C) for discharging treated effluent with the option of land application on adjacent property for irrigation of non-food crops. Evaporation Ponds 1 and 2 are sized for disposal of the full amount of treated effluent without consideration of land application area (LAA) available for irrigation of non-food crops (the evaporation disposal capacity at 100-yr precipitation conditions will be 0.033 MGD). Irrigation of the LAA is an optional disposal method for Cuyama CSD, but Cuyama CSD is not dependent on the LAA for disposal.

5. The Title 22 engineering report describes the quality of the undisinfected secondary treated wastewater and its potential use on a neighboring 575 acres. The treated wastewater is an alternative irrigation source for growing grape rootstock with drip irrigation. Once the rootstock has sufficiently grown, it is transported, prior to growing fruit, to another field, which does not receive recycled water from CCSD.
6. The owner of the neighboring irrigated land is Mr. Glen Stoller, who currently uses an irrigation well to irrigate the rootstock.

Discharge Specifications

Applicable Basin Plan groundwater and/or surface water limitations in addition to those provided in Section C of this General Order.

1. **Site-specific flow limit** - In no case shall Cuyama CSD discharge exceed 100,000 gpd as a monthly average.
2. The wastewater discharged to the ponds shall not exceed the effluent limits described in Table 1.

TABLE 1 - EFFLUENT LIMITS

Parameter	30-day Monthly Average	7-day Average
Biochemical Oxygen Demand (BOD5)	30 mg/L	45 mg/L
Total Suspended Solids (TSS)	30 mg/L	45 mg/L

3. The average monthly percent removal of BOD5 and TSS shall not be less than 85 percent.

4. The WWTP discharges to lined ponds.
5. Nitrogen effluent limits not are required.
6. The Division of Drinking Water approved of the use of recycled water with the conditions contained in the Title 22 engineering report and subsequent amendments (revised August 2017). The Division of Drinking Water has the additional following conditions:
 - Irrigation with recycled water shall not take place within 150 feet of a domestic (potable) water well.
 - According to *Regulations Related to Recycled Water, Section 60304 (d), (7)*, there must be a 14-day period immediately prior to harvesting, in which there is no irrigation with undisinfected, secondary recycled water.
 - Due to the quality of the recycled water (undisinfected, secondary), and corresponding increased risk to those using it, the recycled water user shall provide ongoing employee training which covers the safe handling of the recycled water and the crop irrigated with recycled water. This includes irrigation, tending the crop, the harvesting process, and transport of the crop to its final destination. The training shall include the use of proper personal protective equipment, hand-washing recommendations (prior to eating, smoking, etc.), and safe transport and re-planting of the harvested crop.
 - The CCSD shall require proof of routine trainings and maintain a record for their files. Training shall be given anytime a new employee is onsite and at routine intervals to maintain a high level of awareness of the potential health impacts of improperly handling disinfected, secondary recycled water.

Cuyama CSD is hereby enrolled under the General Order WQ 2014-0153-DWQ. You are required to comply with the General WDRs and the attached revised monitoring and reporting program (MRP) No. R3-2017-0047. A copy of the General Order can be obtained at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wq2014_0153_dwq.pdf

Your first quarterly report is due February 1, 2018, and every quarter thereafter. Your first annual report is due February 1, 2019, and every year thereafter. Please submit all requested information electronically in a searchable PDF format and email to centralcoast@waterboards.ca.gov using the attached transmittal sheet as the cover page.

Also, you must inform Central Coast Water Board staff if changes are made to Cuyama CSD WWTP that may affect the quality or quantity of waste discharged.

DR. JEAN-PIERRE WOLFF, CHAIR | JOHN M. ROBERTSON, EXECUTIVE OFFICER

895 Aerovista Place, Suite 101, San Luis Obispo, CA 93401 | www.waterboards.ca.gov/centralcoast

The Central Coast Water Board will be notified of your enrollment in the General Order at its next regularly scheduled meeting in San Luis Obispo on December 7-8, 2017. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

If you have any questions, please contact **Howard Kolb** at 805/549-3332 or by email at **howard.kolb@waterboards.ca.gov**.

Sincerely,

for John M. Robertson
Executive Officer

cc.

Reid Johnson, Engineering Manager, Nolte Vertical Five, Reid.Johnson@nv5.com

Michael Downey, DFA, Michael.Downey@waterboards.ca.gov

Dana Solum, Santa Barbara County Public Health Department,

Dana.Solum@sbcphd.org

Jeff Densmore, Division of Drinking Water, Jeff.Densmore@waterboards.ca.gov

Chris Adair P.E., Central Coast Water Board, Chris.Adair@waterboards.ca.gov

Howard Kolb P.E., Central Coast Water Board, howard.kolb@waterboards.ca.gov

Sheila Soderberg, Central Coast Water Board, sheila.soderberg@waterboards.ca.gov

Peter von Langen, Central Coast Water Board, Peter.vonlangen@waterboards.ca.gov

HEK

PCA = 12601

CIWQS Place ID/ECM = 216428

R:\RB3\Shared\WDR\WDR Facilities\Santa Barbara Co\Cuyama CSD\Notice of Applicability 9-11-2017.docx

Attachment A

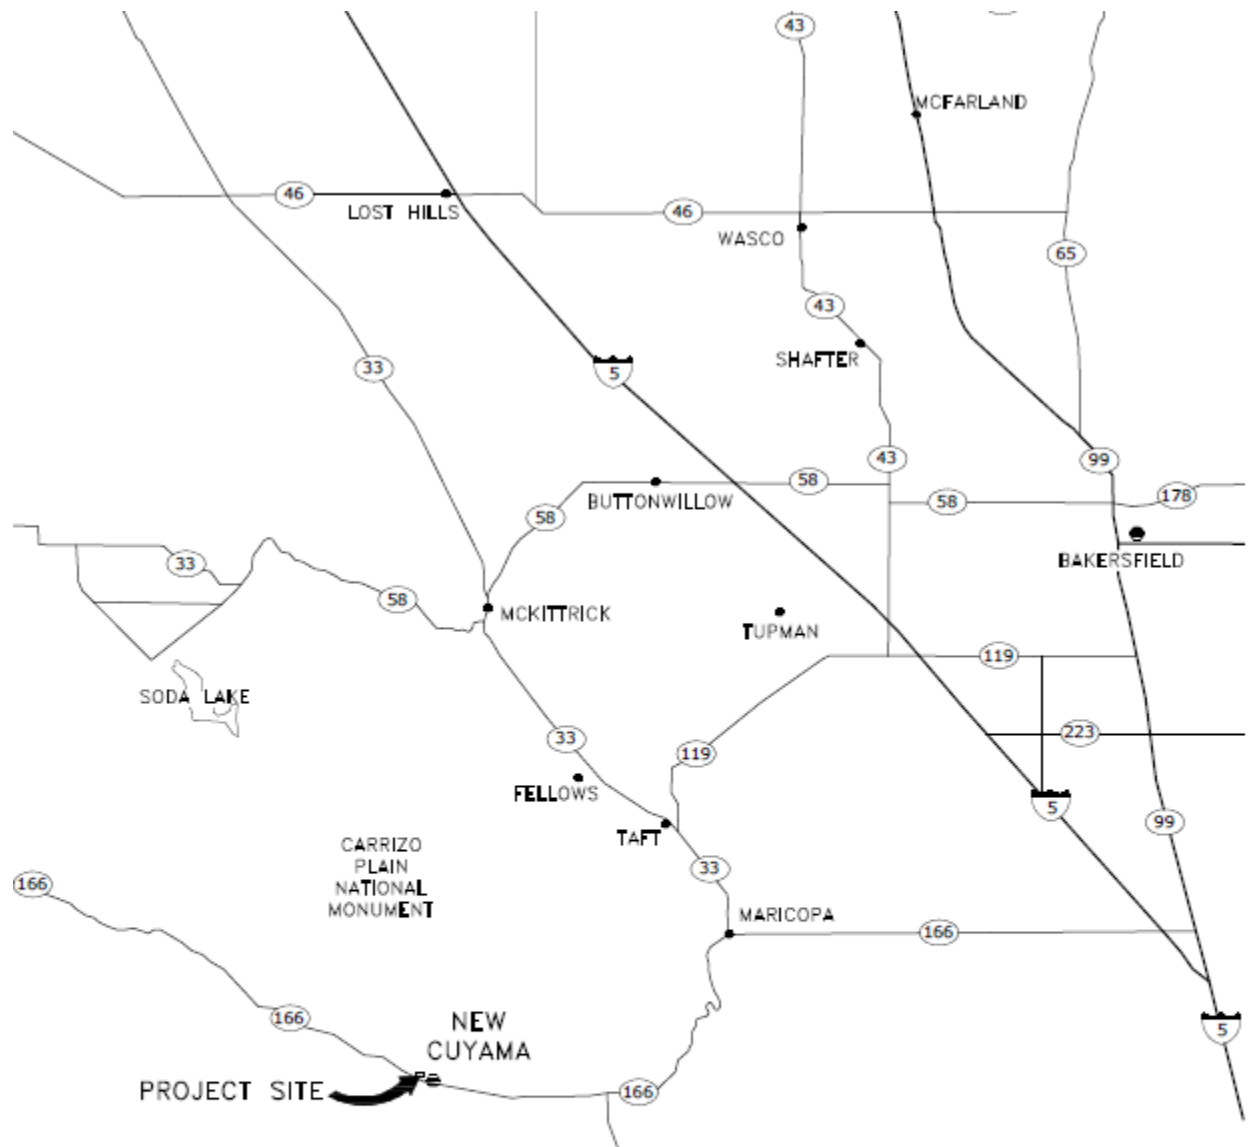


FIGURE 1

CUYAMA COMMUNITY SERVICES DISTRICT

TITLE 22 ENGINEERING REPORT

VICINITY MAP

N | V | 5



Attachment B

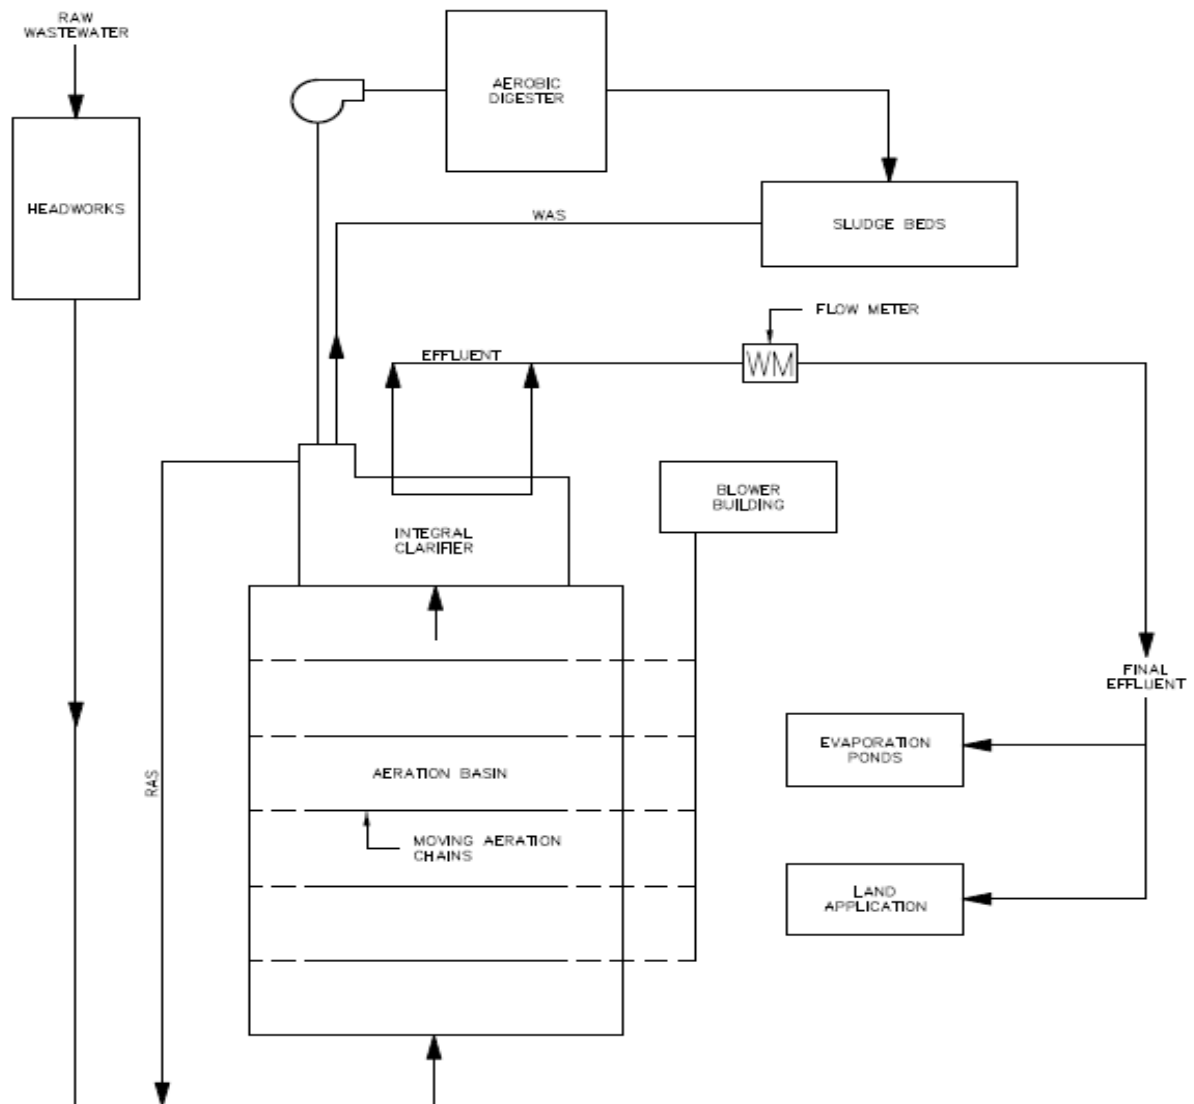


FIGURE 9


CUYAMA COMMUNITY SERVICES DISTRICT

TITLE 22 ENGINEERING REPORT

PROCESS FLOW DIAGRAM

N|V|5

Attachment C

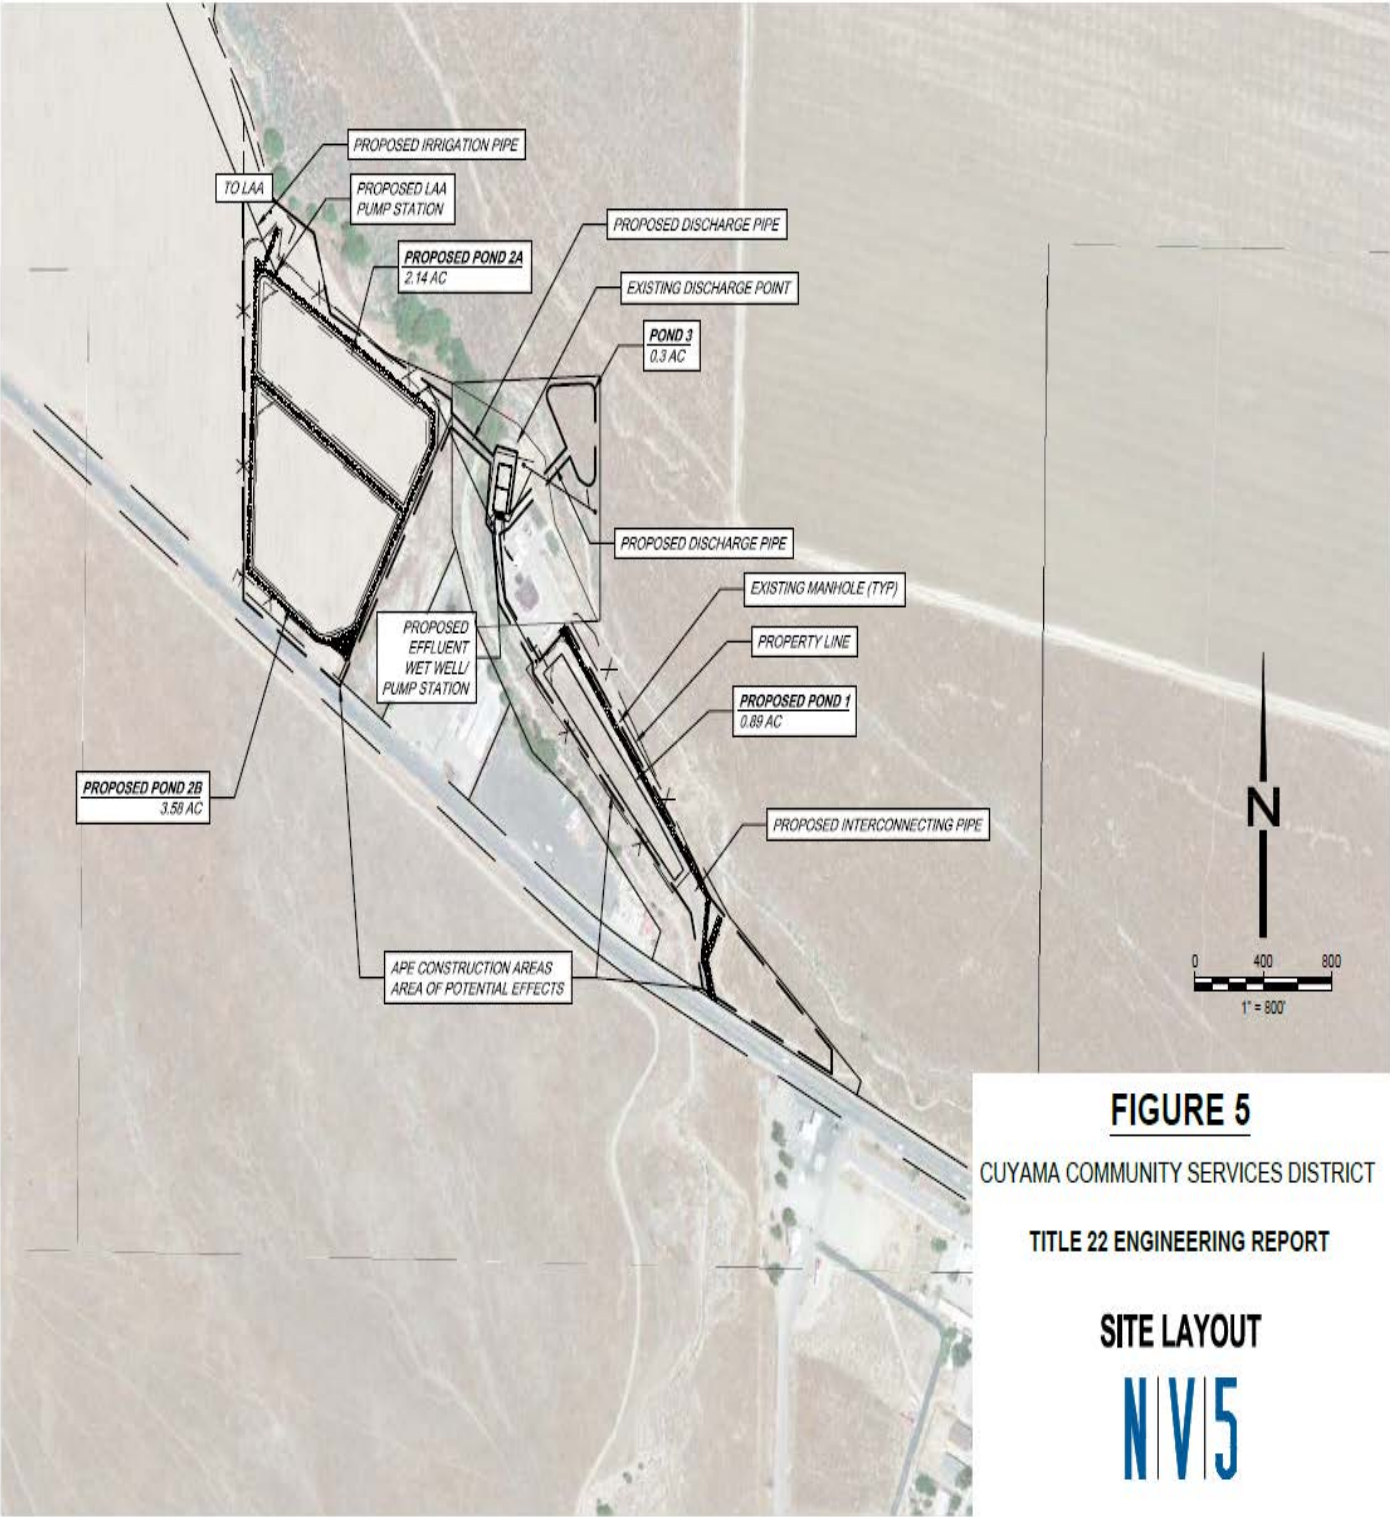

Transmittal Sheet Template

Date:

California Regional Water Quality Control Board
Central Coast Region
Attn: Monitoring and Reporting Review Section
895 Aerovista Place, Suite 101
San Luis Obispo, CA 93401

Facility Name:

Address:

Contact Person:

Job Title:

Phone Number:

WDR/NPDES Order Number:

WDID Number:

Type of Report (circle one):

Monthly

Quarterly

Semi-Annual

Annual

Month(s) (circle applicable months*): JAN FEB MAR APR MAY JUN

JUL AUG SEP OCT NOV DEC

*Annual Reports (circle the first month of the reporting period)

Year:

Violation(s) (Place an X by the appropriate choice):

___ No (there are no violations to report) ___ Yes

If Yes is marked (complete a-g):

a) Parameter(s) in Violation:

b) Section(s) of WDR/NPDES

Violated:

c) Reported Value (s)

d) WDR/NPDES
Limit/Condition:

e) Dates of Violation(s)
(reference page of report/data sheet):

f) Explanation of Cause(s):
(attach additional information
as needed)

g) Corrective Action(s):
(attach additional information
as needed)

In accordance with the Standard Provisions and Reporting Requirements, I certify under penalty of law that this document and all attachments were prepared under my direction or supervision following a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my knowledge of the person(s) who manage the system, or those directly responsible for data gathering, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment.

If you have any questions or require additional information, please contact me at the number provided above.

Sincerely,

Name:

Title: