



Central Coast Regional Water Quality Control Board

December 8, 2025

Sent Via Electronic Mail

Matthew McElhenie, General Manager
Cambria Community Services District
PO Box 65
2150 Main Street, #1-A
Cambria, CA 93428
e-mail: mmcelhenie@cambriacsd.org

Dear Matthew McElhenie:

CAMBRIA COMMUNITY SERVICES DISTRICT WASTEWATER TREATMENT PLANT, 5500 HEATH LANE, CAMBRIA, SAN LUIS OBISPO COUNTY:

- **NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY;**
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM R3-2025-0007; AND**
- **TERMINATION OF INDIVIDUAL PERMIT, WASTE DISCHARGE REQUIREMENTS ORDER 01-100, MODIFIED NOVEMBER 14, 2014, FOR CAMBRIA COMMUNITY SERVICES DISTRICT WASTEWATER TREATMENT PLANT.**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the April 4, 2024, notice of intent and available documents associated with Cambria Community Service District's domestic wastewater treatment facility (Wastewater System) located at 5500 Heath Lane in Cambria, California. The Wastewater System, owned by Cambria Community Service District, is currently regulated pursuant to *Waste Discharge Requirements Order 01-100, Modified November 14, 2014, for Cambria Community Services District Wastewater Treatment Plant, San Luis Obispo County* (Order 01-100).

On September 25, 2020, the Central Coast Water Board adopted *General Waste Discharge Requirements Order R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

JANE GRAY, CHAIR | RYAN E. LODGE, EXECUTIVE OFFICER

This letter serves as a notice of applicability for enrollment in the General Permit. This letter includes: wastewater system operation summary, specific requirements, and limitations (Attachment 1); figures (Attachment 2); and Cambria Community Service District's monitoring and reporting program requirements (Attachment 3).

This letter also serves as a notice of termination of Cambria Community Service District's coverage in existing individual permit, Order 01-100.

Cambria Community Service District must comply with the following:

1. **General Permit** – Cambria Community Service District must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf

2. **Monitoring and Reporting Program** – Cambria Community Service District must comply with the requirements of the monitoring and reporting program enclosed with this letter (monitoring and reporting program R3-2025-0007, Attachment 3). Cambria Community Service District must start implementing the new monitoring and reporting on **January 1, 2026**. Cambria Community Service District must continue to monitor and report pursuant to existing monitoring and reporting program 01-100 (revised on June 27, 2016) until January 1, 2026. The new monitoring and reporting program will change from monthly reports to quarterly reports. The initial quarterly monitoring report is due **May 1, 2026** and the first annual report for the new monitoring program is due **March 1, 2027**. The monthly report for November 2025 is due on December 30, 2025. The monthly report for December 2025 is due on January 30, 2026. The last annual report for the previous monitoring program is due January 30, 2026.

Cambria Community Service District is also required to comply with annual volumetric reporting requirements¹ established by the State Water Resources Control Board (State Water Board), due annually to the GeoTracker database on April 30th.

Quarterly monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

¹ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

The transmittal sheet describes who can sign reports. To authorize someone to sign and submit reports on your behalf, you must submit the “designation of duly authorized representatives form” found at the link below to the Central Coast Water Board.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/

All annual reports must be formatted and completed as specified in the annual report template found at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

Cambria Community Service District must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board’s GeoTracker^{2,3} database with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System – specific global identification number **WDR100029268** over the internet at:

<https://geotracker.waterboards.ca.gov/esi/login.asp>

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements. The Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

3. **Fees** – Cambria Community Service District was billed for their annual fee of \$28,205 on November 19, 2025 for coverage in existing individual permit, Order 01-100. This invoice covers Cambria Community Service District ‘s enrollment in the General Permit for the 2025-2026 fiscal year.

Cambria Community Service District must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board’s fee program and cover the state fiscal year of July 1 through June 30. Cambria Community Service District’s Wastewater System is currently assigned a threat and complexity rating of 2B. A copy of the current state fee schedule is available electronically at the following link:

² Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/

³ Additional information available at: <http://geotracker.waterboards.ca.gov/>

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of Cambria Community Service District's enrollment at a regularly scheduled public meeting on February 26-27, 2026. Details about that meeting are available on our website at:

https://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to California Water Code section 13260, Cambria Community Service District must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, Cambria Community Service District must notify the Central Coast Water Board immediately of such changes.

Attachment 1 contains the Central Coast Water Board's understanding of the Wastewater System located at 5500 Heath Lane, Cambria, California 93428. Please review Attachment 1 to determine if the description is representative of your current system. Pursuant to California Water Code section 13267, Cambria Community Service District must notify the Central Coast Water Board if this information is out of date or incorrect. You are required to provide staff with your updated information within **30 days** of issuance of this letter.

6. **Responsible Party** – Cambria Community Service District is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code, and subjects Cambria Community Service District to enforcement action, and termination of enrollment under this General Permit.
7. **Change in Ownership** - In the event of any change in control or ownership of the property, Cambria Community Service District must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board so that the new owner or operator can be enrolled in the General Permit and Cambria Community Service District's enrollment in the General Permit can be terminated.
8. **Certified Operator** – Cambria Community Service District is required to comply with the operator certification requirements⁴ administered by the State Water Board's Office of Operator Certification, which currently requires a Grade III certified operator onsite to maintain and operate the Wastewater System.

⁴ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

9. Disposal Area - Discharge to areas other than the designated disposal areas shown in Figure 3 and Figure 4 of Attachment 2 is prohibited.

10. Termination of Permit – The existing individual permit, Order 01-100 is terminated, except for enforcement purposes.⁵ Cambria Community Service District is responsible for compliance with Order 01-100 prior to the date of this letter.

If you have any questions, please contact **Cecile Blancarte at (805) 542-4782 or by email at cecile.blancarte@waterboards.ca.gov** or Jennifer Epp at (805) 594-6181 or by email at jennifer.epp@waterboards.ca.gov.

Sincerely,

Jennifer Epp
Digitally signed by Jennifer Epp
Date: 2025.12.08 11:14:01
-08'00'
Water Boards

for Ryan E. Lodge
Executive Officer

Attachments:

Attachment 1. Wastewater System Operation Summary, Specific Requirements, and Limitations

Attachment 2. Figures

Attachment 3. Monitoring and Reporting Program R3-2025-0007

cc:

Antoni Artho, tartho@cambriacsd.org

James Green, jgreen@cambriacsd.org

Tristan Reaper, treaper@cambriacsd.org

Office of Operator Certification, wwopcertprogram@waterboards.ca.gov

Jennifer Epp, jennifer.epp@waterboards.ca.gov

Todd Stanley, todd.stanley@waterboards.ca.gov

Julie Advanto, julie.avanto@waterboards.ca.gov

Cecile Blancarte, cecile.blancarte@waterboards.ca.gov

WDR Program, GeoTracker rb3-wdr@waterboards.ca.gov

ECM/CIWQS = CW-212858

GeoTracker = GT- WDR100029268

Rev 3/15/24

ECM Subject Name = Cambria Community Service District Wastewater Treatment Plant NOA for R3-2020-0020

⁵ The General Permit states "... where a Wastewater System discharge is currently regulated by an individual permit, that permit is terminated upon the enrollment of the Wastewater System into this General Permit."

r:\rb3\shared\wdr\wdr facilities\san luis obispo co\cambria csd\wwtp\1- permit\transition to r3-2020-0020
application\wdr mrp\cambria csd 2020-0020 noa_final.docx

ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY, SPECIFIC REQUIREMENTS,
AND LIMITATIONS

1. Ownership and Wastewater System Information

Ownership and wastewater system information submitted by Cambria Community Service District to the Central Coast Water Board is shown in Table 1.

Table 1. Ownership and Wastewater System Information

Name	Cambria Community Service District Wastewater Treatment Plant
Physical Address	5500 Heath Lane Cambria, California 93428
Latitude	Facility: 35.567134 Disposal Ponds: 35.597279
Longitude	Facility: -121.103147 Disposal Ponds: -121.117151
Mailing Address	PO Box 65 Cambria, CA 93428
Owner	Cambria Community Service District
Operator	Antoni Artho phone: (805) 927-6621 e-mail: tartho@cambriacsd.org
Legally Responsible Official	Matthew McElhenie phone: (805) 927-6230 e-mail: mmcelhenie@cambriacsd.org
Billing Contact	Cambria Community Services District – Accounts Payable PO Box 65 Cambria, CA 93428 (805) 927-6223 accountspayable@cambriacsd.org
Service Area	Sewer Connections: 3903 Population Served: 6100 Domestic (%): 100% Industrial (%): 0%
Permitted Design Flow, Average Monthly (gallons per day, gpd)	990,000
Baseline Flow (average monthly flow) in gpd	483,000
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58

Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR
Reclamation Included	No
EPA Approved Pretreatment Program	No

2. Nearby Waterbodies, Groundwater, and Ocean Waters

A. Waters of the United States

San Simeon Creek and Van Gordon Creek are considered waters of the United States^{6 7 8} and are navigable. Van Gordon Creek runs parallel (approximately 175-feet at nearest point) to the northwest edge of the Cambria Community Service District Wastewater Treatment Plant's disposal ponds. San Simeon Creek runs parallel (approximately 175-feet at the nearest point) to the southeastern edge of the disposal ponds. Van Gordon Creek is tributary to the San Simeon Creek. San Simeon Creek empties out into the Pacific Ocean approximately 2,000 feet west of the disposal ponds. There is a nutrient Total Maximum Daily Load for these surface water bodies as presented here:

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/tmdl/docs/san_simeon_nitrate/index.html

B. Groundwater

The Cambria Community Service District's wastewater disposal ponds overlie the Estero Bay – San Simeon groundwater sub-basin as defined by the California Department of Water Resources Bulletin 118 or the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).⁹ Past subsurface investigations within

⁶ WATERS GeoViewer 2.0,
<https://epa.maps.arcgis.com/apps/webappviewer/index.html?id=074cfede236341b6a1e03779c2bd0692>

⁷ Navigable Waters – US Army Corps of Engineers Los Angeles District,
<https://www.spl.usace.army.mil/Missions/Regulatory/Jurisdictional-Determination/Navigable-Waterways/>

⁸ Van Gordon Creek is a tributary to San Simeon Creek. Pursuant to 40 CFR 120.2(a)(3), tributaries of waters identified as navigable waters are also a water of the US.
<https://www.ecfr.gov/current/title-40/chapter-I/subchapter-D/part-120/section-120.2>

⁹ Current edition, June 2019 is available at:

https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete_webaccess.pdf

the disposal pond area state the area is underlain with a sandy loam soil sand clay profile to a depth of 10-feet below grade surface. Encountered groundwater to between 7 to 14 feet below grade surface.

C. Pacific Ocean

The Pacific Ocean is approximately 2,000-feet west of the Cambria Community Service District's wastewater disposal ponds.

3. Wastewater System Operation Summary

Cambria Community Service District Wastewater Treatment Plant (Wastewater System) is a Class III wastewater system. Cambria Community Service District must staff a Grade III chief plant operator for proper operation of the Wastewater System. The current chief plant operator is Antoni Artho, Grade III, License Number 43448.

The Wastewater System can treat 990,000 gpd to a secondary treatment level. In 2014, the original activated sludge treatment unit was temporarily converted to a Modified Ludzack-Ettinger (MLE) process with the installation of temporary piping and pumps to internally return activated sludge (RAS) from the clarifiers, located after the aerobic zone treatment. In 2025, the MLE went through extensive upgrades to make the system components permanent. Upgrades included the installation of an equalization basin, piping, SCADA system, and new variable frequency drive (VFD) controlled pumps, mixers, and blowers. The upgrades made to the MLE will provide better control for treatment processes, with the new influent equalization system balancing influent fluctuating flows and tapering the maximum flow requirements for the downstream aeration basin treatment processes. The MLE is in operation and is the wastewater treatment method authorized by this notice of applicability. **Cambria Community Services District is required to submit a report of waste discharge for approval by the Central Coast Water Board 120-days prior to any changes to the wastewater system configuration authorized by this notice of applicability.** The Wastewater System consists of the treatment technologies and treatment capabilities shown in Table 2.

Table 2. Treatment Technology and Capacity

Headworks/Preliminary Treatment	Raw wastewater is pumped to a screw screen (3/8" mesh) that removes the rags and debris. It then flows to an aerated grit chamber. New grit chamber blowers were installed in 2025. A grit pump removes the grit from the grit chamber and pumps it into a cyclone separator, which de-waters the grit and deposits it into a dumpster for disposal at a landfill. Following the grit chamber, the wastewater flows into a new flow equalization basin that has a maximum operating volume of 167,752 gallons. New VFD blowers and pumps treat and pump wastewater from the equalization basin into the distribution pipes. Headworks capacity (gpd): 990,000
Secondary Treatment	Wastewater enters the secondary treatment train and is metered via VFD pumps from the equalization basin to the splitter box. RAS from the secondary clarifiers is mixed with wastewater in the splitter box, which then enters the anoxic zone of the activated sludge treatment train. The splitter box splits the flow equally between the two activated sludge treatment trains. Each activated sludge treatment train consists of a 96,954-gallon anoxic zone separated by a baffle from a 355,497-gallon aeration basin. The average wastewater contact time in the anoxic zone is 9.6 hours. Following the anoxic zone, wastewater moves past the baffle into the aeration basin, where it has an average contact time of 35.3 hours. Wastewater then flows from the aeration basin to the secondary clarifiers. The sludge floc settles out in the secondary clarifiers and is moved towards the RAS pits by flights (a.k.a. scrapers, plows). The retention time of the clarifiers is approximately 5.4 hours. Decanted clarified water flows into one of three treated flow equalization ponds (Pond 1, Pond 2, and Pond 3). Ponds 1 through 3 require a continuous minimum hydraulic head (static water column) of 9-feet to avoid structural and liner damage due to high groundwater levels in the area. Secondary treatment capacity (gpd): 990,000
Tertiary Treatment	Not Applicable
Disinfection	Not Applicable

Wastewater Disposal Method	Treated effluent is pumped to the land disposal site, which is located 2.5 miles north of the treatment plant. The treated effluent is pumped to one of three percolation ponds, Pond A, Pond B, and Pond C. There is a Pond D, but its use is not currently authorized due to an adjacent downgradient private water supply well. The use of each pond is on a rotational basis to ensure proper resting in between use and to provide time for pond maintenance. Ponds A, B, and C each have an approximate wetted area of 3 acres and are no more than 5-feet in depth. Percolation tests performed for the design of the ponds found rates of 1 to 948 inches per day. There will be some reduction in pond water percolation rate due to soil clogging. As a result, the pond design is based on conservative percolation rates ranging from 5-10 inches per day for each individual pond. Engineering documents state 2 inches per day of percolation can process up to 0.5 million gallons per day (mgd). Therefore, the daily percolation capacity for each disposal field is between 1.25 – 2.5 mgd. Disposal capacity (mgd): 1.25 – 2.5 per disposal pond
Biosolids/Sludge Production and Handling	Waste activated sludge is wasted into one of two sludge thickening tanks each with a capacity of 98,337 gallons. Thickened sludge is then sent to an aerobic digester before it is pumped to the solids handling system. The solids handling system consists of a polymer mixing skid where polymer is mixed with water, a floc tank where the polymer-water mixture is mixed with the sludge to create flocs, and a screw press for de-watering the flocked sludge. The de-watered sludge is fed into a 40-foot-long dump trailer for hauling to the composting facility. Annual production of biosolids: 1,056 tons Biosolids are hauled away by Synagro West LLC to the Liberty Composting Facility located at 12421 Holloway Road, Lost Hills, California

A summary of historic and recent average effluent and groundwater constituent concentrations are included in Tables 3 and 4, which were reported in Cambria Community Service District's annual monitoring reports. The Central Coast Water Board used reported effluent and groundwater water quality data to establish the effluent and groundwater limitations presented in section 4.

Table 3. Historic and 2024 Effluent Water Quality for Select Constituents

Constituents	Units ^[1]	Historical Average ^[2]	2024 Annual Average ^[3]
Biochemical Oxygen Demand, 5-Day	mg/L	5.6	3.9
Total Suspended Solids	mg/L	6.5	5.7
Total Dissolved Solids	mg/L	986	1,007
Sodium	mg/L	202	196
Total Nitrogen	mg/L	5.1	7.2
Nitrate as Nitrogen	mg/L	3.0	4.7
Boron ^[4]	mg/L	No Data	0.35

[1] mg/L denotes milligrams per liter

[2] Based on water quality data reported by Cambria Community Service District in their 2016 to 2023 annual monitoring reports.

[3] Based on water quality data reported by Cambria Community Service District in the 2024 Annual Monitoring Report.

[4] Boron sampling was not required as part of the previous permit. Results are based on a single sample collected in 2024.

Table 4. 2016 through 2024 Downgradient Groundwater Quality and Median Value for Select Constituents in Monitoring Wells 16D1 and MW-4

Date	Well 16D1 TDS (mg/L)	Well MW-4 TDS (mg/L)	Well 16D1 Chloride (mg/L)	Well MW-4 Chloride (mg/L)
Jan-2016	620	1200	110	370
Feb-2016	710	1400	150	590
Sep-2016	830	720	210	150
Oct-2016	540	720	96	140
Nov-2016	360	750	22	150
Dec-2016	380	740	29	130
Jan-2017	680	520	140	62
Feb-2017	400	480	27	44
Mar-2017	640	500	110	47
Apr-2017	660	1200	100	61
May-2017	670	620	95	63
Jun-2017	640	660	98	77
Jul-2017	620	680	93	82
Aug-2017	640	640	89	74
Sep-2017	890	1300	190	350
Nov-2017	590	540	76	61
Dec-2017	560	530	72	62
Jan-2018	570	530	68	63
Feb-2018	610	560	74	69
Mar-2018	540	550	68	73
Apr-2018	550	630	71	89
May-2018	540	650	72	90
Jun-2018	560	660	77	96

Date	Well 16D1 TDS (mg/L)	Well MW-4 TDS (mg/L)	Well 16D1 Chloride (mg/L)	Well MW-4 Chloride (mg/L)
Apr-2024	370	630	74	46
Oct-2024	650	650	73	84
Median	610	640	77	77

4. Wastewater System Specific Requirements and Limitations

Cambria Community Service District must operate the Wastewater System in accordance with the General Permit and this notice of applicability. Cambria Community Service District must comply with the wastewater specific limitations specified in Table 5 through Table 9.

A. Flow Limitations

Table 5. Flow Limitations

Flow	Units	Limit	Point of Compliance
Average Monthly Dry Weather ^[1]	gpd	990,000	Influent
Instantaneous Maximum Daily Wet Weather ^[2]	gpd	2,500,000	Influent
Average Monthly Effluent (to disposal area)	gpd	2,500,000	Effluent

[1] Average Monthly Dry Weather (May through October) to be calculated by the total discharge to the headworks by volume during a calendar month divided by the number of days in the month that the wastewater system headworks received flow.

[2] Wet Weather is November through April

B. Effluent Limitations

Table 6. Effluent Limitations: Activated Sludge at ES-1

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Biochemical Oxygen Demand, 5-Day	mg/L	30 and average percent removal must not be less than 85 percent [2][3]	45 ^{[2][3]}	Not Applicable
Total Suspended Solids	mg/L	30 and average percent removal must not be less than 85 percent [2][3]	45 ^{[2][3]}	Not Applicable
Settleable Solids	mL/L ^[1]	0.1	0.3	0.5

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
pH	Standard Units	between 6.5 and 8.4	Not Applicable	Not Applicable

[1] mL/L denotes milliliters per liter

[2] USEPA Office of Wastewater Management, Water Permits Division, State and Regional Branch, EPA 833-K-10-001, September 2010.

[3] USEPA, Code of Federal Regulations, title 40, part 133.102, Secondary Treatment Standards, Technology-Based Effluent Limits.

**Table 7. Effluent Limitations at ES-1
Based on Non-Designated Groundwater Basins**

Constituents	Units	25-Month Rolling Median	Sample Maximum
Sulfate	mg/L	250	500
Boron	mg/L	0.5	Not Applicable
Sodium	mg/L	250	Not Applicable
Total Nitrogen	mg/L	10	Not Applicable

C. Groundwater Limitations

Based on review of past effluent water quality (see Table 3), Cambria Community Service District is unable to consistently comply with the General Permit effluent limitations for TDS and it is uncertain if they can comply with chloride effluent limits at the point of discharge. Therefore, groundwater monitoring for TDS and chloride will be used to demonstrate compliance.

Through groundwater monitoring, Cambria Community Service District must demonstrate that the discharge does not cause underlying groundwater to exceed the water quality objectives set forth in the Basin Plan including the limitations listed in Table 8. Compliance with groundwater monitoring limits will be determined by downgradient monitoring wells 16D1 and MW-4 (Figure 3).

Table 8. Groundwater Limitations for Non-Designated Groundwater Basins

Constituents	Units	25-Month Rolling Median	Sample Maximum
Total Dissolved Solids	mg/L	500	1000
Chloride	mg/L	250	500

D. Groundwater Elevation Requirements

Cambria Community Services District must manage wastewater disposal and groundwater pumping such that static ground water levels at well No. 9P7 are equal to or less than those at production well No. SS4 at all times¹⁰. This is to ensure wastewater that has percolated to groundwater at the percolation ponds does not flow

¹⁰ This requirement is unchanged from Order No. 01-100.

east towards the Cambria Community Services District potable water supply well field. Specifics of the monitoring are detailed in the Groundwater Monitoring section of Monitoring and Reporting Program R3-2025-0007.

Table 9. Groundwater Elevation Limitations

Groundwater Monitoring Well	Groundwater Elevation Limitations
9P7	No. 9P7 equal to No. SS4 or No. 9P7 less than No. SS4

E. Disposal Pond Requirements

Cambria Community Services District must monitor and maintain the Wastewater System disposal pond's structural integrity and permitted disposal capacity. This is to ensure continued wastewater percolation as designed and prevent disposal pond failures. Following are the minimum maintenance requirements for the Wastewater System disposal ponds.

- Sludge and sediment removal must occur annually or whenever sludge and sediment reduce the disposal pond's original design capacity by more than 25%.
- Aquatic weed and vegetation removal in and around the disposal ponds must occur annually, to maintain original disposal pond design capacity and prevent the creation of wildlife habitats.
- Outfalls to the disposal ponds must not be clogged from debris or sediment build-up.
- The discharge of periodic extracted groundwater that is treated through Cambria CSD's advanced water treatment plant is permitted to be discharged to the disposal ponds. This discharge is enrolled under the Central Coast Water Board General Waiver for Specific Types of Discharges Order¹¹.

5. National Alliance for Water Innovation (NAWI) Pilot Program – Reverse Osmosis Brine Liquid Reduction from Cambria Community Services District Water Reclamation Facility

The U.S. Department of Energy (DOE) announced \$5M in funding for 11 NAWI pilot projects, including a zero liquid discharge pilot at the Cambria Community Services District's Water Reclamation Facility. This pilot project will evaluate the effectiveness of the NAWI process to maximize liquid removal from reverse osmosis brine produced at the Cambria Community Services District Water Reclamation Facility. The Water Reclamation Facility is located adjacent to the Wastewater System's disposal ponds and is regulated by Waste Discharge Requirements and Water Recycling Requirements Order R3-2019-0051. The intent of this pilot project is to reduce the volume of liquid

¹¹ Cambria CSD Advanced Water Treatment Plant General Waiver NOA
<https://geotracker.waterboards.ca.gov/?surl=y1euY>

waste (reverse osmosis brine) produced at the Water Reclamation Facility that requires off-site disposal at an authorized brine disposal facility.

The NAWI pilot project will run for 5 to 30 days, depending upon how long it takes for the NAWI pilot project team to analyze and resolve any operational issues. It will produce two waste streams, a highly concentrated brine that will have a TDS concentration of approximately 300,000 mg/L, and a permeate that is expected to have a TDS concentration of approximately 160 mg/L. Permeate from the NAWI pilot project will be discharged to either Pond A, B, or C at the Wastewater System. The concentrated brine from the NAWI pilot project will be hauled and disposed of at the Kettleman City landfill or similarly regulated landfill. This notice of applicability authorizes the disposal of NAWI pilot project permeate into the Wastewater System ponds.

Chemical of concern: The NAWI pilot project requires the use of the solvent dimethyl ether along with reverse osmosis and forward osmosis membranes to remove salts and other dissolved constituents contained in the reverse osmosis concentrate produced at the Water Reclamation Facility. Dimethyl ether, a polar aprotic solvent, can potentially leach to groundwater due to its high mobility in soil and its partial miscibility with water. While it's not expected to significantly absorb to sediment or bioconcentrate in aquatic organisms, its properties make it a potential groundwater contaminant.¹² Chemical details, as presented by the US Environmental Protection Agency (USEPA) on dimethyl ether report that it is highly flammable and needs to be handled with care.¹³ Additionally, the USEPA reports that dimethyl ether is not classified as dangerous for the environment or a human carcinogen. There is no drinking water maximum contaminant level for dimethyl ether.

Requirements for discharge of the permeate produced by the project are as follows:

- a) The permeate must be discharged to the same percolation pond (e.g., either pond A, B, or C) that is receiving treated wastewater effluent from the Cambria Community Service District's Wastewater System.
- b) All permeate produced by the project must be captured in tanks. Cambria Community Service District must receive approval from the Central Coast Water Board before discharging the permeate to the percolation ponds. Central Coast Water Board approval is subject to review of the water quality monitoring data required by the Wastewater System's monitoring and reporting program

¹² Gerald L. Kennedy, Dimethyl Ether, Editor(s): Philip Wexler, Encyclopedia of Toxicology (Second Edition), Elsevier, 2005,



Pages 49-51, <https://www.sciencedirect.com/science/article/abs/pii/B012369400000613X>

¹³ USEPA Chemical Details: <https://comptox.epa.gov/dashboard/chemical/executive-summary/DTXSID8026937>

R3-2025-0007.

- c) Monitoring of the permeate must occur in accordance with the Wastewater System's monitoring and reporting program R3-2025-0007, which will require analysis of the NAWI pilot project permeate effluent for TDS, chloride, pH, boron, and volatile organic carbons.
- d) The pilot project will last no more than 30 days without receiving approval for an extension from the Central Coast Water Board.
- e) The requirement to obtain approval before discharging permeate may be modified or removed by the Central Coast Water Board if the results of monitoring demonstrate that the permeate poses no threat to groundwater quality or beneficial uses.
- f) The discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of the Basin Plan water quality objectives. Specifically, Cambria Community Service District must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the Basin Plan. These objectives include:
 - 1. General objectives for taste and odors and radioactivity for all groundwaters.
 - 2. Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15.

ATTACHMENT 2 FIGURES

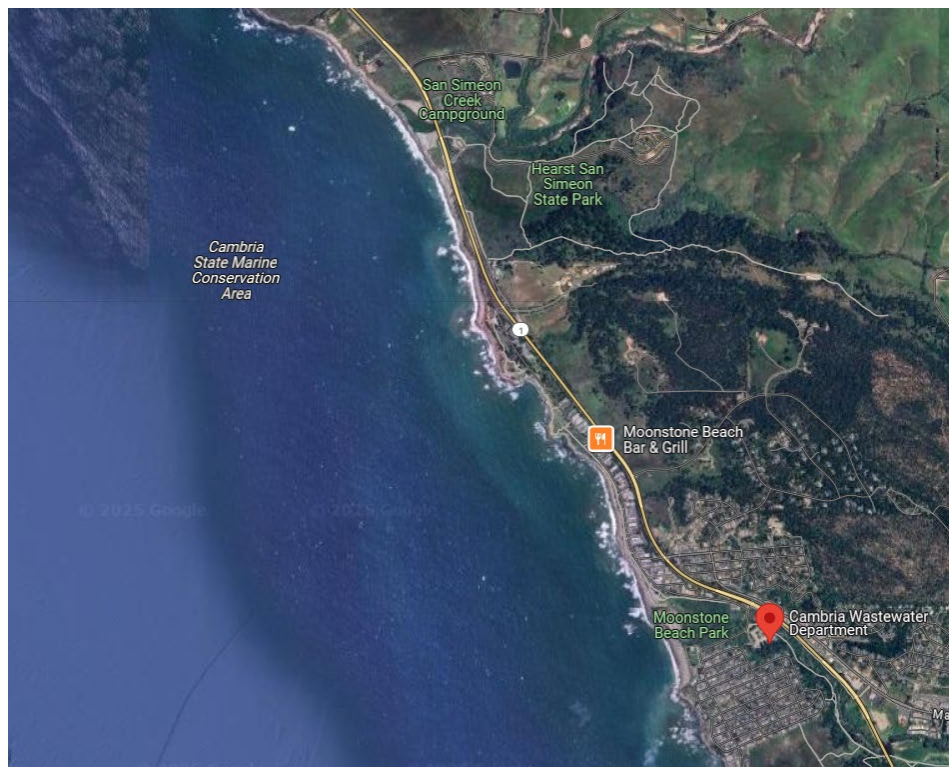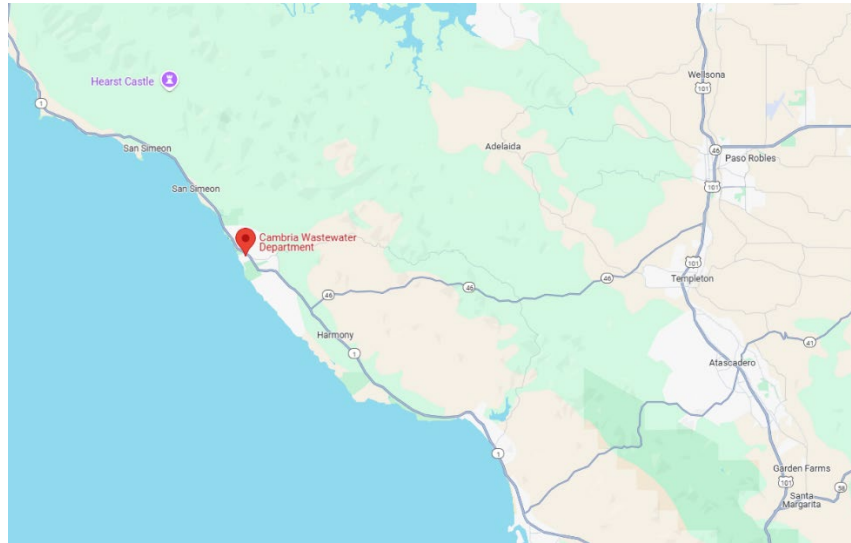

Figures 1a and 1b. Vicinity Maps





Figure 3. Disposal area (shaded in blue), groundwater monitoring wells, and former brine disposal pond.



Figure 4. Percolation ponds A, B, and C and Water Reclamation Facility. Black shaded area of pond D is not authorized for disposal due to nearby water supply well.



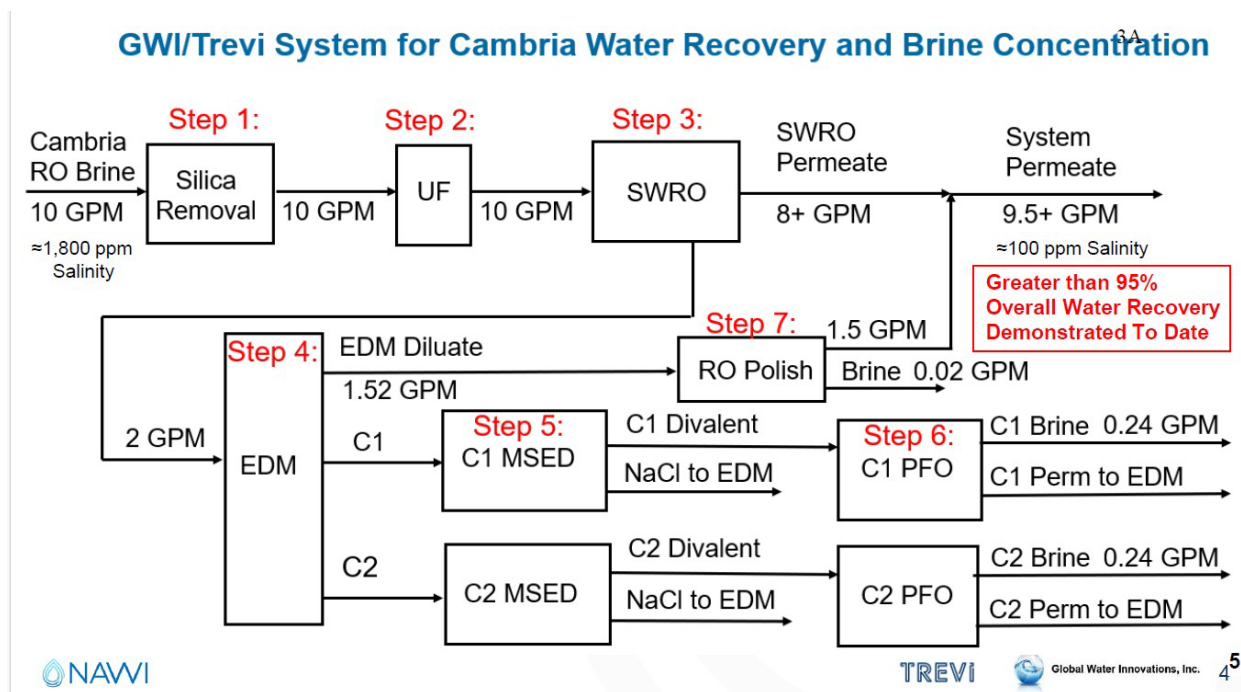


Figure 6. NAWI Pilot Project Process Flow Diagram

**ATTACHMENT 3
MONITORING AND REPORTING PROGRAM**

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

**MONITORING AND REPORTING PROGRAM R3-2025-0007
DECEMBER 8, 2025**

**FOR
CAMBRIA COMMUNITY SERVICE DISTRICT WASTEWATER TREATMENT PLANT
CAMBRIA, SAN LUIS OBISPO COUNTY**

This Monitoring and Reporting Program contains monitoring and reporting requirements for Cambria Community Service District Wastewater Treatment Plant (Wastewater System) enrolled in *General Waste Discharge Requirements Order R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

Cambria Community Service District owns and operates the Wastewater System that is subject to the General Permit and notice of applicability.

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The monitoring and reporting program directs Cambria Community Service District to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board's GeoTracker database (see monitoring and reporting program section 9).

1. SAMPLING AND ANALYSIS

Cambria Community Service District must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Regional Water Quality Control Board (Central Coast Water Board). All samples (e.g., wastewater, groundwater, soil, sludge) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must

also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the Operations and Maintenance Manual for Central Coast Water Board review and approval.

A. Sampling Schedule

Unless otherwise specified below, sampling must be performed in accordance with Table 1.

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Monthly	Each month of the year
Quarterly	January, April, July, and October
Semiannually	April and October
Annually	October

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

- i. The user is trained in proper use and maintenance of the instruments;
- ii. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
- iii. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
- iv. Field calibration reports are maintained and available for at least three years.

B. Monitoring Location Descriptions

All samples including influent samples (IS), effluent samples (ES), and groundwater monitoring wells (MW) must be collected at the locations described in Table 2 and shown in Figures A1 and A2. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. Effluent samples include samples from the treated wastewater and from the National Alliance for Water Innovation (NAWI) pilot project permeate. **Cambria Community Service District must upload the GeoTracker field point information for each sampling location in the GeoTracker database once, prior to uploading laboratory data (see Table 11).**

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Influent Sample	IS-1	Raw wastewater sample collected at the influent wet well and pump station
Effluent Sample	ES-1	Treated wastewater sample collected from the effluent wet well after effluent storage ponds
Effluent Sample	ES-2	NAWI pilot project permeate sample collected after treatment and before sending to temporary holding tanks.
Monitoring Well	SS3	Monitoring well SS3 located north-east of disposal area off San Simeon-Monterey Creek Rd (Latitude: 35.6011875°, Longitude: -121.1108156°)
Monitoring Well	SS4	Monitoring well SS4 located north-east of disposal area off Washburn Campground Rd adjacent to San Simeon Creek (Latitude: 35.5983848°, Longitude: -121.1143492°)
Monitoring Well	9P7	Monitoring well 9P7 located in disposal area between percolation ponds B, C, and D (Latitude: 35.5970721°, Longitude: -121.1170154°)
Monitoring Well	(MW-4)	Monitoring well MW-4 located southwest of disposal area off Wan Gordon Creek Rd adjacent to Van Gordon Creek (Latitude: 35.5960610°, Longitude: -121.1215432°)
Monitoring Well	16D1	Monitoring well approximately 150 feet west of well MW-4.

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Monitoring Well	9N2	Monitoring well 9N2 located west of disposal area off Van Gordon Creek Rd (Latitude: 35.5960610°, Longitude: - 121.1215432°)
Water Supply Well	WSW-1 ^[1]	Representative sample of potable source water to wastewater customers

^[1] Water supply sample data should be included in the annual report but does not need to be uploaded to GeoTracker if the Central Coast Water Board approves submittal of a Well Identification Number pursuant to the Water Supply Monitoring section below.

2. WATER SUPPLY MONITORING

Representative samples of the town of Cambria's raw water supply served to wastewater customers of the Cambria Community Services District (sampled before use or treatment) must be collected and analyzed, at a minimum, for constituents specified in Table 3.

In lieu of the required water supply sampling, Cambria Community Service District may request Central Coast Water Board approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county, provided, at a minimum, all of the required constituents are sampled at the frequency specified in Table 3. Cambria Community Service District must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 3. Cambria Community Service District must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Cambria Community Service District must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring

Constituent	Units^[1]	Sample Type	Sampling Frequency
Nitrate (as N)	mg/L	Grab	Annually
Total Dissolved Solids	mg/L	Grab	Annually

Constituent	Units ^[1]	Sample Type	Sampling Frequency
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

[1] mg/L denotes milligrams per liter

3. INFLUENT AND EFFLUENT MONITORING

A. Influent and Effluent Flow Monitoring

Cambria Community Service District must monitor and report flow in gallons per day, as described in Table 4, with each monitoring report. See Reporting Requirements section for supplemental volumetric annual reporting requirements established by the State Water Board.

Table 4. Influent and Effluent Flow Monitoring

	INFLUENT (IS-1)	INFLUENT (IS-1)	EFFLUENT (ES-1)	EFFLUENT (ES-1)
Parameter	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Daily Flow	Metered	Daily	Metered	Daily
Maximum Daily Flow	Metered	Daily	Metered	Daily
Monthly Average Flow ^[1]	Calculated	Monthly	Not Applicable	Not Applicable
Percent of Permitted Monthly Average and Maximum Daily Flow ^[2]	Calculated	Monthly	Calculated	Monthly

[1] Monthly Average Flow to be calculated by the total flow by volume during a calendar month divided by the number of days in the month that the wastewater system received flow.

- [2] The General Permit notice of applicability specifies the Wastewater System's maximum permitted flow. In the monitoring reports, Cambria Community Service District must evaluate and provide a comparison of monitored flow as a percentage to the permitted flow.

B. Wastewater System Monitoring

Representative samples of Cambria Community Service District's influent (raw wastewater) into the Wastewater System and effluent (treated wastewater) discharged to land must be collected and analyzed in accordance with the treatment technology-based monitoring requirements (including sample type and frequency) summarized in the tables below. See Figures A1 and A2 for the location of samples and GeoTracker field points.



C. Wastewater Disposal Pond System Monitoring

- i. **Required Disposal Pond Monitoring** – All wastewater treatment and treated wastewater storage/disposal ponds (lined and unlined) must be monitored as specified in Table 5. Sampling for pH and dissolved oxygen must be a grab sample taken from 1 foot below pond surface.

Observations do not need to be reported in the monitoring reports unless a violation, significant change, or treatment issue is observed. Photos of the pond(s) verifying the observations must be collected annually and included in the annual report, with the date and location of the photo clearly marked. Observations must be noted in a logbook or database and made available to the Central Coast Water Board upon request. Any problems must be promptly corrected and recorded.

Table 5. Wastewater Storage/Disposal Pond Monitoring in Ponds A, B, and C

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency
Freeboard	0.1 feet	Measured	Weekly
pH	pH Units	Grab	Weekly
Dissolved Oxygen	mg/L	Grab	Monthly
Sludge Depth	0.1 feet	Measured	Annually
Percent Sludge	%	Measured	Annually
Color	Not applicable	Observation	Monthly
Vegetation in and surrounding ponds	Not Applicable	Observation	Monthly
Berm condition	Not Applicable	Observation	Monthly
Precipitation	inches/day and date	Measured ^[1]	Each precipitation event ^[2]

[1] Cambria Community Service District may use a rain gauge or use a National Oceanic and Atmospheric Administration, United States Geological Survey, or California Irrigation Management Information System weather station, such as <http://scacis.rcc-acis.org/>.

[2] A precipitation event is one producing precipitation of ½ inch or more.

D. Activated Sludge Wastewater Systems (All Other Wastewater Systems)

- i. **Influent and Effluent Monitoring** – At a minimum, influent and effluent constituent monitoring for all activated sludge, membrane biological reactor, sequencing batch reactor or similar wastewater treatment systems must be consistent with Table 6.

Table 6. Influent and Effluent Monitoring

		INFLUENT (IS-1)	INFLUENT (IS-1)	EFFLUENT (ES-1)	EFFLUENT (ES-1)
Constituent	Units	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
pH	units	Grab	Weekly	Grab	Weekly
Settleable Solids	ml/L	Not Required	Not Required	Grab	Weekly
Biochemical Oxygen Demand, 5-Day	mg/L	24-hour composite	Quarterly	Grab	Monthly
Total Suspended Solids	mg/L	24-hour composite	Quarterly	Grab	Monthly
Total Nitrogen ^[2]	mg/L	Calculated	Quarterly	Calculated	Monthly
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	24-hour composite	Quarterly	Grab	Monthly
Total Kjeldahl Nitrogen (as N)	mg/L	24-hour composite	Quarterly	Grab	Monthly
Ammonia (as N)	mg/L	24-hour composite	Quarterly	Grab	Monthly
Total Dissolved Solids	mg/L	24-hour composite	Quarterly	Grab	Monthly
Chloride	mg/L	24-hour composite	Quarterly	Grab	Monthly
Sodium	mg/L	24-hour composite	Quarterly	Grab	Monthly
Sulfate	mg/L	24-hour composite	Quarterly	Grab	Monthly
Boron	mg/L	Not Required	Not Required	Grab	Monthly
Carbonate	mg/L	Not Required	Not Required	Grab	Semiannually
Bicarbonate	mg/L	Not Required	Not Required	Grab	Semiannually
Calcium	mg/L	Not Required	Not Required	Grab	Semiannually
Potassium	mg/L	Not Required	Not Required	Grab	Semiannually

		INFLUENT (IS-1)	INFLUENT (IS-1)	EFFLUENT (ES-1)	EFFLUENT (ES-1)
Constituent	Units	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Magnesium	mg/L	Not Required	Not Required	Grab	Semiannually

[1] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

- ii. **Effluent Monitoring** – Activated sludge, membrane biological reactor, sequencing batch reactor or similar treatment systems wastewater effluent monitoring for select constituents is required if the Wastewater System receives wastewater with significant amount of oil and grease.

Types of waste streams that could contribute fats, oil, grease, phenol, formaldehyde, or zinc to a Wastewater System might include flows from oil pressing/bottling, meat processing, holding tanks (e.g., recreational vehicles, portable toilets, airplane wastewater). Effluent monitoring for select constituents shall be consistent with Table 7.

Table 7. Effluent (ES-1) Monitoring for Select Constituents for All Other Wastewater Systems

Parameter/ Constituent	Units	Sample Type	Sampling Frequency
Oil & Grease	mg/L	Grab	Monthly

4. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

Cambria Community Service District must report the handling and disposal of all sludge/biosolids generated at the Wastewater System. Records must include the date removed from the Wastewater System, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

Cambria Community Service District must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

If sludge/biosolids are not removed during the year, Cambria Community Service District must explain the absence of this monitoring in the annual report.

5. GROUNDWATER MONITORING

A. Groundwater Quality Monitoring

All monitoring wells designated as part of the monitoring well network must be, at a minimum, sampled and analyzed as specified in Table 8 and the Central Coast Water Board approved sampling and analysis plan (see section VI.A.2.i of the General Permit).

Prior to sampling, depth to groundwater must be measured and groundwater elevations¹⁴ must be calculated. The monitoring wells must be purged at least three well volumes and until measurements of the following parameters have stabilized (i.e., are reproducible within 10 percent): pH, temperature, dissolved oxygen, electrical conductivity, and turbidity. No-purge, low-flow, or other sampling techniques are acceptable only if they are approved in advance by the Central Coast Water Board and described in an approved sampling and analysis plan. Once the groundwater level in each of the wells has recovered sufficiently to ensure the collection of representative groundwater samples, a qualified individual (e.g., consultant, technician) trained in using proper sampling methods must recover samples using approved USEPA methods. Laboratories analyzing groundwater samples must be accredited by the State Water Board Environmental Laboratory Accreditation Program, in accordance with California Water Code section 13176, and must include quality assurance/quality control data with their reports.

Cambria Community Service District must provide monitoring well field sheets and report monitoring data, as described in Table 8, with each monitoring report. Suspected tidal and other outside influence on downgradient wells shall be fully explained at the time of reporting. Unexplained constituent elevations will be presumed a result of this discharge.

Groundwater monitoring must be monitored as specified in Table 8.

Table 8. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Elevation ^[1]	0.01 ft msl	Calculated	Quarterly
Depth to Groundwater ^[1]	0.01 ft bgs	Measurement	Quarterly
Gradient	feet/feet	Calculated	Quarterly

¹⁴ The locations and top-of-casing elevations for the existing groundwater monitoring wells must be surveyed by a licensed land surveyor if not already completed at the time of installation.

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Flow Direction ^[4]	degrees	Calculated	Quarterly
Total Dissolved Solids	mg/L	Grab	Quarterly
Chloride	mg/L	Grab	Quarterly
pH	pH Units	Metered	Quarterly
Dissolved Oxygen	mg/L	Metered	Quarterly
Electrical Conductivity	µS/cm ^[2]	Metered	Quarterly
Oxidation Reduction Potential	mV ^[3]	Metered	Quarterly
Temperature	degrees Celsius	Metered	Quarterly

[1] ft. msl denotes feet above mean sea level and ft bgs denotes feet below ground surface.

[2] µS/cm denotes microsiemens per centimeter

[3] mV denotes millivolts

[4] Calculations must be prepared by, or under the responsible charge of, a California licensed professional.

B. Groundwater Elevation Monitoring

Static water surface elevations shall be measured at wells SS3, SS4, and 9P7 twice a month. Water surface elevations of 9P7 and SS4 shall be measured weekly when the water surface elevation of 9P7 is equal to or above that of SS4. All static water level measurements shall be made during periods when the District's well has been operated at peak operating pumping rates and wells within the disposal area and near 9P7 have not been operated within at least two hours. An annual summary of disposal area water surface elevations shall be submitted by July 20, of each year delineating the groundwater gradient between the spray disposal area and San Simeon Creek wellfield.

6. NAWI PILOT PROJECT – REVERSE OSMOSIS BRINE LIQUID REDUCTION DISCHARGE MONITORING

NAWI pilot project start-up date notification must be submitted to the Central Coast Water Board no more than 14-days prior to pilot project startup. NAWI pilot project permeate must be contained in storage tanks and analyzed for the constituents in Table 9 prior to discharging the permeate to the Wastewater System percolation

ponds. Except for boron and per- and polyfluoroalkyl substances (PFAS), the permeate is anticipated to have significant water contaminants. Analytical methods used to test the permeate must be USEPA-approved methods for drinking water. Total dissolved solids and total organic carbon are used as indicators of the performance of the reverse and forward osmosis treatment systems. NAWI pilot project monitoring must be consistent, at a minimum, with Table 9.

Table 9. Reverse Osmosis Brine Concentrate Permeate Monitoring at ES-2

Parameter/Constituent	Units ¹	Sample Type	Sampling Frequency ²
Daily Flow	gpd	Metered	Daily
Receiving Disposal Pond	Pond A, B, or C	Recorded	Daily
pH	standard units	Grab	One sample per 10,000 gallons
Total Nitrogen	mg/L	Calculated	One sample per 10,000 gallons
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	Grab	One sample per 10,000 gallons
Total Kjeldahl Nitrogen (as N)	mg/L	Grab	One sample per 10,000 gallons
Total Dissolved Solids	mg/L	Grab	One sample per 10,000 gallons
Chloride	mg/L	Grab	One sample per 10,000 gallons
Sodium	mg/L	Grab	One sample per 10,000 gallons
Sulfate	mg/L	Grab	One sample per 10,000 gallons
Boron	mg/L	Grab	One sample per 10,000 gallons
Total Organic Carbon	mg/L	Grab	One sample per 10,000 gallons
Purgeable Organic Carbons ³	µg/L	Grab	One sample per 10,000 gallons
polyfluoroalkyl substances (PFAS) ⁴	ng/L	Grab	One sample per 10,000 gallons

[1] µg/L = micrograms per liter, ng/L = nanograms per liter

[2] Samples will be collected and analyzed prior to Water Board approval of discharge into disposal pond. The sampled and analyzed 10,000 gallons must not receive additional permeate prior to disposal.

[3] The USEPA method must include dimethyl ether as one of the analytes with a method detection limit no greater than 1.0 µg/L.

[4] Analysis to be performed using USEPA Method 537.1 (Rev 2.0)

7. REPORTING REQUIREMENTS

A. Quarterly and Annual Monitoring Reports

Quarterly and annual monitoring reports are due as described in Table 10.

Table 10. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	May 1
Second Quarter Monitoring Report	April 1 to June 30	August 1
Third Quarter Monitoring Report	July 1 to September 30	November 1
Fourth Quarter Monitoring Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

1. **Quarterly Monitoring Reporting** – At a minimum, the quarterly reports must include:
 - i. Results of all required monitoring in tabular format.
 - ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
 - iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. **Cambria Community Service District must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.
 - iv. Copies of laboratory analytical report(s) and chain of custody form(s).
 - v. Copies of groundwater monitoring well field sheets with purge methods and data.

2. **Annual Reporting** – Cambria Community Service District must submit annual reports in compliance with Standard Provisions 2013¹⁵, (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by Central Coast Water Board.

The current annual report template can be found here:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

Cambria Community Service District must include the following operator information with the annual report:

- i. The name, grade, and license number for the wastewater operator responsible for operation, maintenance, and system monitoring, and all operator personnel.
 - ii. A copy of the current Office of Operator Certification Wastewater Treatment Plant Classification Form.
 - iii. A copy of the current Office of Operator Certification Chief Plant Operator Acknowledgement Form.
 - iv. If a contract operator is used, a copy of the contract operator certificate from the Office of Operator Certification.
3. **State Water Board Volumetric Annual Reporting** – Cambria Community Service District must electronically certify and submit a summary of the monthly influent and effluent flow volume by April 30th of each calendar year via the State Water Board's Internet GeoTracker database.¹⁶

The following information is required:

- v. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e. total monthly influent volume).
- vi. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.
- vii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

¹⁵ See Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

¹⁶ See: <https://geotracker.waterboards.ca.gov/>

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website¹⁷.

8. NON-COMPLIANCE REPORTING:

Cambria Community Service District must notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, and wastewater containment failure, pursuant to General Permit section VI.C.2.

9. ELECTRONIC GEOTRACKER SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current self-monitoring report cover sheet (a.k.a. transmittal sheet) found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permiitting/docs/transmittal_sheet.pdf

The transmittal sheet describes who can sign reports. To authorize someone to sign and submit reports on your behalf, you must submit the "designation of duly authorized representatives form" found at the link below to the Central Coast Water Board.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permiitting/

Cambria Community Service District must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker^{18,19} database consistent with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System-specific global identification number WDR100029268 at:

<https://geotracker.waterboards.ca.gov/esi/login>

For general questions, please contact the GeoTracker Help Desk at:

Geotracker@waterboards.ca.gov.

Table 11 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

¹⁷ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

¹⁸ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

¹⁹ Additional information available at: <https://geotracker.waterboards.ca.gov/>

Table 11. GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload or direct your California ELAP-accredited laboratory staff to upload, all EDF laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.

Electronic Submittal	Description of Action	Action	Frequency
Field Points, Location Data (Geo XY) ^[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.” These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.
Elevation Data (Geo Z) ^[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Wastewater System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. Cambria Community Service District must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

10. TECHNICAL REPORTS

The technical reports are due as described in Table 12.

Table 12. Technical Report Submittal Due Dates

Report	Report Due Date
Operations and Maintenance Manual	December 8, 2026

Report	Report Due Date
Climate Change Adaptation Plan	December 8, 2027
Capital Improvement Plan	December 8, 2027

A. Operations and Maintenance Manual

In addition to the required components specified in Standard Provisions²⁰ A.12 and A.28 (and any updates to the Standard Provisions) and General Permit section VI.A.2, the Operations and Maintenance Manual must contain the following components. Each component must contain an implementation schedule and identification of adequate funding to implement the component.

- i. **Sampling and Analysis Plan** – Cambria Community Service District's Operation and Maintenance Manual must contain a sampling and analysis plan that meets the requirements specified herein. Anyone performing sampling on behalf of Cambria Community Service District must be familiar with the sampling and analysis plan. At a minimum, the sampling and analysis plan must contain the following:
 - a. A wastewater treatment process flow schematic with the monitoring locations labeled and scaled Wastewater System maps with treatment components, discharge locations (both treated wastewater and non-potable recycled water), monitoring locations, groundwater wells, storage locations (e.g., chemical, sludge, emergency overflow ponds), and buildings. (if Cambria Community Service District needs to update Figures A1 and A2 to comply with this requirement, a copy of the updated process flow schematic will also be included with the annual report).
 - b. Sample identification details in tabular format. The table must include the sample titles, GeoTracker field point information, sample description(s), and sampling frequencies.
 - c. Sample chain-of-custody procedures and documentation.
 - d. Sample handling/preservation procedures.
 - e. A description of the analytical methods.
 - f. A description of sample containers, preservatives, and holding times.
 - g. For water supply monitoring, a description of the location and method of data collection (e.g., onsite well sampling, use of consumer confidence report).

²⁰ See Standard Provisions, 2013:
https://www.waterboards.ca.gov/centralcoast/board_decisions/do-cs/wdr_standard_provisions_2013.pdf

- h. For groundwater monitoring, a description of the well purging and field methods.
 - ii. **Sludge Management Plan** – Cambria Community Service District’s Operation and Maintenance Manual must contain a sludge management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the plan must describe the following:
 - a. An estimated volume/amount and quality of sludge and scum that will be generated.
 - b. How sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.
 - c. If sludge will be subject to further treatment, describe the treatment and storage requirements.
 - d. Procedures for cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.
 - iii. **Wastewater Disposal Management Plan** – Cambria Community Service District’s Operation and Maintenance Manual must contain a wastewater disposal management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the wastewater disposal management plan must include:
 - a. A description of the wastewater disposal area and a map denoting acreage.
 - b. Loading calculations based on flow volumes, applied acreage, and biochemical oxygen demand, salts (total dissolved solids, sodium, chloride, sulfate, boron), and nitrogen analytical results.
 - c. A description of wastewater disposal and water quality protection practices.
 - d. Ripping/dredging maintenance schedule of disposal ponds.
 - iv. **Spill Prevention and Emergency Response Plan** – Cambria Community Service District’s Operation and Maintenance Manual must contain a spill prevention and emergency response plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. The spill prevention and emergency response plan must describe operation and maintenance activities to prevent accidental releases of wastewater and to effectively respond to such releases and minimize the environmental impact. At a minimum, the spill prevention and emergency response plan must address the following:
 - a. Operation and Control of Wastewater System - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.

- b. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.
- c. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order WQ 2022-0103-DWQ, Statewide Waste Discharge Requirements General Order for Sanitary Sewer Systems (or its replacement), reports prepared to comply with State Water Board Order WQ 2022-0103-DWQ satisfy this requirement.
- d. Emergency Response - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater treatment, storage, or disposal ponds or treated non-potable recycled water storage ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.
- e. Finance - At a minimum, discuss current fees, projected fees, current budget for spill prevention and emergency response, projected budget for spill prevention and emergency response.
- f. Notification Procedures - Coordination procedures with fire, police, Governor's Office of Emergency Services (CalOES), Central Coast Water Board, and local county health department personnel.
- g. Training Records Log – Cambria Community Service District's Operation and Maintenance Manual must contain updated training records logs that demonstrates Cambria Community Service District is complying with General Permit section VI.B.3.

B. Climate Change Adaptation

The Climate Change Adaptation Plan must, at a minimum, include the following components:

- i. **Hazards and Vulnerabilities** – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using up-to-date tools, data, and guidance from the State of California (e.g., Cal-Adapt²¹, Sea-Level Rise Guidance from

²¹ Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor's Office of Planning and Research (OPR) recommends agencies use Representative

Ocean Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California Climate Assessment Regional Reports), assess the Wastewater System's vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities. If

- a. Sea Level Rise – Saltwater intrusion, flooding and inundation, and increased coastal erosion.
- b. Precipitation Pattern Changes.
 - I. Drought – Decreased influent quantity and quality.
 - II. Peak Events – Flooding and increased influent quantity.
- c. Temperature fluctuations and extremes.
- d. Increased wildfires.
- e. Increased power outages.
- ii. **Resiliency Actions** – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.

C. Capital Improvements Plan

Cambria Community Service District must prepare and submit a Capital Improvement Plan. The Capital Improvement Plan must contain all significant capital projects, equipment purchases, and major studies for operating the Cambria Community Service District's Wastewater System and sanitary sewer collection system. In general, the Capital Improvement Plan will include the following elements:

- i. Estimated overall cost of each project
- ii. Estimated operational and maintenance cost for each project
- iii. Estimated project timelines
- iv. Funding sources
- v. Project prioritization

Concentration Pathway (RCP) 8.5 for analyses considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

11. LEGAL REQUIREMENTS

The Central Coast Water Board requires Cambria Community Service District to submit the technical and monitoring reports described in this monitoring and reporting program pursuant to [California Water Code section 13267](#). Failure to submit reports in accordance with the schedules established by the Permit or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Cambria Community Service District to enforcement action pursuant to [California Water Code section 13268](#).

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the Permit and to protect water quality. Cambria Community Service District is required to submit this information because it is subject to the Permit and is responsible for the discharge.

Cambria Community Service District must implement the above monitoring program beginning January 1, 2026. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Cambria Community Service District must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered By:

 Digitally signed by Jennifer Epp
Date: 2025.12.08 11:15:03
-08'00'
Water Board

for Ryan E. Lodge
Executive Officer

R:\RB3\Shared\WDR\WDR Facilities\San Luis Obispo Co\Cambria CSD\WWTP\1-Permit\Transition to R3-2020-0020 Application\WDR MRP\Cambria CSD 2020-0020 NOA_Final.docx

rev: 3/15/24