



Central Coast Regional Water Quality Control Board

March 23, 2026

Sent Via Electronic Mail

Justin Black
Assistant General Manager
Templeton Community Services District
420 Crocker Street
Templeton, CA 93465
e-mail: jblack@templetoncsd.org

Dear Justin Black:

**MEADOWBROOK WWTF, 1394 SHANE LANE, TEMPLETON, CALIFORNIA, 93465,
SAN LUIS OBISPO COUNTY:**

- **NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY;**
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM R3-2026-0006; AND**
- **TERMINATION OF INDIVIDUAL PERMIT, WASTE DISCHARGE REQUIREMENTS ORDER R3-2007-0029 FOR MEADOWBROOK WWTF.**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the June 27, 2023 notice of intent and available documents associated with Templeton Community Services District's domestic wastewater treatment facility (Wastewater System) located at 1394 Shane Lane in Templeton, California. The Wastewater System, owned by Templeton Community Services District is currently regulated pursuant to *Waste Discharge Requirements Order R3-2007-0029 for Templeton Community Services District Meadowbrook Wastewater Facilities*.

On September 25, 2020, the Central Coast Water Board adopted *General Waste Discharge Requirements Order R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

JANE GRAY, CHAIR | RYAN E. LODGE, EXECUTIVE OFFICER

895 Aerovista Place, Suite 101, San Luis Obispo, CA 93401 | www.waterboards.ca.gov/centralcoast

This letter serves as a notice of applicability for enrollment in the General Permit. This letter includes: Wastewater System Operation Summary, Specific Requirements, and Limitations (Attachment 1); Figures (Attachment 2); and Templeton Community Services District's (Templeton CSD) Monitoring and Reporting Program Requirements (Attachment 3).

This letter also serves as a notice of termination of Templeton CSD's coverage in existing individual permit, Order R3-2007-0029.

Templeton CSD must comply with the following:

1. General Permit

1.1. Templeton CSD must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf

2. Monitoring and Reporting Program

2.1. Templeton CSD must comply with the requirements of the Monitoring and Reporting Program enclosed with this letter (Monitoring and Reporting Program **R3-2026-0006**; Attachment 3). Templeton CSD must begin implementing the new monitoring and reporting requirements on July 1, 2026, and must continue to comply with the existing Monitoring and Reporting Program (R3-2007-0029) through June 30, 2026. The first quarterly monitoring report under the new enrollment is due November 1, 2026, and the first annual report is due March 1, 2027. The final quarterly monitoring report under Monitoring and Reporting Program R3-2007-0029 is due July 30, 2026.

2.2. Templeton CSD is also required to comply with annual volumetric reporting requirements established by the State Water Resources Control Board (State Water Board), due annually to the GeoTracker database on April 30th. Monitoring reports must be submitted electronically in searchable PDF format, using the Central Coast Water Board's current transmittal as the cover page. The transmittal sheet is available at the following link:

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

2.3. The transmittal sheet identifies who is authorized to sign reports. To authorize an individual to sign and submit reports on its behalf, Templeton CSD must submit a Designation of Duly Authorized Representatives form to the Central Coast Water Board, available at the following link:

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/

2.4. Templeton CSD must submit all reports, documents, and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker database, with applicable Electronic Submittal of Information (ESI) requirements, under the wastewater system-specific global identification number **WDR100034862**, at the following link:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

2.5. The attached monitoring and reporting program describes the specific GeoTracker electronic reporting requirements. The Central Coast Water Board may request submittal of some documents in paper form, such as drawings or maps that require a large format to be readable, or in alternative electronic formats when necessary for data evaluation.

2.6. Templeton CSD must also comply with annual volumetric reporting requirements¹ established by the State Water Resources Control Board (State Water Board). These reports must be submitted annually to the GeoTracker database by April 30th.

3. Fees

3.1. Templeton CSD paid an annual fee of \$14,103 on December 17, 2025, for coverage in existing individual permit, Order R3-2007-0029. This payment covers Templeton CSD's enrollment in the General Permit for the 2025-2026 fiscal year.

3.2. Templeton CSD must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board's fee program and cover the state fiscal year of July 1 through June 30. The Central Coast Water Board discovered an error in our billing, resulting in Templeton CSD receiving a 50% reduction (for the last 10 years) for facilities with domestic discharges less than 50,000 gallons per day. Templeton CSD's flow has been significantly higher than this threshold and therefore should not have received the discount. Starting with the 2026-2027 invoice, Templeton CSD's annual fee will be at least \$28,205². Templeton CSD's Wastewater System is currently assigned a threat and complexity rating of 2B. A copy of the current state fee schedule is available electronically at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

¹ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

² Annual fees for 2026-2027 may be higher than the fee schedule for 2025-2026.

4. Notification

4.1. The Central Coast Water Board will be notified of Templeton CSD's enrollment at a regularly scheduled public meeting on April 16-17, 2026. Details about that meeting are available on our website at:

https://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. Future Discharge Modifications

5.1. Pursuant to California Water Code section 13260, Templeton CSD must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, Templeton CSD must notify the Central Coast Water Board immediately of such changes.

5.2. Attachment 1 contains the Central Coast Water Board's understanding of the Wastewater System located at 1394 Shane Lane, Templeton, California, 93465. Please review Attachment 1 to determine if the description is representative of your current system. Pursuant to California Water Code section 13267, Templeton CSD must notify the Central Coast Water Board if this information is out of date or incorrect. You are required to provide staff with your updated information within **30 days** of issuance of this letter.

6. Responsible Party

6.1. Templeton CSD is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code, and subjects Templeton CSD to enforcement action, and termination of enrollment under this General Permit.

7. Change in Ownership

7.1. In the event of any change in control or ownership of the property, Templeton CSD must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board so that the new owner or operator can be enrolled in the General Permit and Templeton CSD's enrollment in the General Permit can be terminated.

8. Certified Operator

8.1. Templeton CSD is required to comply with the operator certification requirements³ administered by the State Water Board's Office of Operator Certification, which currently requires a Grade II certified operator onsite to maintain and operate the Wastewater System. Templeton CSD must:

8.1.1. Keep a current Wastewater Treatment Plant Classification Form on file with the Office of Operator Certification and update the form when modifications to the Wastewater System treatment processes occur.

8.1.2. Provide the Office of Operator Certification with a Chief Plant Operator Acknowledgement Form and update this information within 30 days of a change of Chief Plant Operator.

8.1.3. If a contractor operator is used, the contract operator must register with the Office of Operator Certification and obtain a contract operator certificate for the Wastewater System.

8.1.4. Forms are available at the following link:

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/form.html

9. Disposal Area

9.1. Discharge to areas other than the designated 7 Selby percolation ponds A through G shown on Figure 2 of Attachment 2 and sprayfield area shown on Figure 3 of Attachment 2 is prohibited. Spray irrigation of the adjacent Templeton CSD-owned field shown on Figure 3 of Attachment 2 is not a primary disposal method and is implemented only as necessary to manage flows when the percolation basins are temporarily unavailable or capacity-limited.

10. Termination of Permit

10.1. The existing individual permit, Order R3-2007-0029 is terminated, except for enforcement purposes.⁴ Templeton CSD is responsible for compliance with Order R3-2007-0029 prior to the date of this letter.

³ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

⁴ The General Permit states "... where a Wastewater System discharge is currently regulated by an individual permit, that permit is terminated upon the enrollment of the Wastewater System into this General Permit."

11. Compliance Schedule

11.1. As required in the attached monitoring and reporting program, Templeton CSD must submit a Time Schedule Compliance Plan by the date identified in Table 11 of Attachment 3, pursuant to Water Code section 13300. The Time Schedule Compliance Plan must include sufficient details, milestones, and a schedule for potential upgrades to address any potential treatment upgrades and operational changes needed to achieve compliance with effluent limits specified in Attachment 1.

11.2. Prior to developing the request, Central Coast Water Board recommends Templeton CSD set up a meeting with staff to discuss potential options.

11.3. Templeton CSD must include updates on the status, implementation, and progress toward completion of the Time Schedule Compliance Plan in the annual reports beginning with the 2027 annual report.

If you have any questions, please contact **Rachel Hohn at (805) 542-4789 or by email at rachel.hohn@waterboards.ca.gov** or Tamara Anderson at tamara.anderson@waterboards.ca.gov.

Sincerely,



for Ryan E. Lodge
Executive Officer

Attachments

Attachment 1. Wastewater System Operation Summary, Specific Requirements, and Limitations

Attachment 2. Figures

Attachment 3. Monitoring and Reporting Program R3-2026-0006

cc:

Jeff Briltz, Templeton Community Services District, jbriltz@templetoncsd.org
Lori Azeem, Templeton Community Services District, lazeem@templetoncsd.org
Office of Operator Certification, wwopcertprogram@waterboards.ca.gov
Tamara Anderson, Central Coast Water Board, tamara.anderson@waterboards.ca.gov
Jennifer Epp, Central Coast Water Board, Jennifer.Epp@Waterboards.ca.gov
Julie Avanto, Central Coast Water Board, Julie.Avanto@waterboards.ca.gov

Harvey Packard, Central Coast Water Board, harvey.packard@waterboards.ca.gov
Rachel Hohn, Central Coast Water Board, Rachel.Hohn@waterboards.ca.gov
Todd Stanley, Central Coast Water Board, Todd.Stanley@waterboards.ca.gov
WDR Program, *GeoTracker* RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-240168

GeoTracker = GT- WDR100034862

Rev 10/17/2023

ECM Subject Name = Meadowbrook WWTF NOA for R3-2020-0020

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\San Luis Obispo Co\Templeton

CSD Meadowbrook\1- Permit\Big Order

Enrollment\NOA_MRP_TempletonCSD_final.docx

ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY, SPECIFIC REQUIREMENTS,
AND LIMITATIONS

1. OWNERSHIP AND WASTEWATER SYSTEM INFORMATION

1.1. Ownership and wastewater system information submitted by Templeton Community Services District (Templeton CSD) to the Central Coast Water Board is shown in Table 1.

Table 1. Ownership and Wastewater System Information

Name	Meadowbrook WWTF
Physical Address	1394 Shane Lane Templeton, California, 93465
Latitude	35.53263
Longitude	120.70822
Mailing Address	P.O. Box 780 Templeton, California, 93465
Owner	Templeton Community Services District
Chief Plant Operator	Justin Black, Grade IV, 10704 Templeton Community Services District phone: 805-434-4907 e-mail: jblack@templetoncsd.org
Legally Responsible Official	Justin Black phone: 805-434-4900 e-mail: jblack@templetoncsd.org
Service Area	Sewer Connections: 2,316 Population Served: 6,184 Domestic (%): 98.5% Industrial (%): 1.5%
Permitted Design Flow, Maximum Monthly Average (gallons per day, gpd)	600,000
Baseline Flow (average annual flow) in gpd	400,000
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR
Reclamation Included	No
EPA Approved Pretreatment Program	No

1.2. The Salinas River is the nearest surface water to the Meadowbrook WWTF disposal site. The river is approximately 200 feet from the northern edge of the disposal area, 300 feet from the eastern edge of the disposal area, and 250 feet from the southern edge of the disposal area. Paso Robles Creek is approximately 120 feet to the south and east of the sprayfield disposal area. The percolation pond disposal area is within the Salinas River 100-year flood plain and a portion of the sprayfield is within the Paso Robles Creek 100-year flood plain. First-encountered groundwater is approximately 11.5 - 15 feet below ground surface.

2. WASTEWATER SYSTEM OPERATION SUMMARY

2.1. Meadowbrook WWTF is a Class II wastewater system. As minimum qualification, Templeton CSD must staff a Grade II chief plant operator for proper operation of the wastewater system. The current chief plant operator is Justin Black, Grade IV, License Number 10704. Operator names, grades, and license numbers are shown in Table 2.

Table 2. Wastewater System Operators

Operator Name	Grade	License Number
Justin Black	IV, Chief Plant Operator	10704
KC Hamblin	III	44219
Eric Pepe	III	75199
Vince Corcoran	V	77380
Travis Gates	I	47128
Nic Coons	I	44569

2.2. The Wastewater System is comprised of an advanced integrated wastewater pond system (pond system) and can treat 600,000 gallons per day to a secondary treatment level. Pond systems are typically comprised of advanced facultative ponds with an anaerobic pit, digester pit, and aerated zone (primary treatment), secondary facultative ponds with digester pits and aerated zone (secondary treatment), secondary ponds backflow to primary ponds, and maturation/settling ponds (polishing). In the advanced facultative ponds (primary treatment), there is an anaerobic and aerobic zone. The Meadowbrook WWTF uses two treatment trains (1 and 2) for primary and secondary treatment. Flow is mixed following primary and secondary treatment for final polishing in three maturation ponds in series. The Wastewater System consists of the treatment technologies and treatment capabilities shown in Table 3.

Table 3. Treatment Technology and Capacity⁵

Headworks/Preliminary Treatment	The headworks includes a bar screen and Parkson Aqua Guard with Screenings Screw Classifier
	Headworks capacity (gpd): 2,500,000
Primary Treatment	Flow is diverted to two aerated ponds in parallel. The ponds exhibit approximately 4.1 days and 10-day hydraulic retention time for the anaerobic pit and aerated zone, respectively. Following primary treatment, flow is mixed between the two ponds, then diverted to two secondary treatment ponds.
	Primary ponds treatment capacity (gpd): 600,000
Secondary Treatment	Wastewater is directed into two sets of secondary aerated ponds, operated in parallel. Each pond includes total digester volume of 110,000 gallons and an aerated treatment volume of 1,190,000 gallons. Following this, wastewater is directed to three small polishing ponds in series, each with approximately 700,000 gallons of treatment volume, then the two larger polishing ponds in series, with a total volume of approximately 9 million gallons.
	Secondary ponds treatment capacity (gpd): 600,000
Effluent Storage/Wet Weather Storage	The system includes one effluent and wet-weather storage pond that provides approximately 21 million gallons of operational storage prior to wastewater disposal.
Wastewater Disposal Method	Treated effluent is disposed of at the Selby Percolation Site (Figure 2), which consists of seven percolation ponds with a combined surface area of approximately 4.4 acres.
	As an alternative disposal option, the facility maintains a 25-acre sprayfield (Figure 3) for use when discharge to the percolation ponds is not feasible and onsite storage is limited.
	Disposal capacity (gpd): 600,000
Biosolids/Sludge Production and Handling	Advanced integrated wastewater pond systems are designed to not require sludge handling. Meadowbrook WWTF staff obtain sludge depth measurements semi-annually.

⁵ Templeton CSD is currently updating its WWTF Master Plan, including review of treatment and disposal capacities.

2.3. A summary of historic and recent average effluent concentrations is included in Table 4, which were reported in Templeton CSD's quarterly monitoring reports. The Central Coast Water Board used reported effluent water quality data to establish the effluent and groundwater limitations in the Wastewater System Specific Requirements and Limitations Section below.

Table 4. Effluent Water Quality for Select Constituents

Constituents	Units^[1]	Historical Average^[2]	Annual Average for 2025^[3]
Biochemical Oxygen Demand, 5-Day	mg/L	24	5
Total Suspended Solids	mg/L	30	8
Total Dissolved Solids	mg/L	1390	1350
Chloride	mg/L	384	300
Sodium	mg/L	269	203
Sulfate	mg/L	223	--
Boron	mg/L	0.1	--
Total Nitrogen	mg/L	18	29
Nitrate as Nitrogen	mg/L	11	--

[1] mg/L denotes milligrams per liter

[2] Based on water quality data reported by Templeton CSD in their 2012 to 2025 monitoring reports.

[3] Based on water quality data reported by Templeton CSD in the 2025 Quarterly Monitoring Reports.

2.4. A summary of recent average groundwater concentrations is included in Table 5, which were reported in Templeton CSD quarterly monitoring reports.

Table 5. Groundwater Water Quality for Select Constituents Upgradient and Downgradient of Wastewater Disposal

Constituents	Units^[1]	Upgradient Annual Average for 2025	Downgradient Annual Average for 2025
Total Dissolved Solids	mg/L	1027	1155
Chloride	mg/L	104	150
Sodium	mg/L	48	120.5
Nitrate as Nitrogen	mg/L	ND	6.9

[1] mg/L denotes milligrams per liter

3. WASTEWATER SYSTEM SPECIFIC REQUIREMENTS AND LIMITATIONS

3.1. Templeton CSD must operate the Wastewater System in accordance with the General Permit and this notice of applicability. Templeton CSD must comply with the wastewater specific limitations specified in Table 6 through Table 8. Templeton CSD land applies treated wastewater; therefore, the organic loading limitations specified in Table 9 apply. As of the date of this Notice of Applicability, Templeton CSD is preparing a Wastewater Treatment Master Plan which will evaluate the capacity of the existing treatment and disposal systems and may inform future operational or infrastructure improvements.

3.2. Flow Limitations:

Table 6. Flow Limitations

Flow	Units	Limit	Point of Compliance
Maximum Average Monthly ^[1,2]	Gallons per day	600,000	Effluent

[1] Wastewater must not be applied to a land application area within 24 hours of forecasted precipitation with a greater than 50-percent probability of occurring, during precipitation events, or when the land application area surface soil is saturated.

[2] Spray irrigation with treated wastewater is prohibited when wind speed (including gusts) exceeds 10 miles per hour. Wind speed may be measured onsite or at a nearby weather station operated by a governmental organization. If the Discharger's land application areas are isolated from receptors, the Discharger may request Executive Officer approval to spray irrigate when wind speeds exceed 10 miles per hour.

3.3. Effluent Limitations:

Table 7. Effluent Limitations: Pond Systems

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Biochemical Oxygen Demand, 5-Day	mg/L	45	65	Not Applicable
Total Suspended Solids	mg/L	45	65	Not Applicable
Settleable Solids	mL/L ^[1]	0.3	Not Applicable	0.5
pH	Not Applicable	6.5 - 8.4	Not Applicable	Not Applicable

[1] mL denotes milliliters

3.4. Groundwater Limitations:

3.4.1. Based on review of historical effluent water quality (see Table 4), Templeton CSD is unable to consistently comply with the General Permit effluent limitations for total dissolved solids, sodium, chloride, sulfate, and

total nitrogen, thus the point of compliance for these constituents will be underlying groundwater.

- 3.4.2. Through groundwater monitoring, Templeton CSD must demonstrate that the discharge does not cause underlying groundwater to exceed the water quality objectives set forth in the Water Quality Control Plan for the Central Coastal Basin (Basin Plan) including the limitations listed in Table 8 and the groundwater limitations contained in the existing individual permit, Order R3-2007-0029.

**Table 8. Groundwater Limitations
for Designated Groundwater Basin - Paso Robles Area Templeton**

Constituents	Units	25-Month Rolling Median^[1]
Total Dissolved Solids	mg/L	500 ^[2]
Chloride	mg/L	100
Sodium	mg/L	75
Sulfate	mg/L	120
Boron	mg/L	0.2 ^[2]
Total Nitrogen	mg/L	2.7

[1] Rolling Median is the median from all data collected over the most recent 25 months

[2] The same limits as contained in the facility's previous individual permit, Order R3-2007-0029 apply

- 3.4.3. Groundwater monitoring results from Templeton CSD indicate that facility effluent is likely contributing to downgradient groundwater degradation, as reflected by elevated sodium, chloride, TDS, sulfate, and total nitrogen concentrations in groundwater. Templeton CSD must take immediate action to reduce effluent sodium, chloride, TDS, sulfate, and total nitrogen to comply with the groundwater limitations described in Table 8. The attached Monitoring and Reporting Program details required groundwater compliance monitoring and reporting.

3.5. Organic Loading Limitations

- 3.5.1. Templeton CSD land applies treated wastewater to an adjacent sprayfield during contingency conditions and therefore, the organic loading limitations specified in Table 9 apply.

Table 9. Organic Loading Limitations

Constituents	Units	30-Day Average	Maximum
Biochemical Oxygen Demand, 5-Day	Pounds/acre/day	100	300

3.6. Requirements for Disposal Sprayfield

- 3.6.1. Discharge of treated wastewater to the sprayfield for disposal is only authorized as necessary to manage flows when the percolation basins are temporarily unavailable or capacity-limited when the percolation basins are temporarily unavailable or capacity-limited.
- 3.6.2. Templeton CSD must comply with the requirements in General Permit section IV.C Land Application by Spray or Drip Methods.

ATTACHMENT 2
FIGURES

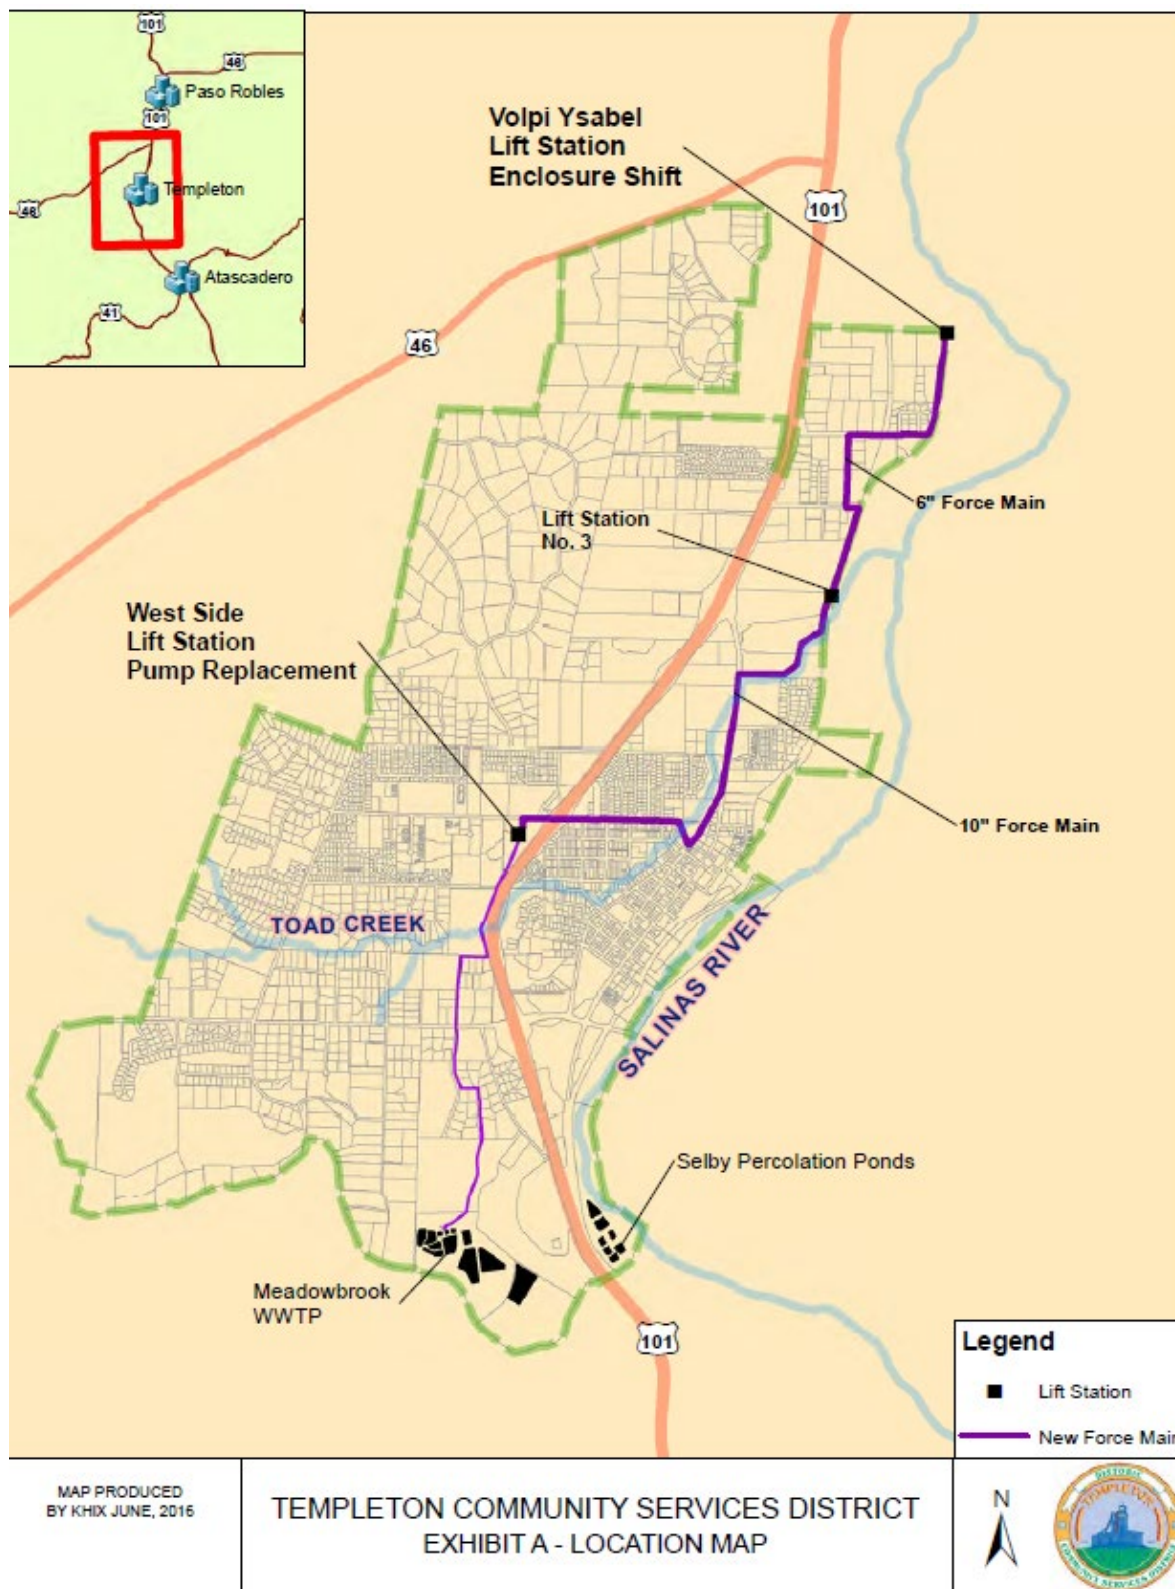


Figure 1. Location Map (Source: 2016 Templeton CSD Sanitary Sewer Management Plan)

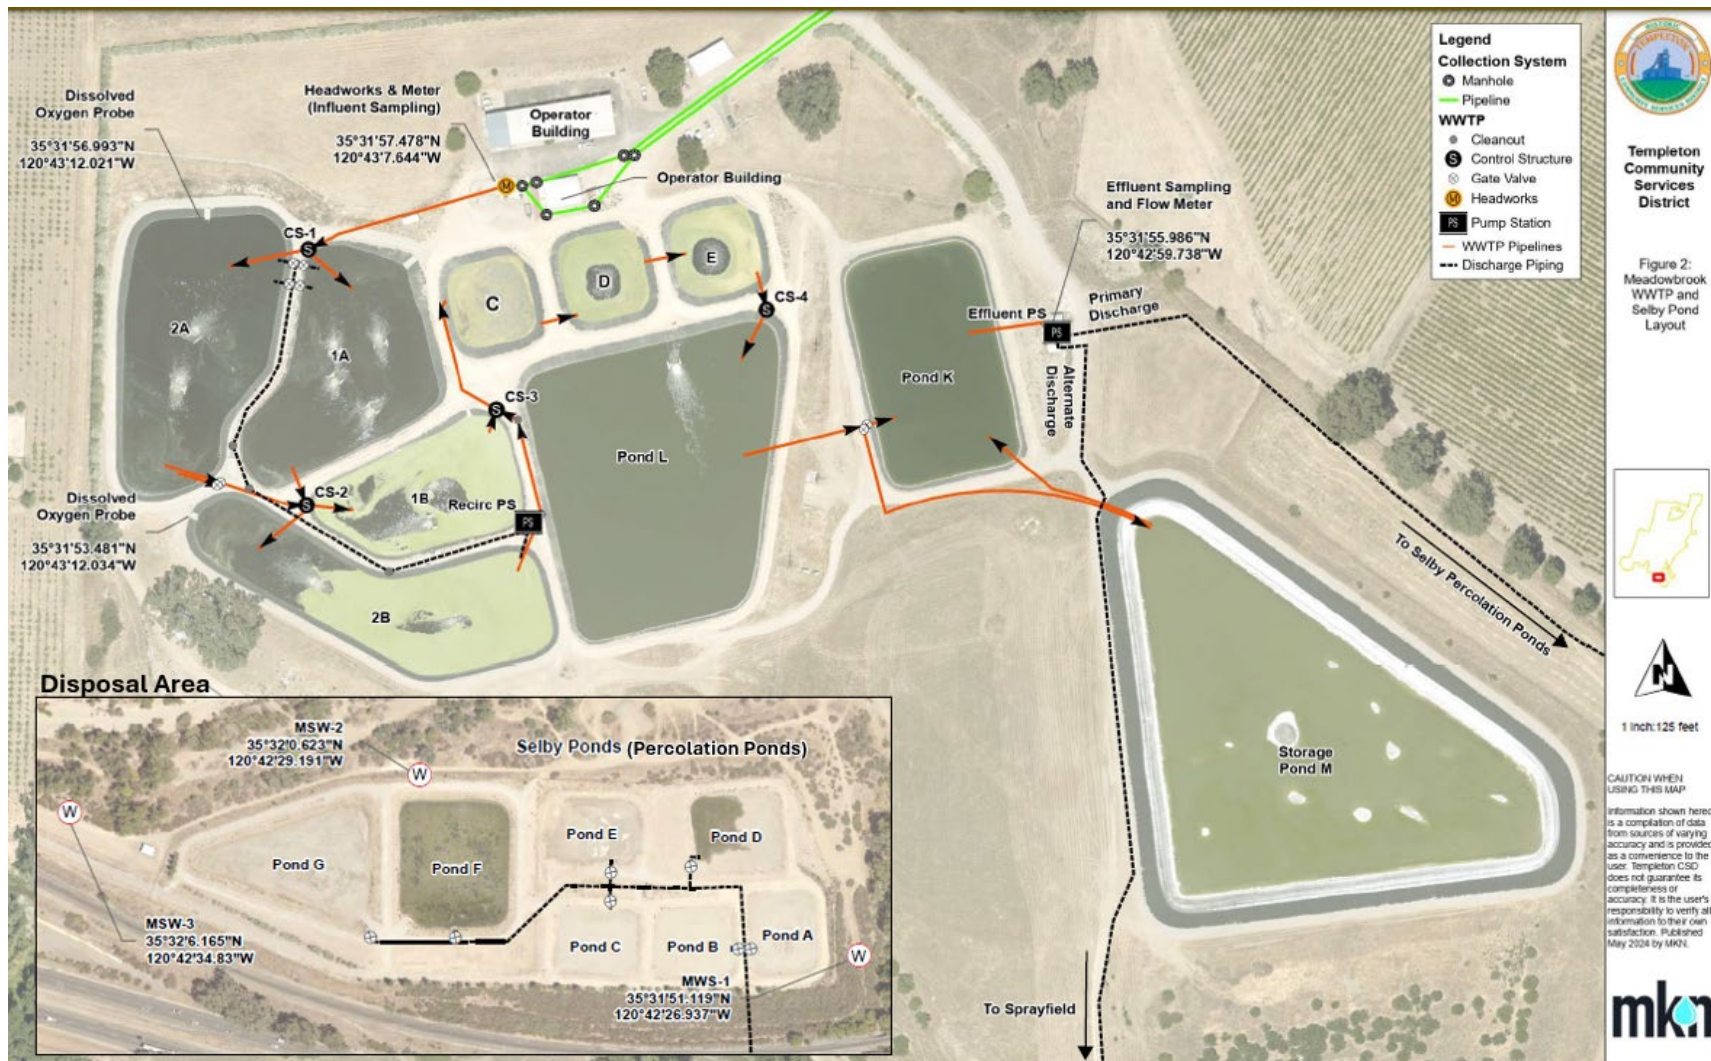


Figure 2. Meadowbrook WWTF and Disposal Pond Layout (Source: Templeton CSD Meadowbrook WWTF Report of Waste Discharge)



Figure 3. Permitted sprayfield application area and required setback distances from adjacent features (Source: Templeton CSD Meadowbrook WWTF Report of Waste Discharge)

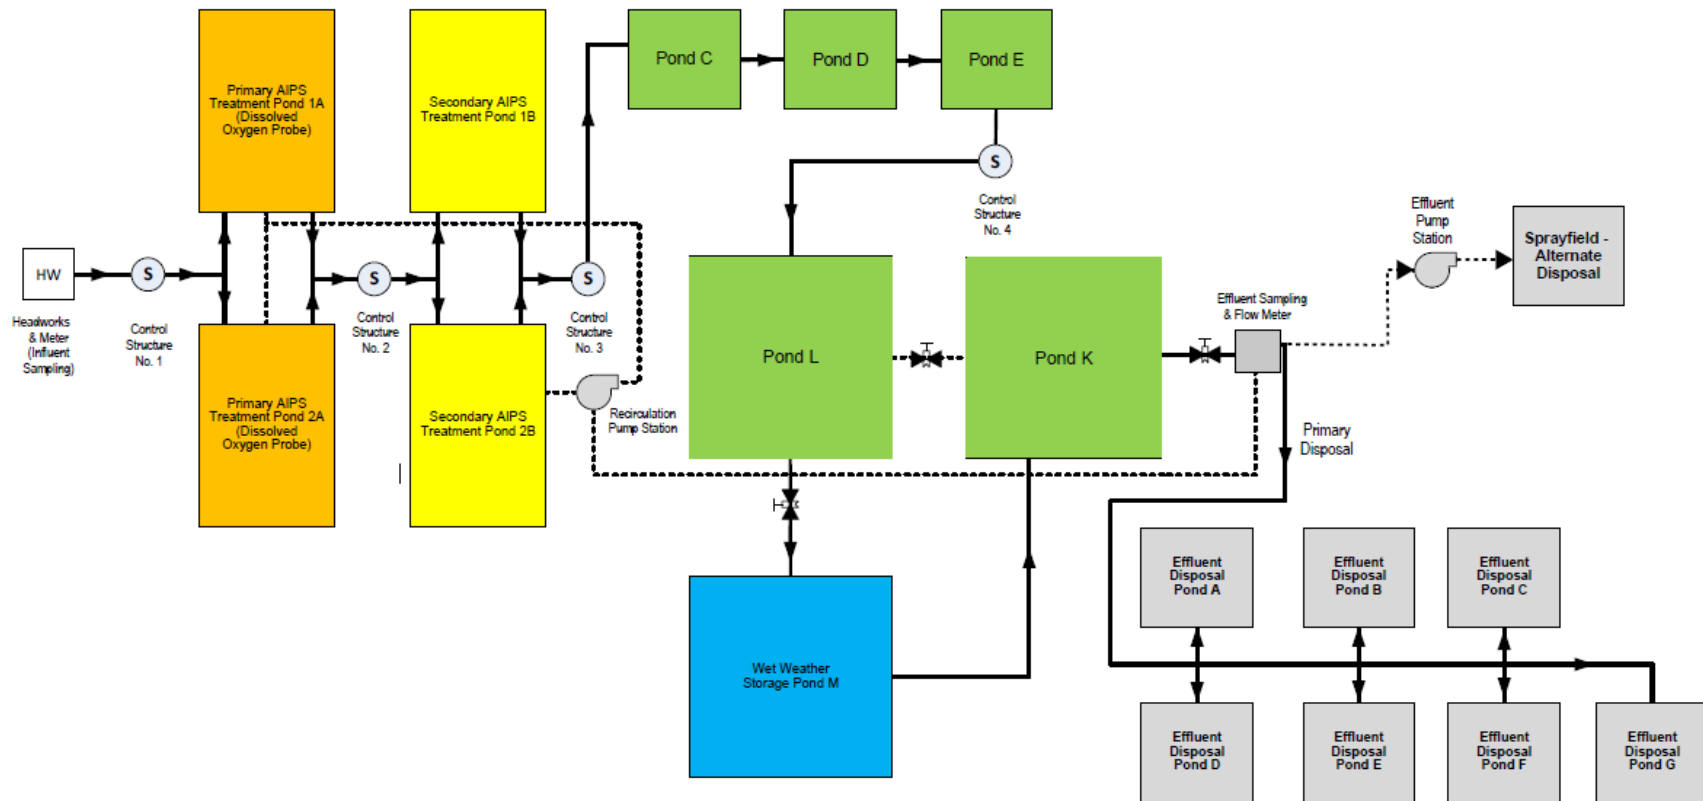


Figure 4. Meadowbrook WWTF and Disposal Pond Process Flow Diagram (Source: Templeton CSD Meadowbrook WWTF Report of Waste Discharge)

ATTACHMENT 3
MONITORING AND REPORTING PROGRAM

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

MONITORING AND REPORTING PROGRAM R3-2026-0006

March 23, 2026

**MODIFICATION OF MONITORING AND REPORTING PROGRAM R3-2020-0020
FOR
MEADOWBROOK WWTF's WASTEWATER SYSTEM
TEMPLETON, SAN LUIS OBISPO COUNTY**

This Monitoring and Reporting Program contains monitoring and reporting requirements for Meadowbrook WWTF (Wastewater System) enrolled in *General Waste Discharge Requirements Order R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

Templeton Community Services District (Templeton CSD) owns and operates the Wastewater System that is subject to the General Permit and notice of applicability.

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The monitoring and reporting program directs Templeton CSD to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board GeoTracker database (see Electronic GeoTracker Submittal section below).

1. SAMPLING AND ANALYSIS

1.1. Templeton CSD must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Regional Water Quality Control Board (Central Coast Water Board). All samples (e.g., wastewater, groundwater, soil, sludge) must be representative of the volume and nature of the discharge or matrix of materials sampled.

1.2. All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the Operations and Maintenance Manual for Central Coast Water Board review and approval.

1.3. Sampling Schedule

1.3.1. Unless otherwise specified below, sampling must be performed in accordance with Table 1.

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Monthly	Each month of the year
Quarterly	January, April, July, and October
Semiannually	April and October
Annually	October

1.3.2. Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

1.4. Monitoring Location Descriptions

1.4.1. All samples including influent samples (IS), effluent samples (ES), and groundwater monitoring wells (MW) must be collected at the locations described in Table 2 and shown in the Process Flow Diagram, Figure 1 of

this monitoring and reporting program. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. **Templeton CSD must upload the GeoTracker field point information for each sampling location in the GeoTracker database once, prior to uploading laboratory data (see Table 10).**

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Influent Sample	IS-1	Raw wastewater sample collected at the headworks
Effluent Sample	ES-1	Treated wastewater sample collected after final effluent storage ponds prior to disposal
Monitoring Well	MWS-1	Up-gradient/background monitoring well
Monitoring Well	MWS-2	Center/onsite monitoring well
Monitoring Well	MWS-3	Down-gradient water-supply/compliance well
Water Supply Well	WSW-1 ^[1]	Representative sample from potable wells serving the development

[1] Water supply sample data should be included in the annual report but does not need to be uploaded to GeoTracker if the Central Coast Water Board approves submittal of a Well Identification Number pursuant to the Water Supply Monitoring section below.

2. WATER SUPPLY MONITORING

2.1. Templeton CSD relies on thirteen groundwater supply wells distributed across its service area. The system includes three shallow underflow wells located in the Salinas River alluvium (Smith, Creekside River, and Platz River) and ten deeper basin wells completed in the Paso Robles Formation. Representative samples of Templeton CSD's raw water supply (sampled before use or treatment) must be collected and analyzed, at a minimum, for constituents specified in Table 3.

2.2. For consistency and interpretability, Templeton CSD must collect raw water quality samples as individual grab samples from each active water supply well. Water supply quality may be reported using annual average values or concentration ranges rather than individual well-by-well results.

2.3. In lieu of the required water supply sampling, Templeton CSD may request Central Coast Water Board approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county, provided, at a minimum, all of the required constituents are sampled at the frequency specified in Table 3. Templeton CSD must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 3. Templeton CSD must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

2.4. Templeton CSD must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring

Constituent	Units^[1]	Sample Type	Sampling Frequency
Nitrate (as N)	mg/L	Grab	Annually
Total Dissolved Solids	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

[1] mg/L denotes milligrams per liter

3. INFLUENT AND EFFLUENT MONITORING

3.1. General Influent and Effluent Monitoring Requirements

Representative samples of Templeton CSD's influent (raw wastewater) to the Wastewater System and effluent (treated wastewater) discharged to percolation ponds and/or land application areas must be collected and analyzed in accordance with pond system treatment technology-based monitoring requirements, including sample type and frequency, summarized in the tables below.

Ponds must also be monitored for operations and maintenance parameters to ensure proper pond performance.

See Figure 1 for sample locations and corresponding GeoTracker field points.


3.2. Influent and Effluent Flow Monitoring

Templeton CSD must monitor and report influent and effluent flow, in gallons per day, as described in Table 4, with each monitoring report. See State Water Board Volumetric Annual Reporting section of this monitoring and reporting program for supplemental annual volumetric reporting requirements established by the State Water Board.

Table 4. Influent and Effluent Flow Monitoring

	INFLUENT		EFFLUENT	
Parameter	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Daily Flow	Metered	Daily	Metered	Daily
Maximum Daily Flow	Metered	Monthly	Metered	Monthly
Mean Daily Flow	Calculated	Monthly	Calculated	Monthly
Percent of Permitted Flow ^[2]	Calculated	Quarterly	N/A	N/A

^[1] The General Permit notice of applicability specifies the Wastewater System's maximum permitted flow. In the monitoring reports, Templeton CSD must evaluate and provide a comparison of monitored flow to the permitted flow.

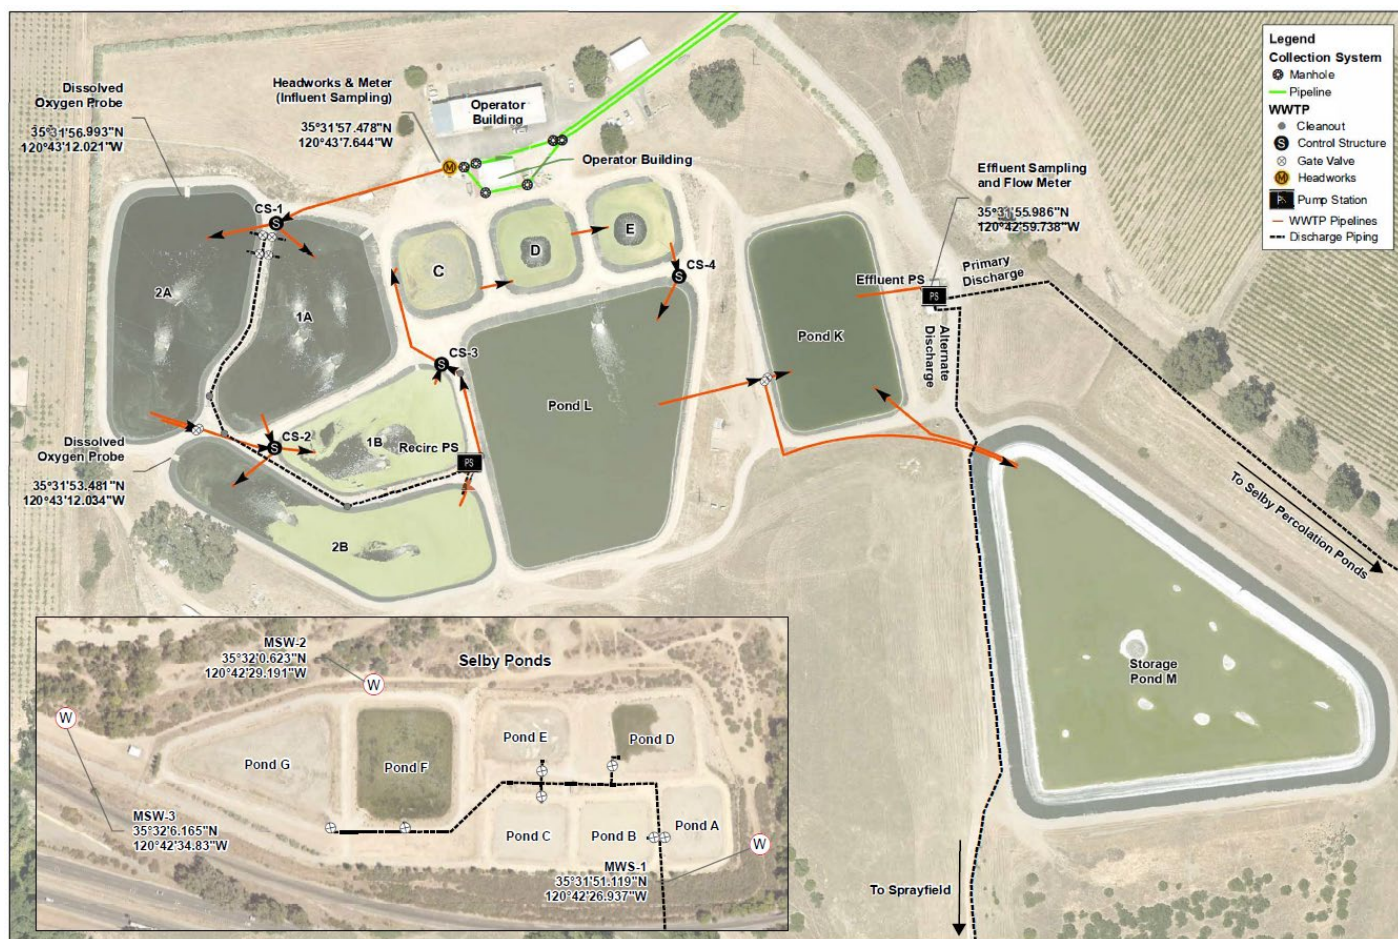

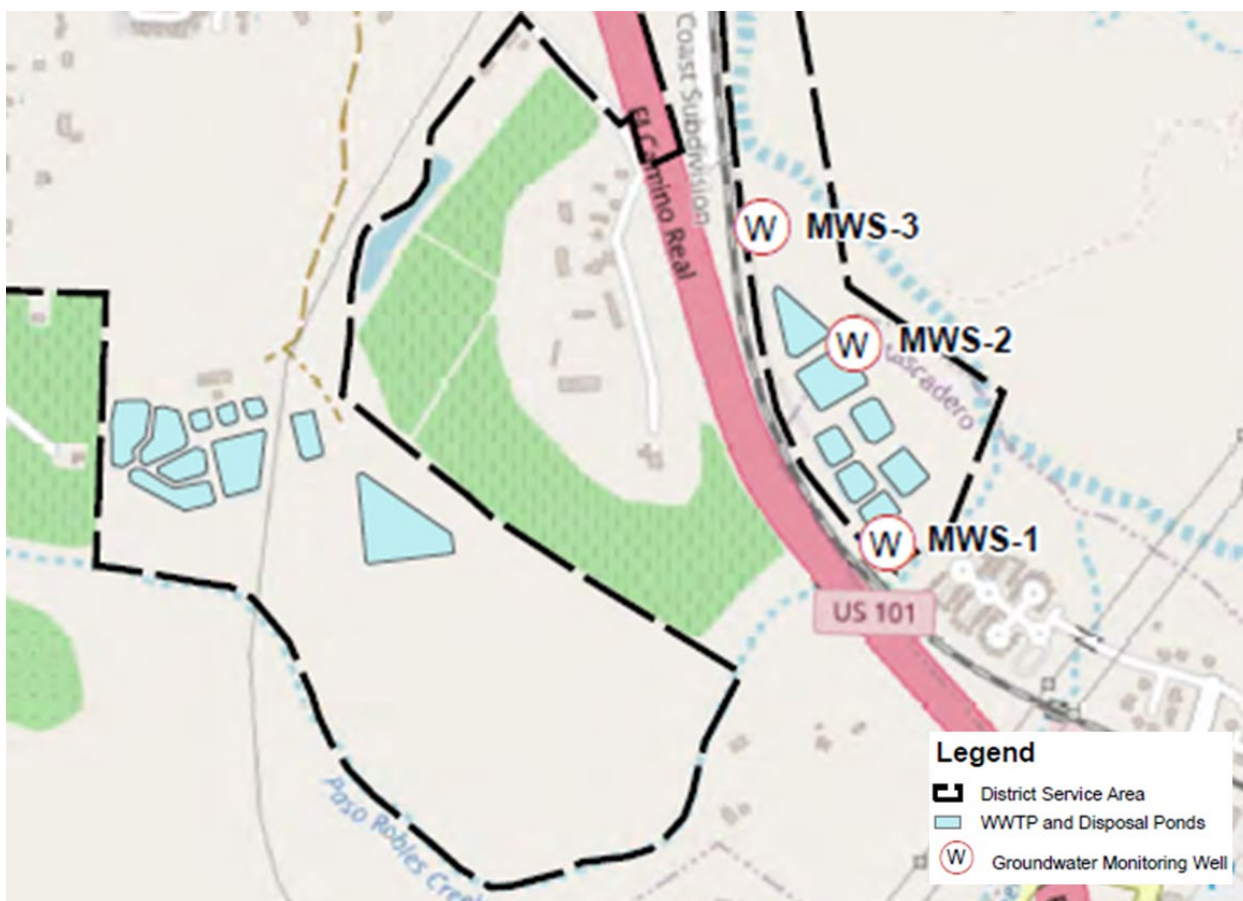


Figure 2. Monitoring Well Locations Referenced in Table 2 (Adapted from Mkn Figure 5: WWTF and Disposal Systems and Groundwater Monitoring Wells within 0.5 Miles, May 2024).

3.3. Pond System Specific Monitoring

3.3.1. Pond System Influent and Effluent Constituent Monitoring

At a minimum, influent and effluent monitoring for pond-based treatment technology systems must be conducted as specified in Table 5.

Table 5. Influent and Effluent Monitoring for Pond Treatment Systems

Parameter/ Constituent	Units	INFLUENT (IS-1)		EFFLUENT (ES-1)	
		Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
pH	units	Grab	Weekly	Grab	Weekly
Biochemical Oxygen Demand, 5-Day	mg/L	24-hour composite	Quarterly	Grab	Quarterly

Parameter/ Constituent	Units	INFLUENT (IS-1)		EFFLUENT (ES-1)	
		Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Total Suspended Solids	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Settleable Solids	ml/L ^[1]	Not Applicable	Not Applicable	Grab	Weekly
Total Nitrogen ^[2]	mg/L	Calculated	Quarterly	Calculated	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Ammonia (as N)	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Total Dissolved Solids	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Chloride	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Sodium	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Sulfate	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Boron	mg/L	Not Applicable	Not Applicable	Grab	Quarterly
Carbonate	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Bicarbonate	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Calcium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Potassium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Magnesium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually

[1] ml/L denotes milliliters per liter

[2] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

3.4. Storage and Disposal Pond Operations and Maintenance Monitoring

3.4.1. All wastewater treatment and treated wastewater storage/disposal ponds (lined and unlined) must be monitored as specified in Table 6. Sampling for

pH and dissolved oxygen must be collected as grab samples taken approximately one foot below pond surface.

3.4.2. Routine operations and maintenance monitoring observations are not required to be reported unless a violation, significant change, or treatment issue is observed. Photographs of the pond(s) documenting the observed conditions must be collected annually and included in the annual monitoring report, with the date and location of the photograph clearly identified.

3.4.3. Observations must be recorded in a logbook or database and made available to the Central Coast Water Board upon request. Any problems must be promptly corrected and recorded.

Table 6. Storage and Disposal Pond Monitoring

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency
Freeboard	0.1 feet ^[1]	Measured	Weekly
pH	pH Units	Grab	Weekly
Dissolved Oxygen (in pond)	mg/L	Grab	Monthly
Sludge Depth	0.1 feet	Measured	Annually
Color	Not applicable	Observation	Monthly
Vegetation in and surrounding ponds	Not Applicable	Observation	Monthly
Berm condition	Not Applicable	Observation	Monthly
Precipitation	inches/day and date	Measured ^[2]	Each precipitation event ^[3]

[1] Freeboard must be measured to the nearest 0.1 inch. Reported values are expressed in 0.1-foot increments to reflect the same level of precision in consistent units.

[2] Templeton CSD may use a rain gauge or use a National Oceanic and Atmospheric Administration, United States Geological Survey, or California Irrigation Management Information System weather station, such as <http://scacis.rcc-acis.org/>.

[3] A precipitation event is one producing precipitation of ½ inch or more.

4. WASTEWATER DISPOSAL MONITORING

4.1. Templeton CSD must monitor all wastewater disposal areas (e.g., disposal sprayfields and percolation ponds) during periods when wastewater is applied. Inspections (observations) must be conducted as described in Table 7.

4.2. Observations must be recorded in a bound logbook or equivalent electronic record. Identified problems must be promptly corrected and documented. Records of inspections must be maintained onsite and made available to the Central Coast Water Board upon request.

4.3. Routine observations are not required to be reported in monitoring reports unless a violation of permit conditions, a significant change, or a treatment or disposal issue is observed. If violations are observed, the Templeton CSD must report the violations and describe the planned and implemented mitigation measures in the applicable monitoring report.

4.4. Disposal Application Rates and Loading Evaluation

4.4.1. Templeton CSD must evaluate and summarize wastewater disposal application rates, loading rates (pounds/acre/day), and violations found during the inspections, with each monitoring report.

4.5. Reporting During No-Discharge Periods

4.5.1. If wastewater is not discharged to land during a reporting period, Templeton CSD must still submit the required monitoring report and clearly indicate that no discharge occurred during the reporting period.

Table 7. Wastewater Disposal Monitoring

Constituent	Units	Sample Type	Monitoring Frequency
Local Precipitation	Inches/day	Weather Station ^[2]	Each precipitation event
Acreage Applied ^[3]	Acres	Measured	Daily
Application Rate	Gallons per day	Metered/Estimated ^[1]	Daily
Average Monthly Biochemical Oxygen Demand, 5-Day (BOD) Applied ^[4] ^[5]	lbs/acre/day	Calculated	Monthly
Maximum Daily BOD ₅ Applied ^[5]	lbs/acre/day	Calculated	Daily
Total Nitrogen Applied ^[4] ^[5]	lbs/acre/day	Calculated	Monthly

Constituent	Units	Sample Type	Monitoring Frequency
Salts Applied ^[4] ^[5] (total dissolved solids, sodium, chloride, sulfate, boron)	lbs/acre/day	Calculated	Monthly
Soil Erosion Evidence	Not Applicable	Observation	Monthly
Containment Berm Condition	Not Applicable	Observation	Monthly
Soil Saturation/Ponding	Not Applicable	Observation	Monthly
Nuisance Odors/Vectors	Not Applicable	Observation	Monthly
Discharge Offsite	Not Applicable	Observation	Monthly

[1] Requires meter reading, a pump run time meter, or other approved method. If the flow is estimated, Templeton CSD is required to provide an explanation (e.g., no meter- estimated using pump operations including rate and time) with each monitoring report.

[2] Templeton CSD must have a rain gauge or use a NOAA or USGS rain station, such as <http://scacis.rcc-acis.org/>.

[3] Acreage applied denotes the acreage to which wastewater is applied.

[4] Applied loading rates are calculated as described in Land Application Mass Loading Calculation section of this Monitoring and Reporting Program

[5] Frequencies of analytical testing are defined in the influent and effluent monitoring tables

4.6. Land Application Mass Loading Calculation (lb/acre/day)

Total Nitrogen/Salts/BOD Applied (pounds/acre/ day) =

$$\frac{X \text{ [mg/L]} \times Q \text{ [million gallons per day]} \times 8.34}{\text{Acreage Applied [acres]}}$$

Where X = Total nitrogen, salts, or BOD concentration

Where Q = Application Rate (often effluent flow rate)

Where 8.34 = Unit conversion factor from mg/L to pounds/million gallons per day

5. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

5.1. Templeton CSD must report on the handling and disposal of all sludge/biosolids generated at the Wastewater System. Records must include the date removed from the Wastewater System, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

5.2. Templeton CSD must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

5.3. If sludge/biosolids are not removed during the year, Templeton CSD must explain the absence of this monitoring in the annual report.

6. GROUNDWATER MONITORING

6.1. Templeton CSD has chosen General Permit Option 2 for groundwater monitoring. If Templeton CSD is regulated under this option and discharges in excess of effluent limitations specified in Table 6 or Table 7 of the General Permit, Templeton CSD must implement a groundwater monitoring program to demonstrate compliance with the groundwater limitations in the notice of applicability and water quality objectives specified in the Basin Plan. Groundwater monitoring reports, workplans, and other technical reports that interpret groundwater data must be prepared and stamped by a California licensed civil engineer or professional geologist.

6.2. By the Date Specified in Table 11, Templeton CSD must:

- 6.2.1. Submit a groundwater monitoring plan and preliminary hydrogeologic conceptual site model for Central Coast Water Board approval. At a minimum, the workplan must evaluate the adequacy of the existing groundwater wells for use as monitoring wells and, if existing wells are not sufficient, propose the installation of new groundwater monitoring wells. The proposed groundwater monitoring well network must be sufficient to establish groundwater gradient, groundwater flow velocity and direction, and evaluate groundwater quality influenced by the wastewater disposal. The number, depth, screen intervals, and locations of monitoring wells must be sufficient to determine potential impacts and must be representative of groundwater conditions upgradient and downgradient of the permitted disposal/dispersal area.
- 6.2.2. No new groundwater monitoring wells may be installed, and no existing wells can be modified, prior to Central Coast Water Board approval of the

groundwater monitoring workplan and preliminary hydrogeologic conceptual site model. If installation of new groundwater monitoring wells is proposed and approved, the wells must be installed within first encountered groundwater and in accordance with California Department of Water Resources Bulletin 74-81 and Supplement 74-90, California Water Code sections 13710 through 13755, and applicable local permitting requirements. The locations and top-of-casing elevations of the newly installed monitoring wells must be surveyed by a licensed land surveyor. Templeton CSD must install⁶ the Central Coast Water Board approved groundwater monitoring well network within **90 days** of receiving Central Coast Water Board approval.

- 6.2.3. All monitoring wells designated as part of the monitoring well network must be sampled and analyzed at a minimum as specified in Table 8 and the Central Coast Water Board approved sampling and analysis plan (see section VI.A.2.i of the General Permit).
- 6.2.4. Prior to sampling, depth to groundwater must be measured and groundwater elevations⁷ must be calculated. The monitoring wells must be purged of at least three well volumes and until measurements of the following parameters have stabilized (i.e., are reproducible within 10 percent): pH, temperature, dissolved oxygen, electrical conductivity, and turbidity. No-purge, low-flow, or other sampling techniques are acceptable only if they are approved in advance by the Central Coast Water Board and described in an approved sampling and analysis plan. Once the groundwater level in each of the wells has recovered sufficiently to ensure the collection of representative groundwater samples, a qualified individual (e.g., consultant, technician) trained in using proper sampling methods must collect samples using approved U.S. EPA methods. Laboratories analyzing groundwater samples must be accredited by the State Water Board Environmental Laboratory Accreditation Program, in accordance with California Water Code section 13176, and must include quality assurance/quality control data with their reports.
- 6.2.5. Templeton CSD must provide monitoring well field sheets and report monitoring data, as described in Table 8, with each monitoring report.
- 6.2.6. Groundwater monitoring must meet, at a minimum, the requirements specified in Table 8.
- 6.2.7. Templeton CSD may request an extension of the groundwater monitoring plan and preliminary hydrogeologic conceptual site model deadline by

⁶ Well installation must be supervised by a California licensed Civil Engineer or Professional Geologist.

⁷ The locations and top-of-casing elevations for the existing groundwater monitoring wells must be surveyed by a licensed land surveyor if not already completed at the time of installation.

submitting an alternative timeline and justification to the Central Coast Water Board.

Table 8. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Elevation ^[1]	0.01 ft msl	Calculated	Quarterly
Depth to Groundwater ^[1]	0.01 ft bgs	Measurement	Quarterly
Gradient	feet/feet	Calculated	Quarterly
Groundwater Flow Direction ^[5]	degrees	Calculated	Quarterly
Total Nitrogen ^[6]	mg/L	Calculated	Quarterly
Nitrate (as N)	mg/L	Grab	Quarterly
Nitrite (as N)	mg/L	Grab	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Grab	Quarterly
Ammonia (as N)	mg/L	Grab	Quarterly
Total Dissolved Solids	mg/L	Grab	Quarterly
Chloride	mg/L	Grab	Quarterly
Sodium	mg/L	Grab	Quarterly
Sulfate	mg/L	Grab	Quarterly
Boron	mg/L	Grab	Quarterly
Carbonate	mg/L	Grab	Semiannually
Bicarbonate	mg/L	Grab	Semiannually
Calcium	mg/L	Grab	Semiannually
Potassium	mg/L	Grab	Semiannually
Magnesium	mg/L	Grab	Semiannually
pH	pH Units	Metered	Quarterly
Dissolved Oxygen	mg/L	Metered	Quarterly
Electrical Conductivity	μS/cm ^[2]	Metered	Quarterly

Constituent	Units	Sample Type	Sampling Frequency
Oxidation Reduction Potential	mV ^[3]	Metered	Quarterly
Temperature	degrees Celsius	Metered	Quarterly
Phenol ^[7]	mg/L	Grab	Quarterly ^[8]
Formaldehyde ^[7]	mg/L	Grab	Quarterly ^[8]
Zinc ^[7]	mg/L	Grab	Quarterly ^[8]

[1] ft.msl denotes feet above mean sea level and ft bgs denotes feet below ground surface.

[2] μ S/cm denotes microsiemens per centimeter

[3] mV denotes millivolts

[5] Calculations must be prepared by, or under the responsible charge of, a California licensed professional.

[6] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

[7] Constituent monitoring is based on raw wastewater characteristics (waste streams). Templeton CSD is required to monitor effluent for this constituent, Templeton CSD must also analyze groundwater for the potential presence of this constituent.

[8] Sampling required once every five years if not detected in initial sample pending a request from Templeton CSD and Central Coast Water Board approval through a revised monitoring and reporting program.

7. REPORTING AND SUBMITTAL REQUIREMENTS

7.1. Quarterly and Annual Monitoring Reports

Quarterly and annual monitoring reports are due as described in Table 9.

Table 9. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	May 1
Second Quarter Monitoring Report	April 1 to June 30	August 1
Third Quarter Monitoring Report	July 1 to September 30	November 1
Fourth Quarter Monitoring Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1

Report	Monitoring Period	Report Due Date
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

7.2. Quarterly Monitoring Reporting

At a minimum, the quarterly reports must include:

- 7.2.1. Results of all required monitoring in tabular format.
- 7.2.2. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
- 7.2.3. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. **Templeton CSD must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.
- 7.2.4. Copies of laboratory analytical report(s) and chain of custody form(s).
- 7.2.5. Copies of groundwater monitoring well field sheets with purge methods and data.

7.3. Annual Reporting

- 7.3.1. Templeton CSD must submit annual reports in compliance with Standard Provisions 2013⁸, (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16, using the most recent annual report template provided by the Central Coast Water Board. The current annual report template can be found here:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

- 7.3.2. Beginning with the 2027 annual report, the annual reports must include updates on the implementation and progress of the Time Schedule Compliance Plan including a summary of completed milestones, any

⁸ See Attachment E, Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

deviations from the approved schedule, and anticipated actions for the upcoming reporting period.

7.3.3. Templeton CSD must include the following operator information with the annual report:

7.3.3.1. The name, grade, and license number for the wastewater operator responsible for operation, maintenance, and system monitoring, and all operator personnel.

7.3.3.2. A copy of the current Office of Operator Certification Wastewater Treatment Plant Classification Form.

7.3.3.3. A copy of the current Office of Operator Certification Chief Plant Operator Acknowledgement Form.

7.3.3.4. If a contract operator is used, a copy of the contract operator certificate from the Office of Operator Certification.

7.4. State Water Board Volumetric Annual Reporting

7.4.1. Templeton CSD must electronically certify and submit a summary of the monthly influent and effluent flow volume **by April 30th** of each calendar year via the State Water Board's Internet GeoTracker database.⁹

7.4.2. At a minimum, the following information must be included:

7.4.2.1. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e. total monthly influent volume).

7.4.2.2. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.

7.4.2.3. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

7.4.3. Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website¹⁰.

7.5. Non-Compliance Reporting:

7.5.1. Templeton CSD must notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, and wastewater containment failure, pursuant to General Permit section VI.C.2.

⁹ See: <https://geotracker.waterboards.ca.gov/>

¹⁰ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

8. Electronic GeoTracker Submittal

8.1. All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

8.2. Templeton CSD must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker^{11,12} database consistent with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System-specific global identification number **WDR100034862** at:

<https://geotracker.waterboards.ca.gov/esi/login>

8.3. For general questions, please contact the GeoTracker Help Desk at: Geotracker@waterboards.ca.gov.

8.4. Table 10 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

Table 10. GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.

¹¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

¹² Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Electronic Submittal	Description of Action	Action	Frequency
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your California ELAP-accredited laboratory staff to upload, all EDF laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.
Field Points, Location Data (Geo XY) ^[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.” These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.

Electronic Submittal	Description of Action	Action	Frequency
Elevation Data (Geo Z) ^[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Wastewater System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. Templeton CSD must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

9. TECHNICAL REPORTS AND ONE-TIME SUBMITTALS

The technical reports are due as described in Table 11.

Table 11. Technical Report Submittal Due Dates

Report	Report Due Date
Operations and Maintenance Manual	March 23, 2027
Climate Change Adaptation Plan	March 23, 2028
Salt and Nutrient Management Plan	March 23, 2028
Time Schedule Compliance Plan	March 23, 2027
Groundwater Monitoring Plan	September 23, 2027
Capital Improvement Plan	March 23, 2029

9.1. Operations and Maintenance Manual

9.1.1. In addition to the required components specified in Standard Provisions¹³ A.12 and A.28 (and any updates to the Standard Provisions) and General Permit section VI.A.2, the Operations and Maintenance Manual must contain the following components. Each component must contain an implementation schedule and identification of adequate funding to implement the component.

9.1.2. **Sampling and Analysis Plan** - Templeton CSD's Operation and Maintenance Manual must contain a sampling and analysis plan that meets the requirements specified herein. Anyone performing sampling on behalf of Templeton CSD must be familiar with the sampling and analysis plan. At a minimum, the sampling and analysis plan must contain the following:

- 9.1.2.1. A wastewater treatment process flow schematic with the monitoring locations labeled and scaled Wastewater System maps with treatment components, discharge locations (both treated wastewater and non-potable recycled water), monitoring locations, groundwater wells, storage locations (e.g., chemical, sludge, emergency overflow ponds), and buildings. (if Templeton CSD needs to update Figure 1 of this monitoring and reporting program and Figure 4 of the notice of applicability Attachment 2 to comply with this requirement, a copy of the updated process flow schematic will also be included with the annual report).
- 9.1.2.2. Sample identification details in tabular format. The table must include the sample titles, GeoTracker field point information, sample description(s), and sampling frequencies.
- 9.1.2.3. Sample chain-of-custody procedures and documentation.
- 9.1.2.4. Sample handling/preservation procedures.
- 9.1.2.5. A description of the analytical methods.
- 9.1.2.6. A description of sample containers, preservatives, and holding times.
- 9.1.2.7. For water supply monitoring, a description of the location and method of data collection (e.g., onsite well sampling, use of consumer confidence report).
- 9.1.2.8. For groundwater monitoring, a description of the well purging and field methods.

¹³ See Attachment E, Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/do-cs/wdr_standard_provisions_2013.pdf

9.1.3. **Sludge Management Plan** - Templeton CSD's Operation and Maintenance Manual must contain a sludge management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the plan must describe the following:

- 9.1.3.1. An estimated volume/amount and quality of sludge and scum that will be generated.
- 9.1.3.2. How sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.
- 9.1.3.3. If sludge will be subject to further treatment, describe the treatment and storage requirements.
- 9.1.3.4. Procedures for cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.

9.1.4. **Wastewater Disposal Management Plan** - Templeton CSD's Operation and Maintenance Manual must contain a wastewater disposal management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the wastewater disposal management plan must include:

- 9.1.4.1. A description of the wastewater disposal area and a map denoting acreage.
- 9.1.4.2. Loading calculations based on flow volumes, applied acreage, and biochemical oxygen demand, salts (total dissolved solids, sodium, chloride, sulfate, boron), and nitrogen analytical results.
- 9.1.4.3. A description of wastewater disposal and water quality protection practices.

9.1.5. **Spill Prevention and Emergency Response Plan** - Templeton CSD's Operation and Maintenance Manual must contain a spill prevention and emergency response plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. The spill prevention and emergency response plan must describe operation and maintenance activities to prevent accidental releases of wastewater and to effectively respond to such releases and minimize the environmental impact. At a minimum, the spill prevention and emergency response plan must address the following:

- 9.1.5.1. Operation and Control of Wastewater System - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.

- 9.1.5.2. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.
- 9.1.5.3. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order WQ 2022-0103-DWQ, Statewide Waste Discharge Requirements General Order for Sanitary Sewer Systems (or its replacement), reports prepared to comply with State Water Board Order WQ 2022-0103-DWQ satisfy this requirement.
- 9.1.5.4. Emergency Response - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater treatment, storage, or disposal ponds or treated non-potable recycled water storage ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.
- 9.1.5.5. Finance - At a minimum, discuss current fees, projected fees, current budget for spill prevention and emergency response, projected budget for spill prevention and emergency response.
- 9.1.5.6. Notification Procedures - Coordination procedures with fire, police, Governor's Office of Emergency Services (CalOES), Central Coast Water Board, and local county health department personnel.
- 9.1.5.7. Training Records Log - Templeton CSD's Operation and Maintenance Manual must contain updated training records logs that demonstrates Templeton CSD is complying with General Permit section VI.B.3.

9.2. Climate Change Adaptation

The Climate Change Adaptation Plan must, at a minimum, include the following components:

- 9.2.1. **Hazards and Vulnerabilities** – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using up-to-date tools, data, and guidance from the State of California (e.g., Cal-Adapt¹⁴, Sea-Level Rise Guidance from Ocean

¹⁴ Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor's Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses considering impacts through

Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California Climate Assessment Regional Reports), assess the Wastewater System's vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities. If

9.2.1.1. Sea Level Rise – Saltwater intrusion, flooding and inundation, and increased coastal erosion.

9.2.1.2. Precipitation Pattern Changes.

9.2.1.3. Drought – Decreased influent quantity and quality.

9.2.1.4. Peak Events – Flooding and increased influent quantity.

9.2.1.5. Temperature fluctuations and extremes.

9.2.1.6. Increased wildfires.

9.2.1.7. Increased power outages.

9.2.2. **Resiliency Actions** – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.

9.3. **Salt and Nutrient Management Plan**

9.3.1. If directed by the Central Coast Water Board pursuant to California Water Code section 13267, Templeton CSD must prepare and submit a Salt and Nutrient Management Plan to ensure that the overall impact of treated wastewater and/or non-potable water recycling projects does not degrade groundwater resources. At a minimum, the salt and nutrient management plan must address the following:

9.3.1.1. An outline and description of an implementable salt and nutrient management program to reduce mass loading of salts and nutrients (with an emphasis on nitrogen species) in treated effluent to a level that will ensure compliance with effluent limitations and protect beneficial uses of groundwater.

9.3.1.1.1. A description of salt reduction measures that identify and focus on all potential salt contributors to the collection system (e.g., water supply, commercial, industrial, residential) and wastewater treatment process.

2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

- 9.3.1.1.2. A description of nutrient reduction measures that focus on source control and optimizing wastewater treatment processes for nitrogen removal.

9.4. Time Schedule Compliance Plan

- 9.4.1. As set forth in General Permit sections V.A and VI.A.5, if Templeton CSD anticipates that additional time is needed to achieve compliance with the effluent limitations, Templeton CSD must prepare and submit for Central Coast Water Board review and approval, a time schedule compliance plan. At a minimum, the Time Schedule Compliance Plan must address the following:

- 9.4.1.1. Comparison of the current effluent quality to the effluent and groundwater limitations in General Permit Tables 3-6.
- 9.4.1.2. A detailed description and chronology of efforts, since issuance of the notice of applicability, to reduce wastes.
- 9.4.1.3. Justification of the need for additional time to achieve the effluent limitations in General Permit Tables 3-6.
- 9.4.1.4. A detailed time schedule of specific actions Templeton CSD will take to achieve the effluent limitations.
- 9.4.1.5. A demonstration that the time schedule requested is as short as possible, considering the technological, operation, and economic factors that affect the design, development, and implementation of the measures that are necessary to comply with the effluent limitation(s).
- 9.4.1.6. If the requested time schedule exceeds one year, the proposed schedule shall include interim requirements and the date(s) for their achievement. The interim requirements shall include both of the following:
 - 9.4.1.7. Effluent limitation(s) for the pollutant(s) of concern.
 - 9.4.1.8. Actions, measurable milestones, and tangible products leading to compliance with the effluent limitation(s).

9.5. Capital Improvements Plan

- 9.5.1. Templeton CSD must prepare and submit a Capital Improvement Plan. The Capital Improvement Plan must contain all significant capital projects, equipment purchases, and major studies for operating the Templeton CSD's Wastewater System. In general, the Capital Improvement Plan will include the following elements:

- 9.5.1.1. Estimated overall cost of each project

9.5.1.2. Estimated operational and maintenance cost for each project

9.5.1.3. Estimated project timelines

9.5.1.4. Funding sources

9.5.1.5. Project prioritization

10. LEGAL REQUIREMENTS

10.1. The Central Coast Water Board requires Templeton CSD to submit the technical and monitoring reports described in this monitoring and reporting program pursuant to [California Water Code section 13267](#). Failure to submit reports in accordance with the schedules established by the Permit or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Templeton CSD to enforcement action pursuant to [California Water Code section 13268](#).

10.2. The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the Permit and to protect water quality. Templeton CSD is required to submit this information because it is subject to the Permit and is responsible for the discharge.

10.3. Templeton CSD must implement the above monitoring program (R3-2026-0006) beginning on July 1, 2026. Templeton CSD must continue to comply with the previous monitoring and reporting program through June 30, 2026. The initial quarterly monitoring report under monitoring and reporting program R3-2026-0006 is due November 1, 2026, and the first annual report for the new monitoring program is due March 1, 2027.

10.4. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Templeton CSD must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered By:

A handwritten signature in blue ink, appearing to read "Ryan E. Lodge".

for Ryan E. Lodge
Executive Officer

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\San Luis Obispo Co\Templeton
CSD Meadowbrook\1- Permit\Big Order
Enrollment\NOA_MRP_TempletonCSD_final.docx