



Central Coast Regional Water Quality Control Board

May 27, 2022

Sent Via Electronic Mail

Drew A. Lander
General Manager / District Engineer
Sunnyslope County Water District
3570 Airline Highway
Hollister, CA, 95023
e-mail: drew@sunnyslopewater.org

Dear Drew A. Lander:

RIDGEMARK ESTATES WASTEWATER TREATMENT FACILITY, 10 GEORGES DRIVE, HOLLISTER, SAN BENITO COUNTY:

- **NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER NO. R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY;**
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2022-0033; AND**
- **TERMINATION OF INDIVIDUAL PERMIT, WASTE DISCHARGE REQUIREMENTS ORDER NO. R3-2004-0065 FOR SUNNYSLOPE COUNTY WATER DISTRICT, RIDGEMARK ESTATES SUBDIVISION, WASTEWATER TREATMENT PLANT, SAN BENITO COUNTY.**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the January 26, 2022 notice of intent and available documents associated with Sunnyslope County Water District's domestic wastewater treatment facility (Wastewater System) located at 10 Georges Drive in Hollister, California. The Wastewater System, owned by Sunnyslope County Water District is currently regulated pursuant to *Waste Discharge Requirements Order No. R3-2004-0065 for Sunnyslope County Water District, Ridgemark Estates Subdivision, Wastewater Treatment Plant, San Benito County* (Order No. R3-2004-0033).

On September 25, 2020, the Central Coast Water Board adopted *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

JANE GRAY, CHAIR | MATTHEW T. KEELING, EXECUTIVE OFFICER

This letter serves as a notice of applicability for enrollment in the General Permit. This letter includes: wastewater system operation summary, specific requirements, and limitations (Attachment 1); figures (Attachment 2); and Sunnyslope County Water District's monitoring and reporting program requirements (Attachment 3).

This letter also serves as a notice of termination of Sunnyslope County Water District's coverage in existing individual permit, Order No. R3-2004-0065.

Sunnyslope County Water District must comply with the following:

1. **General Permit** – Sunnyslope County Water District must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf

2. **Monitoring and Reporting Program** – Sunnyslope County Water District must comply with the requirements of the monitoring and reporting program enclosed with this letter (monitoring and reporting program no. R3-2022-0033, Attachment 3). Sunnyslope County Water District is required to submit quarterly monitoring reports and annual reports to the Central Coast Water Board and comply with annual volumetric reporting requirements¹ established by the State Water Resources Control Board (State Water Board). The first quarterly (2nd Quarter 2022) monitoring report is due **August 1, 2022**, the first annual report is due **March 1, 2023**, and the annual volumetric data submission must be uploaded to the State Water Board GeoTracker database by **April 30, 2023**.

Quarterly monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

All annual reports must be formatted and completed as specified in the annual report template found at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

¹ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

Sunnyslope County Water District must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{2,3} database with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System – specific global identification number WDR100034585 over the internet at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements. The Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

3. **Fees** – Sunnyslope County Water District paid an annual fee of \$23,783 on January 12, 2022 for coverage in existing individual permit, Order No. R3-2004-0065. This payment covers Sunnyslope County Water District's enrollment in the General Permit for the 2021-2022 fiscal year.

Sunnyslope County Water District must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board's fee program and cover the state fiscal year of July 1 through June 30. Your current annual fee is \$23,783. A copy of the current state fee schedule is available electronically at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

Sunnyslope County Water District's Wastewater System is currently assigned a threat and complexity rating of 2B.

4. **Notification** – The Central Coast Water Board will be notified of Sunnyslope County Water District's enrollment at a regularly scheduled public meeting on August 25-26, 2022. Details about that meeting are available on our website at:

https://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to California Water Code section 13260, Sunnyslope County Water District must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume

² Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

³ Additional information available at: <http://geotracker.waterboards.ca.gov/>

or character of the treated wastewater, Sunnyslope County Water District must notify the Central Coast Water Board immediately of such changes.

Attachment 1 contains the Central Coast Water Board's understanding of the Wastewater System located at 10 Georges Drive, Hollister, California 95023. Please review Attachment 1 to determine if the description is representative of your current system. Pursuant to California Water Code section 13267, Sunnyslope County Water District must notify the Central Coast Water Board if this information is out of date or incorrect. You are required to provide staff with your updated information within **30 days** of issuance of this letter.

- 6. Responsible Party** – Sunnyslope County Water District is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code, and subjects Sunnyslope County Water District to enforcement action, and termination of enrollment under this General Permit.
- 7. Change in Ownership** - In the event of any change in control or ownership of the property, Sunnyslope County Water District must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board so that the new owner or operator can be enrolled in the General Permit and Sunnyslope County Water District's enrollment in the General Permit can be terminated.
- 8. Termination of Permit** - The existing individual permit, Order No. R3-2004-0065 is terminated, except for enforcement purposes⁴. Sunnyslope County Water District is responsible for compliance with Order No. R3-2004-0065 prior to the date of this letter.

If you have any questions, please contact **Mark Lemus at (805) 549-3703 or by email at Mark.Lemus@waterboards.ca.gov** or Jennifer Epp at (805) 594-6181 or by email at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

 Digitally signed by Jennifer Epp
Date: 2022.05.27 09:08:42
-07'00'
Water Boards

for Matthew T. Keeling
Executive Officer

⁴ The General Permit states "... where a Wastewater System discharge is currently regulated by an individual permit, that permit is terminated upon the enrollment of the Wastewater System into this General Permit."

Attachments:

Attachment 1: Wastewater System Operation Summary, Specific Requirements, and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program Order No. R3-2022-0033

cc:

Jennifer Epp, Central Coast Water Board, Jennifer.Epp@Waterboards.ca.gov
Todd Stanley, Central Coast Water Board, Todd.Stanley@Waterboards.ca.gov
Henry Gonzalez, City of Hollister, Henry.Gonzalez@hollister.ca.gov
Garrett Haertel, San Benito County Water District, garrett@sbcwd.com
Mark Lemus, Central Coast Water Board, Mark.Lemus@Waterboards.ca.gov
WDR Program, GeoTracker RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-252700

GeoTracker No. = GT- WDR100034585

Rev 3/4/2022

ECM Subject Name = Ridgemark Estates Wastewater Treatment Facility NOA for R3-2020-0020

R:\RB3\Shared\WDR\WDR Facilities\San Benito Co\Sunnyslope WD-Ridgemark Estates\Big Order Enrollment\0020_NOA&MRP_Ridgemark_Estates\Final\R3-2020-0020 NOA Ridgemark Estates.docx

**ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY, SPECIFIC REQUIREMENTS,
AND LIMITATIONS**

1. OWNERSHIP AND WASTEWATER SYSTEM INFORMATION

Ownership and wastewater system information submitted by Sunnyslope County Water District to the Central Coast Water Board is shown in Table 1.

Table 1. Ownership and Wastewater System Information

Name	Ridgemark Estates Wastewater Treatment Facility
Physical Address	10 Georges Drive, Hollister, CA 95023
Latitude	36.81165 and 36.81655
Longitude	-121.37832 and -121.38245
Mailing Address	3570 Airline Highway Hollister, CA 95023
Owner	Sunnyslope County Water District
Operator	Sunnyslope County Water District phone: (831) 637-4670 e-mail: drew@sunnyslopewater.org
Chief Plant Operator	Jose Rodriguez, Grade V WWTPO (License No.: V-9646)
Legally Responsible Official	Drew A. Lander phone: (831) 637-4670 e-mail: drew@sunnyslopewater.org
Raw Wastewater Characteristics	Sewer Connections: 1,250 Population Served: 4,125 Domestic (%): 97% Commercial (%): 3%
Permitted Design Flow, Maximum Daily (gallons per day, gpd)	350,000
Baseline Flow (average annual flow) in gpd	160,328
Threat to Water Quality	2
Complexity	B

2. WASTEWATER SYSTEM OPERATION SUMMARY

Ridgemark Estates Wastewater Treatment Facility (Wastewater System) is a Class III wastewater system. Sunnyslope County Water District must staff a Class III chief plant operator for proper operation of the Wastewater System.

The Wastewater System is capable of treating 350,000 gallons per day to a secondary treatment level. The Wastewater System consists of the treatment technologies and treatment capabilities shown in Table 2.

Table 2. Treatment Technology and Capacity

Headworks/Preliminary Treatment	Influent wastewater enters the treatment plant where flows are measured through a magnetic flow meter. The flow meter records the instantaneous and totalized flow. A flow-based composite sampler captures influent samples for operation and reporting. Trash and debris is removed by a perforated drum screen, which overflows to a manual screen/trash rack if it becomes clogged. Next, a mechanical vortex removes grit. Trash and grit are directed to trash bins by screw conveyors.
	Headworks capacity (gpd): 1,430,000
Primary Treatment	From the Headworks screens, wastewater flows directly into the sequencing batch reactor (SBR) basins without any prior sedimentation basins.
Secondary Treatment	SBR technology is used for secondary treatment. Each of the two 320,000 gallon basins alternate between aerobic and anaerobic conditions for nitrogen removal. The design hydraulic retention time for an average flow rate of 350,000 gpd is 43.8 hours.
	Secondary treatment capacity (gpd): 350,000
Wastewater Disposal Method	Treated effluent is disposed of through onsite percolation ponds. Disposal is rotated between the four percolation ponds so that maintenance can be conducted on each pond as it is rotated out of service. There are two additional inactive ponds located to the east of the main Wastewater Plant at the former Ridgemark II Plant. These additional two ponds can accept flow for percolation if needed.
	Disposal capacity (gpd): 840,000
Emergency Storage	The Wastewater Plant can store raw sewage in two decommissioned ponds at the former Ridgemark II Plant in an emergency. The liner has been unconfirmed to conform with the General Permit's requirements for existing storage ponds. An investigation will be conducted to determine the two ponds liner condition.
Biosolids/Sludge Production and Handling	Sludge from the SBR undergoes further anaerobic treatment in a sludge storage tank. Solids are then pumped into one of four 23,100 square foot concrete lined sludge drying beds. Once sludge is sufficiently dried, they are tested and removed to a landfill.
	Annual production of biosolids: 48.1 tons

	The ultimate destination of biosolids produced is John Smith Landfill located at 2650 John Smith Road, Hollister	
Non-Potable Recycled Water	Non-potable recycled water produced onsite:	Wastewater System does NOT produce non-potable recycled water.

3. WASTEWATER SYSTEM SPECIFIC REQUIREMENTS AND LIMITATIONS

Sunnyslope County Water District must operate the Wastewater System in accordance with the General Permit and this notice of applicability. Sunnyslope County Water District must comply with the wastewater specific limitations specified in Table 3 through 5.

Table 3. Flow Limitations

Flow	Units	Limit	Point of Compliance
Maximum Daily Average	Gallons per day	350,000	Influent
Maximum Effluent (to disposal area)	Gallons per day	840,000	Effluent

Table 4. Effluent Limitations: Activated Sludge

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Biochemical Oxygen Demand, 5-Day	mg/L ^[1]	30	45	Not Applicable
Total Suspended Solids	mg/L	30	45	Not Applicable
Settleable Solids	mL/L ^[3]	0.1	0.3	0.5
pH	Standard Units	Between 6.5 and 8.4	Not Applicable	Not Applicable

[1] mg/L denotes milligrams per liter

A. Groundwater Limitations:

Based on review of historical data, Sunnyslope County Water District is unable to comply with the General Permit effluent limitations for constituents specified in Table 4 and thus the point of compliance for these constituents will be underlying groundwater. Through groundwater monitoring, Sunnyslope County Water District must demonstrate that the discharge does not cause underlying groundwater to exceed the water quality objectives set forth in the Basin Plan including the limitations listed in Table 5.

Table 5. Groundwater Limitations for Designated Groundwater Basins - Pajaro Valley Hollister

Constituents	Units	25-Month Rolling Median^[2]
Total Dissolved Solids	mg/L ^[1]	1200
Chloride	mg/L	150
Sodium	mg/L	200
Sulfate	mg/L	250
Boron	mg/L	1
Total Nitrogen	mg/L	5

[1] mg/L denotes milligrams per liter

[2] Rolling Median is the median from all data collected over the most recent 25 months

**ATTACHMENT 2
FIGURES**

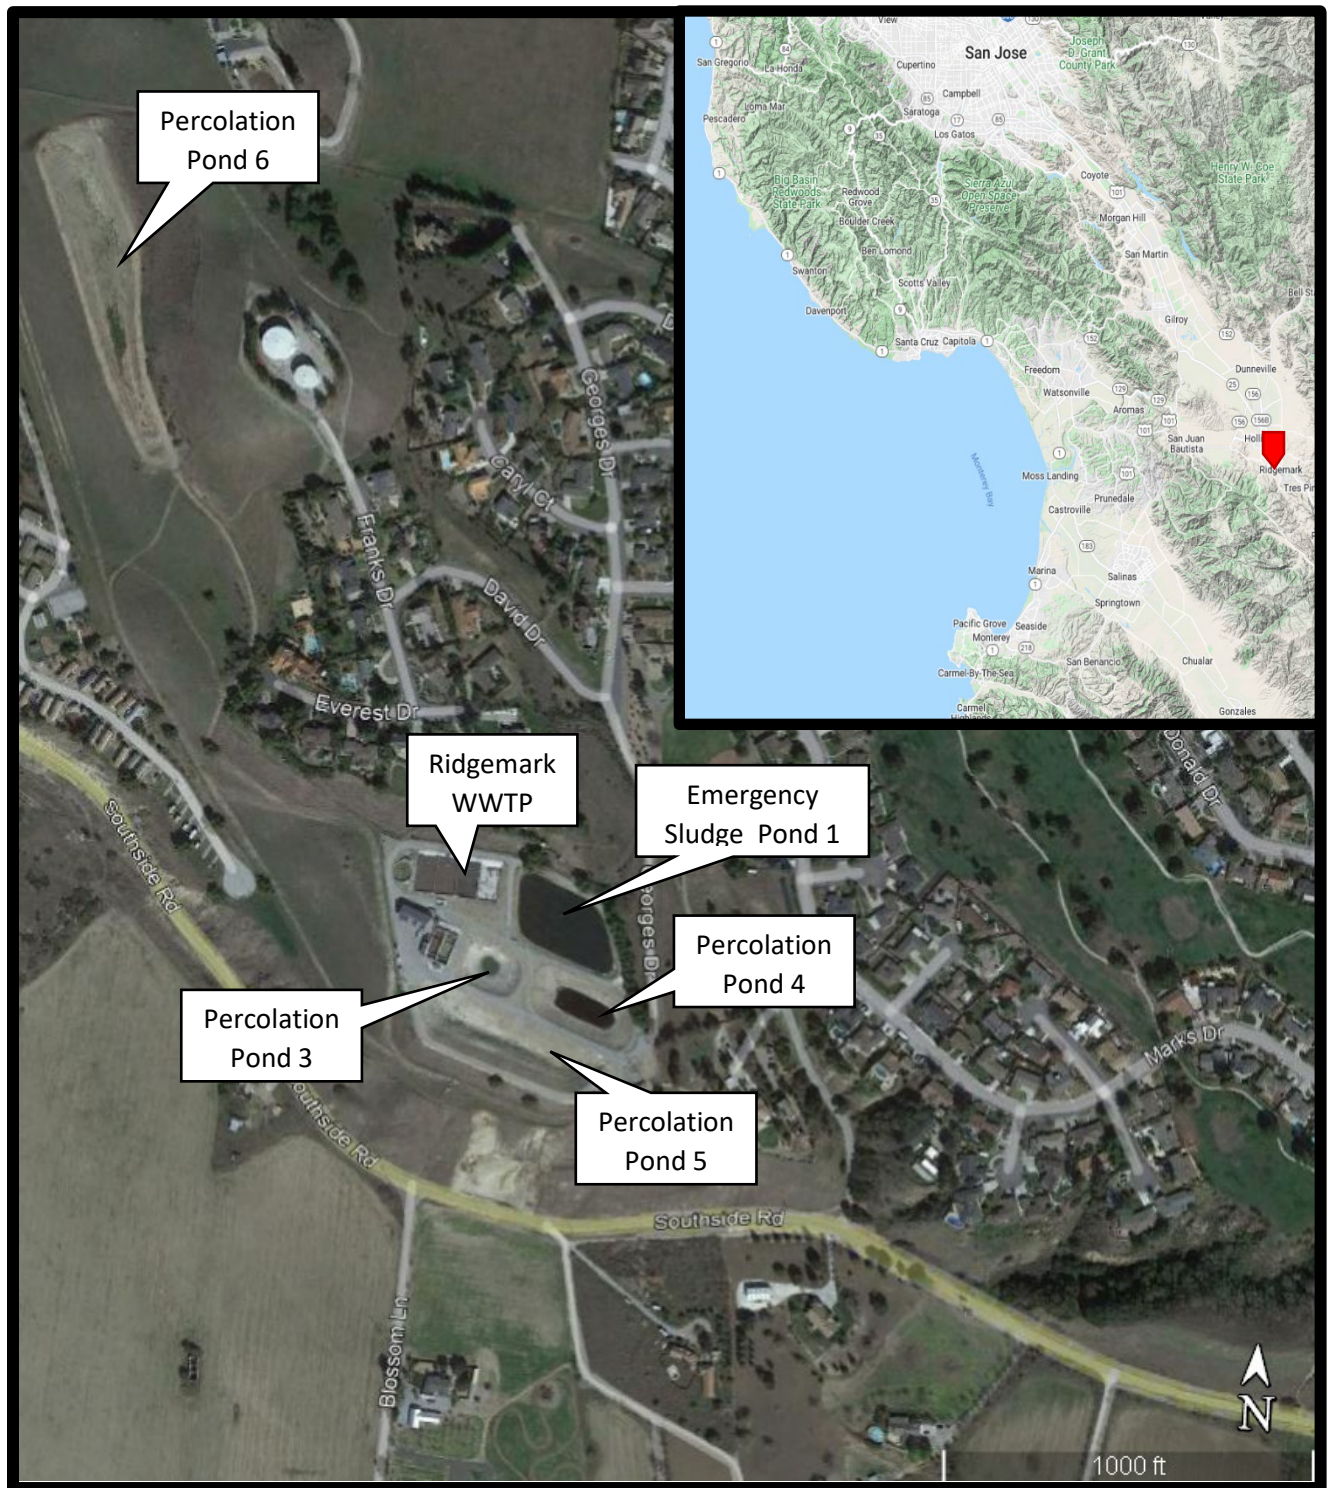


FIGURE 1. SITE LOCATION



FIGURE 2. FACILITY AERIAL MAP

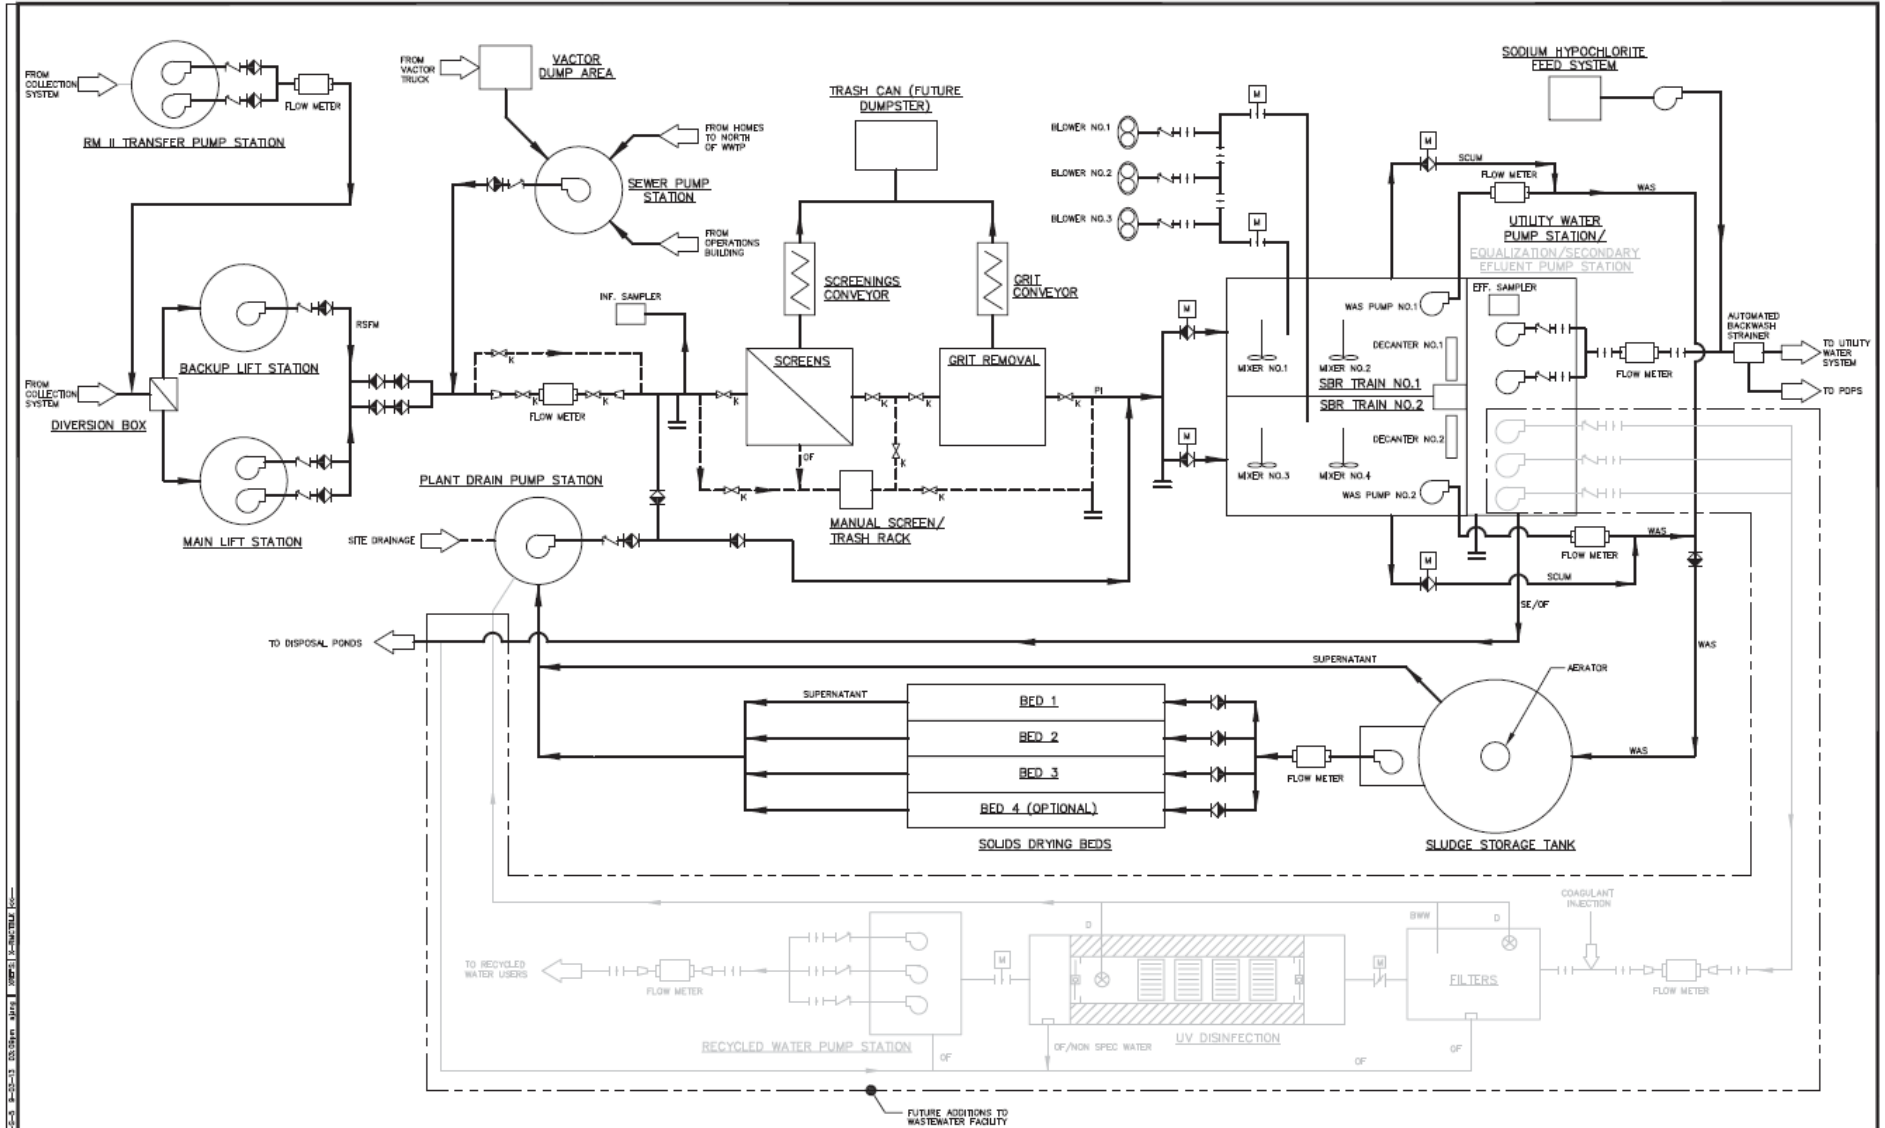


FIGURE 3. PROCESS FLOW DIAGRAM

ATTACHMENT 3
MONITORING AND REPORTING PROGRAM

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

**MONITORING AND REPORTING PROGRAM ORDER NO. R3-2022-0033
(MODIFICATION OF MRP ORDER NO. R3-2020-0020)**

FOR

**RIDGEMARK ESTATES WASTEWATER TREATMENT FACILITY
HOLLISTER, SAN BENITO COUNTY**

This Monitoring and Reporting Program (MRP) applies to the monitoring and reporting requirements for Ridgemark Estates Wastewater Treatment Facility (Wastewater System) enrolled in *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

Sunnyslope County Water District owns and operates the Wastewater System that is subject to the General Permit and notice of applicability. Sunnyslope County Water District must not implement any changes to this MRP unless and until a revised MRP is issued by the Central Coast Regional Water Quality Control Board (Central Coast Water Board).

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The MRP directs Sunnyslope County Water District to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board's GeoTracker database (see MRP section VII.D).

I. SAMPLING AND ANALYSIS

Sunnyslope County Water District must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Water Board. All samples (e.g., wastewater, groundwater, soil, sludge, etc.) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the

Operations and Maintenance Manual for Central Coast Water Board review and approval.

- A. Sampling Schedule** – Unless otherwise specified below, sampling must be performed in accordance with Table 1,

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Quarterly	January, April, July, and October
Semiannual	April and October
Annual	October

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity, etc.) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

- B. Monitoring Location Descriptions** – All samples including influent samples (IS), effluent samples (ES), groundwater monitoring well (MW), etc. must be collected at the locations described in Figure 1 and Table 2. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. Sunnyslope County Water District must upload the GeoTracker field point information once for each sampling location in the GeoTracker database (see Table 10).

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Influent Sample	IS-1	Raw wastewater sample collected at the headworks
Effluent Sample	ES-1	Treated wastewater sample collected downstream of the SBR process prior to disposal
Monitoring Well 1	MW-1	North of WWTP

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Monitoring Well 2	MW-2	Southeast of MW-5
Monitoring Well 3	MW-3	East of WWTP, Southwest of MW-6
Monitoring Well 4	MW-4	South of MW-1, North of WWTP
Monitoring Well 5	MW-5	Southeast Corner of WWTP
Monitoring Well 6	MW-6	East of WWTP Near Ridgemark II Lift Station

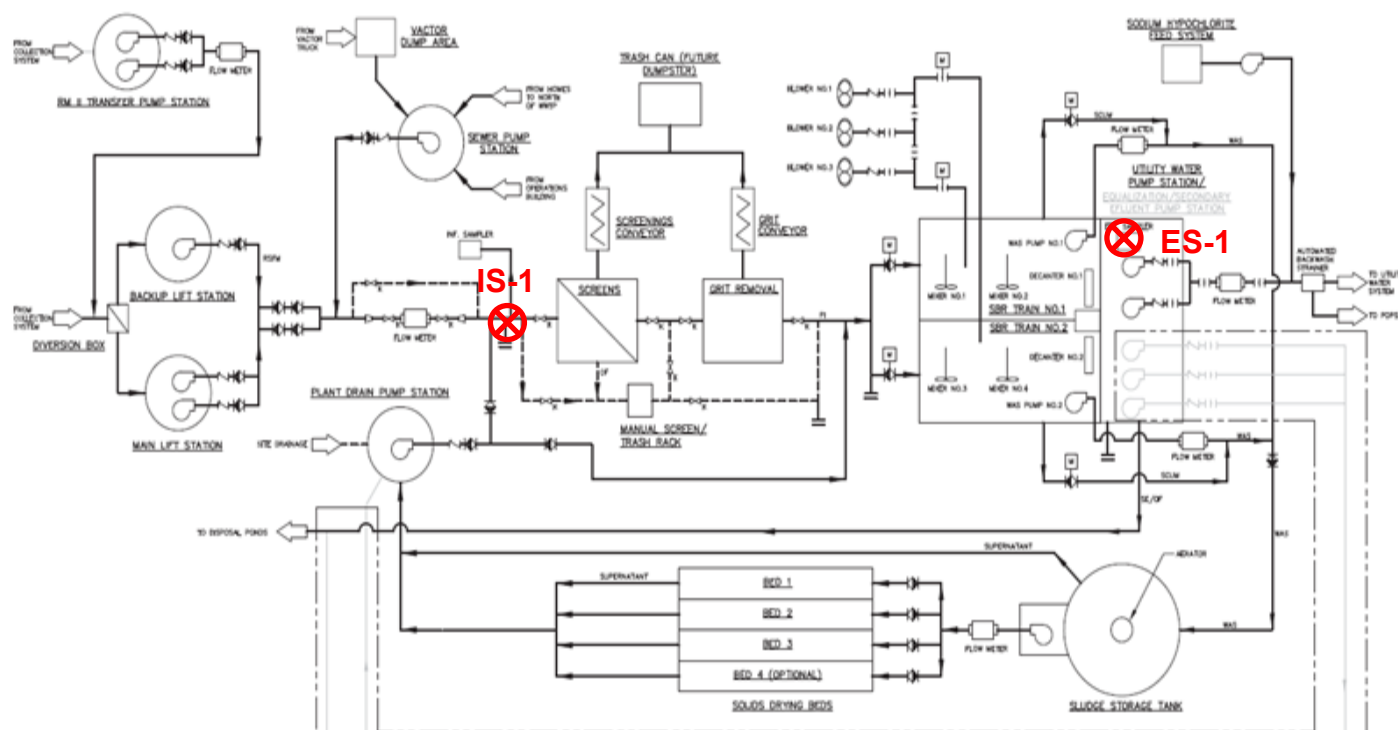


Figure 1. Process Flow Diagram and Sample Locations Referenced in Table 2

II. WATER SUPPLY MONITORING

Representative samples of Sunnyslope County Water District's potable water supply (sampled before use or treatment) must be collected and analyzed, at a minimum, for constituents specified in Table 3.

In lieu of the required water supply sampling, Sunnyslope County Water District may request Central Coast Water Board approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county, provided, at a minimum, all of the required constituents are sampled at

the frequency specified Table 3. Sunnyslope County Water District must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 3. Sunnyslope County Water District must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Sunnyslope County Water District must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring

Constituent	Units ^[1]	Sample Type	Sampling Frequency ^[2]
Nitrate (as N)	mg/L	Grab	Annually
Total Dissolved Solids	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

[1] mg/L denotes milligrams per liter

III. INFLUENT AND EFFLUENT MONITORING

A. Influent and Effluent Monitoring – At a minimum, influent and effluent flow and constituent monitoring must be consistent with Tables 4 and 5. See MRP section VII.B.3 for supplemental volumetric annual reporting requirements established by the State Water Board.

Table 2. Influent and Effluent Flow Monitoring

		INFLUENT	INFLUENT	EFFLUENT	EFFLUENT
Parameter	Units	Sample Type	Reporting Frequency	Sample Type	Reporting Frequency
Daily Flow ^[1]	Gallons per day	Metered	Daily	Metered	Daily

		INFLUENT	INFLUENT	EFFLUENT	EFFLUENT
Parameter	Units	Sample Type	Reporting Frequency	Sample Type	Reporting Frequency
Maximum (Peak) Daily Flow	Gallons per day	Metered	Monthly	Metered	Monthly
Mean Daily Flow	Gallons per day	Calculated	Monthly	Calculated	Monthly

[1] The General Permit notice of applicability specifies the Wastewater System's permitted flow. In the monitoring reports, Sunnyslope County Water District must evaluate and provide a comparison of monitored flow to the permitted flow.

Table 5. Influent and Effluent Quality Monitoring

		INFLUENT (IS)	INFLUENT (IS)	EFFLUENT (ES)	EFFLUENT (ES)
Constituent	Units	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
pH	Standard Units	Grab	Weekly	Grab	Weekly
Biochemical Oxygen Demand, 5-Day	mg/L ^[1]	24-hour composite	Quarterly	24-hour composite	Monthly
Total Suspended Solids	mg/L	24-hour composite	Quarterly	24-hour composite	Monthly
Settleable Solids	mg/L	Not Applicable	Not Applicable	24-hour composite	Monthly
Total Nitrogen ^[2]	mg/L	Calculated	Quarterly	Calculated	Monthly
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	24-hour composite	Quarterly	24-hour composite	Monthly
Total Kjeldahl Nitrogen (as N)	mg/L	24-hour composite	Quarterly	24-hour composite	Monthly
Ammonia (as N)	mg/L	24-hour composite	Quarterly	24-hour composite	Monthly
Total Dissolved Solids	mg/L	24-hour composite	Quarterly	24-hour composite	Monthly
Chloride	mg/L	24-hour composite	Quarterly	24-hour composite	Monthly
Sodium	mg/L	24-hour composite	Quarterly	24-hour composite	Monthly
Sulfate	mg/L	24-hour composite	Quarterly	24-hour composite	Monthly
Boron	mg/L	Not Applicable	Not Applicable	24-hour composite	Monthly

		INFLUENT (IS)	INFLUENT (IS)	EFFLUENT (ES)	EFFLUENT (ES)
Constituent	Units	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Carbonate	mg/L	Not Applicable	Not Applicable	24-hour composite	Semiannually
Bicarbonate	mg/L	Not Applicable	Not Applicable	24-hour composite	Semiannually
Calcium	mg/L	Not Applicable	Not Applicable	24-hour composite	Semiannually
Potassium	mg/L	Not Applicable	Not Applicable	24-hour composite	Semiannually
Magnesium	mg/L	Not Applicable	Not Applicable	24-hour composite	Semiannually

[1] mg/L denotes milligrams per liter

[2] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

IV. WASTEWATER DISPOSAL MONITORING

Sunnyslope County Water District must monitor all wastewater disposal areas when wastewater is applied. Inspections must be conducted and documented at least weekly during operation and during and after rain events. Notations must be made in a bound logbook and include observations of bank/soil erosion, excessive odors, insects, or other potential nuisance conditions that may be present. Any problems must be promptly corrected and recorded. A log of these inspections must be maintained onsite and made available to Central Coast Water Board upon inspection.

Sunnyslope County Water District must evaluate and summarize wastewater disposal application rates, loading rates (pounds/acre/day), violations found during the inspections, etc. with each monitoring report.

Wastewater disposal monitoring must be consistent with Table 6.

A. Disposal Pond System Monitoring - All treated wastewater disposal ponds must be monitored as specified in Table 6.

Table 6. Disposal Pond Monitoring

Parameter/ Constituent	Units^[1]	Sample Type	Sampling/ Monitoring Frequency
Freeboard	0.1 feet	Measured	Weekly
pH	Standard Units	Grab	Weekly
Dissolved Oxygen (in pond)	mg/L	Grab	Monthly

Parameter/ Constituent	Units ^[1]	Sample Type	Sampling/ Monitoring Frequency
Nuisance Odors/Vectors	Not Applicable	Observation	Weekly
Berm condition	Not Applicable	Observation	Monthly
Precipitation	inches/day and date	Measured ^[2]	Each precipitation event
Evaporation	inches/day	Measured ^[2]	Daily
Application Rate	Gallons per day	Metered/Estimated ^[3]	Daily
Acreage Applied ^[4]	Acres	Measured	Monthly
Biochemical Oxygen Demand, 5-Day (BOD) Applied ^[5]	lbs/acre/day	Calculated	Monthly
Total Nitrogen Applied ^[5]	lbs/acre/day	Calculated	Monthly
Salts Applied ^[5] (total dissolved solids, sodium, chloride, sulfate, boron)	lbs/acre/day	Calculated	Monthly
Soil Erosion Evidence	Not Applicable	Observation	Monthly

[1] mg/L denotes milligrams per liter

[2] Sunnyslope County Water District must use an onsite rain gauge/evaporation pan or a nearby governmental weather reporting station.

[3] Requires meter reading, a pump run time meter, or other approved method. If the flow is estimated, Sunnyslope County Water District is required to provide an explanation (e.g., no meter- estimated using pump operations including rate and time) with each monitoring report.

[4] Acreage applied denotes the acreage to which wastewater is applied.

[5] The total nitrogen, salts, and BOD applied loading rates must be calculated from wastewater flow volumes, applied acreage, and concentrations reported in effluent analytical testing as follows: **Total Nitrogen/Salts/BOD Applied (pounds/acre/ day) =**

$$\frac{X \text{ [mg/L]} \times Q \text{ [million gallons per day]} \times 8.34 \text{ [(conversion from mg/L to pounds/million gallons per day]}}{\text{Acreage Applied [acres]}}$$

Where X = Total nitrogen, salts, or BOD concentration

Where Q = Application Rate (often effluent flow rate)

V. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

Sunnyslope County Water District must report the handling and disposal of all sludge/biosolids generated at the Wastewater System. Records must include the date removed from the Wastewater System, name/contact information for the hauling

company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

Sunnyslope County Water District must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

If sludge/biosolids are not removed during the year, Sunnyslope County Water District must explain the absence of this monitoring in the annual report.

VI. GROUNDWATER MONITORING

Groundwater Monitoring Program – Sunnyslope County Water District has chosen General Permit option for groundwater monitoring. Under this option, if Sunnyslope County Water District discharges in excess of effluent limitations specified in Table 6 of the General Permit¹, Sunnyslope County Water District must implement a groundwater monitoring program to demonstrate compliance with the groundwater limitations in the notice of applicability and water quality objectives specified in the Basin Plan. Groundwater monitoring reports, workplans, etc., that interpret groundwater data must be prepared and stamped by a California licensed civil engineer or professional geologist.

Prior to sampling, depth to groundwater must be measured and groundwater elevations¹ must be calculated. The monitoring wells must be purged of at least three well volumes and until measurements of the following parameters have stabilized (i.e., are reproducible within 10 percent): pH, temperature, dissolved oxygen, electrical conductivity, and turbidity. No-purge, low-flow, or other sampling techniques are acceptable if they are described in the Central Coast Water Board approved sampling and analysis plan. Once the groundwater level in each of the wells has recovered sufficiently to ensure the collection of representative groundwater samples, a qualified individual (e.g., consultant, technician, etc.) trained in using proper sampling methods must recover samples using approved USEPA methods. Laboratories analyzing groundwater samples must be accredited by the State Water Board Environmental Laboratory Accreditation Program, in accordance with California Water Code section 13176, and must include quality assurance/quality control data with their reports.

Sunnyslope County Water District must provide monitoring well field sheets and report monitoring data, as described in Table 7, with each monitoring report. If the groundwater monitoring well is found to be dry, so shall the report state.

¹ The locations and top-of-casing elevations for the existing groundwater monitoring wells must be surveyed by a licensed land surveyor if not already completed at the time of installation.

All monitoring wells listed in Table 2 must be, at a minimum, sampled and analyzed as specified in Table 7 and the Central Coast Water Board approved sampling and analysis plan (see section VI.A.2.i of the General Permit).

Table 7. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Elevation ^[4]	0.01 feet msl	Calculated	Quarterly
Depth to Groundwater ^[4]	0.01 feet bgs	Measurement	Quarterly
Gradient	feet/feet	Calculated	Quarterly
Groundwater Flow Direction ^[5]	degrees	Calculated	Quarterly
Total Nitrogen ^[6]	mg/L ^[1]	Calculated	Quarterly
Nitrate (as N)	mg/L	Grab	Quarterly
Nitrite (as N)	mg/L	Grab	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Grab	Quarterly
Ammonia (as N)	mg/L	Grab	Quarterly
Total Dissolved Solids	mg/L	Grab	Quarterly
Chloride	mg/L	Grab	Quarterly
Sodium	mg/L	Grab	Quarterly
Sulfate	mg/L	Grab	Quarterly
Boron	mg/L	Grab	Quarterly
Carbonate	mg/L	Grab	Semiannually
Bicarbonate	mg/L	Grab	Semiannually
Calcium	mg/L	Grab	Semiannually
Potassium	mg/L	Grab	Semiannually
Magnesium	mg/L	Grab	Semiannually
pH	pH Units	Grab	Quarterly
Dissolved Oxygen	mg/L	Grab	Quarterly
Electrical Conductivity	µS/cm ^[2]	Grab	Quarterly

Constituent	Units	Sample Type	Sampling Frequency
Oxidation Reduction Potential	mV ^[3]	Grab	Quarterly
Temperature	degrees Celsius	Grab	Quarterly

[1] mg/L denotes milligrams per liter

[2] μ S/cm denotes microsiemens per centimeter

[3] mV denotes millivolts

[4] ft.msl denotes feet above mean sea level and ft bgs denotes feet below ground surface

[5] Calculations must be prepared by, or under the responsible charge of, a California licensed professional.

[6] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

VII. REPORTING REQUIREMENTS

A. TECHNICAL REPORTS

The technical reports are due as described in Table 8.

Table 38. Technical Report Submittal Due Dates

Report	Report Due Date ^[1]
Operations and Maintenance Manual	12 months
Climate Change Adaptation Plan	24 months
Updated/revised Salt and Nutrient Management Plan	24 months
Former Ridgemark II Pond (Emergency Storage) Liner Evaluation ^[2]	12 months

[1] Reports are due within the time specified after issuance of notice of applicability to Sunnyslope County Water District (May 27, 2022)

[2] As per General Permit Section IV.B.1

- 1. Operations and Maintenance Manual** – In addition to the required components specified in Standard Provisions² A.12 and A.28 (and any updates to the Standard Provisions) and General Permit section VI.A.2, the Operations and Maintenance Manual must contain the following components. Each component

² See Attachment E, Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

must contain an implementation schedule and identification of adequate funding to implement the component.

- i. **Sampling and Analysis Plan** – Sunnyslope County Water District's Operation and Maintenance Manual must contain a sampling and analysis plan that meets the requirements specified herein. Anyone performing sampling on behalf of Sunnyslope County Water District must be familiar with the sampling and analysis plan. At a minimum, the sampling and analysis plan must contain the following:
 - a. A wastewater treatment process flow schematic with the monitoring locations labeled and scaled Wastewater System maps with treatment components, discharge locations (both treated wastewater and non-potable recycled water), monitoring locations, groundwater wells, storage locations (e.g., chemical, sludge, emergency overflow ponds, etc.), buildings, etc. (if Sunnyslope County Water District needs to update Figure 1 to comply with this requirement, a copy of the updated process flow schematic will also be included with the annual report).
 - b. Sample identification details in tabular format. The table must include the sample titles, GeoTracker field point information, sample description(s), and sampling frequencies.
 - c. Sample chain-of-custody procedures and documentation.
 - d. Sample handling/preservation procedures.
 - e. A description of the analytical methods.
 - f. A description of sample containers, preservatives, and holding times.
 - g. For water supply monitoring, a description of the location and method of data collection (e.g., onsite well sampling, use of consumer confidence report, etc.).

For groundwater monitoring, a description of the well purging and field methods.
- ii. **Sludge Management Plan** – Sunnyslope County Water District's Operation and Maintenance Manual must contain a sludge management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the plan must describe the following:
 - a. An estimated volume/amount and quality of sludge and scum that will be generated.
 - b. How sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.
 - c. If sludge will be subject to further treatment, describe the treatment and storage requirements.

- d. Procedures for cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.
- iii. **Wastewater Disposal Management Plan –** Sunnyslope County Water District's Operation and Maintenance Manual must contain a wastewater disposal management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the wastewater disposal management plan must include:
 - a. A description of the wastewater disposal area and a map denoting acreage.
 - b. Loading calculations based on flow volumes, applied acreage, and biochemical oxygen demand, salts (total dissolved solids, sodium, chloride, sulfate, boron), and nitrogen analytical results.
 - c. A description of wastewater disposal and water quality protection practices.
- iv. **Spill Prevention and Emergency Response Plan –**Sunnyslope County Water District's Operation and Maintenance Manual must contain a spill prevention and emergency response plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. The spill prevention and emergency response plan must describe operation and maintenance activities to prevent accidental releases of wastewater and to effectively respond to such releases and minimize the environmental impact. At a minimum, the spill prevention and emergency response plan must address the following:
 - a. Operation and Control of Wastewater System - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.
 - b. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.
 - c. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order No. 2006-0003-DWQ, Statewide General Waste Discharge Requirements for Sanitary Sewer Systems (or its replacement), reports prepared to comply with State Water Board Order No. 2006-0003-DWQ satisfy this requirement.

- d. **Emergency Response** - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater treatment, storage, or disposal ponds or treated non-potable recycled water storage ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.
 - e. **Finance** - At a minimum, discuss current fees, projected fees, current budget for spill prevention and emergency response, projected budget for spill prevention and emergency response.
 - f. **Notification Procedures** - Coordination procedures with fire, police, Governor's Office of Emergency Services (CalOES), Central Coast Water Board, and local county health department personnel.
 - v. **Training Records Log** – Sunnyslope County Water District's Operation and Maintenance Manual must contain updated training records logs that demonstrates Sunnyslope County Water District is complying with General Permit section VI.B.3.
2. **Climate Change Adaptation** –The Climate Change Adaptation Plan must, at a minimum, include the following components:
- i. **Hazards and Vulnerabilities** – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using up-to-date tools, data, and guidance from the State of California (e.g., Cal-Adapt³, Sea-Level Rise Guidance from Ocean Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California Climate Assessment Regional Reports), assess the Wastewater System's vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities.

³ Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor's Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

- a. Sea Level Rise – Saltwater intrusion, flooding and inundation, and increased coastal erosion.
 - b. Precipitation Pattern Changes.
 - I. Drought – Decreased influent quantity and quality.
 - II. Peak Events – Flooding and increased influent quantity.
 - c. Temperature fluctuations and extremes.
 - d. Increased wildfires.
 - e. Increased power outages.
 - ii. Resiliency Actions – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.
3. **Salt and Nutrient Management Plan** – If directed by the Central Coast Water Board pursuant to California Water Code section 13267, Sunnyslope County Water District must prepare and submit a Salt and Nutrient Management Plan to ensure that the overall impact of treated wastewater and/or non-potable water recycling projects does not degrade groundwater resources. At a minimum, the salt and nutrient management plan must address the following:
- i. An outline and description of an implementable salt and nutrient management program to reduce mass loading of salts and nutrients (with an emphasis on nitrogen species) in treated effluent to a level that will ensure compliance with effluent limitations and protect beneficial uses of groundwater.
 - a. A description of salt reduction measures that identify and focus on all potential salt contributors to the collection system (e.g., water supply, commercial, industrial, residential, etc.) and wastewater treatment process.
 - b. A description of nutrient reduction measures that focus on source control and optimizing wastewater treatment processes for nitrogen removal.

B. QUARTERLY AND ANNUAL MONITORING REPORTS

Quarterly and annual monitoring reports are due as described in Table 9.

Table 9. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	May 1
Second Quarter Monitoring Report	April 1 to June 30	August 1

Report	Monitoring Period	Report Due Date
Third Quarter Monitoring Report	July 1 to September 30	November 1
Fourth Quarter Monitoring Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

1. **Quarterly Monitoring Reporting** – At a minimum, the quarterly reports must include:
 - i. Results of all required monitoring in tabular format.
 - ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
 - iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. **Sunnyslope County Water District must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.
 - iv. Copies of laboratory analytical report(s) and chain of custody form(s).
 - v. Copies of groundwater monitoring well field sheets with purge methods and data.
2. **Annual Reporting** – Sunnyslope County Water District must submit annual reports in compliance with Standard Provisions 2013⁴, (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by Central Coast Water Board.
 - i. An updated hydrogeologic conceptual site model with the groundwater monitoring reporting requirements based on new information generated from the monitoring well boring logs, groundwater elevation data, water quality data, etc.

⁴ See Attachment E, Standard Provisions, 2013:
https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

The current annual report template can be found here:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

3. **State Water Board Volumetric Annual Reporting** – Sunnyslope County Water District must electronically certify and submit a summary of the monthly influent and effluent flow volume by April 30th of each calendar year via the State Water Board's Internet GeoTracker database⁵.

The following information is required:

- i. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e. total monthly influent volume).
- ii. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.
- iii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website⁶.

C. VERBAL NON-COMPLIANCE REPORTING:

Sunnyslope County Water District must verbally notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, the conditionally accepted wastewater containment failure, pursuant to General Permit section VI.C.2.

D. ELECTRONIC GEOTRACKER SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permiiting/docs/transmittal_sheet.pdf

⁵ See: <https://geotracker.waterboards.ca.gov/>

⁶ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

Sunnyslope County Water District must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker^{7,8} database consistent with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System-specific global identification number WDR100034585 at:

<https://geotracker.waterboards.ca.gov/esi/login>

For general questions, please contact the GeoTracker Help Desk at:

Geotracker@waterboards.ca.gov.

Table 10 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

Table 40. GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your California ELAP-accredited laboratory staff to upload, all EDF laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.

⁷ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

⁸ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Electronic Submittal	Description of Action	Action	Frequency
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.
Field Points, Location Data (Geo XY) ^[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.” These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.
Elevation Data (Geo Z) ^[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Wastewater System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. Sunnyslope County Water District must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

VIII. LEGAL REQUIREMENTS

All technical and monitoring reports submitted pursuant to this MRP are required pursuant to section 13267 of the California Water Code. Failure to submit reports in accordance with schedules established by this General Permit or attachments to this General Permit, or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board, may subject Sunnyslope County Water District to enforcement action pursuant to section 13268 of the California Water Code.

California Water Code section 13267 states, in part:

“In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports and shall identify the evidence that supports requiring that person to provide the reports.”

California Water Code section 13268 states, in part:

“(a) Any person failing or refusing to furnish technical or monitoring program reports as required by subdivision (b) of section 13267, or failing or refusing to furnish a statement of compliance as required by subdivision (b) of section 13399.2, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in accordance with subdivision (b).

(b)(1) Civil liability may be administratively imposed by a regional board in accordance with article 2.5 (commencing with section 13323) of chapter 5 for a violation of subdivision (a) in an amount which shall not exceed one thousand dollars (\$1,000) for each day in which the violation occurs.”

The technical and monitoring reports required by this General Permit, the notice of applicability, and this MRP are necessary to ensure compliance with this General Permit. The evidence supporting the need for the reports are contained in the information provided by Sunnyslope County Water Districts subject to this General Permit and in the files of the Central Coast Water Board. The burden and cost of preparing the monitoring and technical reports is reasonable and consistent with the interest of the state in maintaining water quality. The reports are necessary to ensure that Sunnyslope County Water District complies with the notice of applicability and General Permit. Pursuant to California Water Code section 13267, Sunnyslope County Water District must implement this MRP and must submit the monitoring and technical reports described herein.

Sunnyslope County Water District must implement the above monitoring program as of the date of this MRP. The Central Coast Water Board may rescind or modify this MRP at any time.

MRP No. R3-2022-0033
Ridgemark Estates, Hollister

May 27, 2022

Ordered By:

Jennifer Epp  Digitally signed by Jennifer Epp
Date: 2022.05.27 09:09:46 -07'00'

for Matthew T. Keeling
Executive Officer

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\San Benito Co\Sunnyslope WD-
Ridgemark Estates\Big Order Enrollment\0020_NOA&MRP_
Ridgemark_Estates\FInal\Ridgemark Estates MRP R3-2022-00331-Jepp.docx
Last modified: 01/10/2022