

Central Coast Regional Water Quality Control Board

October 18, 2022

Sent Via Electronic Mail

William Stephen "Steve" MacElvaine
Rancho Colina Mutual Water Company
1045 Atacadero Road
Morro Bay, CA 93442
Email: smacelvaine@live.com

Dear William Stephen "Steve" MacElvaine,

RANCHO COLINA MUTUAL WATER COMPANY WASTEWATER TREATMENT FACILITY, 1045 ATASCADERO ROAD, MORRO BAY, CA 93442, SAN LUIS OBISPO COUNTY:

- **NOTICE OF APPLICABILITY FOR RANCHO COLINA MUTUAL WATER COMPANY, ENROLLMENT IN *ORDER WQ 2014-0153-DWQ, GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS***
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2022-0071**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER NO. 87-110**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the Form 200, May 2022 Report of Waste Discharge (received on May 18, 2022), and available documents associated with the domestic wastewater treatment system at Rancho Colina Mutual Water Company Wastewater Treatment Facility (Rancho Colina Mutual Water Company WWTF) owned by Rancho Colina Mutual Water Company. The wastewater system is currently regulated pursuant to Order No. 87-110. On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order No. 87-110.

This letter serves as a notice of applicability for Rancho Colina Mutual Water Company's enrollment in the General Permit for the discharge of wastewater from the Rancho Colina Mutual Water Company WWTF.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

Rancho Colina Mutual Water Company must comply with the following:

1. **General Permit** – Rancho Colina Mutual Water Company must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. **Monitoring and Reporting Program** – Rancho Colina Mutual Water Company must comply with the requirements of Monitoring and Reporting Program No. R3-2022-0071, enclosed with this letter (Attachment 3). Your first semiannual report is due on **February 1, 2023**.

Monitoring reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

Rancho Colina Mutual Water Company must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{1,2} database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system-specific global identification number WDR100032825 at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

3. **Fees** – Rancho Colina Mutual Water Company paid an annual fee on December 22, 2021 for coverage in the existing individual permit, Order No. 87-110. This payment covers permit fees for the 2021-2022 fiscal year.

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

² Additional information available at: <http://geotracker.waterboards.ca.gov/>

Rancho Colina Mutual Water Company must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee program and cover the state fiscal year of July 1 through June 30. Your annual fee is currently \$12,344. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 2B and is receiving a 50% fee reduction for domestic discharges less than 50,000 gallons per day.

A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on December 8-9, 2022. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.
6. **Responsible Party** – Rancho Colina Mutual Water Company is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects Rancho Colina Mutual Water Company to enforcement action and termination of enrollment under this General Permit.
7. **Change in Ownership** – In the event of any change in control or ownership of the property, Rancho Colina Mutual Water Company must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.
8. **Certified Operator** – Rancho Colina Mutual Water Company is required to comply with the operator certification requirements³ administered by the State Water Board's Office of Operator Certification, which currently requires a Class III

³ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

certified operator onsite to maintain and operate the treatment system. Rancho Colina Mutual Water Company submitted an executed service agreement to the Central Coast Water Board with Fluid Resource Management, who will provide an appropriately certified operator who will perform required maintenance, sampling, and reporting to the Central Coast Water Board.

If you have any questions, please contact **James Bishop at (805) 542-4628 or by email at James.Bishop@Waterboards.ca.gov**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

for Matthew T. Keeling
Executive Officer

Attachments:

- Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations
- Attachment 2: Figures
- Attachment 3: Monitoring and Reporting Program No. R3-2022-0071

cc:

Cara Aguiar, Fluid Resource Management, caguiar@frm-ops.com
James Bishop, James.Bishop@Waterboards.ca.gov
Jesse Woodard, Jesse.Woodard@waterboards.ca.gov
Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov
WDR Program, RB3-WDR@Waterboards.ca.gov, GeoTracker

ECM/CIWQS = CW-251631

GeoTracker No. = GT- WDR100032825

Rev 6/16/22

Subject Name = Rancho Colina Mutual Water Company Wastewater Permit
R:\RB3\Shared\WDR\WDR Facilities\San Luis Obispo Co\Rancho Colina Mobile Home Estates\0153 Enrollment\Ranch Colina Mail Merge NOA.docx

ATTACHMENT 1

**WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC
REQUIREMENTS AND LIMITATIONS**

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by Rancho Colina Mutual Water Company to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	Rancho Colina Mutual Water Company Wastewater Treatment Facility
Facility Address	1045 Atascadero Road Morro Bay, CA 93442
Parcel Numbers	073-085-027
Latitude/Longitude	35.394745/-120.836973
Onsite Manager	William Stephen "Steve" MacElvaine
Owner of Facility	Rancho Colina Mutual Water Company
Legally Responsible Official of Owner	William Stephen "Steve" MacElvaine
Owner Mailing Address	1045 Atascadero Road Morro Bay, CA 93442
Billing Address	1325 Atascadero Road Morro Bay, CA 93442
Design Flow (gallons per day, gpd)	Maximum daily capacity (dry weather flow) 35,000
Baseline Flow (average annual flow) in gpd	13,600
Operators	Fluid Resources Management and William Stephen "Steve" MacElvaine
Waste type and Service Area	Domestic wastewater from 69 mobile homes and up to 57 recreational vehicles (RVs)
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR

Reclamation Included	No
EPA Approved Pretreatment Program	No

2. WASTEWATER SYSTEM OPERATION SUMMARY

The treatment system consists of coarse screening, extended aeration, settling, chlorination, and discharge to a holding pond. From the holding pond, wastewater is disposed via spray irrigation on a hillside west of the treatment facility. Sludge is stored onsite in a polyethylene tank. From the polyethylene tank, sludge will either be dried on site in a concrete-lined drying bed and the dried biosolids taken to an authorized biosolids disposal facility or pumped from the polyethylene tank as sludge and hauled off site for disposal by a septic pumping service. A summary of the system is included in Table 2 below. A facility site map and dispersal system layout are shown in Attachment 2.

Table 2. Permitted Treatment, Disposal Technologies, and Capacity

Design Flows	Design Influent Maximum Daily Flow 35,000 gallons per day Design Influent Average Flow 24,000 gallons per day
Headworks/Preliminary Treatment	Preliminary/primary treatment is provided via coarse bar screening at the headworks.
Treatment	Secondary treatment is provided through extended aeration and clarification processes.
Disinfection	Disinfection is conducted through manual addition of chlorine tablets to the clarification tanks when operators are onsite (five days per week).
Effluent Storage	270,000 clay-lined storage basin.
Disposal	Treated wastewater effluent is disposed of via spray irrigation on a hillside west of the treatment facility. Spray irrigation occurs over an area of approximately three acres.
Biosolids/Sludge Production and Handling	Sludge stored in 5,000 gallon polyethylene tank. Sludge will either be dried on concrete drying beds onsite and then hauled off or be hauled off site via septic pumps.
Wastewater Effluent Design Goals¹	TSS < 30 mg/L mg/L BOD < 30 mg/L mg/L

¹ These are design goals, and should be used to evaluate system performance, not compliance. Compliance with Title 22 recycled water limits is not required as treated wastewater is disposed subsurface and public contact is not occurring.

3. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

Rancho Colina Mutual Water Company must operate the facility in accordance with the General Permit¹ and this notice of applicability.² Rancho Colina Mutual Water Company must operate the system to comply with the effluent limits below.

A. Effluent limits

Rancho Colina Mutual Water Company must comply with the site-specific limits listed in Table 3.

Table 3. Wastewater Limits for Activated Sludge

Constituent	Unit	Limit	Point of Compliance ¹
Flow	gpd	24,000 (monthly mean) 35,000 (maximum daily flow)	Influent (IS-1)
Total Suspended Solids (TSS)	mg/L	30 (monthly average) 45 (7-day average)	Effluent after secondary clarifiers (ES-1)
Five-Day Biochemical Oxygen Demand (BOD ₅)	mg/L	30 (monthly average) 45 (7-day average)	Effluent after secondary clarifiers (ES-1)
Total N	% Influent versus Effluent	50% Removal	Effluent after secondary clarifiers (ES-1)

¹ Refer to monitoring and reporting program for sampling locations

4. GROUNDWATER LIMITS

As stated in the General Permit, Section C, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, Rancho Colina Mutual Water Company must manage the facility to comply with water quality objectives for

² General Permit section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Permit, effluent limits in the General Permit, and compliance with site-specific limits set forth in this notice of applicability.

groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).³ These objectives include:

- 1) General objectives for taste and odors and radioactivity for all groundwaters.
- 2) Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15 2.
- 3) The facility does not discharge into a designated groundwater basin, so there are no groundwater basin-specific objectives.

Rancho Colina Mutual Water Company owns three existing off-site wells. These wells supply the drinking water to the mobile home and RV park.

Currently, the Central Coast Water Board does not require first-encountered groundwater monitoring wells. If effluent water quality indicates exceedances of the Basin Plan groundwater objectives, the Central Coast Water Board may require installation of groundwater monitoring wells in the future.

³ Current edition, June 2019 is available at:
https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

ATTACHMENT 2
FIGURES



Figure 1. Site Location Map

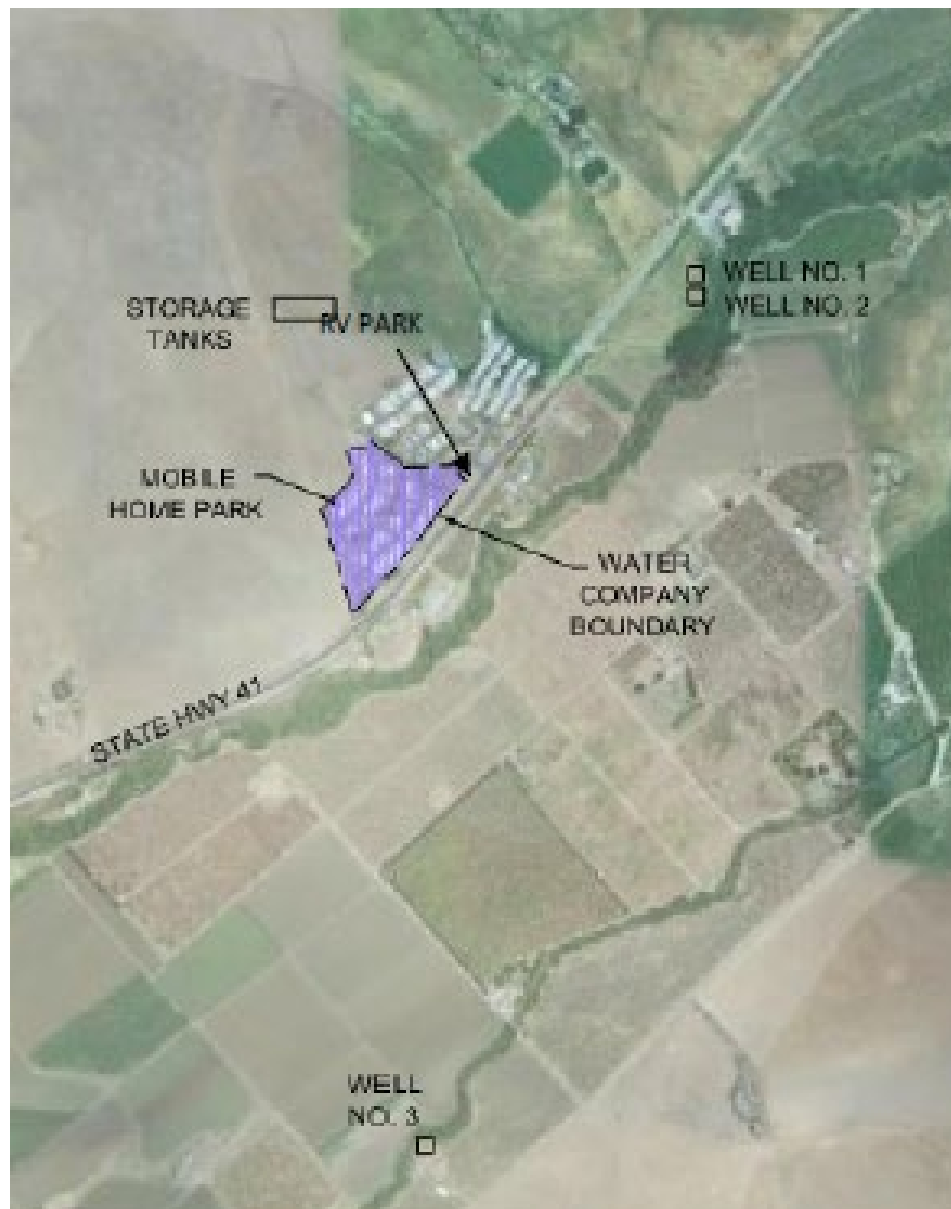


Figure 2. Rancho Colina Mutual Water Company Service Area

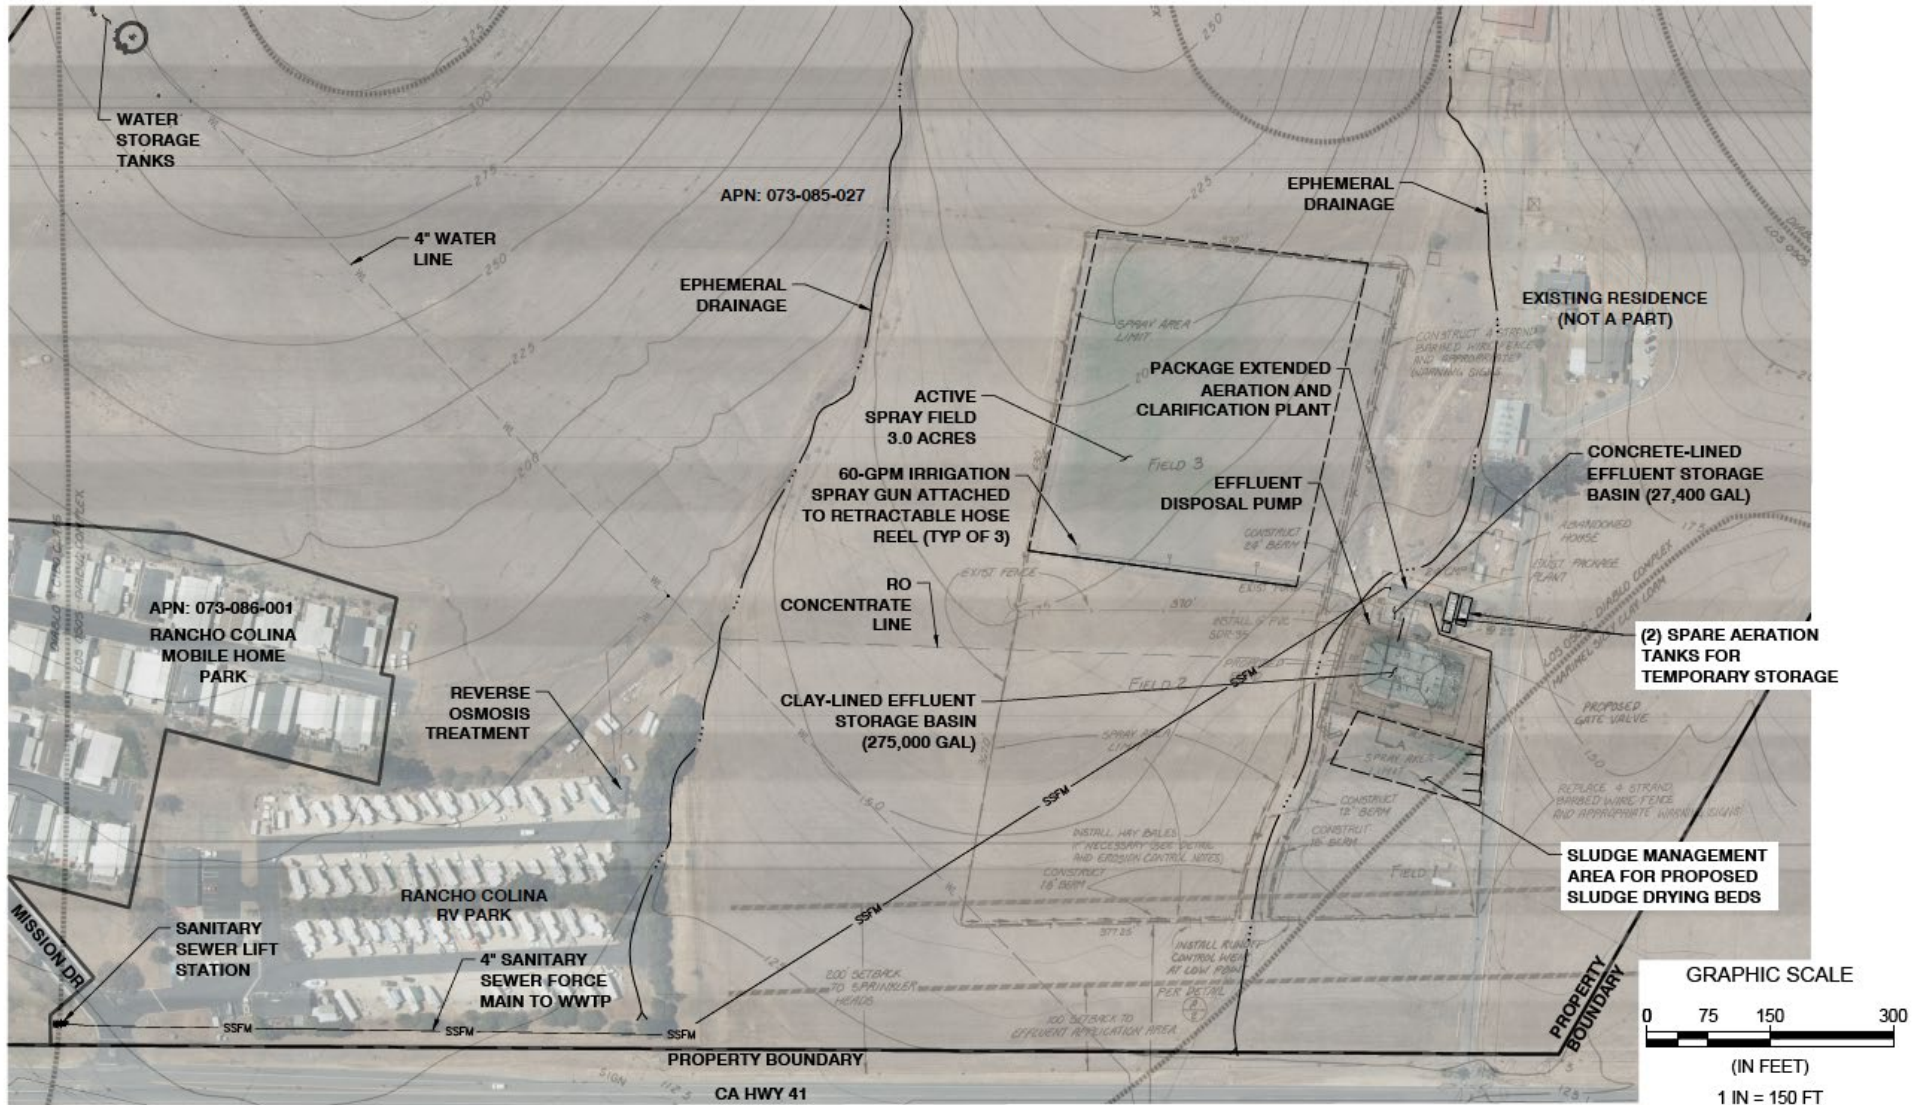


Figure 3. Site Map and Disposal Site Plan

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION**

MONITORING AND REPORTING PROGRAM NO. R3-2022-0071

for

**RANCHO COLINA MUTUAL WATER COMPANY WASTEWATER TREATMENT
FACILITY
SAN LUIS OBISPO COUNTY**

This monitoring and reporting program describes requirements for monitoring a wastewater treatment system for Rancho Colina Mutual Water Company Wastewater Treatment Facility owned by Rancho Colina Mutual Water Company located at 1045 Atascadero Road in Morro Bay, California 93442.

Rancho Colina Mutual Water Company owns and operates the wastewater system that is subject to the notice of applicability dated October 18, 2022, for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2 from the production wells prior to any disinfection.

In lieu of the required water supply sampling, Rancho Colina Mutual Water Company may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Rancho Colina Mutual Water Company must report the results of any constituent monitored more frequently than is required by this monitoring and reporting program. Rancho Colina Mutual Water Company must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling Frequency	Reporting Frequency
TDS	mg/L	Grab	Annually	Annually
Nitrate and Nitrite (as N)	mg/L	Grab	Annually	Annually

mg/L denotes milligrams per liter

3. MONITORING LOCATIONS

Monitoring location information, including nomenclature that shall be used when reporting data to the GeoTracker database (described below), is shown in Table 3.

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code	Sample Description
Influent Sample – 1	IS-1	Representative grab sample after lift station and before screening
Effluent Sample – 1	ES-1	Representative grab sample from clear well after secondary clarifiers

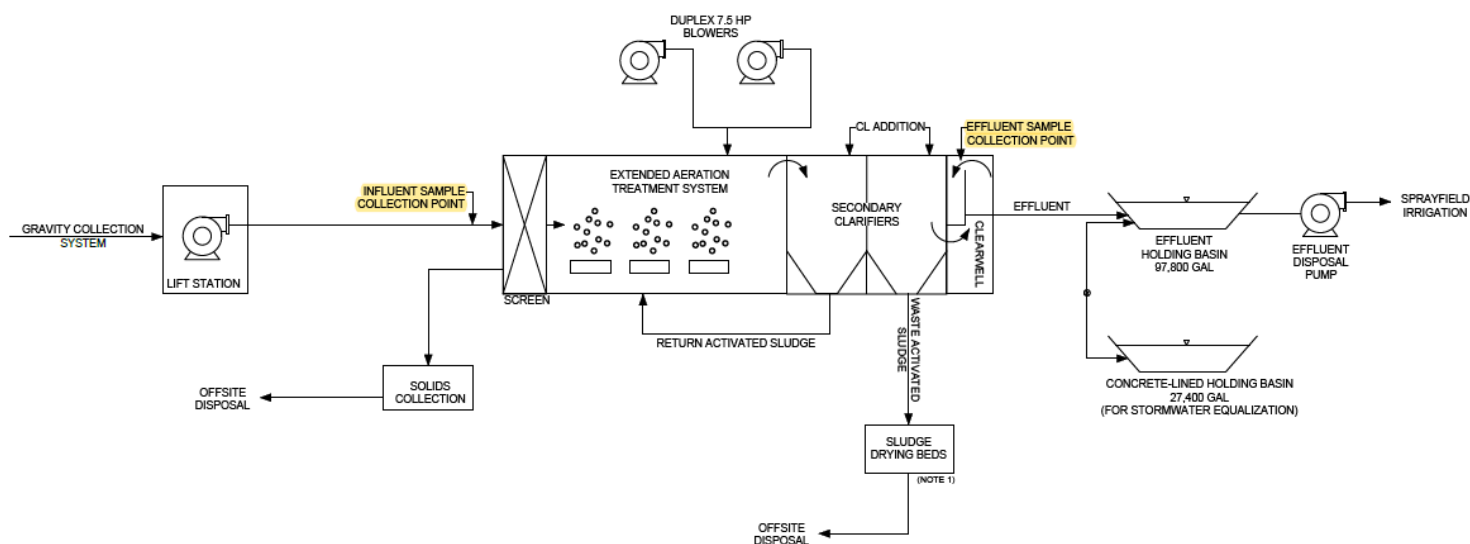


Figure 1. Process Flow Diagram with Sampling Locations

4. TREATMENT SYSTEM MONITORING

4.1 Flow Monitoring

Rancho Colina Mutual Water Company must monitor and report flow, as described in Table 4, with each monitoring report. Flow is calculated by assuming that 95% of potable water use becomes wastewater.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Sampling Frequency
Daily Flow	Gallons per day	Calculated	Daily
Maximum Daily Flow	Gallons per day	Calculated	Monthly
Mean Daily Flow	Gallons per day	Calculated	Monthly

4.2 Influent and Effluent Constituent Monitoring

Representative samples of Rancho Colina Mutual Water Company WWTF's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. All samples must be grab.

Table 5. Influent and Effluent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency
Biochemical Oxygen Demand, 5-Day	mg/L	Not Required	Monthly

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency
Total Suspended Solids	mg/L	Not Required	Monthly
pH	pH units	Not Required	Monthly
Total Nitrogen	mg/L	Quarterly	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species ¹	mg/L	Quarterly	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Quarterly
Total Dissolved Solids	mg/L	Not Required	Semi-annually
Chloride	mg/L	Not Required	Semi-annually
Sodium	mg/L	Not Required	Semi-annually
Sulfate	mg/L	Not Required	Semi-annually
Zinc	mg/L	Not Required	Quarterly
Phenol	mg/L	Not Required	Quarterly
Formaldehyde	mg/L	Not Required	Quarterly

mg/L = milligram per liter

MPN = most probably number

¹ Nitrate and nitrite sample may be combined

5. SPRAYFIELD DISPOSAL AREA INSPECTIONS

Rancho Colina Mutual Water Company shall monitor the Spray Irrigation Disposal Site when wastewater irrigation is applied. If wastewater irrigation is not applied during a reporting period, the monitoring report shall so state. A positive containment ditch and a berm are located on the downhill side of the spray field, between the spray field and the ephemeral drainage. The ditch and the berm were constructed to ensure that wastewater applied to the spray field does not discharge to the ephemeral drainage. These structures must be inspected on a weekly basis and maintained immediately if any deficiencies are observed. Spray Irrigation Disposal Site monitoring shall include the following:

Table 6. Land Application Area Monitoring

Parameter	Units	Sample Type	Sample Frequency
Daily Effluent Flow	gpd ¹	Metered/Estimated ²	Semiannually
Total Flow	gallons	Calculated	Monthly
Acreage Applied ³	Acres	Calculated	Monthly
Application Rate	gal/acres/month	Calculated	Monthly
Local Rainfall	Inches	Weather Station ⁴	Each Precipitation Event
Irrigation Equipment	--	Observations ⁶	Weekly
Nuisance Odor Condition	--	Observations	Weekly
Saturated Soil/Ponding	--	Observations	Weekly
Plant Growth	--	Observations	Weekly
Vectors or Animals Burrowing	--	Observations	Weekly
Evidence of Soil Erosion	--	Observations	Weekly
Positive Containment Ditch	—	Observations	Weekly
Berm Condition	—	Observations	Weekly

¹ gpd denotes gallons per day

² Effluent flow can be determined via an effluent meter reading or estimated using the volume of potable water delivered to the mobile home and RV Park.

³ Acreage applied denotes the acreage to which wastewater is applied

⁴ Weather station may be site-specific station, onsite gauge, or nearby governmental weather reporting station.

⁶ Observations must be maintained onsite in a bound logbook and made available to the Central Coast Water Board upon inspection. Any problems must be promptly corrected and recorded.

6. SOLIDS DISPOSAL MONITORING

Rancho Colina Mutual Water Company must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

7. WASTEWATER CONSOLIDATION PROGRESS REPORTING

Each semiannual monitoring report must provide a status update with respect to the ongoing efforts to consolidate the Rancho Colina wastewater treatment facility with the City of Morro Bay's wastewater collection system. The monitoring report must include a description of activities that occurred in the previous six months related to this consolidation and must include a timeline for completion of future activities that will lead to consolidation. If it is determined that consolidation with the City of Morro Bay's wastewater collection system is not feasible, Rancho Colina Mutual Water Company must submit plans detailing the facility's needed wastewater treatment upgrades and timeline for implementation.

8. REPORTING

The semiannual monitoring reports must be submitted in accordance with Table 7.

Table 7. Semiannual Monitoring Reports

Report	Monitoring Period	Report Due Date
First Semiannual Report	January 1 to June 30	August 1
Second Semiannual Report	July 1 to December 31	February 1

At a minimum, the semiannual reports must include:

- **Facility Information and Description** -- Briefly describe your facility, treatment process, and disposal process with references to figures.
- **Data Tables** -- Tabular summaries of all monitoring data (water supply, influent, effluent, and groundwater) compared to effluent limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program.
- **Compliance and Performance Discussion** –
 - Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Permit requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.
 - An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (BOD₅, TSS, Total Nitrogen, Total Coliforms) over time, nuisance conditions, system problems, etc.
 - A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.
- **Disposal Area Inspection** -- Report the results of the disposal area inspections, as described in Section 6.
- **Solids Disposal** -- If solids are disposed of offsite, comply with the reporting in Section 6.

- **Operator Information** -- List the name and contact information for the wastewater operators responsible for operation, maintenance, and/or system monitoring.
- **Flow Evaluation** -- A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.
- **Wastewater Consolidation Progress** -- Provide a summary of progress made towards connection with the City of Morro Bay's wastewater collection system. Provide an updated timeline regarding connection.
- **Figures** -- A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).
- **Laboratory Sheets** -- Copies of laboratory analytical report(s) and chain of custody form(s).

9. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permiiting/docs/transmittal_sheet.pdf

Rancho Colina Mutual Water Company must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{1,2} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number **WDR100032825** at:

<https://geotracker.waterboards.ca.gov/esi/login>

Table 8 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

² Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Table 8. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

10. TECHNICAL REPORTS

Rancho Colina Mutual Water Company must submit to GeoTracker the three reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 9. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

Rancho Colina Mutual Water Company must also submit a Time Schedule Compliance Plan which describes milestones for demonstrating progress towards connecting the Wastewater Treatment Facility to the proposed City of Morro Bay's wastewater collection system extension.

Table 9. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	January 18, 2023
Sampling and Analysis Plan	January 18, 2023
Sludge Management Plan	January 18, 2023
Time Schedule Compliance Plan	April 18, 2023

11. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Rancho Colina Mutual Water Company submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Rancho Colina Mutual Water Company to enforcement action pursuant to [section 13268 of the Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Rancho Colina Mutual Water Company is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained.

Rancho Colina Mutual Water Company must implement the above monitoring program as of the date of this monitoring and reporting program. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Rancho Colina Mutual Water Company must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Rancho Colina Mutual Water Company WWTF
Monitoring and Reporting Program

October 18, 2022

Ordered by:

for Matthew T. Keeling
Executive Officer