

Central Valley Regional Water Quality Control Board

28 June 2019

Kenneth J. Glotzbach, P.E.
(via email: kglotzbach@roseville.ca.us)
Wastewater Utility Manager
City of Roseville
2005 Hilltop Circle
Roseville, CA 95747

CERTIFIED MAIL
91 7199 9991 7035 8363 9673

NOTICE OF APPLICABILITY (NOA); MUNICIPAL GENERAL WASTE DISCHARGE REQUIREMENTS ORDER R5-2017-0085 (NPDES NO. CAG585001); CITY OF ROSEVILLE, PLEASANT GROVE WASTEWATER TREATMENT PLANT, PLACER COUNTY

Our office received a Notice of Intent (NOI) dated 29 October 2018 from the City of Roseville (hereinafter Discharger), for discharge of tertiary treated domestic wastewater to surface water from the Pleasant Grove Wastewater Treatment Plant (hereafter Facility) to Pleasant Grove Creek. The General Order for Municipal Wastewater Dischargers That Meet Objectives/Criteria at the Point of Discharge to Surface Water Order R5-2017-0085 (Municipal General Order) requires the submittal of a NOI to apply for regulatory coverage of a surface water discharge. Based on the NOI and subsequent information submitted by the Discharger, staff has determined that the NOI requirements have been fulfilled and the Facility is eligible for coverage under the Municipal General Order. This Facility's discharge is assigned Municipal General Order enrollee number **R5-2017-0085-005** and National Pollutant Discharge Elimination System (NPDES) Permit No. CAG585001. Please reference your Municipal General Order enrollee number, **R5-2017-0085-005**, in your correspondence and submitted documents.

Discharges to surface water from the Facility are currently regulated by an individual NPDES permit, Order R5-2014-0051 (NPDES No. CA0084573) issued by the Central Valley Regional Water Quality Control Board (Central Valley Water Board) on 28 March 2014. This NOA, authorizing coverage under the Municipal General Order, shall become effective on **1 August 2019**, at which time the terms and conditions in Order R5-2014-0051 will cease to be effective except for enforcement purposes. To meet the provisions contained in division 7 of the Water Code (commencing with section 13000) and regulations adopted thereunder, and the provisions of the Clean Water Act and regulations and guidelines adopted thereunder, the Discharger shall comply with the requirements contained in the Municipal General Order and as specified in this NOA. This action in no way prevents the Central Valley Water Board from taking enforcement action for past violations of Order R5-2014-0051.

The enclosed Municipal General Order may also be viewed at the following web address: https://www.waterboards.ca.gov/centralvalley/board_decisions/adopted_orders/general_orders/r5-2017-0085.pdf. You are urged to familiarize yourself with the entire contents of the enclosed document.

The Monitoring and Reporting Program, Attachment E to the Municipal General Order, contains the general monitoring and reporting requirements. The Discharger specific monitoring and

KARL E. LONGLEY ScD, P.E., CHAIR | PATRICK PULUPA, ESQ., EXECUTIVE OFFICER

reporting requirements are included with this NOA as Appendix D. Only the monitoring and reporting requirements specifically listed in Appendix D of this NOA are applicable to this Facility.

The discharge of treated domestic wastewater shall be in accordance with the requirements contained in the Municipal General Order, as specified in this NOA.

Table 1. Facility Information

WDID	5A310106007
CIWQS Facility Place ID	248706
Discharger	City of Roseville
Name of Facility	Pleasant Grove Wastewater Treatment Plant
Facility Address	5051 Westpark Drive
	Roseville, CA 95747
	Placer County
Facility Contact, Title and Phone	Jason Fick, Chief Operator, (916) 746-1940
Authorized Person to Sign and Submit Reports	Ken Glotzbach, Wastewater Utility Manager, (916) 774-5754
Mailing Address	2005 Hilltop Circle, Roseville, CA 95747
Billing Address	Same as Mailing Address
Type of Facility	Publicly Owned Treatment Works (POTW)
Major or Minor Facility	Major
Threat to Water Quality	1
Complexity	A
Pretreatment Program	Yes
Recycling Requirements	See Master Reclamation Permit, Order 97-147, Amendment No. 2
Facility Permitted Flow	9.5 up to 15 million gallons per day (MGD), average dry weather flow
Facility Design Flow	9.5 MGD, average dry weather flow
Watershed	Lower Sacramento
Receiving Water	Pleasant Grove Creek
Receiving Water Type	Inland Surface Water
Discharge Point 001	Latitude 38° 79' 21" N, Longitude 121° 37' 01" W

I. FACILITY DESCRIPTION

The Facility provides sewerage service for the northwest portion of the City of Roseville, portions of Placer County, and the South Placer Municipal Utilities District and serves a population of approximately 102,000 and nine of the City's ten significant industrial users. The current design average dry weather flow capacity of the Facility is 9.5 MGD.

The Facility provides full nitrification and denitrification for nitrogen removal and uses tertiary filtration followed by ultraviolet light (UV) for disinfection. The components of the treatment system at the Facility include:

- Design capacity average dry weather flow is 9.5 MGD;
- two bar screens;
- four aerated grit chambers;
- three oxidation ditches;

- four secondary clarifiers;
- six sand filters;
- three UV disinfection channels;
- three storage basins totaling 65.1 million gallons storage capacity; and
- one influent emergency storage basin with 20.6 million gallons storage capacity.

The Facility includes three earthen-lined storage basins (approximately 31.8 acres with a combined capacity of 65.1 million gallons) that provide effluent storage capacity for a 100-year rainfall event and are used for storing partially treated effluent for short periods or by storing only tertiary treated effluent. These storage basins are also used in the event of plant upsets to prevent discharge of effluent that does not meet discharge requirements. An additional earthen-lined emergency storage basin (approximately 10 acres with a capacity of 20.6 million gallons) is used to store influent that could compromise the plant process, as well as secondary effluent or tertiary filter effluent from plant upsets. Use of the Facility's four storage basins are part of the treatment process as described above, and thus are covered by the provisions in the Municipal General Order, as specified in this NOA. Tertiary treated wastewater may be recycled in the Discharger's reclaimed water distribution system or discharged from Discharge Point 001 to Pleasant Grove, as defined in Table 1 above. The specifications and use of reclaimed water is covered under a separate Master Reclamation Permit (Order 97-147, Amendment 2) issued to the Discharger in accordance with California Code of Regulations, Title 22 and the California Water Code.

Solids handling facilities include three centrifuges for dewatering. Solids collected from the primary and secondary clarifiers are sent to three centrifuges for dewatering. Biosolids are disposed at the Western Regional Sanitary Landfill.

II. RECEIVING WATER BENEFICIAL USES

The Facility discharges from Discharge Point 001 to Pleasant Grove Creek, a tributary to the Sacramento River via the Pleasant Grove Creek Canal and the Natomas Cross Canal within the Sacramento River watershed. According to the *Water Quality Control Plan for the Sacramento River and San Joaquin River Basins* (Basin Plan) and the Tributary Rule, Pleasant Grove Creek is designated with the following beneficial uses:

- municipal and domestic supply (MUN);
- agricultural supply, including irrigation and stock watering (AGR);
- water contact recreation, including canoeing and rafting (REC-1);
- non-contact water recreation (REC-2);
- warm freshwater habitat (WARM);
- cold freshwater habitat (COLD);
- warm and cold migration of aquatic organisms (MIGR);
- warm and cold spawning, reproduction, and/or early development (SPWN);
- wildlife habitat (WILD); and
- navigation (NAV).

According to the Basin Plan, the groundwater is designated with the following beneficial uses:

- municipal and domestic supply (MUN);
- agricultural supply, including irrigation and stock watering (AGR);
- industrial service supply (IND); and
- industrial process supply (PRO).

III. PROVISIONS AND REQUIREMENTS IMPLEMENTING STATE LAW

The provisions/requirements in section VII.2 (Groundwater Limitations) and section IX, Table 4 (C.4. - Pond Operating Specifications) of this NOA are included to implement State law only. These provisions/requirements and their inclusion in this NOA are not required or authorized under the federal Clean Water Act; consequently, violations of these provisions/requirements are not subject to the enforcement remedies that are available for NPDES violations.

IV. RECEIVING WATER TOTAL MAXIMUM DAILY LOADS (TMDLs)

In accordance with section 303(d) of the Clean Water Act, the Central Valley Water Board is required to develop TMDLs for each 303(d) listed pollutant and water body combination.

Pleasant Grove Creek is not listed as an impaired waterbody on the Clean Water Act 303(d) 2014-2016 California List of impaired water bodies. Therefore, there are no TMDLs applicable to this discharge.

V. DISCHARGE PROHIBITIONS

Discharge prohibitions are contained in section IV of the Municipal General Order. Only the discharge prohibitions listed below are applicable to this Facility. There are no additional site-specific discharge prohibitions for this discharge.

- The discharge of wastes, other than those described in section I.A and meeting the eligibility criteria in section I.B of the Municipal General Order, is prohibited unless the Discharger obtains coverage under another general or individual Order that regulates the discharge of such wastes. (see Municipal General Order section IV.A)
- The by-pass or overflow of wastes to surface waters is prohibited, except as allowed by Federal Standard Provisions sections I.G. and I.H in Attachment D, Standard Provisions, of the Municipal General Order. (see Municipal General Order section IV.B)
- Neither the discharge nor its treatment shall create a nuisance as defined in section 13050 of the Water Code. (see Municipal General Order section IV.C)

VI. EFFLUENT LIMITATIONS

The Discharger shall maintain compliance with the following effluent limitations at Discharge Point 001. Effluent limitations are provided in the Municipal General Order. Only the effluent limitations listed below (items 1-6) are applicable to this Facility. Unless otherwise specified in this NOA, compliance shall be measured at Monitoring Location EFF-001, as described in the Monitoring and Reporting Program, Appendix D of this NOA.

1. The Discharger shall maintain compliance with the effluent limitations specified in Table 2.

Table 2. Effluent Limitations

Parameter	Units	Effluent Limitations			Municipal General Order Section Reference
		Average Monthly	Average Weekly	Maximum Daily	
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	10	15	--	V.A.1.a.ii.(a)
Total Suspended Solids	mg/L	10	15	--	V.A.1.a.ii.(a)

Ammonia Nitrogen, Total (as N)	mg/L	1.9	5.5	--	V.A.1.c.v.(b)
Nitrate plus Nitrite, Total (as N)	mg/L	10	13	--	V.A.1.c.vi

2. **Flow (Municipal General Order section V.A.1.a.iii).** The average dry weather discharge flow shall not exceed 9.5 MGD. Upon compliance with the facility expansion provision in section IX, Provision 2, of this NOA, the permitted average dry weather discharge flow may be increased up to a maximum of 15 MGD, as approved by the Executive Officer.
3. **pH (Municipal General Order section V.A.1.c.iv.(a) Table 13).** The pH shall at all times be within the range of 6.5 and 8.3.
4. **Percent Removal (Municipal General Order section V.A.1.a.ii.(b)).** The average monthly percent removal of BOD₅ and TSS shall not be less than 85 percent.
5. **Total Coliform Organisms (Municipal General Order section V.A.1.a.ii.(c)). (Measured at UVS-002)** Effluent total coliform organisms shall not exceed:
 - i. 2.2 most probable number (MPN) per 100 mL, as a 7-day median;
 - ii. 23 MPN/100 mL, more than once in any 30-day period; and
 - iii. 240 MPN/100 mL, at any time.
6. **Whole Effluent Toxicity, Acute (Municipal General Order section V.A.1.c.i).** Survival of aquatic organisms in 96-hour bioassays of undiluted waste shall be no less than:
 - i. 70%, minimum for any one bioassay; and
 - ii. 90%, median for any three consecutive bioassays.

VII. RECEIVING WATER LIMITATIONS

1. **Surface Water Limitations (Municipal General Order section VI.A).** The Municipal General Order includes receiving surface water limitations in Section VI.A. Based on the information provided in the NOI, only the following receiving surface water limitations listed in Municipal General Order Section VI.A are applicable to the Facility.
 - Bacteria (VI.A.2);
 - Biostimulatory Substances (VI.A.3);
 - Chemical Constituents (VI.A.4);
 - Color (VI.A.5);
 - Dissolved Oxygen (VI.A.6.a.i, ii, iv);
 - Floating Material (VI.A.7);
 - Oil and Grease (VI.A.8);
 - pH (VI.A.9.a);
 - Pesticides (VI.A.10);
 - Radioactivity (VI.A.11);
 - Suspended Sediments (VI.A.12);
 - Settleable Substances (VI.A.13);
 - Suspended Material (VI.A.14);
 - Taste and Odors (VI.A.15);

- Temperature (VI.A.16.c). A more detailed discussion of this receiving water limitation is provided in Appendix C of this NOA, section II.A. The discharge to Pleasant Grove Creek shall not cause the temperature at Monitoring Location RSW-002 to exceed the following:

Table 3. Temperature Receiving Water Limitations for Pleasant Grove Creek

Period	Period Maximum (°F) ¹	Period Average (°F) ²
January and February	69	64
March	70	67
April	74	70
May	78	75
June	81	77
July – September	83	80
October	81	77
November	77	72
December	70	65

¹ Instantaneous maximum not to be exceeded in period.

² Arithmetic average of measurements not to be exceeded in period.

- Toxicity (VI.A.17); and
 - Turbidity (VI.A.18.a).
2. **Groundwater Limitations (Municipal General Order section VI.B).** Release of waste constituents from any storage, treatment, or disposal component associated with the Facility shall not cause the underlying groundwater to contain waste constituents in concentrations greater than background water quality or water quality objectives, whichever is greater.

VIII. MONITORING AND REPORTING

Monitoring and reporting program requirements are contained in Appendix D of this NOA.

IX. PROVISIONS

- Provisions are contained in section VII of the Municipal General Order and the applicable provisions are referenced in the following table.

Table 4. Provisions

Provisions	Municipal General Order Section Applicability to this Facility.
A. Standard Provisions	VII.A – Applicable to all dischargers.
B. Monitoring and Reporting Program (MRP) Requirements	VII.B – The MRP applicable to this Facility is contained in Appendix D of this NOA.
C. Special Provisions	
1. Reopener Provisions	VII.C.1.a, c, d, and e – Applicable. VII.C.1.b, and f through h – Not Applicable.
2. Special Studies, Technical Reports and Additional Monitoring Requirements	
a. Toxicity Reduction Evaluation Requirements	VII.C.2.a – Applicable.
b. Phase 1 Methylmercury Control Study	VII.C.2.b – Not Applicable.
3. Best Management Practices and Pollution Prevention	
a. Pollution Prevention Plan for Mercury	VII.C.3.a – Not Applicable.
b. Mercury Exposure Reduction Program	VII.C.3.b – Not Applicable.

Provisions	Municipal General Order Section Applicability to this Facility.
c. Salinity Evaluation and Minimization Plan	VII.C.3.c – Applicable.
4. Construction, Operation and Maintenance Specifications	
a. Filtration System Operating Specifications	VII.C.4.a.i¹ – Applicable. VII.C.4.a.ii and iii – Not Applicable.
b. UV Disinfection System Operating Specifications	VII.C.4.b.i.(a), ii.(a), and iii through vi – Applicable. VII.C.4.b.i.(b) and ii.(b) – Not Applicable.
c. Pond Operating Specifications	VII.C.4.c – Applicable , except the following: VII.C.4.c.i.(a) and VII.C.4.c.x are Not Applicable.
5. Special Provisions for Municipal Facilities	
a. Pretreatment Requirements	VII.C.5.a – Applicable.
b. Sludge/Biosolids Treatment or Discharge Specifications	VII.C.5.b – Applicable.
c. Collection System	VII.C.5.c – Not Applicable.
d. Anaerobically Digestible Material	VII.C.5.d – Applicable.
6. Other Special Provisions	VII.C.6 – Applicable.
7. Compliance Schedules	VII.C.7 – Not Applicable.

¹ For compliance with Filtration System Operating Specifications, turbidity measurements at FIL-001 shall be used to determine compliance, rather than turbidity measurements at FIL-002. Station FIL-001 is defined in this NOA as the filter effluent, which is equivalent to FIL-002 described in the Municipal General Order.

2. Facility Expansion. The Discharger shall submit a report to the Central Valley Water Board documenting the increase in Facility treatment capacity. The report shall be certified by a registered and licensed Civil Engineer that the Facility has appropriate treatment capacity to the new design average dry weather flow rate up to 15 MGD. The Discharger shall submit a request for permitted flow increase and the permitted flow increase shall not be effective until the request is approved by the Executive Officer.

3. Pretreatment Requirements.

- i. The Discharger shall be responsible and liable for the performance of all Control Authority pretreatment requirements contained in 40 CFR Part 403, including any subsequent regulatory revisions to 40 CFR Part 403. For violations of pretreatment requirements, the Discharger shall be subject to enforcement actions, penalties, fines, and other remedies by U.S. EPA or other appropriate parties, as provided in the CWA. U.S. EPA may initiate enforcement action against a nondomestic user for noncompliance with applicable standards and requirements as provided in the CWA.
- ii. The Discharger shall enforce the requirements promulgated under sections 307(b), 307(c), 307(d), and 402(b) of the CWA with timely, appropriate and effective enforcement actions. The Discharger shall cause all nondomestic users subject to federal categorical standards to achieve compliance no later than the date specified in those requirements or, in the case of a new nondomestic user, upon commencement of the discharge.

- iii. The Discharger shall perform the pretreatment functions as required in 40 CFR Part 403 including, but not limited to:
 - (a) Implement the necessary legal authorities as provided in 40 CFR 403.8(f)(1);
 - (b) Enforce the pretreatment requirements under 40 CFR 403.5 and 403.6;
 - (c) Implement the programmatic functions as provided in 40 CFR 403.8(f)(2); and
 - (d) Provide the requisite funding and personnel to implement the pretreatment program as provided in 40 CFR 403.8(f)(3).
- iv. Pretreatment monitoring and reporting requirements are contained in sections X.D.3 and X.D.4, Table D-10, of Appendix D.

X. COMPLIANCE DETERMINATION

The following compliance determinations, as contained and more fully described in the Municipal General Order, are applicable to this discharge (Municipal General Order section given in brackets, if applicable):

- BOD₅ and TSS Effluent Limitations (VIII.A);
- Average Dry Weather Flow Effluent Limitation (VIII.D);
- Total Coliform Organisms Effluent Limitations (VIII.E);
- Mass Effluent Limitations (VIII.G);
- Dissolved Oxygen Receiving Water Limitation (VIII.I)
- Period Average, Calendar Month Average, and Annual Average (VIII.N);
- Turbidity Receiving Water Limitation (VIII.O); and
- Reporting Requirements (**NOA, Appendix D, section X**).

XI. ANTI-BACKSLIDING REQUIREMENTS

Anti-backsliding requirements are specified in the Municipal General Order, section V.D.3, Attachment F (Fact Sheet). According to the Clean Water Act section 402(o)(2)(B)(i), the removal or relaxation of effluent limitations for the following pollutants is allowed because the updated effluent and receiving water monitoring data collected indicates the discharge no longer exhibits reasonable potential to cause or contribute to an exceedance of water quality objectives/criteria.

- fluoride; and
- mercury

A more detailed anti-backsliding analysis is provided in Appendix C to this NOA in section I.A Satisfaction of Anti-Backsliding Requirements.

XII. ANTIDEGRADATION REQUIREMENTS

Antidegradation requirements are specified in the Municipal General Order, section V.D.4, Attachment F (Fact Sheet). Consistent with Order R5-2014-0051, this NOA allows the Discharger to request an increase to the permitted average dry weather discharge flow of the Facility upon completion of Facility expansion upgrades. Subject to Executive Officer approval, the permitted average dry weather flow may increase up to a maximum of 15 MGD. This NOA does not allow an increase in flow or mass of pollutants to the receiving water. Thus, the relaxation of effluent limitations is consistent with the antidegradation provisions of 40 C.F.R. 131.12 and State Water Board Resolution No. 68-16, and no further antidegradation analysis is required. A more detailed discussion of antidegradation is provided in Appendix C to this NOA, section I.B Antidegradation Policies.

XIII. RATIONALE FOR LIMITATIONS AND MONITORING REQUIREMENTS

Additional rationale for limitations and monitoring requirements is included in Appendix C of this NOA.

XIV. ENFORCEMENT

Failure to comply with the applicable requirements of the Municipal General Order, as specified in this NOA, may result in enforcement actions, which could include civil liability (penalties). Effluent limitation violations may be subject to a Mandatory Minimum Penalty (MMP) of \$3,000 per violation. In addition, late monitoring reports may be subject to MMPs and/or discretionary penalties of up to \$1,000 per day late. If discharges do not occur during any report monitoring period, the Discharger must still submit the monitoring report indicating that no discharge occurred to avoid being subject to enforcement actions.

XV. COMMUNICATION

Until this NOA becomes effective on 1 August 2019, you will need to comply with the effluent limitations and requirements contained in your existing permit, Order R5-2014-0051. For your June and July 2019 monthly self-monitoring reports, you will need to demonstrate compliance with existing Order R5-2014-0051 through 31 July 2019, and compliance with this NOA beginning 1 August 2019.

The Central Valley Water Board is implementing a Paperless Office system to reduce our paper use, increase efficiency, and provide a more effective way for our staff, the public, and interested parties to view documents in electronic form. Therefore, the Discharger is required to submit all self-monitoring, technical, and progress reports required by this NOA via California Integrated Water Quality System (CIWQS) submittal. In general, if any monitoring data for a monitoring location can be submitted using a computable document format (CDF) file upload, then it should be submitted as a CDF file upload, such as characterization monitoring data. However, certain parameters that cannot be uploaded to the CIWQS data tables, such as Annual Operations Reports, should be uploaded as a Portable Document Format (PDF), Microsoft Word, or Microsoft Excel file attachment. Also, please upload or enter a cover letter summarizing the content of the report to the submittal tab of the CIWQS module for each submittal.

All other documents not required to be submitted via CIWQS shall be converted to a searchable PDF and submitted by email to centralvalleysacramento@waterboards.ca.gov. Please include the following information in the body of the email:

- Attention: NPDES Compliance and Enforcement Section
- Discharger: City of Roseville
- Facility: Pleasant Grove Wastewater Treatment Plant
- County: Placer County
- CIWQS place ID 248706

Documents that are 50 megabytes or larger must be transferred to a DVD or flash drive, and mailed to our office, attention "ECM Mailroom-NPDES".

Any person aggrieved by this action of the Central Valley Water Board may petition the State Water Board to review the action in accordance with California Water Code section 13320 and California Code of Regulations, title 23, sections 2050 and following. The State Water Board must receive the petition by 5:00 p.m., 30 days after the date this NOA is issued, except that if the thirtieth day following the date this NOA is issued falls on a Saturday, Sunday, or state holiday, the petition must be received by the State Water Board by 5:00 p.m. on the next business day. Copies of the law and regulations applicable to filing petitions may be found on

the internet at: http://www.waterboards.ca.gov/public_notices/petitions/water_quality or will be provided upon request.

If you have any questions now that your NOA has been issued, the Central Valley Water Board's Compliance and Enforcement Section will take over management of your case, Paul Wadding of the Compliance and Enforcement section is your point of contact for any questions regarding this NOA. If you find it necessary to make a change to your permitted operations, you will be directed to the appropriate Permitting staff. You may contact Paul Wadding at (916) 464-4826 or at Paul.Wadding@waterboards.ca.gov.

Original Signed by


Patrick Pulupa
Executive Officer

Appendices: Appendix A – Location Map
Appendix B – Flow Schematic
Appendix C – Rationale for Limitations and Monitoring Requirements
Appendix D – Monitoring and Reporting Program
Appendix E – Determination of WQBELs


Enclosure: Municipal General Order R5-2017-0085 (Discharger Only)

cc: Elizabeth Sablad, U.S. EPA, Region IX, San Francisco (email only)
Peter Kozelka, U.S. EPA, Region IX, San Francisco (email only)
Afrooz Farsimadan, Division of Water Quality, State Water Board, Sacramento (email only)
Renan Jauregui, Division of Water Quality, State Water Board, Sacramento (email only)
Armando Martinez, Division of Water Quality, State Water Board, Sacramento (email only)
Jarma Bennett, OIMA, State Water Board, Sacramento (email only)
Micheal Garabedian, Friends of the North Fork, Citrus Heights (email only)

APPENDIX A – LOCATION MAP

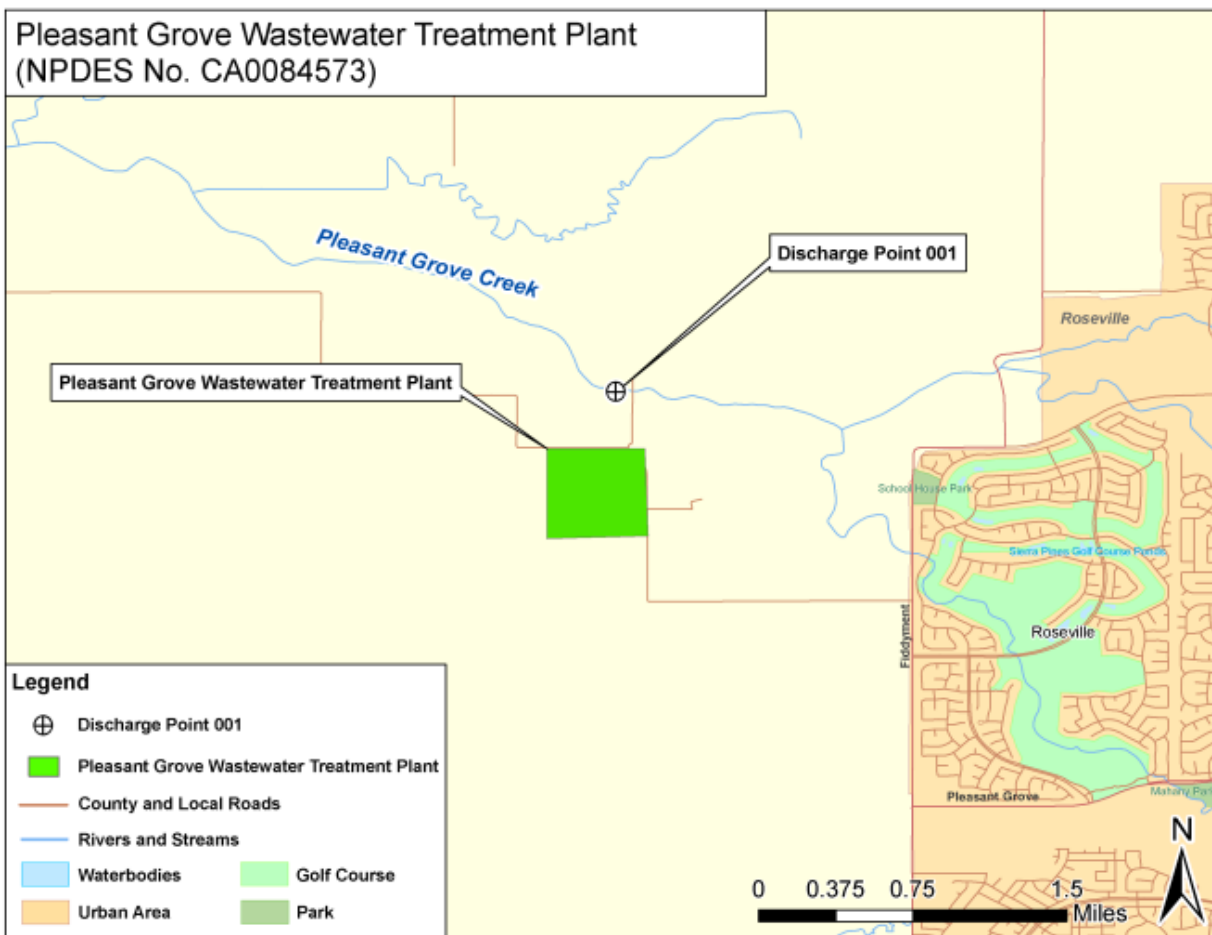

APPENDIX B – FLOW SCHEMATIC

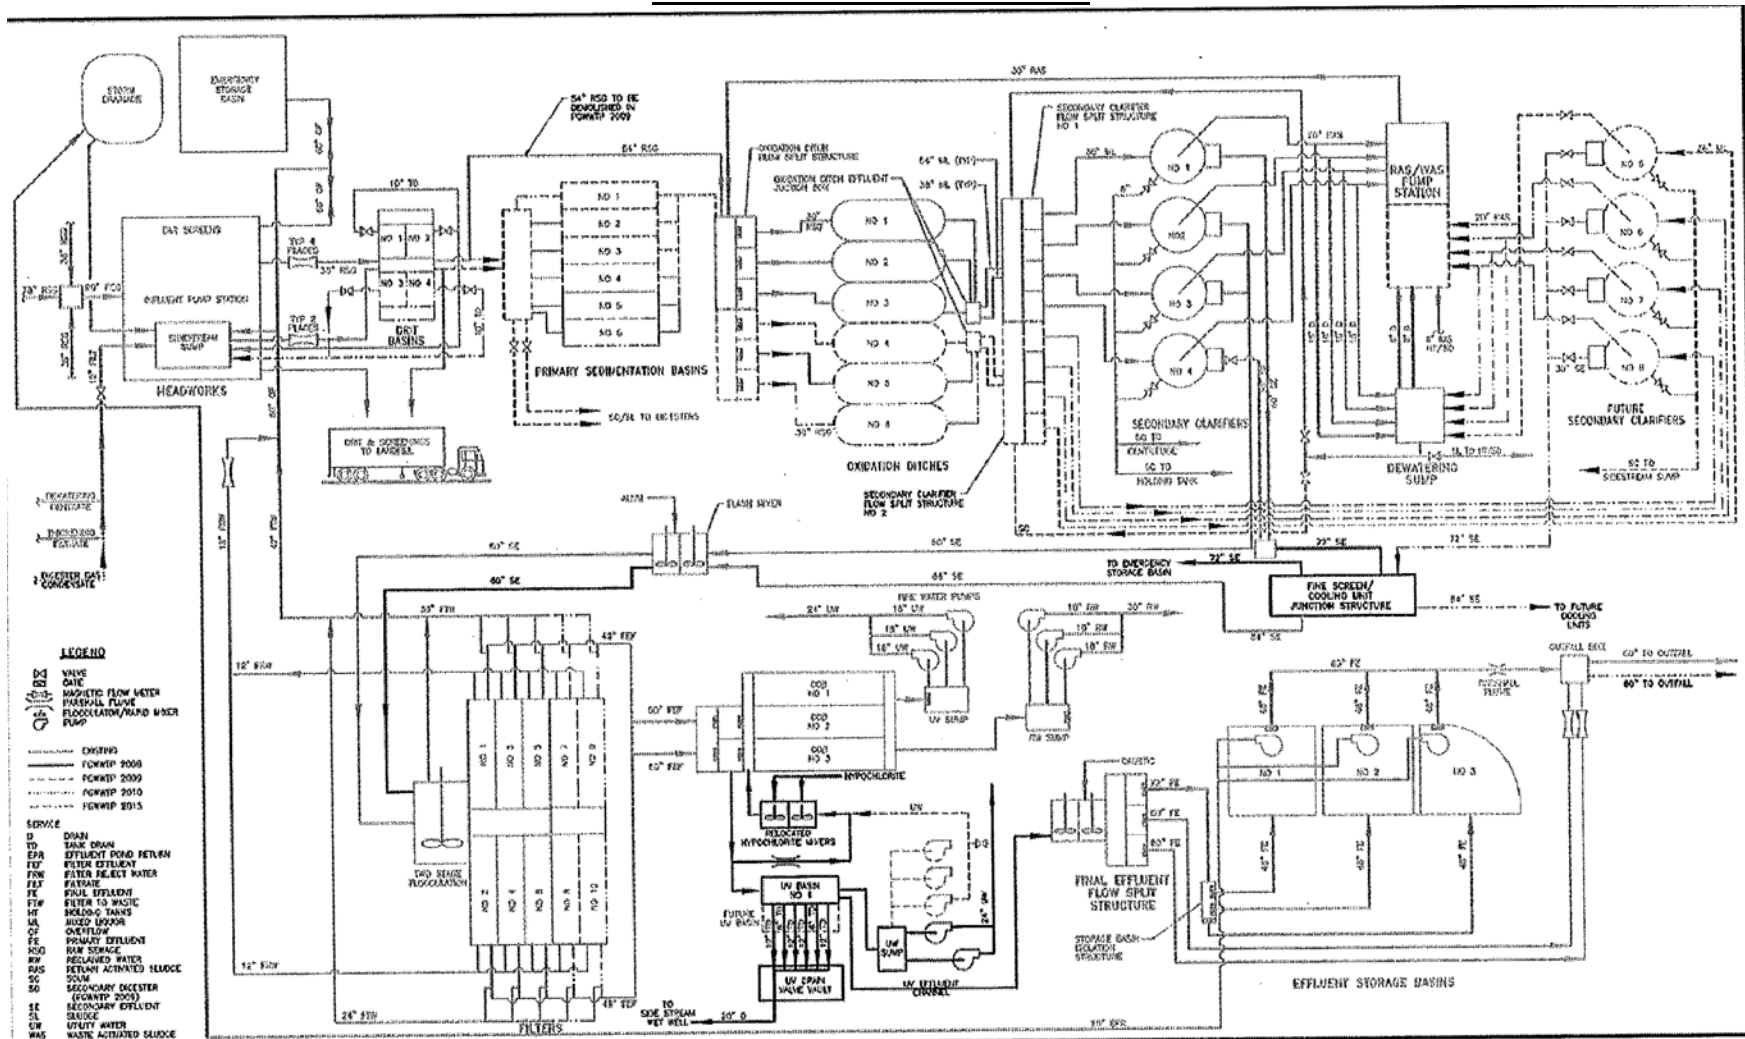

APPENDIX C – RATIONALE FOR LIMITATIONS AND MONITORING REQUIREMENTS

I. RATIONALE FOR EFFLUENT LIMITATIONS

A. Satisfaction of Anti-Backsliding Requirements

The Clean Water Act (CWA) specifies that a revised permit may not include effluent limitations that are less stringent than the previous permit unless a less stringent limitation is justified based on exceptions to the anti-backsliding provisions contained in CWA sections 402(o) or 303(d)(4), or, where applicable, Code of Federal Regulations (C.F.R.), 40 C.F.R. section 122.44(l).

The effluent limitations in this NOA are at least as stringent as the effluent limitations in the Facility's previous Order R5-2014-0051, with the exception of effluent limitations for fluoride, mercury, and the maximum daily and mass-based effluent limits for BOD₅ and TSS. The effluent limitations for these pollutants are less stringent than those in Order R5-2014-0051. This relaxation of effluent limitations is consistent with the anti-backsliding requirements of the CWA and federal regulations.

1. **CWA section 402(o)(1) and 303(d)(4).** CWA section 402(o)(1) prohibits the establishment of less stringent water quality-based effluent limits "except in compliance with Section 303(d)(4)." CWA section 303(d)(4) has two parts: paragraph (A) which applies to nonattainment waters and paragraph (B) which applies to attainment waters.
 - a. For waters where standards are not attained, CWA section 304(d)(4)(A) specifies that any effluent limit based on a TMDL or other WLA may be revised only if the cumulative effect of all such revised effluent limits based on such TMDLs or WLAs will assure the attainment of such water quality standards.
 - b. For attainment waters, CWA section 303(d)(4)(B) specifies that a limitation based on a water quality standard may be relaxed where the action is consistent with the antidegradation policy.

Pleasant Grove Creek is considered an attainment water for ammonia, fluoride, mercury, BOD₅, and TSS because the receiving water is not listed as impaired on the 303(d) list for these constituents.¹ As discussed below, removal of the effluent limits complies with federal and state antidegradation requirements. Thus, removal of the effluent limitations for fluoride and mercury, and the maximum daily and mass-based effluent limits for ammonia, BOD₅, and TSS for this NOA meets the exception in CWA section 303(d)(4)(B).

2. **CWA section 402(o)(2).** CWA section 402(o)(2) provides several exceptions to the anti-backsliding regulations. CWA 402(o)(2)(B)(i) allows a renewed, reissued, or modified permit to contain a less stringent effluent limitation for a pollutant if information is available which was not available at the time of permit issuance (other than revised regulations, guidance, or test methods) and which would have justified the application of a less stringent effluent limitation at the time of permit issuance.

Updated information that was not available at the time Order R5-2014-0051 was issued indicates that fluoride and mercury do not exhibit reasonable potential to cause or contribute to an exceedance of water quality objectives in the receiving water. Additionally, updated

¹ "The exceptions in Section 303(d)(4) address both waters in attainment with water quality standards and those not in attainment, i.e. waters on the section 303(d) impaired waters list." State Water Board Order WQ 2008-0006, Berry Petroleum Company, Poso Creek/McVan Facility.

information that was not available at the time Order R5-2014-0051 was issued indicates that less stringent effluent limitations for fluoride and mercury, based on available data, satisfy requirements in CWA section 402(o)(2). The updated information that supports the relaxation of effluent limitations for these constituents includes the following:

- a. **Fluoride.** Monitoring data collected over the permit term for Order R5-2014-0051 indicates that fluoride in the discharge does not exhibit reasonable potential to cause or contribute to an exceedance of their respective water quality objectives/criteria.
- b. **Mercury.** Monitoring data collected over the permit term for Order R5-2014-0051 indicates that mercury in the discharge does not exhibit reasonable potential to cause or contribute to an exceedance of their respective water quality objectives/criteria.

Thus, removal of the effluent limitations for fluoride and mercury from this NOA is in accordance with CWA section 402(o)(2)(B)(i), which allows for the removal or relaxation of effluent limitations based on information that was not available at the time previous Order R5-2014-0051 was issued.

B. Antidegradation Policies

The Discharger has planned to upgrade and expand the Facility to accommodate anticipated development in the service area which may increase the design treatment capacity of the Facility up to 15 MGD, average dry weather flow. The Central Valley Water Board found in Order R5-2008-0079-01 that *"This Order [R5-2008-0079-01] provides for an increase in the volume and mass of pollutants discharged and is consistent with the antidegradation provisions of 40 CFR 131.12 and State Water Resources Control Board Resolution 68-16 as updated by State Water Board Administrative Procedure Update (APU) No. 90-004."* Therefore, an increase in the permitted average dry weather discharge flow up to 15 MGD was authorized under Order R5-2008-0079-01 and retained in Order R5-2014-0051. Consistent with Orders R5-2008-0079-01 and R5-2014-0051, this NOA allows for an increase in the permitted average dry weather discharge flow in accordance with section IX, Provision 2, of this NOA. This NOA does not allow for an increase in flow or mass of pollutants to the receiving water beyond that allowed by Orders R5-2008-0079-01 and R5-2014-0051. Therefore, a complete antidegradation analysis is not necessary. The NOA requires compliance with applicable federal technology-based standards and with water quality-based effluent limitations (WQBELs) where the discharge could have the reasonable potential to cause or contribute to an exceedance of water quality standards. The permitted surface water discharge is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and State Water Board Resolution No. 68-16. Compliance with these requirements will result in the use of best practicable treatment or control of the discharge. The impact on existing water quality will be insignificant.

This NOA removes effluent limitations for fluoride and mercury based on updated monitoring data demonstrating that the effluent does not cause or contribute to an exceedance of the applicable water quality criteria or objectives in the receiving water. The removal of WQBELs for these parameters will not result in an increase in pollutant concentration or loading, a decrease in the level of treatment or control, or a reduction of water quality. Therefore, the Central Valley Water Board finds that the removal of effluent limitations does not result in an increase in pollutants or any additional degradation of the receiving water. Thus, the removal of effluent limitations is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and State Water Board Resolution No. 68-16.

This NOA also removes maximum daily and mass-based effluent limitations for ammonia, BOD₅ and TSS based on 40 CFR Part 122.45 (d) and (f). The removal of maximum daily and mass-

based effluent limits for ammonia, BOD₅ and TSS will not result in a decrease in the level of treatment or control, or a reduction in water quality.

Furthermore, concentration-based AMELs and AWELs are included for ammonia, BOD₅ and TSS, as well as an average dry weather flow limitation that limits the amount of flow that can be discharged to the receiving water during dry weather months. The combination of flow and concentration-based effluent limits in this NOA are equivalent to mass-based effluent limitations, which were redundant limits contained in previous individual Orders by multiplying the concentration-based effluent limits and permitted average dry weather flow by a conversion factor to determine the mass-based effluent limitations. The Central Valley Water Board finds that the removal of maximum daily and mass-based effluent limits for ammonia, BOD₅ and TSS does not result in an allowed increase in pollutants or any additional degradation of the receiving water. Thus, the removal of maximum daily and mass-based effluent limits for ammonia, BOD₅ and TSS is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and the State Antidegradation Policy.

II. RATIONALE FOR RECEIVING WATER LIMITATIONS

A. Temperature

Pleasant Grove Creek has the beneficial uses of COLD and WARM. The Basin Plan includes the objective that “[a]t not time or place shall the temperature of COLD or WARM intrastate waters be increased more than 5°F above natural receiving water temperature.” Order R5-2008-0079-01 included a receiving water limitation based on the Basin Plan objective.

The Discharger is unable to consistently comply with the Basin Plan objective and submitted an August 2012 *Temperature Study City of Roseville Pleasant Grove Wastewater Treatment Plant* (Robertson-Bryan, Inc.) supporting site-specific receiving water limits for temperature. The temperature study concluded that “*The intermittency of flow and the disrupted hydrology caused by an urbanized watershed render upstream versus downstream temperature differentials an inappropriate means of regulating the thermal effects of the [Facility] discharge to Pleasant Grove Creek.*” In lieu of receiving water limitations based on the Basin Plan objective, the Discharger proposed site-specific receiving water limitations for Pleasant Grove Creek, with compliance measured at Monitoring Location RSW-002, as follows:

Site-Specific Temperature Receiving Water Limitations

Period	Period Maximum (°F) ¹	Period Average (°F) ²
January and February	69	64
March	70	67
April	74	70
May	78	75
June	81	77
July – September	83	80
October	81	77
November	77	72
December	70	65

¹ Instantaneous maximum not to be exceeded in period.

² Arithmetic average of measurements not to be exceeded in period.

The Department of Fish and Wildlife (DFW) reviewed the temperature study and submitted a letter to the Central Valley Water Board dated 4 September 2013 indicating that the Basin Plan objective is not practical in a stream system such as Pleasant Grove Creek that lacks flow and determining that the Discharger’s proposed site-specific temperature limitations are protective of

aquatic life beneficial uses for species that are known to occur or likely to occur in Pleasant Grove Creek at this time. DFW recommended that the Central Valley Water Board accept the Discharger's proposed temperature limitations. Therefore, Order R5-2014-0051 discontinued the receiving water limitation for temperature based on the Basin Plan objective and included the site-specific temperature receiving water limitations based on the Discharger's temperature study. Consistent with Order R5-2014-0051, this NOA retains the site-specific temperature receiving water limitations.

III. RATIONALE FOR MONITORING REQUIREMENTS

A. Influent Monitoring

1. Influent monitoring frequency for flow (continuous), has been retained from previous Order R5-2014-0051. The Central Valley Water Board finds that this frequency will provide sufficient information to determine compliance with percent removal requirements and monitor the performance of the Facility.
2. Order R5-2014-0051 included three per week influent monitoring for biological oxygen demand and total suspended solids. Influent monitoring is required to collect data on the characteristics of the wastewater and to assess compliance with effluent limitations (e.g., BOD₅ and TSS reduction requirements). Influent monitoring frequency for biological oxygen demand (BOD) and total suspended solids (TSS) is reduced to once per week in this NOA. The Central Valley Water Board finds that this frequency is sufficient for determining compliance with the effluent limits for BOD and TSS.

B. Effluent Monitoring

1. CWA section 308 and 40 C.F.R. sections 122.41(h), (j)-(l), 122.44(i), and 122.48 require that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Central Valley Water Board to establish monitoring, inspection, entry, reporting, and recordkeeping requirements. The Municipal General Order, Attachment E and the Monitoring and Reporting Program, Appendix D of this NOA, establish monitoring, reporting, and recordkeeping requirements that implement federal and state requirements. The following provides the rationale for the monitoring and reporting requirements contained in the Monitoring and Reporting Program, Appendix D of this NOA for discharges of treated municipal wastewater to Pleasant Grove Creek.
 - a. Effluent monitoring frequency for flow (continuous), ammonia nitrogen (once per week), electrical conductivity (once per week), hardness (once per month), nitrate nitrogen (once per month), nitrite nitrogen (once per month), and temperature (once per day) have been retained from previous Order R5-2014-0051 to determine compliance with effluent limitations for these parameters.
 - b. Order R5-2014-0051 required continuous effluent monitoring for pH and pH in the discharge did not demonstrate reasonable potential to exceed water quality objectives/criteria. This NOA reduces the monitoring for pH to daily. The Central Valley Water Board finds that this frequency is sufficient for determining compliance with the effluent limits for pH.
 - c. Order R5-2014-0049 required five times per week effluent monitoring for total coliform organisms measured at UVS-002 to determine compliance with the total coliform organisms effluent limits. This NOA reduces the monitoring for total coliform organisms to three times per week. The Central Valley Water Board finds that this frequency is sufficient to characterize the discharge when the discharge is not used for recycled

water per the monitoring requirements in Master Reclamation Permit, Order 97-147, Amendment No. 2.

- d. Order R5-2014-0051 required three times per week effluent monitoring for BOD and TSS to determine the percent removal and effluent concentrations of these parameters. This NOA reduces the monitoring for BOD and TSS to one time per week. The Central Valley Water Board finds that this frequency is sufficient to characterize the discharge.
- e. Order R5-2014-0051 required once per month effluent monitoring for fluoride. Fluoride did not demonstrate reasonable potential to exceed water quality objectives/criteria. Therefore, specific monitoring requirements for fluoride have not been retained in this NOA.
- f. Order R5-2014-0051 required effluent monitoring for mercury and total dissolved solids. Monitoring data collected over the permit term for Order R5-2014-0051 for mercury and total dissolved solids did not demonstrate reasonable potential to exceed water quality objectives/criteria. Pleasant Grove Creek is not on the 303(d) list as being impaired for mercury or total dissolved solids. Therefore, regular monitoring requirements for mercury and total dissolved solids have not been retained in this NOA.
- g. Order R5-2014-0051 required effluent monitoring for priority pollutants and other pollutants of concern quarterly during the third year of the permit term. This NOA revises that schedule to require quarterly monitoring for four consecutive quarters beginning the third quarter of 2020 (see MRP, Appendix D, section F and Table D-8). The Central Valley Water Board finds that this frequency is sufficient to characterize the discharge.

C. Whole Effluent Toxicity Testing Requirements

- 1. **Acute Toxicity.** Effluent monitoring frequency for acute toxicity 96-hour bioassay (twice per year) has been retained from previous Order R5-2014-0051 to demonstrate compliance with the effluent limitation for acute toxicity. The Central Valley Water Board finds that this frequency will provide sufficient information to determine if the Facility is contributing acute toxicity to Pleasant Grove Creek.
- 2. **Chronic Toxicity.** Effluent monitoring frequency for chronic toxicity bioassay testing (once per quarter) has been retained from previous Order R5-2014-0051. Chronic whole effluent toxicity testing is required when discharging to Pleasant Grove Creek in order to demonstrate compliance with the Basin Plan's narrative toxicity objective.

D. Receiving Water Monitoring

- 1. **Pleasant Grove Creek**
 - a. Receiving water monitoring is necessary to assess compliance with receiving water limitations and to assess the impacts of the discharge to Pleasant Grove Creek.
 - b. Monitoring data collected during the term of Order R5-2014-0051 indicates that the discharge has not caused significant impacts to Pleasant Grove Creek. Therefore, this NOA retains the monitoring frequency for pH (once per week), hardness (once per month), and temperature (once per week). The Central Valley Water Board finds that these frequencies are sufficient to assess compliance with receiving water limitations and to assess the impacts of the discharge to Pleasant Grove Creek.
 - c. Order R5-2014-0051 required receiving water monitoring for dissolved oxygen (once per week) and electric conductivity (once per week). Monitoring data collected during the term of Order R5-2014-0051 indicates that the discharge has not caused significant

impacts to Pleasant Grove Creek. Therefore, this NOA decreases the monitoring frequency for dissolved oxygen (once per month) and electric conductivity (once per month). The Central Valley Water Board finds that these frequencies are sufficient to assess compliance with receiving water limitations and to assess the impacts of the discharge to Pleasant Grove Creek.

- d. Order R5-2014-0051 required upstream receiving water monitoring for priority pollutants and other pollutants of concern concurrently with effluent monitoring for one year with samples taken quarterly during the third year of the permit term. This NOA reduces upstream receiving water characterization monitoring to twice per permit term. The first sample event shall be during the third quarter of 2020 and the second sample event shall be during the first quarter of 2021 (see MRP, Appendix D, Table D-8). The Central Valley Water Board finds that this frequency is sufficient to assess the impacts of the discharge to Pleasant Grove Creek.

2. Groundwater– Not Applicable

E. Biosolids Monitoring

1. Biosolids monitoring for compliance with 40 C.F.R. part 503 regulations administered by U.S. EPA is not included in the Municipal General Order, and therefore, is not included in this NOA. However, annual sludge monitoring is required for compliance with the pretreatment requirements as specified in the Municipal General Order, Attachment E, section X.D.5.a.

F. Pond Monitoring

1. When any type of wastewater is directed to any storage basin, this NOA requires the Discharger to keep a log for LND-001, LND-002, LND-003, and LND-004 to record the date, type of wastewater, volume, duration, and freeboard for each pond. Additional pond monitoring requirements contained in the Municipal General Order are applicable as specified in section IX, Provisions, Table 4 of the NOA. The Central Valley Water Board finds that monitoring for these parameters is necessary to ensure proper operation of the storage basins; therefore, these parameters have been included in this NOA.
2. Order R5-2014-0051 required regular monitoring for freeboard, pH, electrical conductivity, odors, levee condition, and dissolved oxygen at LND-001, LND-002, LND-003, and LND-004. The Facilities four storage basins are earthen-lined and do not store wastewater for extended periods of time. The Central Valley Water Board finds that monitoring for these parameters is not necessary to ensure proper operation of the storage basins; therefore, this monitoring has not been retained in this NOA.

G. Filtration System Monitoring

1. Continuous monitoring for turbidity is included under the UV Disinfection System monitoring requirements in previous Order R5-2014-0051. Continuous monitoring for turbidity is retained in this NOA as specified in section IX.C of the MRP, Appendix D.

H. UV Disinfection System Monitoring

1. Continuous monitoring for flow, number of UV banks in operation, UV transmittance, and UV dose has been retained from previous Order R5-2014-0051.
2. Order R5-2014-0051 required five times per week effluent monitoring for total coliform organisms. This NOA reduces the monitoring for total coliform organisms to three times per

week. The Central Valley Water Board finds that this frequency is sufficient to determine compliance with the effluent limits for total coliform organisms.

I. Effluent and Receiving Water Characterization Monitoring

1. Order R5-2014-0051 included quarterly monitoring of the effluent and upstream receiving water during the third year of the permit term. This NOA requires characterization monitoring of the effluent for four consecutive quarters beginning the third quarter of 2020. This NOA requires characterization monitoring of the upstream receiving water once during the third quarter of 2020 and once during the first quarter of 2021. See section IX.F of the MRP, Appendix D, for further details regarding characterization monitoring. The Central Valley Water Board finds that the reduced frequency of receiving water characterization monitoring will be sufficient to characterize the receiving water.

IV. PRETREATMENT PROVISION

A. Pretreatment Requirements

1. On 9 January 1984, the U.S. EPA approved the Discharger's Industrial Pretreatment Program in accordance with 40 CFR Part 403. The Industrial Pretreatment Program requires issuance of waste discharge permits to Significant Industrial Users/Categorical Industrial Users, Non-significant Industrial Users, and food service establishments (to control fats, oils, and grease). The program also regulates Significant Commercial Users and dental offices and implements best management practices. The Discharger's Pleasant Grove and Dry Creek wastewater treatment plants have undergone eight compliance inspections or audits since 2004.
2. The federal CWA section 307(b), and federal regulations, 40 C.F.R. part 403, require POTW's to develop an acceptable industrial pretreatment program. A pretreatment program is required to prevent the introduction of pollutants, which will interfere with treatment plant operations or sludge disposal, and prevent pass through of pollutants that exceed water quality objectives, standards or permit limitations. Pretreatment requirements are imposed pursuant to 40 C.F.R. part 403.
3. The Discharger shall implement and enforce its approved pretreatment program in accordance with 40 C.F.R. part 403 and is an enforceable condition of this NOA. If the Discharger fails to perform the pretreatment functions, the Central Valley Water Board, the State Water Board or U.S. EPA may take enforcement actions against the Discharger as authorized by the CWA.

V. SUMMARY OF REASONABLE POTENTIAL ANALYSIS

Constituent	Units	MEC	B	C	CMC	CCC	Water & Org	Org. Only	Basin Plan	MCL	RP
Ammonia Nitrogen, Total (as N)	mg/L	0.07	--	1.4	17.03 ¹	1.4 ²	--	--	--	--	Yes ³
Nitrate Plus Nitrite (as N)	mg/L	6	0.04	10	--	--	--	--	--	10	Yes ³

General Note: All inorganic concentrations are given as a total recoverable.

MEC = Maximum Effluent Concentration

B = Maximum Receiving Water Concentration or lowest detection level, if non-detect

C = Criterion used for RP Analysis

CMC = Criterion Maximum Concentration (CTR or NTR)

CCC = Criterion Continuous Concentration (CTR or NTR)

Water & Org = Human Health Criterion for Consumption of Water & Organisms (CTR or NTR)

Org. Only = Human Health Criterion for Consumption of Organisms Only (CTR or NTR)

Basin Plan = Numeric Site-specific Basin Plan Water Quality Objective

MCL = Drinking Water Standards Maximum Contaminant Level

NA = Not Available

ND = Non-detect

RP = Reasonable Potential

Footnotes:

¹ U.S. EPA National Recommended Ambient Water Quality Criteria Freshwater Aquatic Life Protection, 1-hour average.

² U.S. EPA National Recommended Ambient Water Quality Criteria Freshwater Aquatic Life Protection, 30-day average.

³ RP exists due to the biological processes inherent to the treatment of domestic wastewater (see sections V.C.3.b.ii and V.C.3.b.ix in Attachment F, Fact Sheet, of the Municipal General Order).

APPENDIX D – MONITORING AND REPORTING PROGRAM

Contents

I. General Monitoring Provisions	D-2
II. Monitoring Locations	D-3
III. Influent Monitoring Requirements	D-4
A. Monitoring Location INF-001	D-4
IV. Effluent Monitoring Requirements	D-4
A. Monitoring Location EFF-001	D-4
V. Whole Effluent Toxicity Testing Requirements	D-5
A. Acute Toxicity Testing	D-5
B. Chronic Toxicity Testing	D-5
C. WET Testing Notification Requirements	D-7
D. WET Testing Reporting Requirements	D-7
VI. Land Discharge Monitoring Requirements – Not Applicable	D-8
VII. Recycling Monitoring Requirements – Not Applicable	D-8
VIII. Receiving Water Monitoring Requirements	D-8
A. Monitoring Locations RSW-001 and RSW-002	D-8
IX. Other Monitoring Requirements	D-9
A. Biosolids – Not Applicable	D-9
B. Ponds	D-9
C. Municipal Water Supply – Not Applicable	D-9
D. Filtration System	D-9
E. Ultraviolet Light (UV) Disinfection System	D-9
F. Effluent and Receiving Water Characterization	D-10
X. Reporting Requirements	D-15
A. General Monitoring and Reporting Requirements	D-15
B. Self-Monitoring Reports	D-15
C. Discharge Monitoring Reports (DMRs)	D-18
D. Other Reports	D-18

Tables

Table D-1. Monitoring Station Locations	D-3
Table D-2. Influent Monitoring	D-4
Table D-3. Effluent Monitoring	D-4
Table D-4. Chronic Toxicity Testing Dilution Series	D-6
Table D-5. Receiving Water Monitoring Requirements	D-8
Table D-6. Filtration System Monitoring Requirements	D-9
Table D-7. UV Disinfection System Monitoring Requirements	D-10
Table D-8. Effluent and Receiving Water Characterization Monitoring	D-11
Table D-9. Monitoring Periods and Reporting Schedule	D-16
Table D-10. Technical Reports	D-21

APPENDIX D – MONITORING AND REPORTING PROGRAM (MRP)

The Municipal General Order contains monitoring and reporting requirements in Attachment E. Some of the monitoring and reporting requirements listed in the Municipal General Order are not applicable to the Discharger. The monitoring and reporting requirements applicable to the Discharger are contained in this Appendix and are listed herein.

The Code of Federal Regulations (40 C.F.R. § 122.48) requires that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Central Valley Water Board to require technical and monitoring reports. This MRP establishes monitoring and reporting requirements that implement federal and California regulations.

I. GENERAL MONITORING PROVISIONS

- A.** Samples and measurements taken as required herein shall be representative of the volume and nature of the monitored discharge. All samples shall be taken at the monitoring locations specified below and, unless otherwise specified, before the monitored flow joins or is diluted by any other waste stream, body of water, or substance. Monitoring locations shall not be changed without notification to and the approval of the Central Valley Water Board.
- B.** Effluent samples shall be taken downstream of the last addition of wastes to the treatment or discharge works where a representative sample may be obtained prior to mixing with the receiving waters. Samples shall be collected at such a point and in such a manner to ensure a representative sample of the discharge.
- C.** Chemical, bacteriological, and bioassay analyses of any material required by the Notice of Applicability (NOA) and this MRP shall be conducted by a laboratory certified for such analyses by the State Water Resources Control Board (State Water Board), Division of Drinking Water (DDW; formerly the Department of Public Health). Laboratories that perform sample analyses must be identified in all monitoring reports submitted to the Central Valley Water Board. In the event a certified laboratory is not available to the Discharger for any onsite field measurements such as pH, dissolved oxygen, turbidity, temperature, and residual chlorine, such analyses performed by a noncertified laboratory will be accepted provided a Quality Assurance-Quality Control Program is instituted by the laboratory. A manual containing the steps followed in this program for any onsite field measurements such as pH, dissolved oxygen, turbidity, temperature, and residual chlorine must be kept onsite in the treatment facility laboratory and shall be available for inspection by Central Valley Water Board staff. The Discharger must demonstrate sufficient capability (qualified and trained employees, properly calibrated and maintained field instruments, etc.) to adequately perform these field measurements. The Quality Assurance-Quality Control Program must conform to U.S. EPA guidelines or to procedures approved by the Central Valley Water Board.
- D.** Appropriate flow measurement devices and methods consistent with accepted scientific practices shall be selected and used to ensure the accuracy and reliability of measurements of the volume of monitored discharges. All monitoring instruments and devices used by the Discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary, at least yearly, to ensure their continued accuracy. All flow measurement devices shall be calibrated at least once per year to ensure continued accuracy of the devices.
- E.** Monitoring results, including noncompliance, shall be reported at intervals and in a manner specified in this MRP.

- F.** Laboratories analyzing monitoring samples shall be accredited by DDW, in accordance with the provision of Water Code section 13176, and must include quality assurance/quality control data with their reports.
- G.** The Discharger shall ensure that the results of the Discharge Monitoring Report-Quality Assurance (DMR-QA) Study or the most recent Water Pollution Performance Evaluation Study are submitted annually to the State Water Resources Control Board at the following address:
- State Water Resources Control Board Quality Assurance Program Officer
Office of Information Management and Analysis
State Water Resources Control Board
1001 I Street, Sacramento, CA 95814
- H.** The Discharger shall file with the Central Valley Water Board technical reports on self-monitoring performed according to the detailed specifications contained in this MRP.
- I.** The results of all monitoring required by this MRP shall be reported to the Central Valley Water Board, and shall be submitted in such a format as to allow direct comparison with the limitations and requirements of the NOA. Unless otherwise specified, discharge flows shall be reported in terms of the monthly average and the daily maximum discharge flows.
- J.** Multiple Discharge Points – Not Applicable.

II. MONITORING LOCATIONS

The Discharger shall establish the monitoring locations listed in Table D-1 to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in the NOA.

Table D-1. Monitoring Station Locations

Discharge Point Name	Monitoring Location Name	Monitoring Location Description
--	INF-001	A location where a representative sample of the influent into the Facility can be collected.
001	EFF-001	A location where a representative sample of wastewater can be collected immediately downstream of the ultraviolet light (UV) disinfection system and the last connection through which water can be admitted into the outfall. Latitude: 38° 79' 21" N Longitude: 121° 37' 01" W
--	RSW-001	In Pleasant Grove Creek, approximately 200 feet upstream of Discharge Point 001.
--	RSW-002	In Pleasant Grove Creek, approximately 200 feet downstream of Discharge Point 001.
--	BIO-001	A location where a representative sample of the biosolids can be obtained.
--	FIL-001	Monitoring of the filter effluent to be measured downstream of the filters and ultraviolet light (UV) disinfection system and upstream of the point of diversion to the effluent storage basins.
--	UVS-001	A location where a representative sample of wastewater can be collected immediately upstream of the UV disinfection system.
--	UVS-002	A location where a representative sample of wastewater can be collected immediately downstream of the UV disinfection system.
--	LND-001	Monitoring within Effluent Storage Basin 1.
--	LND-002	Monitoring within Effluent Storage Basin 2.
--	LND-003	Monitoring within Effluent Storage Basin 3.
--	LND-004	Monitoring within the Emergency Storage Basin.

III. INFLUENT MONITORING REQUIREMENTS

A. Monitoring Location INF-001

1. The Discharger shall monitor influent to the Facility at Monitoring Location INF-001 as specified in Table D-2 below.

Table D-2. Influent Monitoring

Parameter	Units	Sample Type	Sampling Frequency	Required Analytical Test Method
Flow	MGD	Meter	Continuous	--
Conventional Pollutants				
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	24-hr Composite ¹	1/Week	²
Total Suspended Solids	mg/L	24-hr Composite ¹	1/Week	²

¹ 24-hour flow proportional composite.

² Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. part 136; or by methods approved by the Central Valley Water Board or the State Water Board.

IV. EFFLUENT MONITORING REQUIREMENTS

A. Monitoring Location EFF-001

1. The Discharger shall monitor treated domestic wastewater at Monitoring Location EFF-001 as specified in Table D-3. If there was no discharge to receiving water during the designated monitoring period, monitoring is not required for that period. If there was no discharge, the Discharger shall so state in the monthly self-monitoring report (SMR). If more than one analytical test method is listed for a given parameter, the Discharger must select from the listed methods and corresponding Minimum Level (ML).

Table D-3. Effluent Monitoring

Parameter	Units	Sample Type	Sampling Frequency	Required Analytical Test Method
Flow	MGD	Meter	Continuous	--
Conventional Pollutants				
Biochemical Oxygen Demand (5-day @ 20° C)	mg/L	24-hr Composite ¹	1/Week	²
pH	standard units	Grab ³	1/Day ^{4,5}	²
Total Suspended Solids	mg/L	24-hr Composite ¹	1/Week	²
Non-Conventional Pollutants				
Ammonia Nitrogen, Total (as N)	mg/L	Grab ³	1/Week ^{4,6}	²
Electrical Conductivity @ 25°C	µmhos/cm	Grab ^{3,5}	1/Month	²
Hardness, Total (as CaCO ₃)	mg/L	Grab ³	1/Month	²
Nitrate Plus Nitrite (as N)	mg/L	Calculate	1/Month	²
Nitrate Nitrogen, Total (as N)	mg/L	Grab ³	1/Month	²
Nitrite Nitrogen, Total (as N)	mg/L	Grab ³	1/Month	²
Temperature	°C	Grab ³	1/Day ^{4,5}	²

Parameter	Units	Sample Type	Sampling Frequency	Required Analytical Test Method
-----------	-------	-------------	--------------------	---------------------------------

- ¹ 24-hour flow proportional composite.
- ² Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
- ³ A grab sample is defined as an individual discrete sample collected over a period of time not exceeding 15 minutes. It can be taken manually, using a pump, scoop, vacuum, or other suitable device.
- ⁴ pH and temperature shall be recorded at the time of ammonia sample collection.
- ⁵ A hand-held field meter may be used, provided the meter utilizes a U.S. EPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.
- ⁶ Concurrent with whole effluent toxicity monitoring.

V. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS

A. Acute Toxicity Testing.

The Discharger shall conduct acute toxicity testing to determine whether the effluent is contributing acute toxicity to the receiving water. The Discharger shall meet the following acute toxicity testing requirements:

1. Monitoring Frequency – The Discharger shall perform acute toxicity testing, twice per year, while the Facility is discharging to Pleasant Grove Creek and concurrent with effluent ammonia sampling.
2. Sample Types – The Discharger may use flow-through or static renewal testing. For static renewal testing, the samples shall be flow proportional 24-hour composite or grab samples, and shall be representative of the volume and quality of the discharge. The effluent samples shall be taken at Monitoring Location EFF-001.
3. Test Species – The test species shall be rainbow trout (*Oncorhynchus mykiss*).
4. Test Duration – Test duration shall be 96 hours.
5. Methods – The acute toxicity testing samples shall be analyzed using EPA-821-R-02-012, Fifth Edition. Temperature and pH shall be recorded at the time of sample collection. No pH adjustment may be made unless approved by the Executive Officer.
6. Test Failure – If an acute toxicity test does not meet all test acceptability criteria, as specified in the test method, the Discharger must re-sample and re-test as soon as possible, not to exceed 7 days following notification of test failure.

B. Chronic Toxicity Testing.

The Discharger shall conduct chronic toxicity testing to determine whether the effluent is contributing chronic toxicity to the receiving water. The Discharger shall meet the following chronic toxicity testing requirements:

1. Monitoring Frequency – The Discharger shall perform quarterly chronic toxicity testing during quarters in which there is a discharge to receiving water. If the result of the routine chronic toxicity testing event exhibits toxicity, demonstrated by the result greater than 1.3 TUC (as 100/EC25) AND a percent effect greater than 25 percent at 100 percent effluent, the Discharger has the option of conducting two additional compliance monitoring chronic toxicity testing events in order to calculate a median. The optional compliance monitoring events shall occur at least one week apart, and the final monitoring event shall be initiated no later than 6 weeks from the routine monitoring event that exhibited toxicity.

2. **Sample Types** – Effluent samples shall be flow proportional 24-hour composite samples and shall be representative of the volume and quality of the discharge. The effluent samples shall be taken at Monitoring Location EFF-001. The receiving water control shall be a grab sample obtained from Monitoring Location RSW-001.
3. **Sample Volumes** – Adequate sample volumes shall be collected to provide renewal water to complete the test in the event that the discharge is intermittent.
4. **Test Species** – Chronic toxicity testing measures sublethal (e.g., reduced growth, reproduction) and/or lethal effects to test organisms exposed to an effluent compared to that of the control organisms. The Discharger shall conduct chronic toxicity tests with the water flea, *Ceriodaphnia dubia* (survival and reproduction test) unless otherwise specified in writing by the Executive Officer.
5. **Most Sensitive Species Determination** –The Discharger determined the most sensitive species to be the water flea (*Ceriodaphnia dubia*) specified above. The Discharger has made this determination by selecting the species demonstrating the highest percent effect at the instream waste concentration from four quarterly monitoring events and shall be used for chronic toxicity testing for the remainder of the permit term, except where documented issues with the sample analysis or related to the sample analysis prevent a clear selection of the most sensitive species. The Discharger used the four most recent tests conducted prior to receiving the NOA for use in determining the most sensitive species and the tests were conducted in a manner consistent and sufficient to make such determination. The Discharger requested Executive Officer approval on 29 October 2018 of the most sensitive species determination after conducting the four sets of quarterly chronic toxicity monitoring events. Executive Officer approval is hereby issued upon the effective date of this NOA and, therefore, Executive Officer approval of water flea (*Ceriodaphnia dubia*) is granted.
6. **Methods** – The presence of chronic toxicity shall be estimated as specified in *Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition*, EPA/821-R-02-013, October 2002.
7. **Reference Toxicant** – As required by the SIP, all chronic toxicity tests shall be conducted with concurrent testing with a reference toxicant and shall be reported with the chronic toxicity test results.
8. **Dilutions** –The chronic toxicity testing shall be performed using the dilution series identified in Table D-4, below, unless an alternative dilution series is detailed in the submitted Toxicity Reduction Evaluation (TRE) Action Plan. A receiving water control or laboratory water control may be used as the diluent.

Table D-4. Chronic Toxicity Testing Dilution Series

Sample	Dilutions ^a (%)					Control
	100	75	50	25	12.5	
% Effluent	100	75	50	25	12.5	0
% Control Water	0	25	50	75	87.5	100

^a Receiving water control or laboratory water control may be used as the diluent.

9. **Test Failure** – The Discharger must re-sample and re-test as soon as possible, but no later than fourteen (14) days after receiving notification of a test failure. A test failure is defined as follows:
 - a. The reference toxicant test or the effluent test does not meet all test acceptability criteria as specified in the *Short-term Methods for Estimating the Chronic Toxicity of*

Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition, EPA/821-R-02-013, October 2002 (Method Manual), and its subsequent amendments or revisions;
or

- b. The percent minimum significant difference (PMSD) measured for the test exceeds the upper PMSD bound variability criterion in Table 6 on page 52 of the Method Manual. (A retest is only required in this case if the test results do not exceed the monitoring trigger specified in the Special Provision at section VII.C.2.a.iii of the Municipal General Order.)

C. WET Testing Notification Requirements.

The Discharger shall notify the Central Valley Water Board within 24-hours after the receipt of test results exceeding the monitoring trigger during regular monitoring, or an exceedance of the acute toxicity effluent limitation.

D. WET Testing Reporting Requirements.

All toxicity test reports shall include the contracting laboratory's complete report provided to the Discharger and shall be in accordance with the appropriate "Report Preparation and Test Review" sections of the method manuals. At a minimum, whole effluent toxicity monitoring shall be reported as follows:

1. **Chronic WET Reporting.** Chronic toxicity monitoring results shall be reported to the Central Valley Water Board with the quarterly self-monitoring report, and shall contain, at minimum:
 - a. The results expressed in TUC, measured as 100/NOEC, and also measured as 100/LC50, 100/EC25, 100/IC25, and 100/IC50, as appropriate.
 - b. The percent effect at the instream waste concentration;
 - c. The statistical methods used to calculate endpoints;
 - d. The statistical output page, which includes the calculation of the percent minimum significant difference (PMSD);
 - e. The dates of sample collection and initiation of each toxicity test; and
 - f. The results compared to the numeric toxicity monitoring trigger or effluent limitation.

Additionally, the quarterly SMR shall contain an updated chronology of chronic toxicity test results expressed in TUC and percent effect at the instream waste concentration, and organized by type of test (survival, growth or reproduction), and monitoring frequency, i.e., either quarterly, monthly, monthly median, or TRE.

2. **Acute WET Reporting.** Acute toxicity test results shall be submitted with the quarterly SMR and reported as percent survival.
3. **TRE or Toxicity Evaluation Study Reporting.** Reports for TREs or a Toxicity Evaluation Study shall be submitted in accordance with the schedule contained in the Discharger's approved TRE Workplan, or as amended by the Discharger's TRE Action Plan.
4. **Quality Assurance (QA).** The Discharger must provide the following information for QA purposes:
 - a. Results of the applicable reference toxicant data with the statistical output page giving the species, NOEC, LOEC, type of toxicant, dilution water used, concentrations used, PMSD, and dates tested.

- b. The reference toxicant control charts for each endpoint, which include summaries of reference toxicant tests performed by the contracting laboratory.
- c. Any information on deviations or problems encountered and how they were dealt with.

VI. LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE

VII. RECYCLING MONITORING REQUIREMENTS – NOT APPLICABLE

VIII. RECEIVING WATER MONITORING REQUIREMENTS

A. Monitoring Locations RSW-001 and RSW-002

1. The Discharger shall monitor Pleasant Grove Creek at Monitoring Locations RSW-001 and RSW-002 as specified in Table D-5. If there was no discharge to receiving water during the designated monitoring period, monitoring is not required during that period. If there is no upstream flow in the receiving water during the designated monitoring period, monitoring is not required at RSW-001 during that period. Whenever monitoring is not required, the Discharger shall state so in the monthly SMR.

Table D-5. Receiving Water Monitoring Requirements

Parameter	Units	Sample Type	Sampling Frequency	Required Analytical Test Method
Conventional Pollutants				
pH	standard units	Grab ^{1,2}	1/Week	3
Non-Conventional Pollutants				
Dissolved Oxygen	mg/L	Grab ^{1,2}	1/Month	3
Electrical Conductivity @ 25°C	µmhos/cm	Grab ^{1,2}	1/Month	3
Hardness, Total (as CaCO ₃)	mg/L	Grab ²	1/Month	3
Temperature	°C	Grab ^{1,2}	1/Week	3

¹ A hand-held field meter may be used, provided the meter utilizes a U.S. EPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.

² A grab sample is defined as an individual discrete sample collected over a period of time not exceeding 15 minutes. It can be taken manually, using a pump, scoop, vacuum, or other suitable device.

³ Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. part 136 or by methods approved by the Central Valley Water Board or the State Water Board.

2. In conducting the receiving water sampling required by section VIII.A.1 above, a log shall be kept of the receiving water conditions throughout the reach bounded by Monitoring Locations RSW-001 and RSW-002. Attention shall be given to the presence or absence of:
 - a. Floating or suspended matter;
 - b. Discoloration;
 - c. Bottom deposits;
 - d. Aquatic life;
 - e. Visible films, sheens, or coatings;
 - f. Fungi, slimes, or objectionable growths; and
 - g. Potential nuisance conditions.

Notes on receiving water conditions shall be summarized in the monitoring report.

IX. OTHER MONITORING REQUIREMENTS

A. Biosolids

1. Monitoring Location BIO-001

- a. Biosolids monitoring for compliance with 40 C.F.R. part 503 regulations administered by U.S. EPA is not included in the Municipal General Order, and therefore, is not included in this NOA. However, annual sludge monitoring is required for compliance with the pretreatment requirements as specified in the Municipal General Order, Attachment E, section X.D.5.a.

B. Ponds

1. Monitoring Locations LND-001, LND-002, LND-003, and LND-004

- a. The Discharger shall keep a log regarding the use of the basins. In particular, the Discharger shall record in the log the following when any type of wastewater is directed to Effluent Storage Basin 1, Effluent Storage Basin 2, Effluent Storage Basin 3, and the Emergency Storage Basin at Monitoring Locations LND-001, LND-002, LND-003, and LND-004, respectively:
 - i. The date(s) when the wastewater is directed to the basin;
 - ii. The type(s) of wastewater (e.g., untreated due to plant upset, tertiary treated, etc.) directed to the basin;
 - iii. The total volume of wastewater directed to the basin (volume may be estimated); and
 - v. The daily freeboard in the basin.

C. Municipal Water Supply – Not Applicable

D. Filtration System

1. Monitoring Location FIL-001

- a. The Discharger shall monitor the filtration system at Monitoring Location FIL-001 as specified in Table D-6.

Table D-6. Filtration System Monitoring Requirements

Parameter	Units	Sample Type	Sampling Frequency	Required Analytical Test Method
Turbidity	NTU	Meter	Continuous	^{1,2}

¹ For continuous analyzers, the Discharger shall report documented routine meter maintenance activities including date, time of day, and duration, for instances in which a continuous measurement is not available due to the analyzer(s) not being in operation due to maintenance activities. If analyzer(s) fail to provide continuous monitoring for more than two hours and influent and/or effluent from the disinfection process is not diverted for retreatment, the Discharger shall obtain and report hourly manual and/or grab sample results.

² Report daily average and maximum turbidity.

E. Ultraviolet Light (UV) Disinfection System

1. Monitoring Locations UVS-001 and UVS-002

- a. The Discharger shall monitor the UV disinfection system at Monitoring Locations UVS-001 and UVS-002 as specified in Table D-7:

Table D-7. UV Disinfection System Monitoring Requirements

Parameter	Units	Sample Type	Sampling Frequency	Monitoring Location
Flow	MGD	Meter	Continuous ¹	UVS-001
Number of UV banks in operation ²	Number	Observation	Continuous ¹	N/A
UV Transmittance ³	Percent (%)	Meter	Continuous ¹	UVS-001
UV Dose ⁴	mJ/cm ²	Calculated	Continuous ¹	N/A
Total Coliform Organisms ⁵	MPN/100 mL	Grab	3/Week	UVS-002

¹ For continuous analyzers, the Discharger shall report documented routine meter maintenance activities including date, time of day, and duration, for instances in which a continuous measurement is not available due to the analyzer(s) not being in operation due to maintenance activities. If analyzer(s) fail to provide continuous monitoring for more than two hours and influent and/or effluent from the disinfection process is not diverted for retreatment, the Discharger shall obtain and report hourly manual and/or grab sample results. The Discharger shall not decrease power settings or reduce the number of UV lamp banks in operation while the continuous analyzers are out of service and water is being disinfected.

² Report daily number of UV banks in operation.

³ Report daily minimum hourly average UV transmittance. The minimum hourly average transmittance shall consist of lowest average transmittance recorded over an hour of a day when flow is being discharged. If the system does not operate for an entire hour interval on a given day or if effluent flow is not discharged for an entire hour, the transmittance will be averaged based on the actual operation time when discharges are occurring.

⁴ Report daily minimum hourly average UV dose. The minimum hourly average dose shall consist of lowest hourly average dose provided in any channel that had at least one bank of lamps operating during the hour interval. For channels that did not operate for the entire hour interval or when effluent flow is not discharged for the entire hour, the dose will be averaged based on the actual operation time when discharges occurred.

⁵ Pollutant shall be analyzed using the analytical methods described in 40 C.F.R. Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.

F. Effluent and Receiving Water Characterization

The Discharger shall monitor the effluent and receiving water at Monitoring Locations EFF-001 and RSW-001, respectively, for the constituents listed in Table D-8, as described in this section.

- Monitoring Frequency.** Samples shall be collected in four consecutive quarters from the effluent (Monitoring Location EFF-001) beginning third quarter 2020 and twice from the upstream receiving water (Monitoring Location RSW-001), once during third quarter 2020 and once during first quarter 2021. All sampling shall be analyzed for the constituents listed in Table D-8, below. The results of such monitoring shall be submitted to the Central Valley Water Board with the quarterly SMR's. Each individual monitoring event shall provide representative sample results for the effluent and upstream receiving water.
- Concurrent Sampling.** Receiving water sampling shall be performed at approximately the same time and on the same date as the effluent sampling events.
- Sample Type.** All receiving water samples shall be taken as grab samples. Effluent samples shall be taken as described in Table D-8, below.
- Analytical Methods Report.** The Discharger shall submit a report electronically via CIWQS submittal outlining reporting levels (RLs), method detection limits (MDLs), and analytical methods for the constituents listed in tables D-2, D-3, D-5, D-6, D-7, and D-8 by the due date shown in the Technical Reports Table D-10. The Discharger shall comply

with the monitoring and reporting requirements for CTR constituents as outlined in section 2.3 and 2.4 of the SIP. The maximum required reporting levels for priority pollutant constituents shall be based on the MLs contained in Appendix 4 of the SIP, determined in accordance with Section 2.4.2 and Section 2.4.3 of the SIP. In accordance with Section 2.4.2 of the SIP, when there is more than one ML value for a given substance, the Central Valley Water Board shall include as RLs, in the NOA, all ML values, and their associated analytical methods, listed in Appendix 4 of the SIP that are below the calculated effluent limitation. The Discharger may select any one of those cited analytical methods for compliance determination. If no ML value is below the effluent limitation, then the Central Valley Water Board shall select as the RL, the lowest ML value, and its associated analytical method, listed in Appendix 4 of the SIP for inclusion in the NOA. Table D-8 below provides required maximum RLs in accordance with the SIP.

Table D-8. Effluent and Receiving Water Characterization Monitoring

Parameter	Units	Effluent Sample Type	Maximum Reporting Level ¹
2- Chloroethyl vinyl ether	µg/L	Grab ²	1
Acrolein	µg/L	Grab ²	2
Acrylonitrile	µg/L	Grab ²	2
Benzene	µg/L	Grab ²	0.5
Bromoform	µg/L	Grab ²	2
Carbon Tetrachloride	µg/L	Grab ²	0.5
Chlorobenzene	µg/L	Grab ²	2
Chloroethane	µg/L	Grab ²	2
Chloroform	µg/L	Grab ²	2
Chloromethane	µg/L	Grab ²	2
Dibromochloromethane	µg/L	Grab ²	0.5
Dichlorobromomethane	µg/L	Grab ²	0.5
Dichloromethane	µg/L	Grab ²	2
Ethylbenzene	µg/L	Grab ²	2
Hexachlorobenzene	µg/L	Grab ²	1
Hexachlorobutadiene	µg/L	Grab ²	1
Hexachloroethane	µg/L	Grab ²	1
Methyl bromide (Bromomethane)	µg/L	Grab ²	2
Naphthalene	µg/L	Grab ²	10
3-Methyl-4-Chlorophenol	µg/L	Grab ²	--
Tetrachloroethylene	µg/L	Grab ²	0.5
Toluene	µg/L	Grab ²	2
trans-1,2-Dichloroethylene	µg/L	Grab ²	1
Trichloroethene	µg/L	Grab ²	2
Vinyl chloride	µg/L	Grab ²	0.5
Methyl-tert-butyl ether (MTBE)	µg/L	Grab ²	--
1,1,1-Trichloroethane	µg/L	Grab ²	2
1,1,2- Trichloroethane	µg/L	Grab ²	0.5
1,1-dichloroethane	µg/L	Grab ²	1
1,1-dichloroethylene	µg/L	Grab ²	0.5

Parameter	Units	Effluent Sample Type	Maximum Reporting Level ¹
1,2-dichloropropane	µg/L	Grab ²	0.5
1,3-dichloropropylene	µg/L	Grab ²	0.5
1,1,2,2-tetrachloroethane	µg/L	Grab ²	0.5
1,2,4-trichlorobenzene	µg/L	Grab ²	5
1,2-dichloroethane	µg/L	Grab ²	0.5
1,2-dichlorobenzene	µg/L	Grab ²	2
1,3-dichlorobenzene	µg/L	Grab ²	2
1,4-dichlorobenzene	µg/L	Grab ²	2
1,2-Benzanthracene	µg/L	Grab ²	5
1,2-Diphenylhydrazine	µg/L	Grab ²	1
2-Chlorophenol	µg/L	Grab ²	5
2,4-Dichlorophenol	µg/L	Grab ²	5
2,4-Dimethylphenol	µg/L	Grab ²	2
2,4-Dinitrophenol	µg/L	Grab ²	5
2,4-Dinitrotoluene	µg/L	Grab ²	5
2,4,6-Trichlorophenol	µg/L	Grab ²	10
2,6-Dinitrotoluene	µg/L	Grab ²	5
2-Nitrophenol	µg/L	Grab ²	10
2-Chloronaphthalene	µg/L	Grab ²	10
3,3'-Dichlorobenzidine	µg/L	Grab ²	5
3,4-Benzofluoranthene	µg/L	Grab ²	10
4-Chloro-3-methylphenol	µg/L	Grab ²	5
4,6-Dinitro-2-methylphenol	µg/L	Grab ²	10
4-Nitrophenol	µg/L	Grab ²	10
4-Bromophenyl phenyl ether	µg/L	Grab ²	10
4-Chlorophenyl phenyl ether	µg/L	Grab ²	5
Acenaphthene	µg/L	Grab ²	1
Acenaphthylene	µg/L	Grab ²	10
Anthracene	µg/L	Grab ²	10
Benzidine	µg/L	Grab ²	5
Benzo(a)pyrene (3,4-Benzopyrene)	µg/L	Grab ²	2
Benzo(g,h,i)perylene	µg/L	Grab ²	5
Benzo(k)fluoranthene	µg/L	Grab ²	2
Bis(2-chloroethoxy) methane	µg/L	Grab ²	5
Bis(2-chloroethyl) ether	µg/L	Grab ²	1
Bis(2-chloroisopropyl) ether	µg/L	Grab ²	10
Bis(2-ethylhexyl) phthalate ³	µg/L	Grab ²	5
Butyl benzyl phthalate	µg/L	Grab ²	10
Chrysene	µg/L	Grab ²	5
Di-n-butylphthalate	µg/L	Grab ²	10
Di-n-octylphthalate	µg/L	Grab ²	10
Dibenzo(a,h)-anthracene	µg/L	Grab ²	0.1

Parameter	Units	Effluent Sample Type	Maximum Reporting Level ¹
Diethyl phthalate	µg/L	Grab ²	10
Dimethyl phthalate	µg/L	Grab ²	10
Fluoranthene	µg/L	Grab ²	10
Fluorene	µg/L	Grab ²	10
Hexachlorocyclopentadiene	µg/L	Grab ²	5
Indeno(1,2,3-c,d)pyrene	µg/L	Grab ²	0.05
Isophorone	µg/L	Grab ²	1
N-Nitrosodiphenylamine	µg/L	Grab ²	1
N-Nitrosodimethylamine	µg/L	Grab ²	5
N-Nitrosodi-n-propylamine	µg/L	Grab ²	5
Nitrobenzene	µg/L	Grab ²	10
Pentachlorophenol	µg/L	Grab ²	1
Phenanthrene	µg/L	Grab ²	5
Phenol	µg/L	Grab ²	1
Pyrene	µg/L	Grab ²	10
Aluminum	µg/L	24-hr Composite ⁴	--
Antimony	µg/L	24-hr Composite ⁴	5
Arsenic	µg/L	24-hr Composite ⁴	10
Asbestos	MFL	24-hr Composite ⁴	--
Beryllium	µg/L	24-hr Composite ⁴	2
Cadmium	µg/L	24-hr Composite ⁴	0.5
Chromium (Total)	µg/L	24-hr Composite ⁴	10
Chromium (VI)	µg/L	24-hr Composite ⁴	10
Copper	µg/L	24-hr Composite ⁴	0.5
Cyanide	µg/L	Grab ²	5
Iron	µg/L	24-hr Composite ⁴	--
Lead	µg/L	24-hr Composite ⁴	0.5
Mercury ⁷	µg/L	24-hr Composite ⁴	0.012
Manganese	µg/L	24-hr Composite ⁴	--
Nickel	µg/L	24-hr Composite ⁴	20
Selenium	µg/L	24-hr Composite ⁴	5
Silver	µg/L	24-hr Composite ⁴	0.25
Thallium	µg/L	24-hr Composite ⁴	1
Zinc	µg/L	24-hr Composite ⁴	20
4,4'-DDD	µg/L	24-hr Composite ⁴	0.05
4,4'-DDE	µg/L	24-hr Composite ⁴	0.05
4,4'-DDT	µg/L	24-hr Composite ⁴	0.01
alpha-Endosulfan	µg/L	24-hr Composite ⁴	0.02
alpha-Hexachlorocyclohexane (BHC)	µg/L	24-hr Composite ⁴	0.01
Aldrin	µg/L	24-hr Composite ⁴	0.005
beta-Endosulfan	µg/L	24-hr Composite ⁴	0.01
beta-Hexachlorocyclohexane	µg/L	24-hr Composite ⁴	0.005

Parameter	Units	Effluent Sample Type	Maximum Reporting Level ¹
Chlordane	µg/L	24-hr Composite ⁴	0.1
delta-Hexachlorocyclohexane	µg/L	24-hr Composite ⁴	0.005
Dieldrin	µg/L	24-hr Composite ⁴	0.01
Endosulfan sulfate	µg/L	24-hr Composite ⁴	0.05
Endrin	µg/L	24-hr Composite ⁴	0.01
Endrin Aldehyde	µg/L	24-hr Composite ⁴	0.01
Heptachlor	µg/L	24-hr Composite ⁴	0.01
Heptachlor Epoxide	µg/L	24-hr Composite ⁴	0.02
Lindane (gamma-Hexachlorocyclohexane)	µg/L	24-hr Composite ⁴	0.5
PCB-1016	µg/L	24-hr Composite ⁴	0.5
PCB-1221	µg/L	24-hr Composite ⁴	0.5
PCB-1232	µg/L	24-hr Composite ⁴	0.5
PCB-1242	µg/L	24-hr Composite ⁴	0.5
PCB-1248	µg/L	24-hr Composite ⁴	0.5
PCB-1254	µg/L	24-hr Composite ⁴	0.5
PCB-1260	µg/L	24-hr Composite ⁴	0.5
Toxaphene	µg/L	24-hr Composite ⁴	--
2,3,7,8-TCDD (Dioxin)	µg/L	24-hr Composite ⁴	--
Ammonia (as N) ⁵	mg/L	24-hr Composite ⁴	--
Boron	µg/L	24-hr Composite ⁴	--
Chloride	mg/L	24-hr Composite ⁴	--
Flow	MGD	Meter	--
Hardness (as CaCO ₃)	mg/L	Grab ²	--
Foaming Agents (MBAS)	µg/L	24-hr Composite ⁴	--
Mercury, Methyl ⁷	ng/L	Grab ²	--
Nitrate (as N) ⁵	mg/L	24-hr Composite ⁴	--
Nitrite (as N) ⁵	mg/L	24-hr Composite ⁴	--
pH	Std Units	Grab ²	--
Phosphorus, Total (as P)	mg/L	24-hr Composite ⁴	--
Specific conductance ⁶	µmhos/cm	24-hr Composite ⁴	--
Sulfate	mg/L	24-hr Composite ⁴	--
Sulfide (as S)	mg/L	24-hr Composite ⁴	--
Sulfite (as SO ₃)	mg/L	24-hr Composite ⁴	--
Temperature	°C	Grab ²	--
Total Dissolved Solids (TDS)	mg/L	24-hr Composite ⁴	--

Parameter	Units	Effluent Sample Type	Maximum Reporting Level ¹
-----------	-------	----------------------	--------------------------------------

¹ The reporting levels required in this table for priority pollutant constituents are established based on section 2.4.2 and Appendix 4 of the SIP.

² A grab sample is defined as an individual discrete sample collected over a period of time not exceeding 15 minutes. It can be taken manually, using a pump, scoop, vacuum, or other suitable device.

³ In order to verify if bis (2-ethylhexyl) phthalate is truly present, the Discharger shall take steps to assure that sample containers, sampling apparatus, and analytical equipment are not sources of the detected contaminant.

⁴ 24-hour flow proportional composite.

⁵ The Discharger is not required to conduct effluent monitoring per this section for ammonia, pH, temperature, nitrate, and nitrite because regular monitoring is required in section IV.A.1 and Table D-3 of this MRP. Hardness monitoring is required by this section even though regular effluent monitoring is required in Table D-3 because hardness samples are needed concurrently with metals sampling. Receiving water monitoring is required for these constituents during the receiving water monitoring event per this section.

⁶ Electrical conductivity.

⁷ Total mercury samples shall be taken using clean hands/dirty hands procedures, as described in U.S. EPA method 1669: *Sampling Ambient Water for Trace Metals at EPA Water Quality Criteria Levels, for collection of equipment blanks* (section 9.4.4.2), and shall be analyzed by U.S. EPA method 1630/1631 (Revision E) with a reporting limit of 0.5 ng/L for total mercury and 0.05 ng/l for methyl mercury.

X. REPORTING REQUIREMENTS

A. General Monitoring and Reporting Requirements

1. The Discharger shall comply with all Standard Provisions (Attachment D of the Municipal General Order) related to monitoring, reporting, and recordkeeping. Upon written request of the Central Valley Water Board, the Discharger shall submit a summary monitoring report. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year(s)
2. **Compliance Time Schedules - Not Applicable**
3. The Discharger shall report to the Central Valley Water Board any toxic chemical release data it reports to the State Emergency Response Commission within 15 days of reporting the data to the Commission pursuant to section 313 of the *"Emergency Planning and Community Right to Know Act"* of 1986.
4. Monitoring frequencies may be adjusted by the Executive Officer to a less frequent basis if a Discharger makes a request and the request is backed by statistical trends of monitoring data submitted.

B. Self-Monitoring Reports

1. The Discharger shall electronically submit SMRs using the State Water Board's California Integrated Water Quality System (CIWQS) Program website (<http://www.waterboards.ca.gov/ciwqs/index.html>). The CIWQS Web site will provide additional information for SMR submittal in the event there will be a planned service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this MRP under sections III through IX. The Discharger shall submit monthly SMRs including the results of all required monitoring using U.S. EPA-approved test methods or other test methods specified in this MRP. SMRs are to include all new monitoring results obtained since the last SMR was submitted. If the Discharger monitors any pollutant more frequently than required by this MRP, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.

3. Monitoring periods and reporting for all required monitoring shall be completed according to the following schedule:

Table D-9. Monitoring Periods and Reporting Schedule

Sampling Frequency	Monitoring Period Begins On...	Monitoring Period	SMR Due Date
Continuous	1 August 2019	All	Submit with monthly SMR
1/Day	1 August 2019	(Midnight through 11:59 PM) or any 24-hour period that reasonably represents a calendar day for purposes of sampling.	Submit with monthly SMR
1/Week	1 August 2019	Sunday through Saturday	Submit with monthly SMR
2/Week	1 August 2019	Sunday through Saturday	Submit with monthly SMR
3/Week	1 August 2019	Sunday through Saturday	Submit with monthly SMR
1/Month	1 August 2019	1st day of calendar month through last day of calendar month	First day of second calendar month following month of sampling
1/Quarter	1 August 2019	1 January through 31 March; 1 April through 30 June; 1 July through 30 September; 1 October through 31 December	1 May; 1 August; 1 November; 1 February of following year

4. **Reporting Protocols.** The Discharger shall report with each sample result the applicable RL and the current laboratory's MDL, as determined by the procedure in 40 C.F.R. part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- Sample results greater than or equal to the RL shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- Sample results less than the RL, but greater than or equal to the laboratory's MDL, shall be reported as "Detected, but Not Quantified," or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ. The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy ($\pm$ a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.

- Sample results less than the laboratory's MDL shall be reported as "Not Detected," or ND.
- Dischargers are to instruct laboratories to establish calibration standards so that the ML value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the Discharger to use

analytical data derived from extrapolation beyond the lowest point of the calibration curve.

5. **Multiple Sample Data.** When determining compliance with an AMEL, AWEL, or MDEL for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of “Detected, but Not Quantified” (DNQ) or ND. In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:
 - a. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
 - b. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.
6. The Discharger shall submit SMRs in accordance with the following requirements:
 - a. The Discharger shall arrange all reported data in a tabular format. The data shall be summarized to clearly illustrate whether the facility is operating in compliance with interim and/or final effluent limitations. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS. When electronic submittal of data are required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment.
 - b. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the waste discharge requirements; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation. The cover letter must be uploaded directly into CIWQS and violations must be entered into CIWQS under the Violations tab for the reporting period in which the violation occurred in addition to them being identified in the cover letter.
 - c. The Discharger shall attach final laboratory reports for all contracted, commercial laboratories, including quality assurance/quality control information, with all its SMRs for which sample analyses were performed. The quality assurance/quality control information includes dates of sample collection and analysis, sample type, analytical method, reporting limit, method detection limit, qualifiers, flags, blanks, matrix spikes and duplicates, laboratory control sample quality control information (spike levels, percent recovery, relative percent difference), chain of custody, and sample integrity (sample arrival information, bottle analysis information, constituent information, and any comments and/or discrepancies). *Bench sheets are not required* but should be available upon request by Regional Board staff.
7. The Discharger shall submit in the SMRs calculations and reports in accordance with the following requirements.
 - a. **Calendar Annual Average Limitations – Not Applicable.**

- b. **Mass Loading Limitations.** For ammonia, the Discharger shall calculate and report the mass loading (lbs/day) in the SMRs. The mass loading shall be calculated as follows:

$$\text{Mass Loading (lbs/day)} = \text{Flow (MGD)} \times \text{Concentration (mg/L)} \times 8.34$$

When calculating daily mass loading, the daily average flow and constituent concentration shall be used. For weekly average mass loading, the weekly average flow and constituent concentration shall be used. For monthly average mass loading, the monthly average flow and constituent concentration shall be used.

- c. **Removal Efficiency (BOD5 and TSS).** The Discharger shall calculate and report the percent removal of BOD5 and TSS in the SMRs. The percent removal shall be calculated as specified in section VIII.A of the Limitations and Discharge Requirements in the Municipal General Order.
- d. **Total Coliform Organisms Effluent Limitations.** The Discharger shall calculate and report the 7-day median of total coliform organisms for the effluent. The 7-day median of total coliform organisms shall be calculated as specified in section VIII.E of the Limitations and Discharge Requirements in the Municipal General Order.
- e. **Total Calendar Annual Mass Loading Mercury Effluent Limitations – Not Applicable.**
- f. **Temperature Effluent Limitation – Not Applicable.**
- g. **Chlorpyrifos and Diazinon Effluent Limitations – Not Applicable.**
- h. **Dissolved Oxygen Receiving Water Limitations.** The Discharger shall report **monthly** in the SMR the dissolved oxygen concentrations in the receiving water (Monitoring Locations RSW-001 and RSW-002).
- i. **Turbidity Receiving Water Limitations.** The Discharger shall calculate and report the turbidity increase in the receiving water applicable to the natural turbidity condition specified in section VI.A.18.a, of the Limitations and Discharge Requirements in the Municipal General Order.

C. Discharge Monitoring Reports (DMRs)

1. The Discharger shall electronically submit DMRs together with SMRs using Electronic Self-Monitoring Reports module eSMR 2.5 or any upgraded version. Electronic submittal of DMRs will be in addition to electronic submittal of SMRs. Information about electronic submittal of DMRs is provided by the Discharge Monitoring Report website as follows: (http://www.waterboards.ca.gov/water_issues/programs/discharge_monitoring/).

D. Other Reports

1. **Special Study Reports.** Special study reports required by section IX and Table 4, Provisions, in this NOA shall be submitted in accordance with the reporting requirements in Table D-10, Technical Reports.
2. **Annual Operations Report.** The Discharger shall submit a written report to the Central Valley Water Board, electronically via CIWQS submittal, containing the following, by the due date in the Technical Reports Table D-10 below:
- a. The names, certificate grades, and general responsibilities of all persons employed at the Facility.

- b. The names and telephone numbers of persons to contact regarding the plant for emergency and routine situations.
 - c. A statement certifying when the flow meter(s) and other monitoring instruments and devices were last calibrated, including identification of who performed the calibration.
 - d. A statement certifying whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates when these documents were last revised and last reviewed for adequacy.
 - e. The Discharger may also be requested to submit an annual report to the Central Valley Water Board with both tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the compliance record. If violations have occurred, the report shall also discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.
3. **Annual Pretreatment Reporting Requirements.** The Discharger shall submit annually a report to the Central Valley Water Board, with copies to U.S. EPA Region 9 and the State Water Board (submittal requirements follow this section), describing the Discharger's pretreatment activities over the previous 12 months (1 January through 31 December). In the event that the Discharger is not in compliance with any conditions or requirements of the Municipal General Order and this NOA, including noncompliance with pretreatment audit/compliance inspection requirements, then the Discharger shall also include the reasons for noncompliance and state how and when the Discharger shall comply with such conditions and requirements.

An annual report shall be submitted by the due date shown in the Technical Reports Table D-10 and include at least the following items:

- a. A summary of analytical results from representative sampling of the POTW's influent and effluent for those pollutants U.S. EPA has identified under section 307(a) of the CWA which are known or suspected to be discharged by nondomestic users. This will consist of an annual full priority pollutant scan. The Discharger is not required to sample and analyze for asbestos. The Discharger shall submit the results of the priority pollutant scan electronically to the Central Valley Water Board using the State Water Board's CIWQS Program Website.

Sludge shall be sampled during the same 24-hour period and analyzed for the same pollutants as the influent and effluent sampling and analysis. The sludge analyzed shall be a composite sample of a minimum of 12 discrete samples taken at equal time intervals over the 24-hour period. Wastewater and sludge sampling and analysis shall be performed as specified in the NOA. The Discharger shall also provide any influent, effluent or sludge monitoring data for other constituents of concern which may be causing or contributing to Interference, Pass-Through or adversely impacting sludge quality. Sampling and analysis shall be performed in accordance with the techniques prescribed in 40 C.F.R. part 136 and amendments thereto.

- b. A discussion of Upset, Interference, or Pass-Through incidents, if any, at the treatment plant, which the Discharger knows or suspects were caused by nondomestic users of the POTW. The discussion shall include the reasons why the incidents occurred, the corrective actions taken and, if known, the name and address of, the nondomestic user(s) responsible. The discussion shall also include a review of the applicable pollutant limitations to determine whether any additional limitations, or changes to

- existing requirements, may be necessary to prevent Pass-Through, Interference, or noncompliance with sludge disposal requirements.
- c. The cumulative number of nondomestic users that the Discharger has notified regarding Baseline Monitoring Reports and the cumulative number of nondomestic user responses.
 - d. An updated list of the Discharger's significant industrial users (SIU's) including their names and addresses, or a list of deletions, additions and SIU name changes keyed to a previously submitted list. The Discharger shall provide a brief explanation for each change. The list shall identify the SIU's subject to federal categorical standards by specifying which set(s) of standards are applicable to each SIU. The list shall indicate which SIU's, or specific pollutants from each industry, are subject to local limitations. Local limitations that are more stringent than the federal categorical standards shall also be identified.
 - e. The Discharger shall characterize the compliance status through the year of record of each SIU by employing the following descriptions:
 - i. complied with baseline monitoring report requirements (where applicable);
 - ii. consistently achieved compliance;
 - iii. inconsistently achieved compliance;
 - iv. significantly violated applicable pretreatment requirements as defined by 40 C.F.R. section 403.8(f)(2)(vii);
 - v. complied with schedule to achieve compliance (include the date final compliance is required);
 - vi. did not achieve compliance and not on a compliance schedule; and
 - vii. compliance status unknown.
 - f. A summary of the inspection and sampling activities conducted by the Discharger during the past year to gather information and data regarding the SIU's. The summary shall include:
 - i. The names and addresses of the SIU's subjected to surveillance and an explanation of whether they were inspected, sampled, or both and the frequency of these activities at each user; and
 - ii. The conclusions or results from the inspection or sampling of each industrial user.
 - g. The Discharger shall characterize the compliance status of each SIU by providing a list or table which includes the following information:
 - i. Name of SIU;
 - ii. Category, if subject to federal categorical standards;
 - iii. The type of wastewater treatment or control processes in place;
 - iv. The number of samples taken by the POTW during the year;
 - v. The number of samples taken by the SIU during the year;
 - vi. For a SIU subject to discharge requirements for total toxic organics, whether all required certifications were provided;
 - vii. A list of the standards violated during the year. Identify whether the violations were for categorical standards or local limits.
 - viii. Whether the facility is in significant noncompliance (SNC) as defined at 40 C.F.R. section 403.8(f)(2)(viii) at any time during the year; and

- ix. A summary of enforcement or other actions taken during the year to return the SIU to compliance. Describe the type of action (e.g., warning letters or notices of violation, administrative orders, civil actions, and criminal actions), final compliance date, and the amount of fines and penalties collected, if any. Describe any proposed actions for bringing the SIU into compliance;
- x. Restriction of flow to the POTW.
- xi. Disconnection from discharge to the POTW.
- h. A brief description of any programs the POTW implements to reduce pollutants from nondomestic users that are not classified as SIU's;
- i. A brief description of any significant changes in operating the pretreatment program which differ from the previous year including, but not limited to, changes concerning: the program's administrative structure, local limits, monitoring program or monitoring frequencies, legal authority, enforcement policy, funding levels, or staffing levels;
- j. A summary of the annual pretreatment budget, including the cost of pretreatment program functions and equipment purchases; and
- k. A summary of activities to involve and inform the public of the program including a copy of the newspaper notice, if any, required under 40 C.F.R. section 403.8(f)(2)(viii).
- l. Pretreatment Program reports shall be submitted as follows:
 - i. Electronically to the Central Valley Water Board using the CIWQS system or emailed as a PDF file to: RB5S-NPDES-Comments@waterboards.ca.gov; and
 - ii. Emailed to the State Water Board as a PDF file to: NPDES_Wastewater@waterboards.ca.gov; and
 - iii. Emailed to the U.S. EPA to: R9Pretreatment@epa.gov.
- 4. **Technical Report Submittals.** The Municipal General Order, as specified in this NOA, includes requirements to submit various reports and documents that may include, a Notice of Intent, special study technical reports, progress reports, and other reports identified in the MRP (hereafter referred to collectively as "technical reports"). The Technical Reports Table D-10 below summarizes the technical reports that are applicable to this discharge and required by this NOA, and the due dates for each submittal. All technical reports shall be submitted electronically via CIWQS submittal. Technical reports should be uploaded as a PDF, Microsoft Word, or Microsoft Excel file attachment.

Table D-10. Technical Reports

Report #	Technical Report	Due Date	CIWQS Report Name
Standard Reporting Requirements			
1	Notice of Intent	1 August 2023	NOI
2	Analytical Methods Report	1 October 2019	MRP IX.F.4
3	Annual Operations Report	1 February 2020	MRP X.D.2
4		1 February 2021	
5		1 February 2022	
6		1 February 2023	
7		1 February 2024	

Report #	Technical Report	Due Date	CIWQS Report Name
Other Reports			
8	Updated Salinity Evaluation and Minimization Plan	1 April of year following exceedance¹	MGO VII.C.3.c
9	Annual Pretreatment Reports	28 February 2020	MRP X.D.3
10		28 February 2021	
11		28 February 2022	
12		28 February 2023	
13		28 February 2024	

¹ This report is only required if the annual average calendar year effluent EC concentration exceeds 900 µmhos/cm. If required, the report shall consist of a summary of the evaluation of the effectiveness of the Salinity Evaluation and Minimization Plan according to section VII.C.3.c of the Limitations and Discharge Requirements in the Municipal General Order.

APPENDIX E – DETERMINATION OF WQBELS

The Central Valley Water Board determined water quality-based effluent limitations (WQBELS) as described in the Municipal General Order, section V.C.4 of the Fact Sheet (Attachment F), using the effluent limits tables included in the Municipal General Order, section V.A.1 of the Limitations and Discharge Requirements. For parameters with both human health and aquatic life objectives/criteria, the final effluent limitations in this NOA are based on the lower of the effluent limitations based on the aquatic life objectives/criteria and human health objectives/criteria.

Human Health WQBELS Calculations – MUN USE							
Parameter	Units	Criteria	CV ¹	Effluent Limit Table ²	AMEL	AWEL	MDEL
Non-Conventional Pollutants							
Nitrate Plus Nitrite (as N)	mg/L	10 ³	0.2	Table 17B	10	13	--

¹ Coefficient of Variation (CV) calculated using sample data for the parameter listed.

² Effluent Limit Table as indicated and contained in section V, Effluent Limitations and Discharge Specifications, of the Municipal General Order. Specific table listed is used to determine the appropriate AMEL, AWEL, or MDEL.

³ U.S. EPA's Primary Maximum Contaminant Level concentration for nitrate plus nitrite.

Aquatic Life WQBELs Calculations									
Parameter	Units	Criteria			Aquatic Life Calculations		Final Effluent Limitations		
		CMC	CCC	Lowest Criteria	CV ¹	Effluent Limit Table ²	AMEL	AWEL	MDEL
Non-Conventional Pollutants									
Ammonia Nitrogen, Total (as N)	mg/L	8.11	2.16	CCC	1.0	Table 15E	1.9	5.5	--

¹ Coefficient of Variation (CV) calculated using sample data for the parameter listed.

² Effluent Limit Table as indicated and contained in section V, Effluent Limitations and Discharge Specifications, of the Municipal General Order. Specific table listed is used to determine the appropriate AMEL, AWEL, or MDEL.