

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 97-015

WASTE DISCHARGE REQUIREMENTS
FOR
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WASTEWATER TREATMENT FACILITY
MADERA COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Madera County Maintenance District No. 22A (hereafter Discharger) submitted a Report of Waste Discharge (RWD), dated 6 February 1996, and supplemental information dated 25 March 1996, in support of a proposed flow increase and a change in the method of treatment at its wastewater treatment facility (WWTF). The WWTF property of 153 acres (Assessor's Parcel Nos. 064-083-001, 064-090-001, 064-090-022, and 064-140-071) is owned by Madera County. A portion of the sprayfield disposal area and one storage reservoir are on 282 acres of a nearby property of 572 acres (Assessor's Parcel Nos. 055-190-015, and 055-140-051) owned by Allan Rosasco and will be used by the Discharger under a proposed long term lease agreement.
2. Waste Discharge Requirements Order No. 88-027, adopted by the Board on 20 January 1988, prescribes requirements for a discharge of 0.25 million gallons per day (mgd) from the WWTF to a sprayfield of 54 acres.
3. Order No. 88-027 must be revised to reflect the flow increase, additional discharge locations, and current plans and policies of the Board.
4. The proposed WWTF will provide extended aeration treatment of an average daily wastewater flow of 0.65 mgd of domestic waste from the unincorporated community of Oakhurst. The WWTF will consist of headworks, splitter box, aeration tanks, clarifiers, sludge storage basin and drying beds, chlorination units, effluent storage reservoirs (capacity totalling 98 acre-ft), and 149 acres of sprayfield for effluent disposal. The WWTF will include a septage receiving station of 0.10 mgd capacity. The 0.10 mgd of septage is included in the overall average daily wastewater flow of 0.65 mgd. Dewatered sludge will be hauled off-site for land application at a permitted facility.
5. The existing 0.25 mgd WWTF was constructed under a Clean Water Grant. The Discharger has applied to the State for a State Revolving Loan and to the U.S. Department of Agriculture, Rural Economic and Development Services, for funding assistance to construct a 0.65 mgd WWTF.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

-2-

6. The WWTF and leased Allan Rosasco property are in Sections 8, 9, 15 and 16, T7S, R21E, MDB&M, with surface water drainage to the Fresno River, as shown in Attachment A, which is attached hereto and part of this Order by reference. The site lies within the Ahwahnee Hydrologic Unit (No. 539.31), as depicted on interagency hydrologic maps prepared by the Department of Water Resources in August 1986.
7. Two year-round surface waters begin as seeps on the WWTF property below the existing sprayfield area and drain to the Fresno River.
8. Soils on the WWTF and sprayfield properties consist of sands, silts, and clays overlying granitic bedrock at depths of 4.5 to greater than 14 feet below ground surface (bgs). Soil percolation rates from on-site testing were variable, with a range of 5 to greater than 300 minutes per inch.
9. The RWD includes a water balance for the effluent storage reservoir and sprayfield disposal system that demonstrates it will have sufficient capacity to accommodate precipitation from a 25-year annual rainfall season. Typically, the Board requires that effluent storage reservoirs be able to accommodate precipitation from a 100-year annual rainfall season, however, economic considerations do not permit the Discharger to achieve this higher standard. Effluent application is rotated from sprayfield to sprayfield with valve and automatic timer control. Any effluent runoff from the sprayfields is intercepted by ditches at the base of the sprayfields, conveyed to sumps, and returned by lift pumps to the nearest storage reservoir. Run-on of stormwater is not intercepted upgradient of the sprayfields, however, contact with effluent is prevented by not applying effluent to the sprayfields while precipitation is occurring, or is forecast to occur within 24 hours. Runon to the sprayfields during the non-irrigation period resulting in runoff is collected in the collection ditches at the base of the sprayfields and diverted by control gates to the Fresno River. A minimum buffer zone of 300 feet will be maintained between sprayfields and reservoirs and the Fresno River.
10. The Board adopted a Water Quality Control Plan for the Sacramento River and San Joaquin River Basins, Third Edition (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.
11. Groundwater is found in fractured bedrock at varying depths.
12. The beneficial uses of underlying groundwater are domestic, industrial, and agricultural supply.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

-3-

13. On 12 August 1996, the Madera County Board of Supervisors certified a final environmental impact report (EIR) for the WWTF expansion in accordance with the California Environmental Quality Act (CEQA) (Public Resources Code Section 21000, et seq.) and the State CEQA Guidelines. The EIR has been reviewed, and the Board concurs that the project as approved will not have a significant effect on water quality.
14. The permitted discharge is consistent with the antidegradation provisions of State Water Resources Control Board Resolution No. 68-16. The WWTF will produce a high quality effluent, and impacts on water quality will be insignificant. The expanded discharge accommodates housing and economic expansion in the area, and is considered to be a benefit to the people of the state.
15. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
16. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Madera County Maintenance District No. 22 A, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Discharge of untreated or partially treated waste is prohibited.
3. The by-pass or overflow of wastes from the WWTF is prohibited, except as allowed by Standard Provision E.2.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

-4-

4. Discharge of pollutant-free wastewater into the WWTF collection, treatment, and disposal systems in amounts that significantly diminish the systems' capability to comply with this Order is prohibited. Pollutant-free wastewater means stormwater (i.e., inflow), ground water (i.e., infiltration), cooling waters, and condensates that without treatment are essentially free of pollutants.
5. The discharge of waste classified as 'hazardous' or 'designated', as defined in Sections 2521(a) and 2522(a) of Title 23, California Code of Regulations, Sections 2510, et seq. (hereafter Chapter 15) is prohibited.

B. Discharge Specifications

1. Subject to satisfaction of Provision F.4, the monthly average daily dry weather discharge shall not exceed 0.65 mgd.
2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment, storage, and reclamation areas.
3. As a means of discerning compliance with Discharge Specification No. 2, the dissolved oxygen content in the upper zone (1 foot) of wastewater in the effluent storage reservoirs shall not be less than 1.0 mg/l.
4. The discharge shall not exceed the following limits:

<u>Constituent</u>	<u>Units</u>	<u>Monthly Average</u>	<u>7-Day Median</u>	<u>Daily Maximum</u>
BOD ₅ ¹	mg/l	30		60
Total Suspended Solids	mg/l	30		60
Settleable Solids	ml/l	0.1		0.2
Total Coliform Organisms	MPN/100 ml	—	23	240

¹ 5-day, 20 °C Biochemical Oxygen Demand.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

-5-

5. The discharge shall not have a pH less than 6.0 or greater than 9.0.
6. Specific Electrical Conductance at 25°C (EC) of the discharge shall not exceed the average EC of the source water plus 500 μ mhos/cm.
7. Public contact with treated and untreated wastewater at the WWTF shall be precluded through such means as fences, signs, and other acceptable alternatives.
8. The WWTF shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
9. Storage reservoirs shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the nonirrigation season. Design seasonal precipitation shall be based on total annual precipitation using a return period of 25 years, distributed monthly in accordance with historical rainfall patterns. Freeboard in effluent storage reservoirs shall never be less than 2 feet (measured vertically).
10. To facilitate compliance with Discharge Specification B.9 above, storage reservoirs shall have sufficient capacity available each year on 1 October to store all flow that cannot be disposed of during the nonirrigation season.
11. Standing water shall not be present in a sprayfield area for more than 24 hours after application to the area has ceased.
12. Wastewater shall not be sprayed while precipitation is occurring, or is forecast to occur within 24 hours.
13. Stormwater runoff to a sprayfield, within 24 hours of start or cessation of effluent application to the sprayfield shall be returned to an effluent storage reservoir and not be discharged to the Fresno River.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

-6-

C. Sludge Disposal Specifications

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15 and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice shall be reported to the Executive Officer **at least 90 days in advance** of the change.
3. Use and disposal of sewage sludge shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.

If the State Water Resources Control Board and the regional water quality control boards accept primacy to implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards..

D. Ground Water Limitations

The discharge, in combination with other sources, shall not cause underlying ground water to contain waste constituents in concentrations statistically greater than background water quality.

E. Provisions

1. The Discharger shall comply with Monitoring and Reporting Program No. 97-015, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with all items of the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements," dated 1 March 1991, which are part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision (s)."

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

-7-


3. At least **90 days** prior to termination or expiration of any lease, contract, or agreement involving disposal or reclamation areas or off-site reuse of effluent, used to justify the capacity authorized herein and assure compliance with this Order, the Discharger shall notify the Board in writing of the situation and of what measures have been taken or are being taken to assure full compliance with this Order.
4. At least **30 days prior** to actual start-up of the 0.65 mgd WWTF, the Discharger shall certify that it has obtained control of the disposal area by lease agreement and report the expiration date of the agreement and shall submit a technical report that certifies that the WWTF was constructed and designed, and is ready to operate in full compliance with the terms of this Order. The report shall be prepared and signed by a California registered civil engineer experienced in wastewater treatment and disposal. The report is subject to approval or disapproval by the Executive Officer. Until the report is approved by the Executive Officer, the monthly average daily dry weather discharge flow shall not exceed 0.25 mgd.
5. At least **30 days prior** to actual start-up of the 0.65 mgd WWTF, the Discharger shall submit a copy of the operation and maintenance manual for the WWTF. The Operation and Maintenance Manual shall be prepared under the supervision of a California registered civil engineer and include descriptions of complete operational procedures for the WWTF, effluent storage reservoirs, and sprayfields that assure compliance with Title 22 and this Order. Further, the operation and maintenance manual must address the items in Standard Provision B.2.
6. By **1 April 1997**, the Discharger shall submit a technical report demonstrating how it proposes to comply with Sludge Disposal Specifications C.1 and C.3. The report shall be prepared and signed by a California registered civil engineer experienced in wastewater treatment and disposal.
7. The Discharger shall use the best practicable, cost-effective control technique currently available to comply with this Order.
8. If reclaimed water is used for construction purposes, it shall comply with the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes". Other uses of reclaimed water shall be subject to the approval of the Executive Officer and shall comply with 22 CCR, Division 4.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

-8-

9. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
10. A copy of this Order shall be kept at the WWTF for reference by operating personnel. Key operating personnel shall be familiar with its contents.
11. The Board will review this Order periodically and will revise requirements when necessary.

I, JAMES R. BENNETT, Interim Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 24 January 1997.

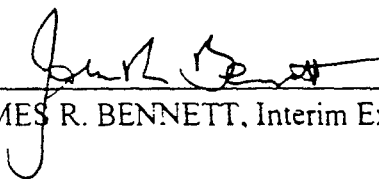

JAMES R. BENNETT, Interim Executive Officer

LML:lml/rac:1/24/97

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

REVISED MONITORING AND REPORTING PROGRAM NO. 97-015
FOR
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WASTEWATER TREATMENT FACILITY
MADERA COUNTY

Specific sample station locations shall be established with concurrence of the Board's staff, and a description of the stations shall be submitted to the Board and attached to this Program.

INFLUENT MONITORING

Influent samples shall be collected at the inlet of the headworks and at approximately the same time as effluent samples. Influent monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
BOD ₅ ¹	mg/l	Grab	Weekly
Total Suspended Solids	mg/l	Grab	Weekly
Settleable Solids	ml/l	Grab	Weekly

¹ Five-day, 20° Celsius biochemical oxygen demand.

EFFLUENT MONITORING

Except for flow, which may be measured either at the headworks or the outlet from the treatment system, effluent samples shall be collected just prior to discharge for reclamation. Effluent samples should be representative of the volume and nature of the discharge. Time of collection of a grab sample shall be recorded.

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency¹</u>
Total Daily Flow	mgd	Metered	Continuous
BOD ₅ ^{2,3}	mg/l	Grab	Weekly
Total Suspended Solids	mg/l	Grab	Weekly
Settleable Solids	ml/l	Grab	Weekly
Electrical Conductivity @ 25°C	μmhos/cm	Grab	Weekly
pH	pH Units	Grab	Weekly
Total Coliform Organisms ³	MPN ⁴ /100 ml	Grab	Weekly

See footnotes next page

REVISED MONITORING AND REPORTING PROGRAM NO. 97-015
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

-2-

- ¹ If results of monitoring a pollutant appear to violate effluent limitations, but monitoring frequency is not sufficient to validate violation (e.g., the monthly average for BOD), or indicate a violation and potential upset of the treatment process (e.g., less than minimum D.O.), the frequency of sampling shall be increased to confirm the magnitude and duration of violation, if any, and aid in identification and resolution of the problem.
- ² Five-day, 20° Celsius biochemical oxygen demand.
- ³ BOD₅ and total coliform organisms samples shall be dechlorinated immediately following sample collection as part of sample collection procedures.
- ⁴ Most Probable Number.

STORAGE RESERVOIR MONITORING

The freeboard shall be monitored in each effluent storage reservoir to the nearest tenth of a foot. Storage reservoir water monitoring shall include the following:

<u>Constituent</u>	<u>Unit</u>	<u>Type of Sample</u>	<u>Frequency</u>
Freeboard	feet	Measurement	Weekly ¹

- ¹ To ascertain compliance with Discharge Specification B.10, an additional freeboard measurement shall be obtained on 1 October of each year.

SPRAY DISPOSAL FIELD MONITORING

Monitoring of soils in the spray disposal field areas shall include the following:

<u>Constituent</u>	<u>Units</u>	<u>Depth of Soil Profile</u>	<u>Frequency</u>
Nitrate-Nitrogen	mg/l	2,4, and 6 ft. ¹	2/year
Kjeldahl-Nitrogen	mg/l	2,4, and 6 ft. ¹	2/year
Total Nitrogen	mg/l	2,4, and 6 ft. ¹	2/year

- ¹ The minimum depth of soil profile monitoring shall be 6 feet or the soil rock interface, if less than 6 feet.

The spray disposal fields shall be inspected daily during spraying and for 24 hours following cessation of disposal for the following:

- a. breaches of berms and collection ditches
- b. overspray or direct runoff from the disposal site
- c. erosion
- d. standing water
- e. seepage or indirect runoff from the disposal site

Any evidence of runoff or necessary corrective actions shall be noted and summarized in the monitoring report.

GROUNDWATER MONITORING

By 1 October 2000, the Discharger shall submit for Executive Officer approval, a technical report proposing a groundwater monitoring program. The technical report shall contain a work plan for the installation of a groundwater monitoring well network. The network shall consist of one or more background monitoring wells and two or more downgradient wells capable of yielding representative samples from the uppermost layer of water representative of the uppermost aquifer located at the hydraulically downgradient limit(s) of the Facility and/or permitted discharge area. All monitoring wells shall meet DWR Well Standards in addition to performance standards prescribed by Title 27, Section 20415(b)(4) et seq. All well locations and construction features are subject to the prior approval of the Executive Officer and must be sufficient to monitor potential impacts of the spray field disposal area on the uppermost groundwater aquifer. The technical report shall also include a detailed description of the procedures and techniques for: (a) sample collection, including purging techniques, sampling equipment, and decontamination of sampling equipment; (b) sample preservation and shipment; (c) analytical procedures; and (d) chain of custody control. Construction of the proposed monitoring well network shall be completed within 60 days following work plan approval. Within 30 days following the construction of the approved network, the Discharger shall submit copies of drillers' logs and "as-built" construction drawings of each groundwater monitoring well, as well as properly surveyed reference point elevations for each well.

Prior to purging and sampling of monitoring wells, the Discharger shall measure the water level in each well. The Discharger shall report water level data as groundwater depth (in feet and hundredths) and as groundwater surface elevation (in feet and hundredths above mean sea level). The Discharger shall include in its quarterly submittal of groundwater elevation data, a contour map based on said data showing the gradient and direction of groundwater flow under/around the Facility and effluent disposal area(s).

Prior to collecting samples, the monitoring well shall be adequately purged to remove water that has been standing within the well screen and casing that may not be chemically representative of formation water. Depending on the hydraulic conductivity of the geologic setting, the volume removed during purging is typically from 3 to 5 volumes of the standing water within the well casing and screen, or additionally the filter pack pore volume.

Samples shall be collected quarterly from approved monitoring wells and analyzed for the following constituents of concern:

REVISED MONITORING AND REPORTING PROGRAM NO. 97-015
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

-4-

<u>Constituent of Concern</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Frequency</u>
pH	pH units	Field	Quarterly ¹
EC	µmhos/cm	Field	Quarterly ¹
Ammonia-Nitrogen	mg/l	Grab	Quarterly ¹
Kjeldahl-Nitrogen (TKN)	mg/l	Grab	Quarterly ¹
Nitrate-Nitrogen	mg/l	Grab	Quarterly ¹
Manganese	mg/l	Grab	Quarterly ¹
Total Dissolved Solids ²	mg/l	Grab	Quarterly ¹
Total Phosphorus	mg/l	Grab	Quarterly ¹
COD	mg/l	Grab	Quarterly ¹
Minerals ³	mg/l	Grab	Quarterly ¹
Metals ⁴	µg/l	Grab	Quarterly ¹
Gross Alpha Activity	pCi/l ⁵	Grab	Quarterly ¹
Uranium	pCi/l ⁵	Grab	Quarterly ¹
Total Coliform Organisms	MPN ⁶ /100ml	Grab	Quarterly ¹

1 January, April, July and October.

2 Total and inorganic dissolved solids shall be determined using EPA Test Method Nos. 160.1 and 160.4, respectively.

3 Minerals shall include chloride, sulfate nitrate, bicarbonate, carbonate, calcium, magnesium, potassium, sodium, silica, boron, iron, ammonia, phosphate, and all other major cations and anions and include a verification that the analysis is complete (i.e., cation/anion balance).

4 Metals shall include cadmium, copper, zinc, total chromium and be determined using EPA Method 6020.

5 PicoCuries/liter.

6 Most Probable Number.

SLUDGE MONITORING

When sludge is removed from the treatment units, but prior to disposal, a composite sample of sludge shall be analyzed, on a dry weight basis, for Total Solids (%), Nitrogen (total, NH₄-N, and NO₃-N), Total Phosphorous, Total Potassium, and totals of specific metals (Pb, Zn, Cu, Ni, Cd, and Ag). Analytical results shall be submitted to the Executive Officer. Analysis of soluble concentrations of these specific metals shall also be included as needed. Sampling records shall be retained for a minimum of five years. A log shall be kept of sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log should be complete enough to serve as a basis for part of the annual report. Additional sludge sampling may be requested at subsequent intervals, depending upon review of analytical results.

WATER SUPPLY MONITORING

A sampling station shall be established where a representative sample of the water supply can be obtained. Water supply monitoring shall include at least the following:

<u>Constituent</u>	<u>Unit</u>	<u>Sample Frequency</u>
Conductivity	μ mhos/cm	Quarterly

If the source water is from more than one well, the Conductivity shall be reported as a weighted average and include copies of supporting calculations.

SURFACE WATER MONITORING

1 April 1997, the Discharger shall submit a work plan for establishing surface water monitoring stations S-1 and S-2 on the Fresno River as described below:

<u>Station</u>	<u>Description</u>
S-1	500 feet upstream of the most upstream location from which surface water drainage leaving the spray disposal fields can enter the river. ¹
S-2	500 feet downstream of the most downstream location from which surface water drainage leaving the spray disposal fields can enter the river.

The samples shall be analyzed for the following:

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u> ¹
Total Coliform Organisms	MPN/100 ml	Grab	2/month
Nitrate-Nitrogen	mg/l	Grab	2/month
Kjeldahl-Nitrogen	mg/l	Grab	2/month
Total Nitrogen	mg/l	Grab	2/month

¹ The samples shall be collected if spray disposal has been utilized since the previous sampling. The sampling dates shall be selected to coincide with periods of time when any impacts would most likely be expected to occur (e.g., during or immediately after periods of spray disposal).

REPORTING

Monthly monitoring reports shall be submitted to the Board by the **20th day of the month** following sample collection. Quarterly and annual monitoring results shall be submitted by the **20th day of the month** following each calendar quarter and year, respectively.

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly whether the discharge complies with waste discharge requirements.

If the Discharger monitors any pollutant at the locations designated herein more frequently than is required by this Revised Monitoring and Reporting Program, the results of such monitoring shall be included in the calculation and reporting of the values required in the discharge monitoring report form. Such increased frequency shall be indicated on the discharge monitoring report form.

The Discharger may also be requested to submit an annual report to the Board with tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.

By **1 February of each year**, the Discharger shall submit a written report to the Executive Officer containing the following:

- a. The names, titles, certificate grade (if any) and general responsibilities of persons operating and maintaining the wastewater treatment plant.
- b. The names and telephone numbers of persons to contact regarding the plant for emergency and routine situations.
- c. A certified statement of when the flow meter and other monitoring instruments and devices were last calibrated, including identification of who did the calibration (Standard Provision C.4).
- d. A statement whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates when these documents were last reviewed for adequacy.
- e. The total quantity of sludge disposed of during the previous year and ultimate disposal site(s).

REVISED MONITORING AND REPORTING PROGRAM NO. 97-015
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

-7-

By **1 February of each year**, the Discharger shall submit an annual groundwater-monitoring report covering the previous calendar year. This report shall contain:

- a. Copies of quarterly groundwater contour maps from the previous four quarters as detailed above;
- b. Hydrographs showing the groundwater elevation in each approved well for at least the previous five years, as historical data becomes available. The hydrographs should show groundwater elevation with respect to the elevations of the top and bottom of the screened interval and be presented at a scale of values appropriate to show trends or variations in groundwater elevation. The scale for the background plots shall be the same as that used to plot downgradient elevation data;
- c. Graphs of the laboratory analytical data for all samples taken from each approved well within at least the previous five calendar years, as historical data becomes available. Each such graph shall plot the concentration of one or more waste constituents over time for a given monitoring well, at a scale appropriate to show trends or variations in water quality. The graphs shall plot each datum, rather than plotting mean values. For any given waste constituent, the scale for the background plots shall be the same as that used to plot downgradient data;
- d. All monitoring analytical data obtained during the previous four quarterly reporting periods, presented in tabular form, as well as 3.5" computer diskettes (or submitted separately via e-mail), either in MS-DOS / ASCII format or in another file format acceptable to the Executive Officer (e.g., Microsoft Excel); and
- e. A comprehensive discussion of the compliance record, and the result of any corrective actions taken or planned that may be needed to bring the Discharger into full compliance with the waste discharge requirements.

The monitoring reports must be signed and include the following certification on the cover page:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

REVISED MONITORING AND REPORTING PROGRAM NO. 97-015
MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY


-8-

The report shall discuss compliance for the reporting period. If violations have occurred, the report shall identify the violations and also discuss the corrective actions taken and planned to bring the discharge into full compliance with this Revised Monitoring and Reporting Program. All reports submitted in response to this Revised Monitoring and Reporting Program shall comply with the signatory requirements in Standard Provision B.3.


The Discharger shall implement the above monitoring and reporting program effective
1 September 2000.

Ordered by GARY M. CARLTON, Executive Officer

by:

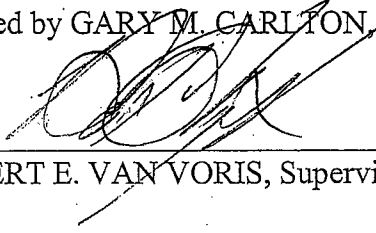
BERT E. VAN VORIS, Supervising Engineer

REVISED: 7 August 2000

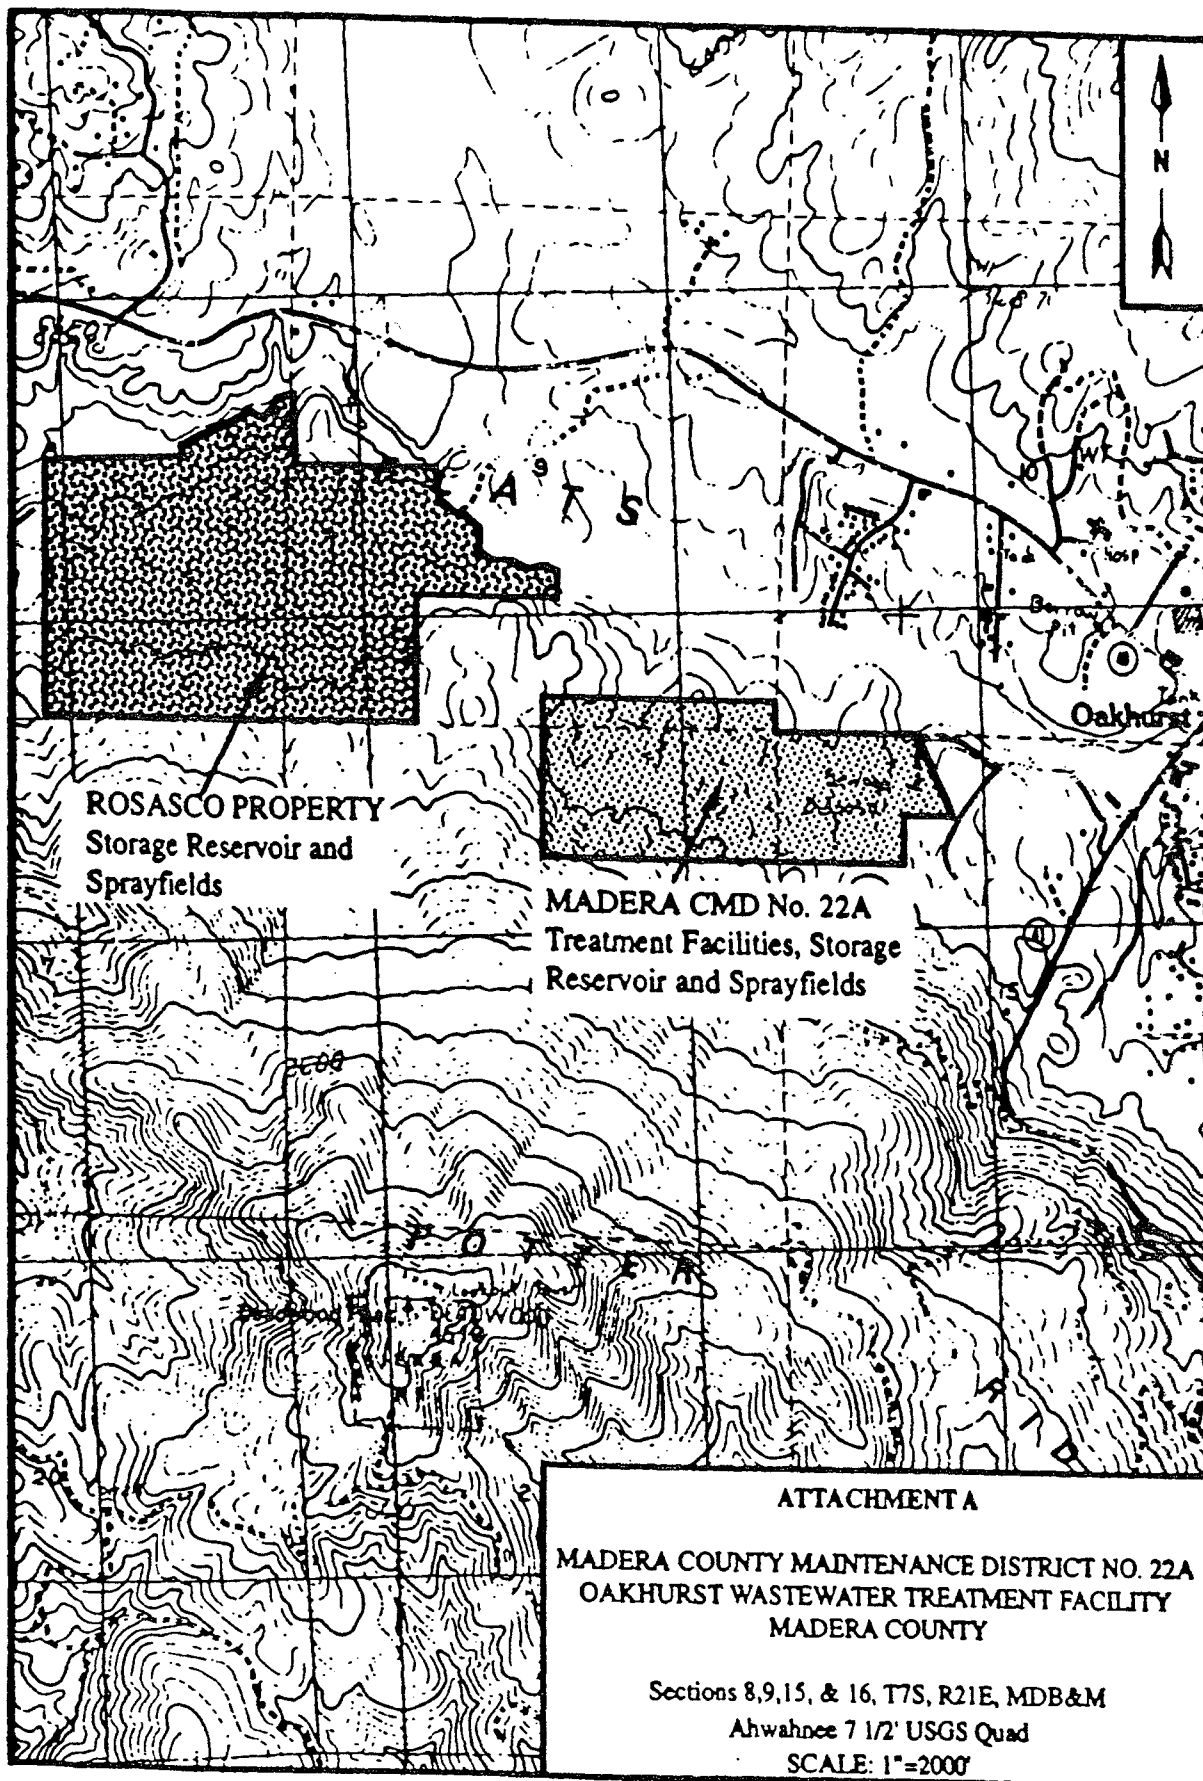

ATTACHMENT A

**MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WASTEWATER TREATMENT FACILITY
MADERA COUNTY**

Sections 8,9,15, & 16, T7S, R21E, MDB&M

Ahwahnee 7 1/2' USGS Quad

SCALE: 1"=2000'

INFORMATION SHEET

MADERA COUNTY MAINTENANCE DISTRICT NO. 22A OAKHURST WASTEWATER TREATMENT FACILITY MADERA COUNTY

Madera County Maintenance District No. 22A is the owner and operator of a wastewater treatment facility (WWTF) that services Oakhurst, an unincorporated community in Madera County.

The existing 0.25 mgd WWTF was constructed with a Clean Water Grant. The Discharger has applied to the State for a State Revolving Loan and to the U.S. Department of Agriculture, Rural Economic and Development Service, for funding assistance to construct a 0.65 mgd WWTF.

The proposed WWTF will provide extended aeration treatment of an average daily wastewater flow of 0.65 mgd of domestic waste. The WWTF will consist of headworks, splitter box, aeration tanks, clarifiers, sludge storage basin and drying beds, chlorination facilities, effluent storage reservoirs (capacity totalling 98 acre-ft), and 149 acres of sprayfield for effluent disposal. The WWTF will include a septage receiving station of 0.10 mgd capacity. The 0.10 mgd of septage is included in the overall average daily wastewater flow of 0.65 mgd. Dewatered sludge will be hauled off-site for land application at a permitted facility.

The current property of 153 acres will be expanded to include use of property owned by Allan Rosasco and used by the Discharger under a proposed long term lease agreement. One effluent storage reservoir and 95 acres of sprayfield will be on the Rosasco property.

The proposed Order includes weekly monitoring of effluent total coliform organism. More frequent monitoring for total coliform organisms was considered but determined to be unnecessary, because the effluent is disposed of to land and not reclaimed.

Soils on the WWTF and sprayfield properties consist of sands, silts, and clays overlying granitic bedrock at depths of 4.5 to greater than 14 feet below ground surface (bgs). Soil percolation rates from on-site testing were variable, with a range of 5 to greater than 300 minutes per inch.

The effluent storage reservoirs and sprayfield disposal system will accommodate precipitation from a 25-year annual rainfall season.

Average annual precipitation in the area is approximately 32 inches and average annual evaporation is roughly 40 inches.

INFORMATION SHEET - Continued

MADERA COUNTY MAINTENANCE DISTRICT NO. 22A
OAKHURST WWTF
MADERA COUNTY

Surface water drainage is to the Fresno River. by sheet flow. The beneficial uses of the Fresno River are municipal and domestic supply, agricultural supply; water contact and non-contact water recreation; warm and cold fresh water habitat; and wildlife habitat.

Two year-round surface waters begin as seeps on the WWTF property below the existing sprayfield area and drain to the Fresno River.

Groundwater is found in fractured bedrock at varying depths. The beneficial uses of underlying ground water are municipal and domestic, industrial, and agricultural supply.

On 12 August 1996, the Madera County Board of Supervisors certified a final environmental impact report (EIR) for the WWTF expansion in accordance with the California Environmental Quality Act (CEQA) (Public Resources Code Section 21000, et seq.) and the State CEQA Guidelines. The EIR has been reviewed, and the Board concurs that the project as approved will not have a significant effect on water quality.

LML:lml/rac:1/24/97