

Central Coast Regional Water Quality Control Board

September 29, 2023

Sent Via Electronic Mail

Kathy Baker
Cypress Ridge Sewer Co.
2299 Tattler St.
Arroyo Grande, CA 93420
Email: kathybaker9871@gmail.com

Dear Kathy Baker,

CYPRESS RIDGE SEWER, 796 CYPRESS RIDGE PARKWAY, ARROYO GRANDE, CA 93420, SAN LUIS OBISPO COUNTY:

- **NOTICE OF APPLICABILITY FOR CYPRESS RIDGE SEWER CO.'S ENROLLMENT IN *ORDER WQ 2014-0153-DWQ, GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS***
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2023-0055**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER NO. 97-66**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the December 14, 2021 Form 200, October 6, 2022 Report of Waste Discharge Engineering Report, the July 3, 2023 electronic Notice of Intent, and available documents associated with the domestic wastewater treatment system at the Cypress Ridge Wastewater Treatment Plant (WWTP) owned by Cypress Ridge Sewer Co. The wastewater system is currently regulated pursuant to Order No. 97-66. On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order No. 97-66.

This letter serves as a notice of applicability for Cypress Ridge Sewer Co.'s enrollment in the General Permit for the discharge of wastewater from the Cypress Ridge WWTP.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), a monitoring and reporting program (Attachment 3), and a copy of the title 22 engineering report conditional acceptance letter (Attachment 4).

JANE GRAY, CHAIR | MATTHEW T. KEELING, EXECUTIVE OFFICER

Cypress Ridge Sewer Co. must comply with the following:

1. **General Permit** – Cypress Ridge Sewer Co. must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. **Monitoring and Reporting Program** – Cypress Ridge Sewer Co. must comply with the requirements of Monitoring and Reporting Program No. R3-2023-0055, enclosed with this letter (Attachment 3). Cypress Ridge Sewer Co. must start implementing the monitoring on **October 1, 2023**. Your first semiannual report is due on **February 1, 2024**.

Monitoring reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

Cypress Ridge Sewer Co. must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{1,2} database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system-specific global identification number WDR100028962 at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

3. **Fees** – Cypress Ridge Sewer Co. paid an annual fee on December 22, 2022 for coverage in the existing individual permit, Order No. 97-66. This payment covers permit fees for the 2023-2024 fiscal year.

Cypress Ridge Sewer Co. must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

² Additional information available at: <http://geotracker.waterboards.ca.gov/>

program and cover the state fiscal year of July 1 through June 30. Your annual fee is currently \$26,785. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 2B. However, the Central Coast Waterboard has determined that a threat and complexity of 3B is more appropriate for your facility.

A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

- 4. Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on December 14-15, 2023. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

- 5. Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.
- 6. Responsible Party** – Cypress Ridge Sewer Co. is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects Cypress Ridge Sewer Co. to enforcement action and termination of enrollment under this General Permit.
- 7. Change in Ownership** – In the event of any change in control or ownership of the property, Cypress Ridge Sewer Co. must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.
- 8. Certified Operator** – Cypress Ridge Sewer Co. is required to comply with the operator certification requirements³ administered by the State Water Board's Office of Operator Certification, which currently requires a Class III certified operator onsite to maintain and operate the treatment system.

³ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

- 9. Termination of Permit** – The existing individual permit, Order No. 97-66 is terminated, except for enforcement purposes. Cypress Ridge Sewer Co. is responsible for compliance with Order No. 97-66 prior to the date of this letter.

If you have any questions, please contact **James Bishop at (805) 542-4628 or by email at James.Bishop@waterboards.ca.gov**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

 Digitally signed by Jennifer Epp
Date: 2023.09.29 13:10:09
-07'00'
Water Boards

Jennifer Epp

for Matthew T. Keeling
Executive Officer

Attachments:

- Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations
- Attachment 2: Figures
- Attachment 3: Monitoring and Reporting Program No. R3-2023-0055
- Attachment 4: Title 22 Engineering Report conditional acceptance letter from the Division of Drinking Water dated June 10, 1999

cc:

Eric Sweeney, Chief Plant Operator, cypressridgewwtp@gmail.com
Jeff Densmore, DDW, Jeff.Densmore@Waterboards.ca.gov
James Bishop, James.Bishop@waterboards.ca.gov
Corinne Watson, Corinne.Watson@waterboards.ca.gov
Jesse Woodard, Jesse.Woodard@waterboards.ca.gov
Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov
WDR Program, RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-216491

GeoTracker No. = GT-WDR100028962

Rev 6/6/2023

Subject Name = Cypress Ridge WWTP Wastewater Permit

\\ca.epa.local\rb\rb3\shared\wdr\wdr facilities\san luis obispo co\cypress ridge\cypress ridge wwtp\1- permit\re-enroll in 0153 2022\noa and mrp\0153 noa and mrp for cypress ridge wwtp_final.docx

ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC
REQUIREMENTS AND LIMITATIONS

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by Cypress Ridge Sewer Co. to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	Cypress Ridge Wastewater Treatment Plant
Facility Address	796 Cypress Ridge Parkway Arroyo Grande, CA 93420
Parcel Numbers	075-400-015
Latitude/Longitude	35.067080/ -120.571740
Owner of Facility	Cypress Ridge Sewer Co.
Legally Responsible Official of Owner	Kathy Baker
Owner Mailing Address	Cypress Ridge Sewer Co. 2299 Tattler St. Arroyo Grande, CA 93420
Billing Address	PO Box 745 Grover Beach, CA 93483
Permitted Flow, Max Average Monthly (gallons per day, gpd)¹	Maximum Average Monthly Flow 100,000
Baseline Flow (average annual flow) in gpd	40,000
Operators	Eric Sweeney, Chief Plant Operator, Grade 3 Seth Hutchinson, Plant Operator, Grade 2 Patrick Stebbins, Plant Operator, Grade 1 SCADA System (Supervisory Control and Data Acquisition) is present
Waste type and Service Area	Domestic wastewater from 381 residential units and 10 commercial units.
Threat to Water Quality	3
Complexity	B
For Internal Use	

Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR
Reclamation Included	Yes
EPA Approved Pretreatment Program	No

Cypress Ridge WWTP stores tertiary recycled water in an impoundment located on the Cypress Ridge Golf Course for use at the golf course (see Figure 3). Water is stored in the primary impoundment and evaporated. If the primary impoundment reaches capacity, excess water will be pumped to a secondary impoundment. The distribution and use of recycled water by the Cypress Ridge Golf Course is not authorized by enrollment in this General Permit. The distribution and use of recycled water at Cypress Ridge Golf Course will be permitted through in the statewide general order for recycled water distribution and use, WQ 2016-0068-DWQ.

2. WASTEWATER SYSTEM OPERATION SUMMARY

In the early 2000s, the property experienced issues with recurrent effluent violations of turbidity, total coliform, settleable solids, suspended solids, and biochemical oxygen demand (BOD). Furthermore, the property experience issues with violations for multiple incomplete reports. On January 24, 2008, The Central Coast Water Quality Control Board issued a Cleanup and Abatement Order [CAO] (Order No. R3-2008-0022) to the property owner. The property owner complied with the terms of the CAO and on May 19, 2011, the CAO was rescinded.

The treatment system is composed of conveyance piping, lift stations, a grinder, two sequencing batch reactors, a decant tank, a sand filter, a chlorination system, a sludge digestion and dewatering system, emergency storage pond, and a supervisory control and data acquisition (SCADA) system. A summary of the system is included in Table 2 below. A facility site map and dispersal system layout are shown in Attachment 2.

Table 2. Sequencing Batch Reaction Treatment, Disposal Technologies, and Capacity

Permitted Flows	Maximum Average Monthly Flow 100,000 gallons per day (gpd)
Design Flows¹	Average Dry Weather Flow, 140,000 gpd Peak Day Wet Weather Flow, 200,000 gpd Peak Hour Wet Weather Flow, 275 gallons per minute (GPM)
Headworks/Preliminary Treatment	A continuous duty grinder (JWC Muffin Monster) is installed on the influent line with a design capacity of 432,000 gpd.

Treatment	Solids removal, nitrification, denitrification, and organic material removal occur in two sequencing batch reactors (U.S. Filter Jet Tech Omnifo SBR's) with a total capacity of 140,00 gpd. Treated effluent is transferred to a 18,500 gallon decant tank, and settled sludge is pumped to a 34,000 gallon digester tank. The water receives chemical dosing (Blue & White A1N30F-4T) and rapid mixing (Komax – Custom Polymer Static Mixer) in a 2,100 gallon flocculation tank. Sand filtration is provided by a dual U.S. Filter, Zimpro Hydro-Clear San Filter Model 714.
Disinfection	Effluent enters the chlorine contact chamber where a SCADA controlled chlorine feed pump adds a 12.5% sodium hypochlorite solution. A free chlorine analyzer (Hach 9184 SC) sends the chlorine level to the SCADA system for dosing rates. Then the water traverses through 2 PVC piping routes (84 minute and 15 minute detention times). At this point, a free chlorine analyzer (Hach CL17) reads the residual chlorine and then the effluent continues through a third PVC pipe (11 minute detention time).
Effluent Storage	There is one 3.1 million gallon unlined emergency storage pond
Disposal	Effluent is treated to disinfected tertiary recycled water standards and is stored in a lined primary impoundment (Figures 2 and 3) on the Cypress Ridge Golf Course. If the primary impoundment reaches capacity, Cypress Ridge Golf Course pumps water to a secondary impoundment (Figures 2 and 3). Regulatory coverage for the use of recycled water is authorized by a separate Order.
Biosolids/Sludge Production and Handling	Sludge from the aerobic digester is feed into a screw press (Huber Model 280) for dewatering. Resulting cake is approximately 15-17% dry solids and is composted at Engle and Gray, Inc..
Wastewater Effluent Design Goals²	TSS < 5 mg/L BOD < 5 mg/L Total Nitrogen < 15 mg/30-Day Average Total Coliform < 2.2 MPN Maximum Daily Total Coliform < 23 MPN

¹ Note that the permitted flow is limited to 100,00 gpd as a monthly average. Flow rate at IS-1 that exceeds 100,000 gpd as a monthly average is a violation of the General Permit requirements.

² These are design goals, and should be used to evaluate system performance.

3. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

Cypress Ridge Sewer Co. must operate the facility in accordance with the General Permit⁴ and this notice of applicability.⁵ The facility includes a sequencing batch reactor (SBR) and chlorine disinfection system. Cypress Ridge Sewer Co. must operate the SBR system to comply with section B.3 and B.4. of the General Permit. In addition, the SBR and chlorine disinfection system must comply with the effluent limits below.

A. Effluent limits

Cypress Ridge Sewer Co. must comply with the site-specific limits listed in Table 3.

Table 3. Wastewater Limits for Sequencing Batch Reactor

Constituent	Unit	Limit	Point of Compliance ¹
Flow	gpd	Maximum Average Monthly Flow, 100,000 ²	Influent (IS-1)
Flow	gpm	Peak Hour Wet Weather Flow, 275 gallons per minute	Influent (IS-1)
Flow	gpd	Daily Peak Wet Weather Flow, 200,000	Influent (IS-1)
Total Suspended Solids (TSS)	mg/L	30 (monthly average) 45 (7-day average)	Effluent after chlorine treatment (ES-1)
Five-Day Biochemical Oxygen Demand (BOD ₅)	mg/L	30 (monthly average) 45 (7-day average)	Effluent after chlorine treatment (ES-1)
Total N	% Influent versus Effluent	50% Removal	Effluent after chlorine treatment (ES-1) compared to IS-1
Chlorine, Residual	mg/L	5 (monthly average) 6 (daily average)	Effluent after chlorine treatment (ES-1)

¹ Refer to monitoring and reporting program for sampling locations

² The average is based on the sum of the daily flow that occurs each day in a calendar month, divided by the number of days in the month.

⁴ General Permit sections B.2 and B.6 are not applicable for this facility.

⁵ General Permit section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Permit, effluent limits in the General Permit, and compliance with site-specific limits set forth in this notice of applicability.

4. GROUNDWATER LIMITS

As stated in the General Permit, Section C, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, Cypress Ridge Sewer Co. must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).⁶ These objectives include:

- 1) General objectives for taste and odors and radioactivity for all groundwaters.
- 2) Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15.
- 3) Specific objectives for the groundwater basin where the discharge occurs. This facility discharges into the Lower Nipomo Mesa Aquifer, and those Basin Plan's groundwater objectives are included in Table 4.

Table 4. Basin Plan, Median Groundwater Objectives (mg/L)

Constituent	Median Groundwater Objective for Lower Nipomo Mesa Aquifer
Total Dissolved Solids (TDS)	710
Chloride	95
Sulfate	250
Boron	0.15
Sodium	90
Total Nitrogen as N	5.7

mg/L = milligrams per liter

Based on the existing SBR effluent water quality, the Central Coast Water Board does not require first-encountered groundwater monitoring wells at this time. If effluent water quality indicates exceedances of the Basin Plan groundwater objectives, the Central Coast Water Board may require installation of groundwater monitoring wells in the future.

5. RECYCLED WATER EFFLUENT LIMITS AND REQUIREMENTS

Cypress Sewer Co. is required to produce disinfected tertiary recycled water and must therefore comply with California Code of Regulations (CCR) title 22, division 4, chapter 3, Water Recycling Criteria. This criterion includes the limits in Table 5 and requirements for signage, plumbing, and cross connection control for recycled water

⁶ Current edition, June 2019 is available at:

https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

distributed within the Cypress Ridge WWTP. Cypress Sewer Co. is responsible for complying with any future updates and additions to title 22. This General Permit enrollment does not authorize the use of recycled water.

In May 1999, the previous user and producer of recycled water at Cypress Ridge Golf Course, Cypress Ridge Limited Partnership, submitted a title 22 engineering report describing the production and uses of recycled water for State Water Resources Control Board Division of Drinking Water for review and approval.

On June 10, 1999, the Division of Drinking Water issued a letter conditionally accepting the production of recycled water for unrestricted access golf course irrigation and landscape irrigation (Attachment 4). Cypress Ridge Sewer Co. must comply with requirements described in the Division of Drinking Water acceptance letter dated June 10, 1999 (Attachment 4). Noncompliance with any of the conditions described in Attachment 4 will be a violation of this General Permit enrollment.

Table 5. Effluent Limitations for Title 22 Non-Potable Recycled Water Producers

Constituent	Units	Regulatory Limitations
Total Coliform	MPN/100 mL ¹	Must not exceed: a. Seven-day median concentration of 2.2 MPN/100mL b. 23 MPN/100mL in more than one sample taken over a 30-day range c. 240 MPN/100mL at any time
Turbidity	NTU ²	Must not exceed: a. An average of 2 NTU within a 24-hour period b. 5 NTU more than 5 percent of the time within a 24-hour period; and c. 10 NTU at any time
Chlorine residual	mg/L	Chlorine residual within the disinfection process following filtration must provide a CT ³ value of not less than 450 milligram-minutes per liter at all times with a modal contact time of at least 90 minutes, based on peak dry weather design flow.

¹ MPN / mL denotes most probable number per milliliter

² Denotes nephelometric turbidity units

³ CT is the product of total chlorine residual and model contact time measured at the same point, per CCR title 22 section 60301.23

6. EMERGENCY STORAGE POND REQUIREMENTS

The Cypress Ridge Sewer WWTP is equipped with an emergency storage pond for temporarily storing wastewater if it does not meet the Water Recycling Criteria in California Code of Regulations (CCR) title 22, division 4, chapter 3. Effluent wastewater may be diverted to the emergency storage pond if the continuously monitored data

(Turbidity) provides indication of an imminent violation of the Water Recycling Criteria in California Code of Regulations (CCR) title 22, division 4, chapter 3. The emergency storage pond has capacity for 3 days of wastewater flow and three days of storm water flow. Water stored in the pond will be pumped back to the headworks of the wastewater treatment facility.

Cypress Ridge Sewer Co. is not authorized to discharge effluent wastewater to the emergency unlined storage pond if the treated wastewater meets the Water Recycling Criteria in title 22. Fully treated recycled water that meets the Water Recycling Criteria must be discharged to the lined impoundments on the Cypress Ridge Golf Course. Cypress Ridge Sewer Co. is only authorized to discharge effluent wastewater to the emergency storage pond if the effluent quality does not meet the Water Recycling Criteria. Wastewater discharged to the emergency storage pond must undergo secondary treatment (i.e., oxidized wastewater) before being discharged to the pond. Wastewater discharged without secondary treatment is considered a bypass and is a violation. Cypress Ridge Sewer must operate the emergency storage pond to comply with section B.5. of the General Permit. The wastewater discharged to the emergency storage pond must comply with the effluent limit specified below (Table 6). Cypress Ridge Sewer Co. is required to report any discharge to the emergency unlined storage pond as described in the Monitoring and Reporting Program (Order No. R3-2023-0055).

Table 6. Effluent Limits for Pond Systems

Constituent	Units	Limit
Five-Day Biochemical Oxygen Demand (BOD ₅)	mg/L	90

**ATTACHMENT 2
FIGURES**

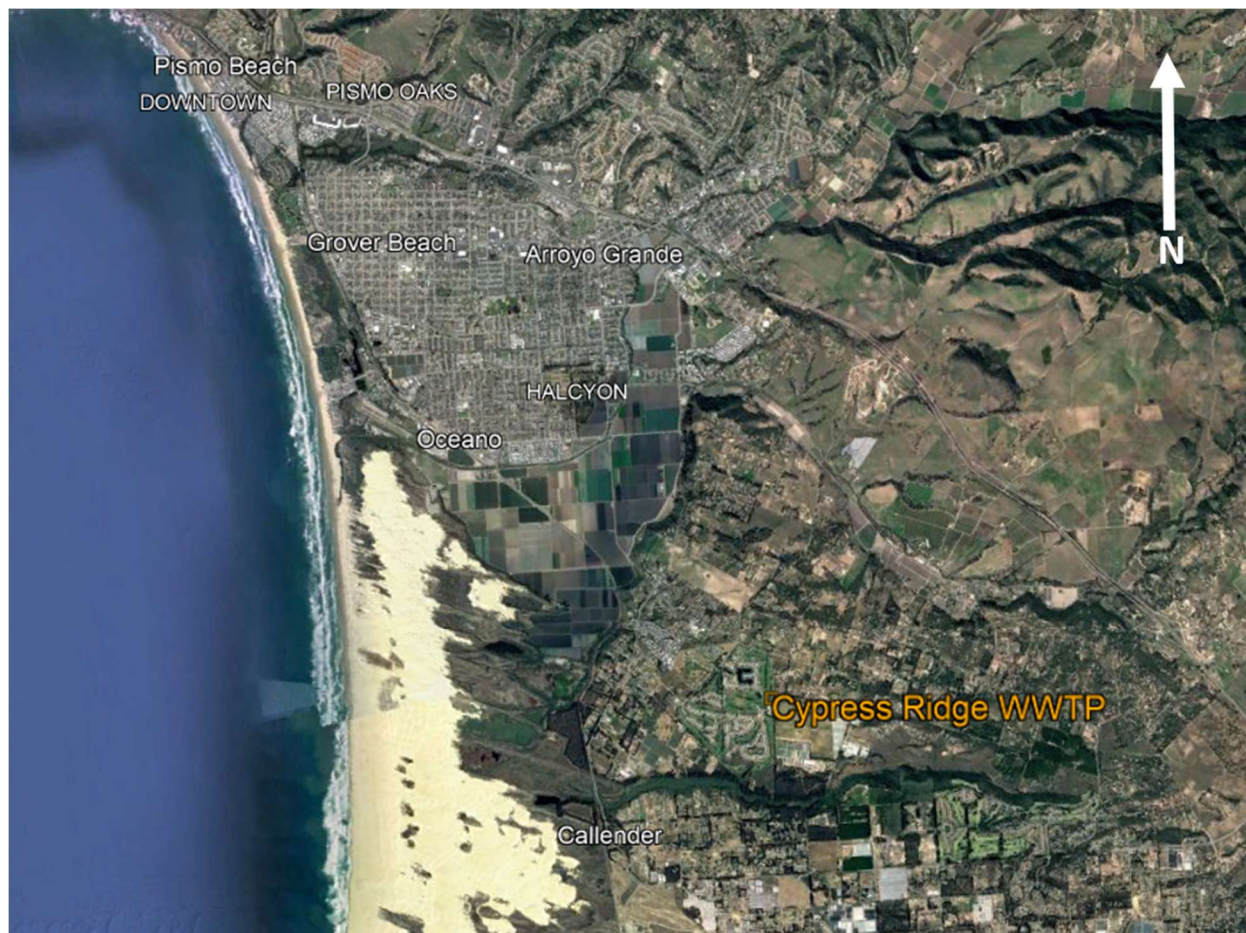


Figure 1. Site Location Map



Figure 2. Site Map Including Primary and Secondary Impoundments

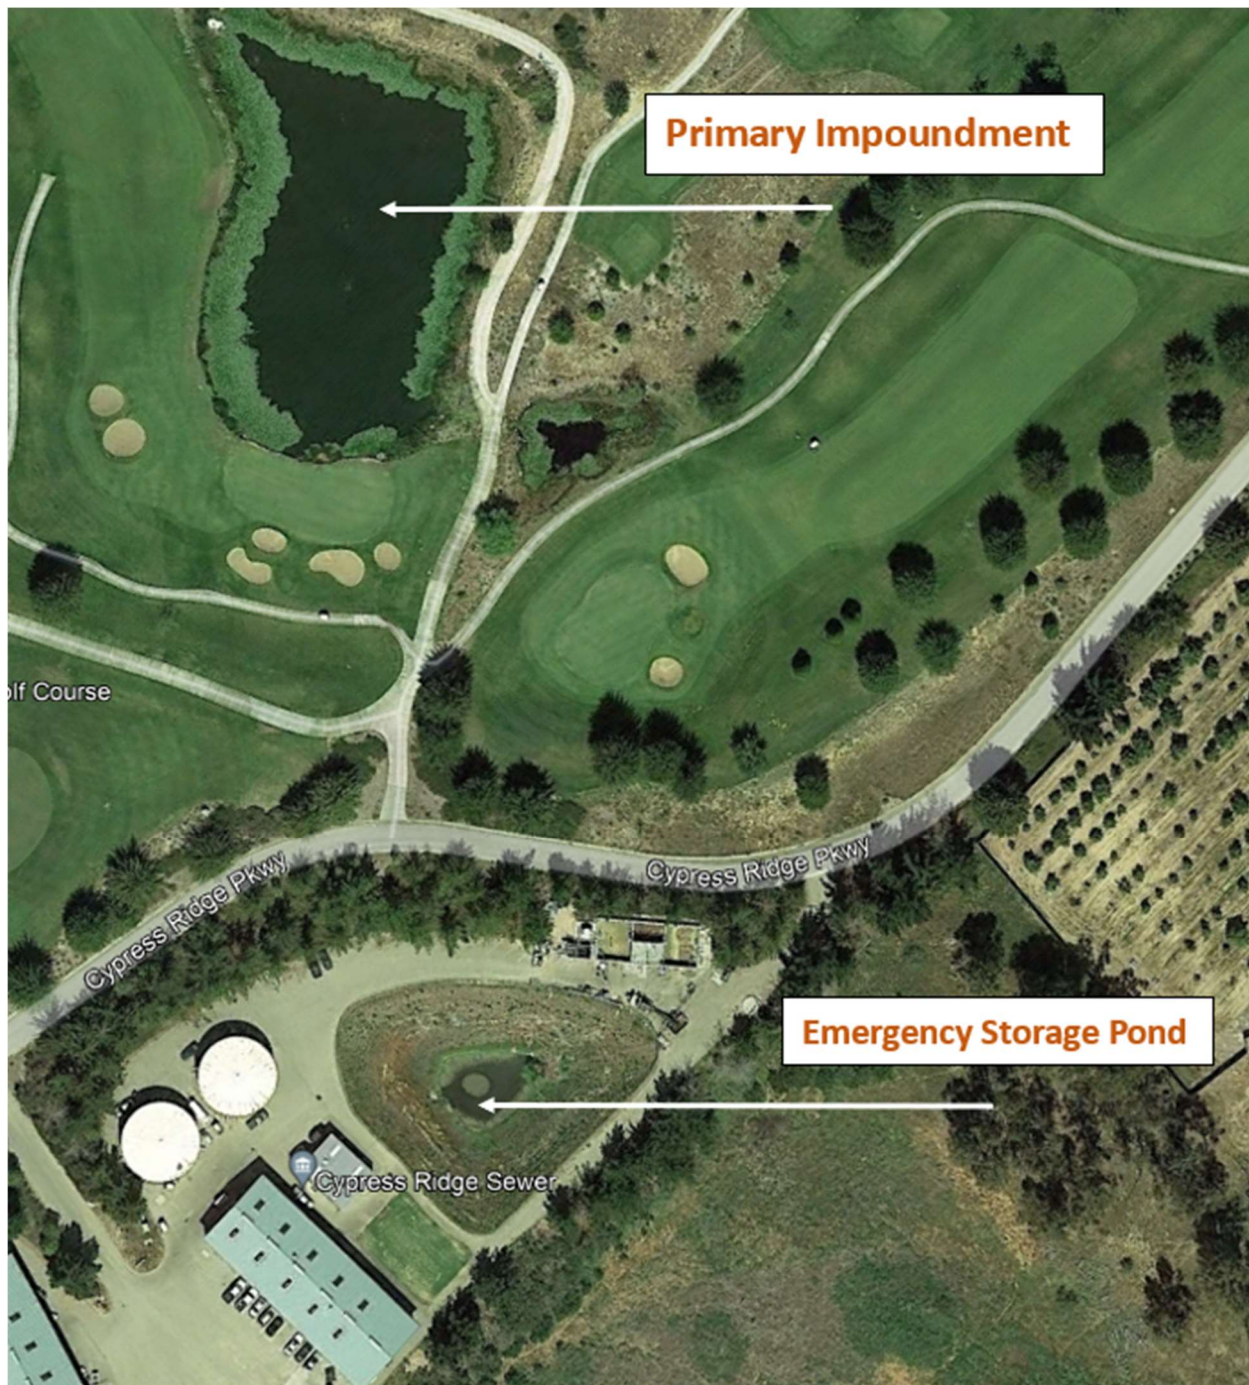


Figure 3. Primary Impoundment for Disinfected Tertiary Recycled Water

**CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD
ATTACHMENT 3**

MONITORING AND REPORTING PROGRAM NO. R3-2023-0055

SEPTEMBER 29, 2023

FOR

**CYPRESS RIDGE WASTEWATER TREATMENT PLANT
ARROYO GRANDE, SAN LUIS OBISPO COUNTY**

This monitoring and reporting program describes requirements for monitoring a wastewater treatment system at the Cypress Ridge Wastewater Treatment Plant (WWTP), owned by Cypress Ridge Sewer Co., located at 796 Cypress Ridge Parkway in Arroyo Grande, California.

Cypress Ridge Sewer Co. owns and operates the wastewater system that is subject to the notice of applicability dated September 29, 2023 issued by the Central Coast Regional Water Quality Control Board (Central Coast Water Board) for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be approved by the Central Coast Water Board. Unless otherwise specified below, sampling must be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used if they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

- A. The user is trained in proper use and maintenance of the instruments;
- B. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
- C. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
- D. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2.

In lieu of the required water supply sampling, Cypress Ridge Sewer Co. may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Cypress Ridge Sewer Co. must report the results of any constituent monitored more frequently than is required by this monitoring and reporting program. Cypress Ridge Sewer Co. must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling Frequency	Reporting Frequency
TDS	mg/L	Grab	Annually	Annually
Nitrate and Nitrite (as N)	mg/L	Grab	Annually	Annually
Chloride	mg/L	Grab	Annually	Annually
Sodium	mg/L	Grab	Annually	Annually
Sulfate	mg/L	Grab	Annually	Annually
Boron	mg/L	Grab	Annually	Annually

mg/L denotes milligrams per liter

3. MONITORING LOCATIONS

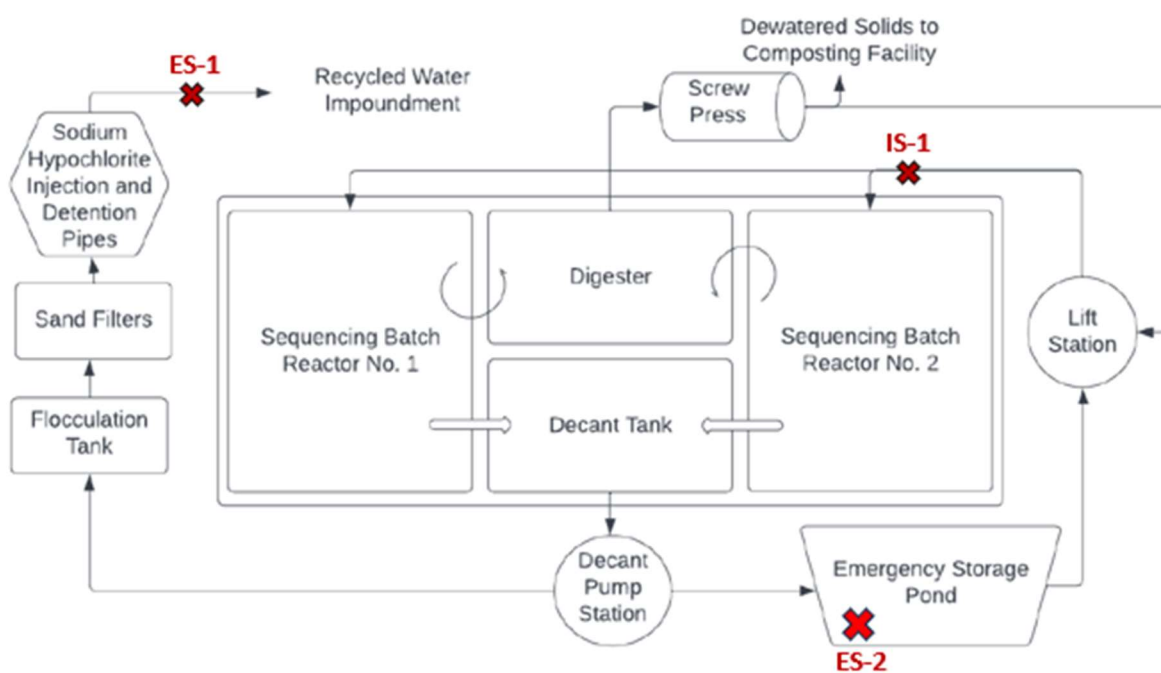
Monitoring location information, including nomenclature that must be used when reporting data to the GeoTracker database and in reports (described below), is shown in Table 3. The field point code and latitude and longitude of all monitoring locations, except supply wells, must be loaded to GeoTracker once. (See Section 10, Electronic Submittal, below.)

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code (Sample ID)	Sample Description
Influent Sample – 1	IS-1	Representative grab sample from the influent piping after grinder and prior to SBR
Effluent Sample – 1	ES-1	Representative grab sample following chlorine disinfection
Effluent Sample – 2 ²	ES-2	Representative grab sample from emergency unlined storage pond

¹ Water supply sample data should be included in the semiannual report but does not need to be uploaded to GeoTracker if the Central Coast Water Board approves submittal of a Well Identification Number pursuant to the Water Supply Monitoring section above.

²Effluent samples from the emergency storage pond are only required when the pond is in use. The pond is considered in-use if any wastewater is actively discharging to the pond. Monitoring is required for the entire duration of discharge as described in Section 6.

**Figure 1. Process Flow Diagram with Sampling Locations IS-1, ES-1, and ES-2**

4. SEQUENCING BATCH REACTOR TREATMENT UNIT MONITORING

A. Flow Monitoring

Cypress Ridge Sewer Co. must monitor and report flow, as described in Table 4, with each monitoring report. Flow is monitored at sample location ES-1 after the chlorine disinfection, and influent flow is approximately equal to effluent flow.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Sampling Frequency
Daily Flow	Gallons per day	Metered	Daily
Maximum Daily Flow	Gallons per day	Metered	Monthly
Average Daily Flow ¹	Gallons per day	Calculated	Monthly

¹ The average is based on the sum of the daily flow that occurs each day in a calendar month, divided by the number of days in the month.

B. Influent and Effluent Constituent Monitoring

Representative samples of Cypress Ridge WWTP's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) must be collected and analyzed if in accordance with Table 5. All samples must be grab.

Table 5. Influent and Effluent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency
Biochemical Oxygen Demand, 5-Day (BOD ₅)	mg/L	Not Required	Quarterly
Total Suspended Solids	mg/L	Not Required	Quarterly
pH	pH units	Not Required	Quarterly
Total Nitrogen	mg/L	Quarterly	Quarterly
Total Dissolved Solids	mg/L	Not Required	Semiannually
Chloride	mg/L	Not Required	Semiannually
Sodium	mg/L	Not Required	Semiannually
Sulfate	mg/L	Not Required	Semiannually
Boron	mg/L	Not Required	Semiannually

mg/L = milligram per liter

5. RECYCLED WATER MONITORING

Cypress Sewer Co. supplies recycled water and must therefore comply with California Code of Regulations title 22 requirements for recycled water monitoring and reporting. Cypress Ridge Sewer Co. must monitor effluent as specified in Table 6 and the most recently approved title 22 Engineering Report.

Table 6. Effluent Monitoring for Non-Potable Recycled Wastewater

Constituent	Units	Sample Type	Sampling Frequency	Sample Location
Total Coliform	MPN/100 mL ¹	Grab	Daily	ES-1
Chlorine Residual	mg/L	Meter	Continuously	ES-1
Daily Minimum CT ² Value	mg/L*min	Calculated ³	Daily	ES-1
Turbidity	NTU ⁴	Meter	Continuously	ES-1
Average Daily Turbidity	NTU	Calculated	Daily	ES-1
Maximum Daily Turbidity	NTU	Calculated	Daily	ES-1

¹ MPN/100 mL denotes most probable number per 100 mL sample

² CT is the product of total chlorine residual and model contact time measured at the same point, per CCR title 22 section 60301.23

³ Daily minimum CT Value is the product of the minimum total chlorine residual (measured within a 24-hour period) and the modal contact time. The modal contact time is the minimum contact time achieved during peak flow as determined by a tracer study.

⁴ NTU denotes nephelometric turbidity units

6. EMERGENCY STORAGE POND MONITORING

In the case of discharge to the emergency unlined storage pond, Cypress Ridge Sewer Co. must monitor effluent and flow volume as specified in Table 7.

Table 7. Effluent Monitoring for Non-Potable Recycled Wastewater

Constituent	Units	Sampling Frequency	Sample Location
Biochemical Oxygen Demand, 5-Day (BOD ₅)	mg/L	Weekly ¹	ES-2
Total Suspended Solids	mg/L	Weekly ¹	ES-2
Total Nitrogen	mg/L	Weekly ¹	ES-2
Days of Discharge	Days	Daily every discharge event	ES-2
Total Volume Discharged	gallons	Weekly ¹	ES-2

¹Samples must be collected at least once per discharge event. If the discharge event surpasses 1 week, monitoring must be conducted weekly as specified above week.

7. SOLIDS DISPOSAL MONITORING

Cypress Ridge Sewer Co. must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

If solids are not removed during the year, Cypress Ridge Sewer Co. must explain the absence of this monitoring in the annual report.

8. COLLECTION SYSTEM MAINTENANCE

Cypress Ridge Sewer Co. must submit records of any maintenance performed on the sewer collection system within the past year.

9. REPORTING

Monitoring reports must be submitted in accordance with Table 8.

Table 8. Semiannual Monitoring Reports

Report	Monitoring Period	Report Due Date
First Semiannual Report	January 1 to June 30	August 1
Second Semiannual Report	July 1 to December 31	February 1
Annual Summary Report	January 1 to December 31	March 1
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

A. Semiannual Reporting

At a minimum, the semiannual reports must include:

1. Results of all required monitoring in tabular format.
2. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program.
3. A comparison of monitoring data to the discharge specifications, applicable effluent limits, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements (data must be presented in tabular format).
4. Title 22 Recycled Water –
 - a. All required calculated data (Minimum Daily CT Value, Daily Average Turbidity, Daily Maximum Turbidity).
 - b. All Total Coliform Daily readings.

- c. An evaluation of the recycled water quality Title 22 compliance (Turbidity, Residual Chlorine, and Total Coliform).
 - d. Any violations of Title 22 requirements. If there was a violation, describe the measures taken to not distribute.
- 5. Copies of laboratory analytical report(s) and chain of custody form(s).
- 6. Emergency Storage Pond
 - a. All required monitoring data (BOD, TSS, Total N, # of Days, and Discharge Volume)
 - b. Summary statement of reason for usage and remediation actions

C. Annual Summary Reporting

The Annual Summary Report must include:

1. Facility Information and Description

Briefly describe your facility, treatment process, and disposal process with references to figures.

2. Data Tables and Graphs

Tabular and graphical summaries of all monitoring data (water supply, influent, effluent, and recycled water) compared to effluent recycled water limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Continuously monitored data (SCADA) does not need to be included in the physical report; however, compliance calculations and daily values must be included.

3. Recycled Water System Performance and Maintenance

Summarize the recycled water quality and describe any maintenance or testing performed on the treatment system to ensure compliance with recycled water criteria.

4. Compliance and Performance Discussion

- a. Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Permit requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.
- b. An evaluation (graphs recommended) of the treatment facilities' performance over time, nuisance conditions, system problems, etc.
- c. A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.

5. Solids Disposal

If solids are disposed of offsite, comply with the reporting in Section 6.

6. Operator Information

A discussion of operator certification and a list of current operating personnel, their grades of certification, and contact information for the wastewater operators responsible for operation, maintenance, and/or system monitoring. Include a copy of the current Office of Operator Certification Wastewater Treatment Plant Classification Form and the current Office of Operator Certification Chief Plant Operator Acknowledgement Form. If a contract operator is used, a copy of the contract operator certificate from the Office of Operator Certification

7. Flow Evaluation

A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.

8. Figures

A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).

10. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permiitting/docs/transmittal_sheet.pdf

Cypress Ridge Sewer Co. must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{1,2} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number **WDR100028962** at:

<https://geotracker.waterboards.ca.gov/esi/login>

Table 9 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

² Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Table 9. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water quality samples from the laboratory, field monitoring not required.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points (excluding supply wells). Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

11. TECHNICAL REPORTS

Cypress Ridge Sewer Co. must submit to GeoTracker the reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 10. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

Cypress Ridge Sewer. Co must also submit to GeoTracker a Collection System Maintenance Plan to ensure that it is properly monitoring and maintaining the collection system to minimize the potential for overflow, bypass, and seepage from wastewater transport systems to adjacent drainage ways or properties. The Collection System Maintenance Plan should address the following elements:

- A. Goal
- B. Organization
- C. Legal Authority
- D. Operation and Maintenance Program
- E. Design and Performance Provisions
- F. Overflow Emergency Response Plan
- G. Fats, Oils, and Grease (FOG) Control Program
- H. System Evaluation and Capacity Assurance Plan
- I. Monitoring, Measurement, and Program Modifications
- J. Collection System Maintenance Plan Audits
- K. Communication Program

Table 10. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	January 1, 2024
Sampling and Analysis Plan	January 1, 2024
Sludge Management Plan	January 1, 2024
Collection System Maintenance Plan	January 1, 2024

12. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Cypress Ridge Sewer Co. submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Cypress Ridge Sewer Co. to enforcement action pursuant to [section 13268 of the California Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Cypress Ridge Sewer Co. is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

Cypress Ridge Sewer Co. must implement the above monitoring program on October 1, 2023. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Cypress Ridge Sewer Co. must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered by:

Digitally signed by Jennifer
Epp
Date: 2023.09.29 13:09:48
-07'00'
Water Board

A blue wavy line graphic, resembling a stylized wave or the letter 'S', is positioned behind the signature text.

for Matthew T. Keeling
Executive Officer

DEPARTMENT OF HEALTH SERVICES**DIVISION OF DRINKING WATER AND ENVIRONMENTAL MANAGEMENT**

530 E. Montecito Street # 102
PO BOX 4339
Santa Barbara, CA 93140-4339
(805) 963-8616
FAX (805) 962-0827



June 10, 1999

Cypress Ridge Limited Partnership
P.O. Box 179
Arroyo Grande, CA 93421

Attention: Mr. Denis Sullivan
President

Gentlemen:

System No: 4090006(701)

The State Department of Health Services, Drinking Water Field Operations Branch (SDHS-DWFOB) has reviewed the Engineering Report, plans and specifications dated May 1999 and has conducted a field site inspection on June 3, 1999 of the Cypress Ridge Development, Wastewater Treatment and Recycled Project (CRD) and water system. Our time will be billed to the Cypress Ridge Limited Partnership as required. The use and the distribution of recycled water must comply with the State Department of Health Service's (SDHS's) Wastewater Reclamation Criteria, Title 22 Criteria and the Cross Connection Control Requirements, Title 17.

Following the review of the information submitted by the CRD and field visit, the SDHS-DWFOB has determined the recycled water project to be conditionally complete following the submission and approval of the "Rules of Service Agreement" between the producer and user and the qualifications of the on site supervisor responsible for the use of the recycled water on the golf course facilities, parks, and homeowners association common area. The CRD will also need to retrofit three recycled water hosebibs connections at the waste water facility with unique keys for the use only by trained staff. There is no domestic water at the waste water treatment plant. If domestic water is ever used at the waste water treatment plant, adequate cross-connection control must be provided. The following are the SDHS-DWFOB comments:

Treatment Comments

1. The SDHS's Criteria for the use of recycled water at a golf course with unrestricted access (homes will be adjacent to the fairways), requires that the effluent be treated to a tertiary level that complies with a coliform level of (2.2 MPN, 7 day

median) and turbidity levels of (2.0 NTU daily average, <5 NTU 95%, 10 NTU Max) for filtered wastewater at all times. The turbidity of the tertiary treated water shall be continuously monitored and recorded prior to and following filtration. The coliform analyses shall be performed daily. A minimum CT of 450 mg-min/l must be provided. The effluent quality must continuously meet the above requirements. A monitoring and reporting program which includes all monitoring required by the Recycled Water Criteria and the RWQCB, and the frequency and location of the sampling is included in the report. The reclamation project will be required to conduct at a minimum daily turbidity, chlorine residual and CT calculations under worst case conditions. The report lists conditions which would require an immediate diversion to take place and a plan for disposal or treatment of the diverted water. The monitoring data will need to be submitted to the RWQCB and the SDHS in a monthly report.

2. The CRD provided construction and operation details for the treatment facility including the filters (filter media depth, type of filter media, effective size of the media, pressure differential, water source for the backwash of the filters, backwash frequency, discharge of backwash water, etc.). CRD has submitted this information. An operations report for the wastewater reclamation treatment facility should be developed. A plan (including methods) must be developed for notifying the recycled water user, the RWQCB, the state and local health departments and other agencies as appropriate of any treatment failures that could result in the delivery of inadequately treated recycled water to the use area. The notification procedures should be included with the "Rules of Service" agreement.
3. The treatment facility needs to be operated by certified reclamation treatment plant operators.

Distribution and Use Comments

4. The CRD shall ensure that there are no cross connections between the domestic potable water lines and recycled water lines at all times. The CRD discharges irrigation well water into the Lake where recycled water effluent is blended with the well water and then used for irrigating the golf course. The irrigation well water is **not** discharged through an approved air gap. The CRD needs to inform the County of San Luis Obispo Environmental Health Department. The irrigation wells can never be used for domestic purposes unless the discharge to the Lake is modified to an approved air gap. The irrigation wells and domestic wells shall not be connected at any time. All backflow devices shall be tested annually by a certified cross connection control specialist. Air gaps shall be at least twice the pipe diameter and be located above ground.
5. The AWWA Guidelines for the Distribution of Non-Potable water need to be followed including the installation of purple pipe, adequate signs, etc. Adequate separation of the recycled water lines, the domestic water lines and sewer lines shall be provided at all times.

6. The CRD shall ensure that no recycled water irrigation use areas and no effluent holding ponds are located within 50 - 100 feet of any domestic water supply well. Any recycled water spray, mist, or runoff shall be confined to the recycled water use area and shall not contact any drinking water fountains, food handling facilities or where the public may be present. Drinking water fountains or bottled water provided on the golf course must be equipped with hoods or covers. Recycled water use shall be limited to times when public is not present. These and other operational controls shall be included in the operations plan and Rules of Service Agreement which will be required prior to delivery of the recycled water. This report must be submitted to the SDHS for review and approval prior to startup.
7. Warning signs shall be used informing the public that recycled water is used for irrigation. The international signage "Do Not Drink" is not required. Bilingual signs should be used.
8. All above ground recycled water irrigation appurtenances shall be marked appropriately.
9. Hosebibs which the public could use shall be eliminated. The CRD will also need to retrofit three hosebibs at the waste water facility with unique keys for the use only by trained staff. Quick couplers may be used.
10. The recycled water provider needs to be defined. Supervisors must be appointed for the recycled water use areas and their staff must be trained on the hazards of working with recycled water and be periodically retrained. The supervisor's qualifications need to be provided.
11. The areas irrigated by recycled water must be inspected yearly by the recycled water provider. The recycled water system shall be evaluated by a shutdown test at a minimum of every four years. A report of findings of the inspections and shutdown tests need to be submitted to the DWFOB, County Health Department and the RWQCB.
12. The recycled water system lateral pipelines are located along the property lines of homeowners. The SDHS-DWFOB has documented cases of homeowners illegally connecting to unpressurized recycled water laterals located near their property. The SDHS-DWFOB recommends a buffer zone between the recycled water lines and the property owners. The type of controls placed to ensure against cross-connections in the future need to be developed in the Rules of Service Agreement. If the CRD does not feel it can maintain adequate control of the recycled water system pipelines, the pipelines will need to be relocated or a physical barrier needs to be installed to prevent this type of potential problem. The homeowners need to

be educated on the use of recycled water in the area. The CRD should specify a plan to interface with the homeowners association as part of the Rules of Service Agreement in an adjacent property awareness program.

Domestic Water System

13. The domestic water system will need to apply for a domestic water supply permit. The system will need to comply with all regulations relating to domestic water systems. The SDHS-DWFOB will issue the permit to the system since the system has over 200 services. The CRD will need to submit source information, distribution system plans and specifications, sewer, water and recycled water line separation, cross-connection control, location of wells or other sources of supply, chemical analyses of the sources of supply, etc. The system will also need to submit the required information on the system's Technical, Managerial and Financial capability to operate a domestic water system. The Drinking Water Source Water Assessment and Protection forms need to be completed and submitted to this office. The CRD has begun submitting this information. The CRD should contact this office if you have any questions. A domestic water supply permit application is attached to this letter. A processing fee of \$507.00 is required. Please submit the fee made out to the State Department of Health Services with the application.

If you have any questions concerning this letter, please contact this office at (805) 963-8616.

Sincerely,

John Curphey, P.E.
District Sanitary Engineer
Santa Barbara District (DWFOB)

cc: San Luis Obispo County Environmental Health
Regional Water Quality Control Board
Gary Kalar, Mauldin-Dorfmeier
bcc: District (2); Region

CR0699.doc