



GAVIN NEWSOM
GOVERNOR



JARED BLUMENFELD
SECRETARY FOR
ENVIRONMENTAL PROTECTION

Central Coast Regional Water Quality Control Board

August 1, 2025

Sent Via Electronic Mail

Patrick Dobbins
Public Works Director/City Engineer
City of Gonzales
147 4th Street
Gonzales, CA 93926
e-mail: pdobbins@ci.gonzales.ca.us

Dear Patrick Dobbins:

**GONZALES WASTEWATER TREATMENT PLANT, 400 SHORT RD, GONZALES,
MONTEREY COUNTY:**

- **SECOND REVISED NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY**
- **TRANSMITAL OF REVISED MONITORING AND REPORTING PROGRAM NO. R3-2025-0056**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the May 29, 2025 and July 17, 2025 Addendum to Report of Waste Discharge R3-2020-0020 submitted by the City of Gonzales (Gonzales) and documents associated with Gonzales' domestic wastewater treatment facility (Wastewater System) located at 400 Short Road in Gonzales, California. The Wastewater System, owned by Gonzales is currently regulated pursuant to *General Waste Discharge Requirements Order R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit). In the May 29, 2025, and July 17, 2025 Addendums, Gonzales proposed the addition of emergency temporary disposal fields.

This letter serves as a **second revised** notice of applicability for enrollment in the General Permit. This letter includes: wastewater system operation summary, specific requirements, and limitations (Attachment 1); figures (Attachment 2); and Gonzales' revised monitoring and reporting program requirements (Attachment 3).

The initial revised notice of applicability was issued on January 15, 2025. This second revised notice of applicability includes the following revisions:

JANE GRAY, CHAIR | RYAN E. LODGE, EXECUTIVE OFFICER

- Updates to the permitted treatment and disposal technologies in Attachment 1, Table 2.
- Addition of emergency disposal-controlled flood fields, and requirements associated with the operation of the fields. Discharge to any areas not identified in this revised notice of applicability is prohibited.
- Monitoring and reporting requirements for the fields.
- Reduction in permitted monthly average influent flow from 1,300,000 gallons per day (gpd) to 1,200,000 gpd.
- Removed the interim limits that were in place until April 11, 2025.

The revised notice of applicability and revised monitoring and reporting program is effective immediately and supersedes and replaces the January 15, 2025 notice of applicability and April 11, 2023 monitoring and reporting program.

Gonzales must comply with the following:

1. **General Permit** – Gonzales must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf

2. **Monitoring and Reporting Program** – Gonzales must comply with the requirements of Monitoring and Reporting Program R3-2025-0056, Attachment 3. The next quarterly monitoring report is due **November 1, 2025** and the annual report is due **March 1, 2026**. Gonzales is also required to comply with annual volumetric reporting requirements¹ established by the State Water Resources Control Board (State Water Board).

Quarterly monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

All annual reports must be formatted and completed as specified in the annual report template found at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

¹ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

As described in the attached monitoring plan, Gonzales must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{2,3} database with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System – specific global identification number **WDR100032021** over the internet at:

<https://geotracker.waterboards.ca.gov/esi/login.asp>

3. **Fees** – Gonzales paid an annual fee of \$28,205 on January 3, 2025, this payment covers Gonzales' enrollment in the General Permit for the 2024-2025 fiscal year.

Gonzales must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board's fee program and cover the state fiscal year of July 1 through June 30. Your current annual fee is \$28,205. Gonzales' Wastewater System is currently assigned a threat and complexity rating of 2B. A copy of the current state fee schedule is available electronically at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board was notified of Gonzales' enrollment into the General Permit at a public meeting on June 23, 2023. Details about that meeting are available on our website at:

https://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to California Water Code section 13260, Gonzales must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, Gonzales must notify the Central Coast Water Board immediately of such changes.

Attachment 1 contains the Central Coast Water Board's understanding of the Wastewater System located at 400 Short Road in Gonzales. Please review Attachment 1 to determine if the description is representative of your current system. Pursuant to California Water Code section 13267, Gonzales must notify the Central Coast Water Board if this information is out of date or incorrect. You are required to provide staff with your updated information within **30 days** of issuance of this letter.

² Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/

³ Additional information available at: <https://geotracker.waterboards.ca.gov/>

- 6. Responsible Party** – Gonzales is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code, and subjects Gonzales to enforcement action, and termination of enrollment under this General Permit.
- 7. Change in Ownership** - In the event of any change in control or ownership of the property, Gonzales must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board so that the new owner or operator can be enrolled in the General Permit and Gonzales' enrollment in the General Permit can be terminated.
- 8. Certified Operator** – Gonzales is required to comply with the operator certification requirements⁴ administered by the State Water Board's Office of Operator Certification, which currently requires a Grade II certified operator onsite to maintain and operate the Wastewater System.
- 9. Disposal Area** - Discharge to areas other than the designated infiltration basins shown in Figure 1 and 4 of Attachment 2 is prohibited. Figures 4 and 5 show the Emergency Infiltration Basin D and the emergency disposal fields to account for the decrease in capacity of the current disposal area. Prior to discharging into the new emergency, temporary disposal fields, Gonzales must provide final engineering drawings, photographs of the new disposal fields, and photographs of fencing surrounding the disposal fields. Gonzales must obtain Central Coast Water Board staff approval via email prior to discharging to the emergency, temporary infiltration basin and disposal fields.

If you have any questions, please contact **Kathy Truong-Krebs at (805) 549-3293 or by email at Kathy.Truong-Krebs@waterboards.ca.gov** or Jennifer Epp at (805) 594-6181 or by email at Jennifer.Epp@waterboards.ca.gov.

Sincerely,



for Ryan E. Lodge
Executive Officer

⁴ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.
https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

Attachments:

Attachment 1: Wastewater System Operation Summary, Specific Requirements, and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program Order R3-2025-0056

cc:

Tiffany Twissleman, Gonzales, ttwisselmann@ci.gonzales.ca.us

Megan Panofsky, MNS Engineers, mpanofsky@mnsengineers.com

Connor Cappi, Monterey County cappic@countyofmonterey.gov

Jennifer Epp, Central Coast Water Board, Jennifer.Epp@Waterboards.ca.gov

Todd Stanley, Central Coast Water Board, Todd.Stanley@waterboards.ca.gov

Kathy Truong Krebs, Central Coast Water Board, Kathy.Truong-Krebs@Waterboards.ca.gov

WDR Program, GeoTracker RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-227602

GeoTracker No. = GT- WDR100032021

Rev 10/6/2022

ECM Subject Name = Gonzales Wastewater Treatment Plant Second Revised NOA for R3-2020-0020

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\Monterey Co\Gonzales, City of WWTP\1_Permits\Existing Permits\Revised Big Order Aug 2025\Aug2025_GonzalesSecondRevisedNOA_MRP_0020_final.docx

**ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY, SPECIFIC REQUIREMENTS,
AND LIMITATIONS**

I. OWNERSHIP AND WASTEWATER SYSTEM INFORMATION

Ownership and wastewater system information submitted by Gonzales to the Central Coast Water Board is shown in Table 1.

Table 1. Ownership and Wastewater System Information

Name	Gonzales Wastewater Treatment Plant
Physical Address	400 Short Road Gonzales, CA 93926
Latitude	36.48971
Longitude	-121.47357
Mailing Address	147 4th Street Gonzales, CA 93926
Owner	City of Gonzales
Chief Plant Operator	Tiffany Twissleman phone: 831-776-2095 email: ttwisselmann@ci.gonzales.ca.us
Legally Responsible Official	Patrick Dobbins Public Works Director/City Engineer phone: 831-675-5000 email: pdobbins@ci.gonzales.ca.us
Raw Wastewater Characteristics	Sewer Connections: 1,900 Population Served: 8,348 Domestic (%): 33% Industrial (%): 67%
Maximum Permitted Design Flow (gallons per day, gpd)	1,200,000 average monthly
Baseline Flow (average annual flow in 2023) gpd	1,120,000
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58
Fees Received	--
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR
Reclamation Included	No
EPA Approved Pretreatment Program	No

II. WASTEWATER SYSTEM OPERATION SUMMARY

Gonzales Wastewater Treatment Plant wastewater treatment facility (Wastewater System) is a Class II wastewater system. Gonzales must staff a Class II chief plant operator for proper operation of the Wastewater System. The current chief plant operator is Tiffany Twisselmann, Grade 2, License Number 43086.

The Wastewater System is designed to treat 1,200,000 gpd (3,700,000 peak hourly) to a secondary treatment level. The Wastewater System consists of the treatment technologies and treatment capabilities shown in Table 2.

Table 2. Treatment Technology and Capacity

Emergency Storage/Overflow	Unlined Emergency Pond, Infiltration Basin D, and Controlled Flood Disposal Fields 1 and 2.
Headworks/Preliminary Treatment	The headworks consists of a bar screen and influent channels with two grinders, then a vortex grit chamber to settle out large inorganic solids from the influent flow.
	Headworks capacity (gpd): 4.0 million gpd (MGD) peak hour
Primary and Secondary Treatment	Six facultative treatment ponds (Ponds 1 to 6) with surface aerators, followed by two polishing ponds (Ponds 7 and 8) function to remove Biochemical Oxygen Demand (BOD ₅) and Total Suspended Solids (TSS) from the influent wastewater. The ponds are set up as two parallel trains of four ponds in series, with each train treating about half of the flow.
	Secondary treatment capacity (gpd): 1,200,000 average daily flow
Wastewater Disposal Method (Infiltration Basins)	Treated effluent is discharged to one of three 7-acre infiltration basins (Basin A, Basin B, and Basin C). An infiltration study at the site suggests long-term infiltration rates to be on the order of 1.5 feet per day (3,500,000 gpd per basin). When first-encountered groundwater elevations rise in the area, disposal capacity can significantly decrease, as reported in 2024 monitoring reports.
	Maximum estimated maximum disposal capacity (gpd): 3,500,000 (in dry years)
Emergency Wastewater Disposal (Infiltration Basin and Controlled Flood Disposal Fields)	Treated effluent may be discharged into a temporary infiltration basin (Basin D). Gonzales may only discharge to the basin when all three infiltration basins are full and Gonzales cannot conduct its regular maintenance (tractor ripping) in the three basins. The temporary basin has a 5-acre footprint and is located on Gonzales' property where the future industrial wastewater treatment will be constructed.

	Treated effluent may also be disposed from Basin A to the temporary emergency controlled flood field 1 which is directly east of the current WWTP and field 2 which is to the east of basin D. These fields result in a combined total of 8 acres on city-owned property. This discharge is only to occur with Central Coast Water Board staff approval for specific calendar dates.
	Gonzales must monitor and report on disposal to the infiltration basins and emergency controlled flood disposal fields in compliance with Monitoring and Reporting Program R3-2025-0056 Section V.
Biosolids/Sludge Production and Handling	Gonzales will periodically hire a third party to dredge and dispose of accumulated sludge and debris in the treatment ponds.

A summary of historic and recent average effluent concentrations is included in Table 3, which were reported in Gonzales' quarterly monitoring reports. The Central Coast Water Board used reported effluent water quality data to establish the effluent and groundwater limitations in section 3.

Table 3. Effluent Water Quality for Select Constituents

Constituents	Units^[1]	Historical Average^[2]	Annual Average for 2023^[3]
Biochemical Oxygen Demand, 5-Day	mg/L	94	81
Total Suspended Solids	mg/L	113	158
Total Dissolved Solids	mg/L	860	843
Chloride	mg/L	204	176
Sodium	mg/L	133	145
Sulfate	mg/L	60	67
Boron	mg/L	0.27	0.34
Total Nitrogen ^[4]	mg/L	28.5	45
Nitrate as Nitrogen ^[4]	mg/L	3.84	<0.2

[1] mg/L denotes milligrams per liter

[2] Based on water quality data reported by Gonzales in their 2017 to 2021 monitoring reports.

[3] Based on water quality data reported by Gonzales in the 2023 Annual Monitoring Report.

[4] Total nitrogen and nitrate not included in summary as historical data was not consistently analyzed.

III. WASTEWATER SYSTEM SPECIFIC REQUIREMENTS AND LIMITATIONS

Gonzales must operate the Wastewater System in accordance with the General Permit and this notice of applicability. Gonzales must comply with the wastewater specific limitations specified in Table 4 through Table 8.

Flow limitations are shown in Table 4.

A. Flow Limitations:

Table 4. Flow Limitations

Flow	Units	Limit	Point of Compliance
Maximum Average Monthly (dry and wet weather)	Gallons per day	1,200,000	Influent
Maximum Daily (dry and wet weather)	Gallons per day	1,600,000	Influent

B. Effluent Limitations:

Since April 11, 2025, the treatment pond effluent limitations shown in Table 5 apply.

Table 5. Effluent Limitations: Treatment Ponds

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Biochemical Oxygen Demand, 5-Day	mg/L	45	65	Not Applicable
Total Suspended Solids	mg/L	45	65	Not Applicable
Settleable Solids	mL/L ^[1]	0.3	Not Applicable	0.5
pH	Not Applicable	Between 6.5 and 8.4	Not Applicable	Not Applicable

[1] mL/L denotes milliliters per liter

**Table 6. Effluent Limitations
Based on - Salinas Valley 180-foot Aquifer**

Constituents	Units	25-Month Rolling Median
Total Dissolved Solids	mg/L	1500
Chloride	mg/L	250
Sodium	mg/L	250
Sulfate	mg/L	600
Boron	mg/L	0.5
Total Nitrogen	mg/L	Not Applicable

C. Groundwater Limitations:

Based on review of historical effluent water quality (see Table 3), Gonzales is unable to consistently comply with the General Permit effluent limitations for total nitrogen, thus the point of compliance for this constituent is underlying groundwater.

Through groundwater monitoring, Gonzales must demonstrate that the discharge does not cause underlying groundwater to exceed the water quality objectives set forth in the Basin Plan including the limitations listed in Table 7.

**Table 7. Groundwater Limitations
Salinas Valley 180-foot Aquifer**

Constituents	Units	25-Month Rolling Median^[1]
Total Dissolved Solids	mg/L	1500
Chloride	mg/L	250
Sodium	mg/L	250
Sulfate	mg/L	600
Boron	mg/L	0.5
Total Nitrogen	mg/L	1

[1] Rolling Median is the median from all data collected over the most recent 25 months

D. Organic Loading Limitations

Gonzales land applies treated wastewater to the bermed infiltration basins and emergency disposal areas via controlled flood irrigation and thus organic loading limitations specified in Table 8 apply.

Table 8. Organic Loading Limitations

Constituents	Units	30-Day Average	Maximum
Biochemical Oxygen Demand, 5-Day	Pounds/acre/day	100	300

E. Requirements for Emergency Disposal Fields and Infiltration Basin

Emergency disposal at the disposal fields and Basin D is permitted temporarily, and only when the permanent infiltration basins are not percolating as designed, and influent flows exceed disposal capacity. The Central Coast Water Board may notify Gonzales at anytime to remove the authority to use of the emergency disposal methods including: the Infiltration Basin (Basin D) and controlled flood disposal fields 1 and 2.

Disposal to the fields are only permitted under the following conditions.

1. Gonzales must first obtain Central Coast Water Board staff approval for discharge during specific calendar dates.
2. Gonzales must provide a final field design drawing, the current approved conceptual plan is included at Figure 4, attached.

3. Gonzales must maximize effluent flow to the permanent infiltration basins prior to requesting discharge to the emergency infiltration basin and controlled flood fields.
4. Gonzales must comply with General Permit Section IV.D, Land Application by Controlled Flood Methods.
5. Gonzales can only discharge to the areas shown in Figure 5, attached.
6. Gonzales must operate and maintain the controlled flood fields as proposed in the Addendum to Report of Waste Discharge R3-2020-0020, which includes:
 - a. Discharge operations (bubbling) of effluent between 7:00 AM and 4:00 PM (run times between 3-8 hours per day).
 - b. Selection of the operation zone will be determined by observation of field conditions.
 - c. While bubblers are operating, inspection intervals of 2 hours will take place to monitor for leaks, erosion, and ponding.
 - d. Distribution pipes, pump, and hose will be inspected daily during operation to minimize and/or eliminate leakage.

ATTACHMENT 2
FIGURES

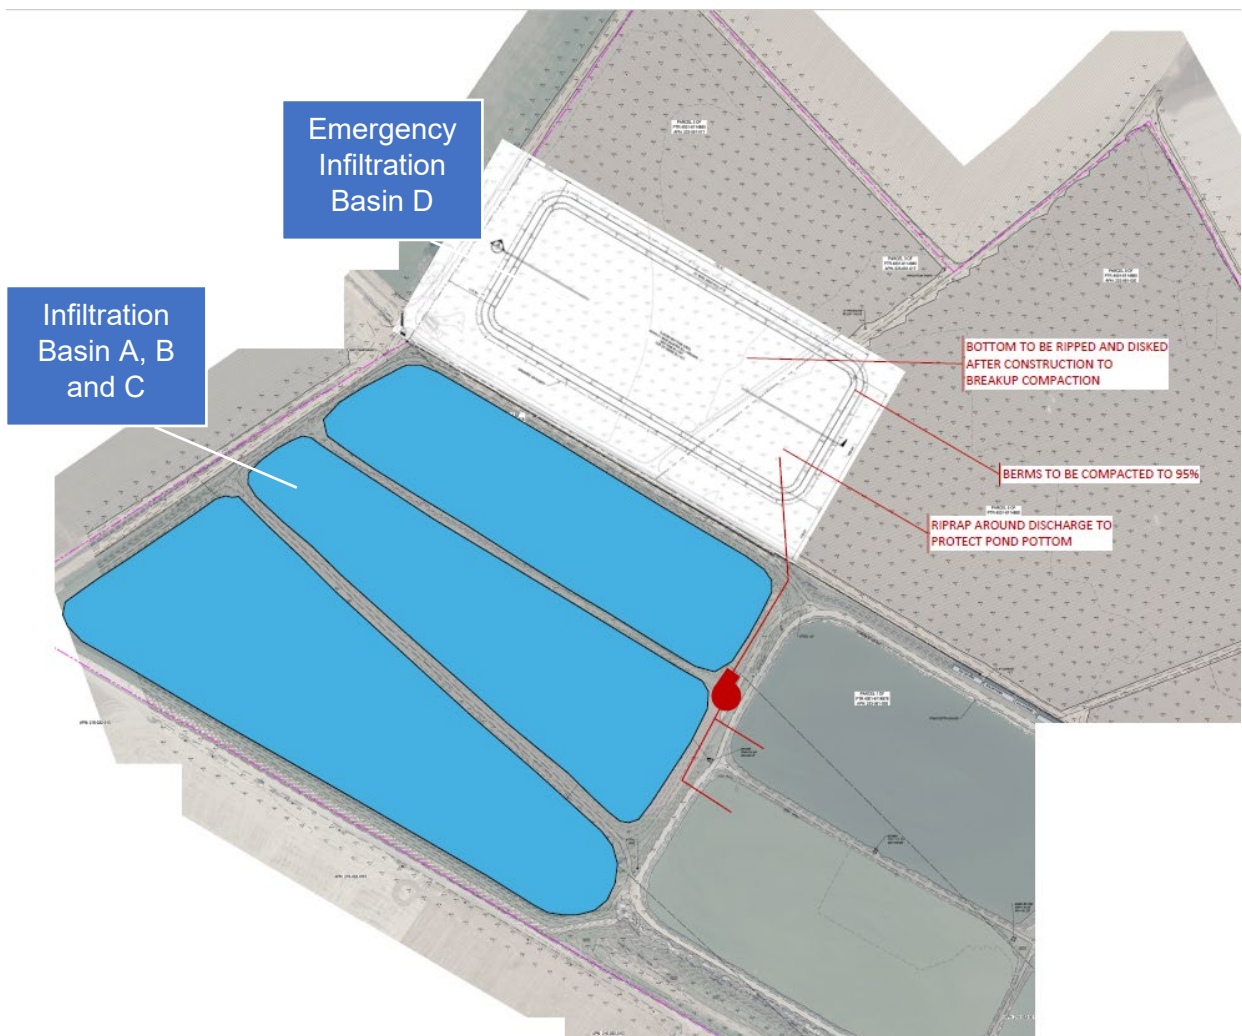


Figure 1. Permitted Disposal Locations: Infiltration Basins A, B, C, and Emergency Infiltration Basin D

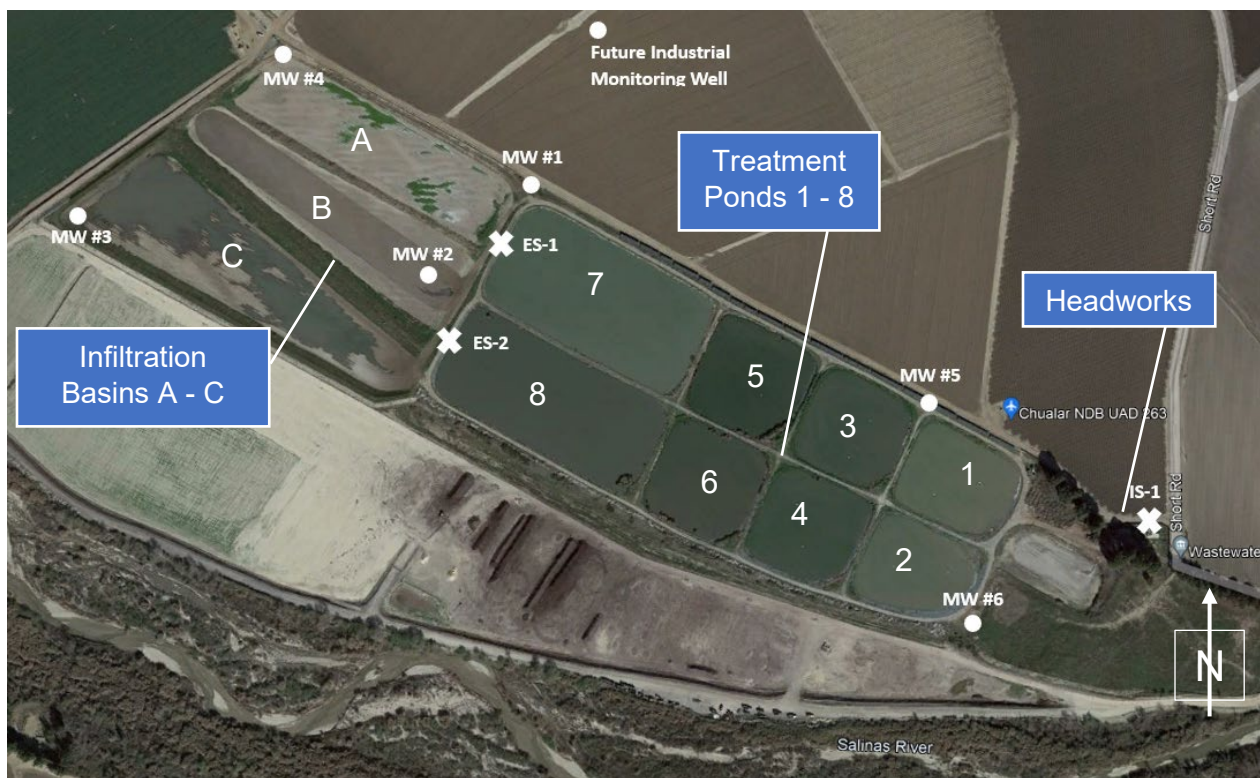
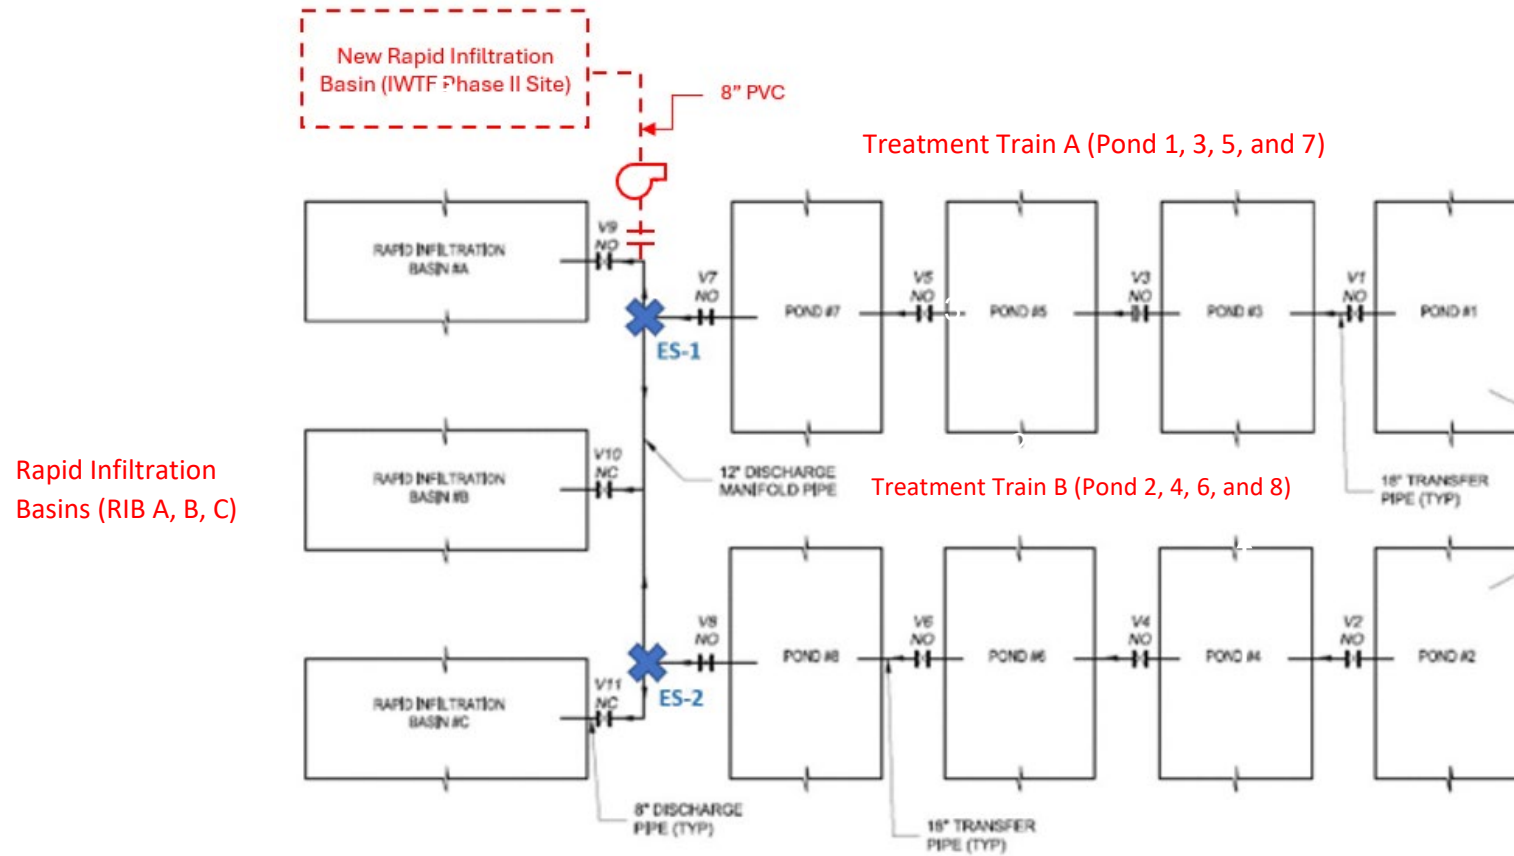


Figure 2. Facility Layout (Excluding Emergency Disposal Ares)
(MW=Monitoring Well; IS=Influent Sample; ES = Effluent Sample)



**Figure 3. Pond Process Flow Diagram with Effluent Sampling Points
(ES-1 and ES-2)**

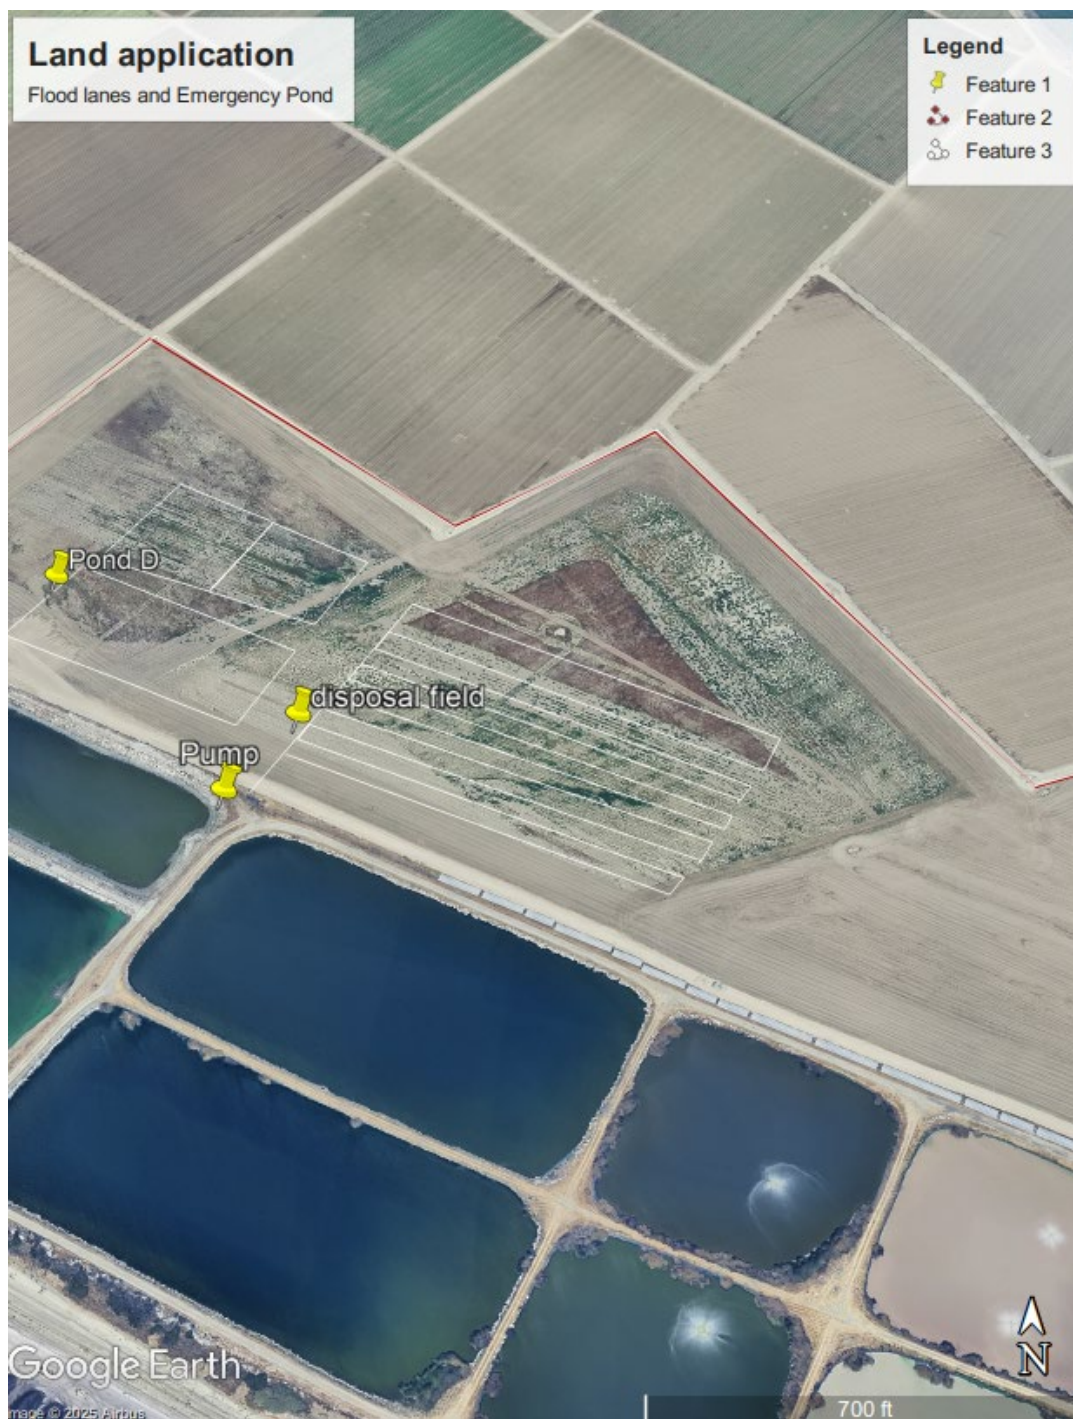


Figure 4. Proposed Addition to Emergency Disposal Area Layout in White
(Source: Addendum to Report of Waste Discharge Provided by The City of Gonzales on July 15, 2025)

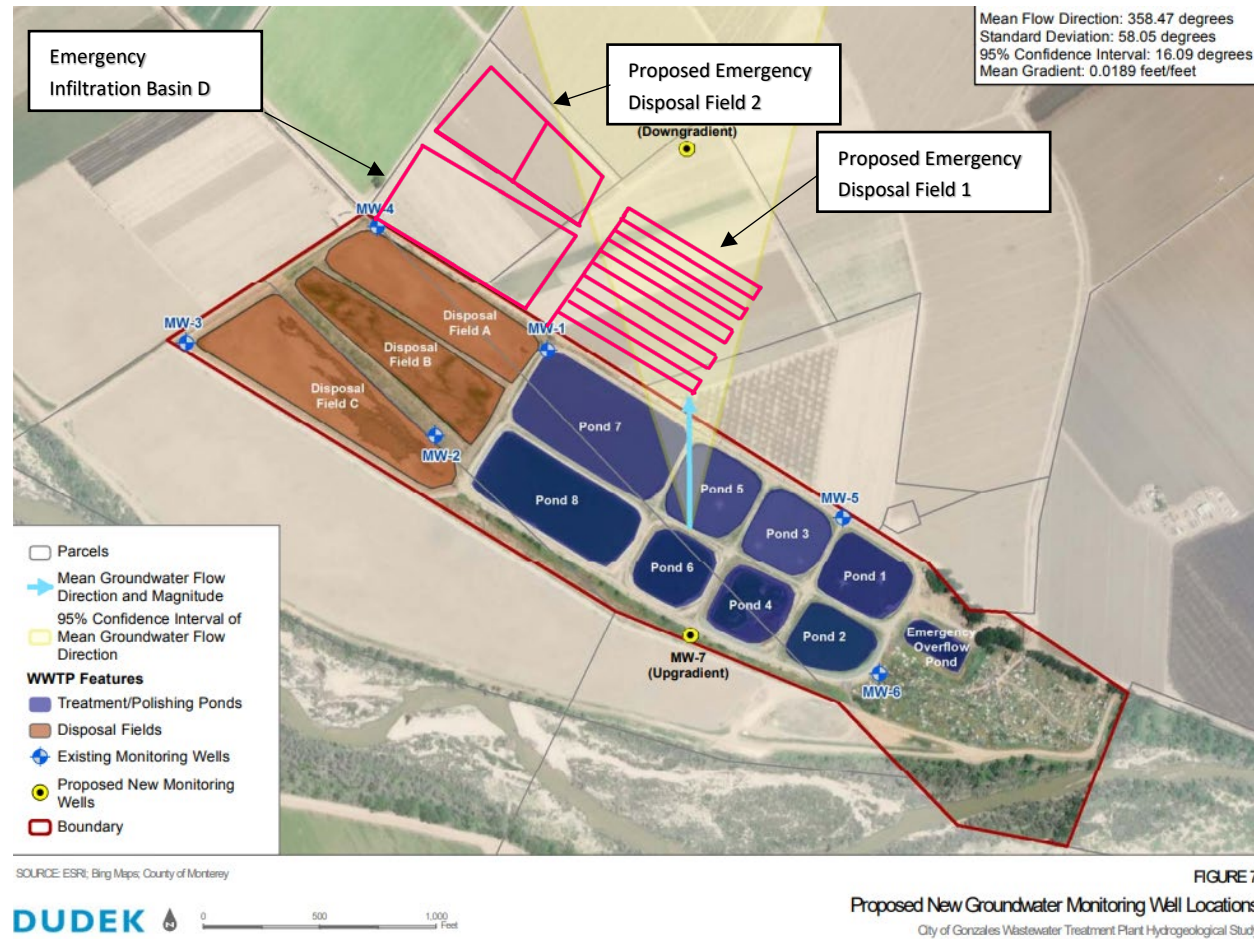


Figure 5. WWTP Monitoring Wells, Ponds, and Proposed Disposal Areas

(Source: Adapted from Emergency Percolation Pond Memo Form 200 dated December 19, 2024)

**ATTACHMENT 3
MONITORING AND REPORTING PROGRAM**

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

**MONITORING AND REPORTING PROGRAM NO. R3-2025-0056
(AUGUST 1, 2025 MODIFICATION OF
MONITORING AND REPORTING PROGRAM NO. R3-2020-0020)
FOR
GONZALES WASTEWATER SYSTEM
GONZALES, MONTEREY COUNTY**

This Monitoring and Reporting Program applies to the monitoring and reporting requirements for the City of Gonzales (Gonzales) Wastewater Treatment Plant (Wastewater System) enrolled in *General Waste Discharge Requirements Order R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

Gonzales owns and operates the Wastewater System that is subject to the General Permit and notice of applicability. Gonzales must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Regional Water Quality Control Board (Central Coast Water Board).

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The monitoring and reporting program directs Gonzales to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board's GeoTracker database (see monitoring and reporting program section VIII.C).

I. SAMPLING AND ANALYSIS

Gonzales must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Water Board. All samples (e.g., wastewater, groundwater, soil, sludge) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must

also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the Operations and Maintenance Manual for Central Coast Water Board review and approval.

- A. Sampling Schedule** – Unless otherwise specified below, sampling must be performed in accordance with Table 1.

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Quarterly	January, April, July, and October
Semiannual	April and October
Annual	October

Field test instruments (such as those used to test pH, dissolved oxygen, electrical conductivity, and settleable solids) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

- B. Monitoring Location Descriptions** – All samples including influent samples (IS), effluent samples (ES), groundwater monitoring well (MW) must be collected at the locations described in Table 2 and Figures 1 and 2. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. **Gonzales must upload the GeoTracker field point information for each sampling location in the GeoTracker database once, prior to uploading laboratory data (see Table 10).**

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Influent Sample	IS-1	Raw wastewater sample collected at the headworks

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Effluent Sample	ES-1 ^[1]	Treated wastewater sample collected leaving Pond 7
Effluent Sample	ES-2 ^[1]	Treated wastewater sample collected leaving Pond 8
Monitoring Well 1	MW-1	Depth: 66'2" Latitude: 36.492863 Longitude: -121.480001
Monitoring Well 2	MW-2	Depth 38'3" Latitude: 36.4920001 Longitude: -121.481491
Monitoring Well 3	MW-3	Depth 48'7" Latitude: 36.492484 Longitude: -121.485456
Monitoring Well 4	MW-4	Depth 27' Latitude: 36.494462 Longitude: -121.483123
Monitoring Well 5	MW-5	Depth 29'2" Latitude: 36.490069 Longitude: -121.475578
Monitoring Well 6	MW-6	Depth 28'5" Latitude: 34.488861 Longitude: -121.474977

[1] Offline treatment trains do not require sampling if not used during the entire duration of the monitoring period. If both treatment trains (Pond 7 and Pond 8) are online, both effluent points must be sampled.

II. WATER SUPPLY MONITORING

Representative samples of Gonzales' raw water supply (sampled before use or treatment) must be collected and analyzed, at a minimum, for constituents specified in Table 3.

In lieu of the required water supply sampling, Gonzales may request Central Coast Water Board approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county, provided, at a minimum, all of the required constituents are sampled at the frequency specified in Table 3. Gonzales must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 3. Gonzales must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Gonzales must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring

Constituent	Units^[1]	Sample Type	Sampling Frequency
Nitrate (as N)	mg/L	Grab	Annually

Constituent	Units ^[1]	Sample Type	Sampling Frequency
Total Dissolved Solids	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

[1] mg/L denotes milligrams per liter

III. INFLUENT AND EFFLUENT MONITORING

A. Influent and Effluent Flow Monitoring – Gonzales must monitor and report flow in gallons per day, as described in Table 4, with each monitoring report. See monitoring and reporting program section VIII.A.3 for supplemental volumetric annual reporting requirements established by the State Water Board.

Table 4. Influent and Effluent Flow Monitoring

	INFLUENT	INFLUENT	EFFLUENT	EFFLUENT
Parameter	Sample Type	Reporting Frequency	Sample Type	Reporting Frequency
Daily Flow ^[1]	Metered	Daily	Estimated ^[2]	Daily
Maximum Daily Flow	Metered	Monthly	Estimated ^[2]	Monthly
Mean Daily Flow	Calculated	Monthly	Calculated	Monthly

[1] The General Permit notice of applicability specifies the Wastewater System's maximum permitted flow. In the monitoring reports, Gonzales must evaluate and provide a comparison of monitored flow to the permitted flow.

[2] If the flow is estimated, Gonzales is required to provide an explanation (e.g., no meter- estimated using pump operations including rate and time) with each monitoring report.

B. Wastewater System Monitoring – Representative samples of Gonzales' influent (raw wastewater) into the Wastewater System and effluent (treated wastewater) discharged to land must be collected and analyzed in accordance with the treatment

technology-based monitoring requirements (including sample type and frequency) summarized in the tables below. See Figures 1 and 2 for the location of samples and GeoTracker influent (IS) and effluent (ES) field points.

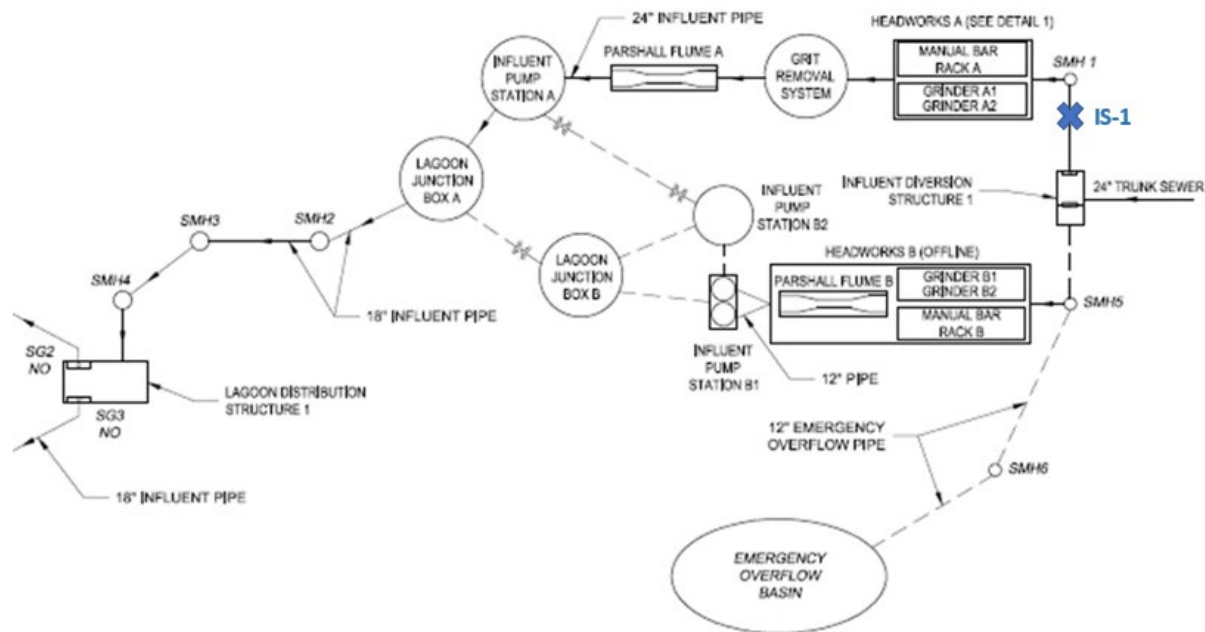


Figure 1. Headworks Process Flow Diagram and Influent Sample (IS)

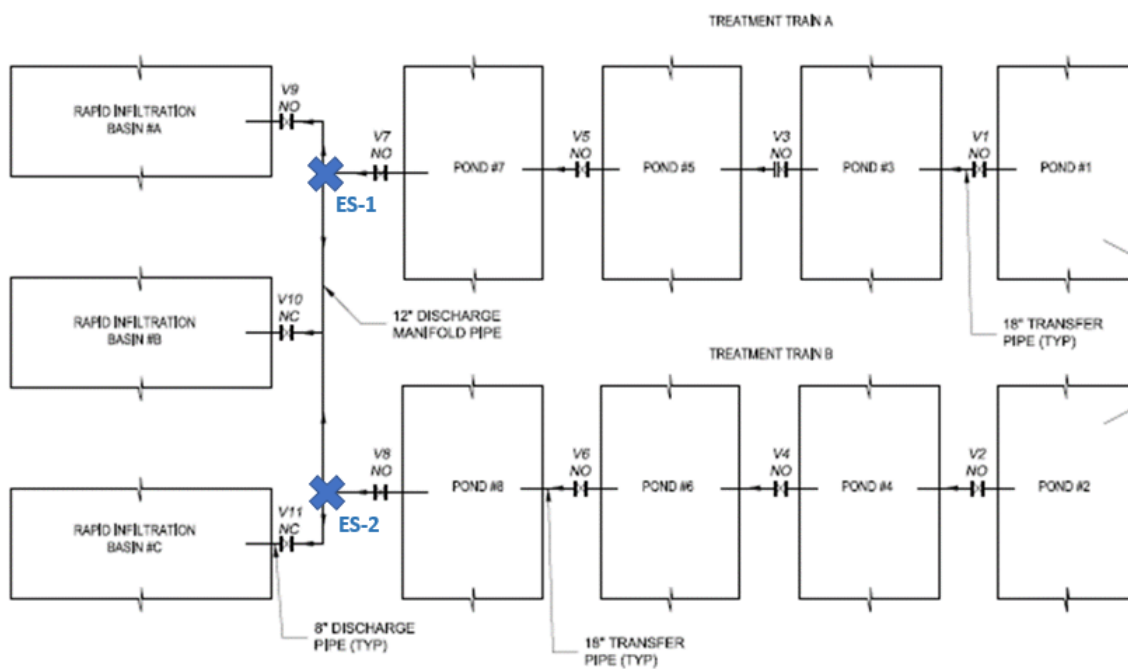


Figure 2. Pond Process Flow Diagram and Effluent Samples (ES)

- i. **Influent and Effluent Monitoring** – At a minimum, influent and effluent constituent monitoring for the pond treatment systems must be monitored as specified in Table 5 at the locations shown in Figure 2 of Attachment 2 of the Notice of Applicability dated August 1, 2025. Influent must be a composite sample while effluent samples must be grab from online treatment trains (Ponds 7 and Pond 8).

Table 5. Influent and Effluent Monitoring

		INFLUENT (IS-1)	EFFLUENT (ES-1) Pond 7	EFFLUENT (ES-2) Pond 8
Parameter/ Constituent	Units	Sampling Frequency	Sample Type	Sampling Frequency
pH	units	Weekly	Weekly	Weekly
Biochemical Oxygen Demand, 5-Day (BOD ₅)	mg/L	Quarterly	Quarterly	Quarterly
Total Suspended Solids (TSS)	mg/L	Quarterly	Quarterly	Quarterly
Settleable Solids	mL/L ^[2]	Not Required	Weekly	Weekly
Total Nitrogen ^[1]	mg/L	Quarterly	Quarterly	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	Quarterly	Quarterly	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Quarterly	Quarterly
Ammonia (as N)	mg/L	Quarterly	Quarterly	Quarterly
Total Dissolved Solids	mg/L	Quarterly	Semiannually	Semiannually
Chloride	mg/L	Quarterly	Semiannually	Semiannually
Sodium	mg/L	Quarterly	Semiannually	Semiannually
Sulfate	mg/L	Quarterly	Semiannually	Semiannually
Boron	mg/L	Not Required	Semiannually	Semiannually
Carbonate	mg/L	Not Required	Semiannually	Semiannually
Bicarbonate	mg/L	Not Required	Semiannually	Semiannually
Calcium	mg/L	Not Required	Semiannually	Semiannually
Potassium	mg/L	Not Required	Semiannually	Semiannually

		INFLUENT (IS-1)	EFFLUENT (ES-1) Pond 7	EFFLUENT (ES-2) Pond 8
Parameter/ Constituent	Units	Sampling Frequency	Sample Type	Sampling Frequency
Magnesium	mg/L	Not Required	Semiannually	Semiannually

[1] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

[2] mL/L denotes milliliters per liter

IV. POND SYSTEM MONITORING

All wastewater treatment ponds (Ponds 1 to 8) must be monitored as specified in Table 6. Sampling for pH and dissolved oxygen must be a grab or continuous permanent meter sample (with field instrument) taken from 1 foot below pond surface.

Observations do not need to be reported in the monitoring reports unless a violation, significant change, or treatment issue is observed. Photos of the pond(s) verifying the observations must be collected annually and included in the annual report, with the date and location of the photo clearly marked. Observations must be noted in a logbook or database and made available to the Central Coast Water Board upon request. Any problems must be promptly corrected and recorded.

Table 6. Wastewater Treatment/Storage/Disposal Pond Monitoring

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency
Freeboard	0.1 feet	Measured	Weekly
pH	pH Units	Grab/Continuous	Weekly
Dissolved Oxygen	mg/L	Grab	Monthly
Sludge Depth	0.1 feet	Measured	Annually
Containment Berm condition	Not Applicable	Observation	Monthly
Color	Not applicable	Observation	Monthly
Vegetation in and surrounding ponds	Not Applicable	Observation	Monthly

V. WASTEWATER DISPOSAL MONITORING OF INFILTRATION BASINS AND EMERGENCY DISPOSAL AREAS

Gonzales must monitor all wastewater disposal areas (rapid infiltration basins A, B, C, D, and the emergency disposal fields) when wastewater is applied. Inspections (observations) must be conducted as described in Table 7. Notations must be made in a bound logbook and problems must be promptly corrected and recorded. A log of these inspections must be maintained onsite and made available to Central Coast Water Board upon inspection. Observations do not need to be reported in the monitoring reports unless a violation of permit conditions is observed. If violations are observed, planned, and implemented mitigation measures to address the violations must be reported.

Emergency disposal areas can only be used when approved by the Central Coast Water Board and must be monitored and reported only when in use. When the emergency disposal areas are in use, Gonzales must visually inspect Basin D and disposal fields 1 and 2 to monitor for leaks, erosion and ponding.

Gonzales must evaluate and summarize wastewater disposal application rates, loading rates (pounds/acre/day), violations found during the inspections, with each monitoring report.

If wastewater is not discharged to land during a reporting period, the monitoring report must still be submitted and indicate that there was no discharge during the reporting period.

Table 7. Wastewater Disposal Monitoring at Infiltration Basins and Disposal Fields

Constituent	Units	Sample Type	Monitoring Frequency
Local Precipitation ^[1]	Inches/day	Weather Station ^[2]	Each precipitation event
Acreage Applied ^[3]	Acres	Measured	Daily
Application Rate	Gallons per day	Metered/Estimated	Daily
Average Monthly BOD ₅ Applied ^[4] ^[5]	lbs/acre/day	Calculated	Monthly

Constituent	Units	Sample Type	Monitoring Frequency
Maximum Daily BOD ₅ Applied ^[4] ^[5]	lbs/acre/day	Calculated	Daily
Average Nitrogen Applied ^[4] ^[5]	lbs/acre/day	Calculated	Monthly
Soil Erosion Evidence	Not Applicable	Observation	Monthly
Containment Berm Condition	Not Applicable	Observation	Monthly
Nuisance Odors/Vectors	Not Applicable	Observation	Monthly
Discharge Offsite	Not Applicable	Observation	Monthly

[1] A precipitation event is one producing precipitation of ½ inch or more.

[2] Gonzales must have a rain gauge or use a NOAA or USGS rain station, such as <http://scacis.rcc-acis.org/>.

[3] Acreage applied denotes the acreage of the rapid infiltration bed to which wastewater is applied.

[4] The total nitrogen, BOD₅ applied loading rates must be calculated from wastewater flow volumes, applied acreage, and concentrations reported in effluent analytical testing as follows:

Total Nitrogen/BOD Applied (pounds/acre/ day) =

$$\frac{X \text{ [mg/L]} \times Q \text{ [million gallons per day]} \times 8.34 \text{ [(conversion from mg/L to pounds/million gallons per day)]}}{\text{Acreage Applied [acres]}}$$

Where X = Total nitrogen or BOD₅ concentration

Where Q = Application Rate (often effluent flow rate)

[5] Frequencies of analytical testing are defined in the influent and effluent monitoring tables.

VI. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

Gonzales must report the handling and disposal of all sludge/biosolids generated at the Wastewater System. Records must include the date removed from the Wastewater System, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

Gonzales must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements

specified by the receiving party, including a regulated landfill and/or regulated composting facility.

If sludge/biosolids are not removed during the year, Gonzales must explain the absence of this monitoring in the annual report.

VII. GROUNDWATER MONITORING

Gonzales must implement a groundwater monitoring program to demonstrate compliance with the groundwater limitations in the NOA and water quality objectives specified in the Basin Plan. Groundwater monitoring reports, workplans, and other technical reports that interpret groundwater data must be prepared and stamped by a California licensed civil engineer or professional geologist. Prior to sampling, depth to groundwater must be measured and groundwater elevations⁵ must be calculated. The monitoring wells must be purged of at least three well volumes and until measurements of the following parameters have stabilized (i.e., are reproducible within 10 percent): pH, temperature, dissolved oxygen, electrical conductivity, and turbidity. No-purge, low-flow, or other sampling techniques are acceptable only if they are approved in advance by the Central Coast Water Board and described in an approved sampling and analysis plan. Once the groundwater level in each of the wells has recovered sufficiently to ensure the collection of representative groundwater samples, a qualified individual (e.g., consultant, technician) trained in using proper sampling methods must recover samples using approved USEPA methods. Laboratories analyzing groundwater samples must be accredited by the State Water Board Environmental Laboratory Accreditation Program, in accordance with California Water Code section 13176, and must include quality assurance/quality control data with their reports.

Gonzales must provide monitoring well field sheets and report monitoring data, as described in Table 8, with each monitoring report.

Table 8. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Elevation ^[1]	0.01 ft msl	Calculated	Semiannually
Depth to Groundwater ^[1]	0.01 ft bgs	Measurement	Semiannually
Gradient	feet/feet	Calculated	Semiannually
Groundwater Flow Direction ^[4]	degrees	Calculated	Semiannually

⁵ The locations and top-of-casing elevations for the existing groundwater monitoring wells must be surveyed by a licensed land surveyor if not already completed at the time of installation.

Constituent	Units	Sample Type	Sampling Frequency
Nitrate (as N)	mg/L	Grab	Semiannually
Ammonia (as N) ^[5]	mg/L	Grab	Semiannually
Total Dissolved Solids	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually
pH	pH Units	Metered	Semiannually
Dissolved Oxygen	mg/L	Metered	Semiannually
Electrical Conductivity	µS/cm ^[2]	Metered	Semiannually
Oxidation Reduction Potential	mV ^[3]	Metered	Semiannually
Temperature	degrees Celsius	Metered	Semiannually

[1] ft msl denotes feet above mean sea level and ft bgs denotes feet below ground surface.

[2] µS/cm denotes microsiemens per centimeter.

[3] mV denotes millivolts.

[4] Calculations must be prepared by, or under the responsible charge of, a California licensed professional.

[5] If ammonia is non-detect for one year in all monitoring wells, no additional groundwater monitoring is required.

VIII. REPORTING REQUIREMENTS

A. QUARTERLY AND ANNUAL MONITORING REPORTS

Quarterly and annual monitoring reports are due as described in Table 9.

Table 9. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	May 1
Second Quarter Monitoring Report	April 1 to June 30	August 1
Third Quarter Monitoring Report	July 1 to September 30	November 1
Fourth Quarter Monitoring Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

1. Quarterly Monitoring Reporting – At a minimum, the quarterly reports must include:

- i. Results of all required monitoring in tabular format.
- ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
- iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. **Gonzales must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.
- iv. Copies of laboratory analytical report(s) and chain of custody form(s).
- v. An updated hydrogeologic conceptual site model with the groundwater monitoring reporting requirements based on new information generated from the monitoring well boring logs, groundwater elevation data, water quality data, etc.
- vi. Copies of groundwater monitoring well field sheets with purge methods and data.

- 2. Annual Reporting** – Gonzales must submit annual reports in compliance with Standard Provisions 2013⁶ by March 1, (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by Central Coast Water Board.

All annual reports must be formatted and completed as specified in the annual report template found at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

Gonzales must include the following operator information with the annual report:

- i. The name, grade, and license number for the wastewater operator responsible for the operation, maintenance, and system monitoring, and all operator personnel.
- ii. A copy of the current Office of Operator Certification Wastewater Treatment Plant Classification Form.

- 3. State Water Board Volumetric Annual Reporting** –Gonzales must electronically certify and submit a summary of the monthly influent and effluent flow volume by April 30th of each calendar year via the State Water Board's Internet GeoTracker database.⁷

The following information is required:

- i. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e. total monthly influent volume).
- ii. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.
- iii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website⁸.

⁶ See Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

⁷ See: <https://geotracker.waterboards.ca.gov/>

⁸ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

B. NON-COMPLIANCE REPORTING:

Gonzales must notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass, or overflow, the conditionally accepted, and wastewater containment failure, pursuant to General Permit section VI.C.2.

C. ELECTRONIC GEOTRACKER SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permiiting/docs/transmittal_sheet.pdf

Gonzales must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker^{9,10} database consistent with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System-specific global identification number **WDR100032021** at:

<https://geotracker.waterboards.ca.gov/esi/login>

For general questions, please contact the GeoTracker Help Desk at:

Geotracker@waterboards.ca.gov.

Table 10 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

⁹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

¹⁰ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Table 10. GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your California ELAP-accredited laboratory staff to upload, all EDF laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.

Electronic Submittal	Description of Action	Action	Frequency
Field Points, Location Data (Geo XY) ^[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.” These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.
Elevation Data (Geo Z) ^[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Wastewater System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. Gonzales must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

TECHNICAL REPORTS

The technical reports are due as described in Table 11. Gonzales’ Groundwater Monitoring Plan and Climate Change Adaptation plans are currently past due.

Gonzales submitted the Time Schedule Compliance plan on April 11, 2024 and Operations and Maintenance Manual on April 10, 2024.

Table 11. Technical Report Submittal Due Dates

Report	Report Due Date
Groundwater Monitoring Plan	October 11, 2024
Climate Change Adaptation Plan	April 11, 2025
Capital Improvement Plan	April 11, 2026

- 1. Groundwater Monitoring Plan** – Submit a groundwater monitoring workplan and preliminary hydrogeologic conceptual site model for Central Coast Water Board approval. The workplan must propose the installation of additional, shallow groundwater monitoring wells to establish groundwater gradient, groundwater flow velocity and direction, and evaluate groundwater quality influenced by the wastewater disposal. The number and location of the proposed groundwater monitoring well network must be on a scale sufficient to determine potential impacts and be sufficiently representative of groundwater conditions upgradient and downgradient of the permitted disposal/dispersal area. The groundwater monitoring wells should not be installed prior to Central Coast Water Board approval of the groundwater monitoring workplan and preliminary hydrogeologic conceptual site model.

The groundwater monitoring wells must be installed within first encountered groundwater and in accordance with California Department of Water Resources Bulletin No. 74-81 and Supplement No. 74-90, California Water Code sections 13710 through 13755, and any local permitting requirements. The locations and top-of-casing elevations for the newly installed monitoring wells must be surveyed by a licensed land surveyor. Gonzales must install¹¹ the Central Coast Water Board approved groundwater monitoring well network within **90 days** of receiving Central Coast Water Board approval.

- 2. Climate Change Adaptation** –The Climate Change Adaptation Plan must, at a minimum, include the following components:

- i. **Hazards and Vulnerabilities** – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using up-to-date tools, data, and guidance from the State of California (e.g., Cal-Adapt¹², Sea-Level Rise Guidance from

¹¹ Well installation must be supervised by a California licensed Civil Engineer or Professional Geologist.

¹² Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-

Ocean Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California Climate Assessment Regional Reports), assess the Wastewater System's vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities.

- a. Sea Level Rise – Saltwater intrusion, flooding and inundation, and increased coastal erosion.
- b. Precipitation Pattern Changes.
 - I. Drought – Decreased influent quantity and quality.
 - II. Peak Events – Flooding and increased influent quantity.
- c. Temperature fluctuations and extremes.
- d. Increased wildfires.
- e. Increased power outages.
- ii. Resiliency Actions – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.
- iii. Adaptation Strategy – For Wastewater Systems with design flows over 1,000,000 gallons per day, develop and implement a strategy to complete resiliency actions, at a minimum encompassing the following:
 - a. Prioritization – Prioritized resiliency actions based on risks to water quality, but also accounting for costs and benefits.
 - b. Schedule and Milestones – Timeframes to complete prioritized resiliency actions and/or climate change hazard triggers to inform when Gonzales must implement actions. Milestones to complete critical steps for prioritized resiliency actions, designed to demonstrate measurable progress at a steady, or accelerated, completion pace over the established timeframes.
 - c. Financial Planning – Projected costs necessary to implement and sustain resiliency actions and strategy to procure funds.
- iv. Recycled Water Feasibility Plan – Dischargers with Wastewater System design flows over 1,000,000 gallons per day must include a recycled water feasibility plan.

level rise, wildfires, and drought. The Governor's Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

The recycled water feasibility plan will assess the viability of using the Wastewater System's treated wastewater effluent for beneficial reuse including, but not limited to the following:

- a. Beneficial Reuse Options – Identification of reuse opportunities for Gonzales' treated effluent that would achieve the highest beneficial impact and best uses possible of non-potable recycled water. Include assessment of the following non-potable recycled water benefits identified in the State Water Board Recycled Water Policy: providing safe alternatives to fresh water or potable water for approved uses; supporting sustainable groundwater and surface water uses with the intent of substituting use of treated effluent for use of fresh water or potable water; and diversifying community water supplies and mitigating for the impacts of climate change.¹³
- b. Viable Users – Identification and viability evaluation of all potential users of the Wastewater System's treated effluent associated with identified beneficial reuse options. Gonzales must demonstrate it engaged potential water purveyors and customers about the viability of reusing the Wastewater System's treated effluent.
- c. Infrastructure Upgrades – Assessment of infrastructure needs to produce non-potable recycled water for identified beneficial reuses and convey non-potable recycled water to beneficial reuse locations.
- d. Fiscal Analysis – Cost estimates for identified reuse options, at a minimum including project development, construction, and long-term maintenance and lifecycle costs. This analysis shall also include identification and evaluation of the following: 1) funding options, including at a minimum, revenues from recycled water sales, grant and loan funding opportunities, and financing from other benefiting parties and 2) funding limitations.
- e. Schedule and Milestones for Next Steps – Timeframes to assess the feasibility of identified beneficial reuse options and to identify proposed beneficial reuse options based on prioritized water recycling and reuse opportunities, feasibility assessments, and other factors identified by Gonzales.
- f. Identification of implementation schedule and adequate funding to implement the plan.

3. Capital Improvements Plan – Gonzales must prepare and submit a Capital Improvement Plan. The Capital Improvement Plan must contain all significant capital projects, equipment purchases, and major studies for operating the

¹³ [Water Quality Control Policy for Recycled Water](#), State Water Board, adopted December 11, 2018, page 1.

Wastewater System. In general, the Capital Improvement Plan will include the following elements:

- i. Estimated overall cost of each project
- ii. Estimated operational & maintenance cost for each project
- iii. Estimated project timelines
- iv. Funding sources
- v. Project prioritization

IX. LEGAL REQUIREMENTS


The Central Coast Water Board's requirements that Gonzales submits the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Gonzales to enforcement action pursuant to section 13268 of the California Water Code. Pursuant to [section 13268 of the Water Code](#), a violation of a request made pursuant to section 13267 may subject Gonzales to civil liability assessment of up to \$1,000 per day in which the violation occurs.

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Gonzales is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

Gonzales must implement the above revised monitoring program on August 1, 2025. The Central Coast Water Board may rescind or modify this monitoring and reporting program at any time. Gonzales must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered By:



for Ryan E. Lodge
Executive Officer

R:\RB3\Shared\WDR\WDR Facilities\Monterey Co\Gonzales, City of
WWTP\1_Permit\Existing Permit\Revised Big Order Aug 2025\
Aug2025_GonzalesSecondRevisedNOA_MRP_0020.docx

Rev: 10/07/2022