
Central Coast Regional Water Quality Control Board

June 3, 2024

Sent Via Electronic Mail

Jeffrey Lindgren
Santa Barbara County
Jalama Beach County Park
123 E. Anapamu Second Floor
Santa Barbara, CA 93101
Email: jlindgren@countyofsb.org

Dear Jeffrey Lindgren,

**NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER WQ 2014-0153-DWQ,
GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC
WASTEWATER TREATMENT SYSTEMS**

**JALAMA BEACH COUNTY PARK, 9999 JALAMA ROAD, LOMPOC, CA 93436,
SANTA BARBARA COUNTY:**

- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM R3-2024-0007**
- **TERMINATION OF ENROLLMENT IN STATE WATER RESOURCES CONTROL BOARD WATER QUALITY ORDER NO. 97-10-DWQ**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the Form 200, Report of Waste Discharge (received on January 3, 2023), and available documents associated with the domestic wastewater system¹ at Jalama Beach County Park owned by Santa Barbara County. The wastewater system is currently regulated pursuant to State Water Resources Control Board Water Quality Order 97-10-DWQ and was significantly upgraded in 2023. On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order 97-10-DWQ.

¹ The General Permit defines the term “wastewater system”. It shall mean the collection system, treatment equipment, pumping stations, treatment ponds, clarifiers, sand/media filters, disinfection systems, recycled water systems (including distribution systems), storage ponds, land application areas, and other systems associated with the collection, treatment, storage, and disposal of wastewater.

This letter serves as a notice of applicability for Santa Barbara County's enrollment in the General Permit for the discharge of wastewater from Jalama Beach County Park.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

Santa Barbara County must comply with the following:

1. General Permit

Santa Barbara County must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. Monitoring and Reporting Program

Santa Barbara County must comply with the requirements of Monitoring and Reporting Program R3-2024-0007, enclosed with this letter (Attachment 3). Santa Barbara County must start implementing the monitoring on July 1, 2024. Santa Barbara County must comply with the previous monitoring and reporting program until July 1, 2024. Your first semiannual report is due on August 1, 2024.

- 2.1. Monitoring reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page:

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/wdr-transmittal-sheet.pdf

- 2.2. The transmittal sheet describes who can sign reports. To authorize someone to sign and submit reports on your behalf, you must submit the "designation of duly authorized representatives form" found at the link below to the Central Coast Water Board.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/

- 2.3. Santa Barbara County must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{2,3} database with applicable Electronic Submittal of

² Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

³ Additional information available at: <http://geotracker.waterboards.ca.gov/>

Information (ESI) requirements under the wastewater system-specific global identification number WDR100035713 at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

- 2.4. The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

3. Installation and Operations Report

- 3.1. Wastewater system installations must be inspected during construction and certified by a qualified professional (e.g., licensed engineer, environmental health specialist). The qualified professional must certify to the Central Coast Water Board that the wastewater systems are installed per design. The qualified professional must inspect and conduct final testing of the wastewater systems in operation. Santa Barbara County must provide certification of correct installation and operation to the Central Coast Water Board within **45-days of start-up and with the first annual report**.
- 3.2. As-built drawings must be submitted to the Central Coast Water Board **within 45-days of start-up and with the first annual report** if the wastewater system installation varies from the design plans in any way.

4. Fees

Santa Barbara County paid an annual fee on January 4, 2024 for coverage in the existing permit, Order 97-10-DWQ. This payment covers permit fees for the 2023-2024 fiscal year.

- 4.1. Santa Barbara County must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee program and cover the state fiscal year of July 1 through June 30. Your annual fee is currently \$10,043. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 2C and is receiving a 50% fee reduction for domestic discharges less than 50,000 gallons per day.
- 4.2. A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

5. Notification

The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on August 22-23, 2024. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

6. Future Discharge Modifications

Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.

7. Responsible Party

Santa Barbara County is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects Santa Barbara County to enforcement action and termination of enrollment under this General Permit.

8. Change In Ownership

In the event of any change in control or ownership of the property, Santa Barbara County must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated.

9. Termination of Permit

Enrollment in the existing permit, Order 97-10-DWQ is terminated, except for enforcement purposes. Santa Barbara County is responsible for compliance with Order 97-10-DWQ prior to the date of this letter.

If you have any questions, please contact **Cecile Blancarte at (805) 542-4782 or by email at Cecile.Blancarte@Waterboards.ca.gov**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

Jennifer Epp  Digitally signed by Jennifer Epp
Date: 2024.05.31 17:11:10
-07'00'

for Ryan E. Lodge
Executive Officer

Attachments:

Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program R3-2024-0007

cc:

Ryan Heath, rheath@countyofsb.org
Guadalupe Puerta, gpuerta@countyofsb.org
Trevor Miller, trmiller@countyofsb.org
Jill Van Wie, JVanWie@countyofsb.org
Todd Robinson, todd@coast-inc.com
Mark Braun, mark@braunassociatesinc.com
Jason Johnston, Jason.Johnston@sbcphd.org
Kylie Brown, brownk@countyofsb.org
Cecile Blancarte, cecile.blancarte@waterboards.ca.gov
Jesse Woodard, Jesse.Woodard@waterboards.ca.gov
Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov
WDR Program, RB3-WDR@Waterboards.ca.gov GeoTracker

ECM/CIWQS = CW-233409

GeoTracker = GT- WDR100035713

Rev 3/20/24

Subject Name = Jalama Beach County Park Wastewater Permit

r:\rb3\shared\wdr\wdr facilities\santa barbara co\jalama beach\1_permit\existing
permit\jalama-noa 0153_june 2024_final.docx

ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC
REQUIREMENTS AND LIMITATIONS

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by Santa Barbara County to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	Jalama Beach County Park
Facility Address	9999 Jalama Road, Lompoc, CA 93436
Parcel Numbers	083-510-001
Latitude/Longitude	34.510920 / -120.500970
Owner of Facility	Santa Barbara County
Legally Responsible Official of Owner	Jeffrey Lindgren
Owner Mailing Address	123 E. Anapamu Second Floor, Santa Barbara, CA 93101
Billing Address	123 E. Anapamu Second Floor, Santa Barbara, CA 93101
Permitted Design Flow, Max Average Monthly (gallons per day, gpd)	5,886 See Table 2 for Maximum Average Monthly Permitted Design Flows for each disposal field.
Maximum Park Overnight Occupancy	290 People
Operators	Santa Barbara County
Waste type and Service Area	Domestic wastewater from five restrooms, seven cabins with bathroom and kitchen area, one shower facility, a restaurant, a workshop, one restaurant mobile home and four camp host mobile homes on a 23.57-acre area.
Threat to Water Quality	2
Complexity	C
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR
Reclamation Included	No
EPA Approved Pretreatment Program	No

2. NAVIGABLE, GROUNDWATER, AND OCEAN WATERS SUSCEPTIBLE TO WASTEWATER POLLUTION

2.1. Waters of the United States

Jalama Creek is a water of the United States. It is navigable and is the nearest surface water located approximately 200 to 225 feet north of the restaurant and playground leachfield. Jalama Creek empties out into the Pacific Ocean approximately 500 feet northwest of the restaurant leachfield. There is a chloride and sodium Total Maximum Daily Load for this surface water body as presented here:

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/tmdl/docs/jalama_creek/

2.2. Groundwater

Jalama Beach does not overlie a groundwater basin as defined by the California Department of Water Resources Bulletin 118 or the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).⁴ Past subsurface investigations around the Jalama Beach County Park have encountered groundwater at approximately 12 feet below ground surface at the playground, Area A, and Area B leachfields. The encountered water is presumed to be ocean water underneath the backshore.

2.3. Pacific Ocean

The Pacific Ocean is west of Jalama Beach County Park. The ocean's high tide line is approximately 150 feet west of the septic tanks that serve the restaurant, the northwest small restroom, and the southwest large restroom. It is approximately 200 feet west of leachfields Area A and Area B. The septic tanks and leachfields are within the area called the backshore.

3. WASTEWATER SYSTEM OPERATION SUMMARY

The wastewater system is composed of sanitary sewer conveyance piping, 11 septic tanks, eight wastewater disposal field areas, an RV dump station, a lift station, one sand trap, and two grease traps. A summary of the wastewater system is included in Table 2 below. A facility site map and dispersal system layout are shown in Attachment 2.

Table 2. Treatment Tank and Disposal Area Maximum Design Limits

Treatment Tank Capacity and Maximum Average	Septic Tank Name(s) <i>Presented are the domestic wastewater sources to the</i>	Tank Capacity (gallons)	Maximum Average Monthly
--	--	--------------------------------	--------------------------------

⁴ Current edition, June 2019 is available at:

https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete_webaccess.pdf

Monthly Design Flow	<i>septic tank, the existence of historic holding tanks, and manholes with storage volume presented when known.</i>		Design Flow (gpd) ^[1]
	ST1: • Workshop Restroom (RR) • Park Ranger Mobile Home PR1	1,500	500
	ST2: • Upper RR • Playground RR • Park Ranger PR3 • Park Ranger PR4	5000	1,667
	ST3: • Day Use RR w/Historic Holding Tank (~780 gallons). Two manholes (~720 gallons) located after septic tank and prior to pump station.	5,000	1,667
	ST4: • RV Dump Station	2 x 4,500 = 9,000	3,000
	ST5: • Gate House RR	5,000	1,667
	ST6: • Point RR w/Historic Holding Tank (volume unknown). One manhole (~450 gallons) located after septic tank and prior to pump station.	5,000	1,667
	ST7: • Park Ranger PR2	1,000	333
	ST8: • Restaurant/Mobile Home (MH)	2,000	665
	ST9: • Upper RR	1,200	400
	ST10:	5,000	1,667

	Shower Station		
	GS1: Restaurant Grease Trap	50	Not applicable
	GS2: Wash Station Grease Trap	50	Not applicable
Disposal Field Capacity and Maximum Design Flow	Leachfield Name and Septic Tanks Disposing into Leachfield	Maximum Monthly Average Flow (gpd) ^{[2][3]}	
	Playground Leachfield - ST1 - ST2 - ST9	800	
	Area A/B Leachfield - ST3 - ST4 - ST5 - ST6	3,150	
	Area C/D Leachfield - ST3 - ST4 - ST5 - ST6	800	
	Restaurant/MH Leachfield - ST8 - GS1	85.5	
	Park Ranger PR2 Leachfield ST7	150	
	Shower Station Infiltrators - ST10 - GS-2	900	
	Grease Traps	Restaurant and wash station grease waste is collected in a 50-gallon grease trap. Grease trap effluent flows into the serving septic tank. The grease traps are pumped clean and disposed offsite regularly.	
Biosolids/Sludge Production and Handling	Septic tank sludge is removed by a certified sewage hauler and disposed of at wastewater treatment plant classified to receive biosolids and sludge.		

Table Notes:

1. Treatment tank capacity is based on 3-day hydraulic retention time and does not include any time held in the historic holding tank or manholes, if present.
2. The disposal field maximum monthly average flow is based on use of 100% leachfield disposal capacity with another 100% on reserve to allow resting. Each disposal field capacity is significantly lower than the sum of septic tank treatment capacities associated with it and therefore it is the limiting factor in the treatment system.
3. Monthly average flow to be calculated by the total discharge to the disposal area by volume during a calendar month divided by the number of days in the month that the discharge to the disposal area occurred.

4. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

Santa Barbara County must operate the facility in accordance with the General Permit and this notice of applicability.⁵ Santa Barbara County must operate the wastewater system to comply with the effluent limits below.

4.1. Effluent Limits

Santa Barbara County must comply with the site-specific limits listed in Table 3.

Table 3. Wastewater System Effluent Limits

Constituent/ Parameter	Unit	Limit	Point of Compliance ^[1]
Maximum Daily Overnight Occupancy	People	290	Daily Reservation Records
Disposal Field Flow	gpd ²	Must not exceed Disposal Field Maximum Monthly Average Flows as presented in Table 2.	Effluent (ES-1 through ES-5)
Formaldehyde	µg/L ³	Daily Max = 100 ⁴	Effluent

Table Notes:

1. Refer to monitoring and reporting program for sampling locations.
2. Denotes gallons per day
3. Denotes micrograms per liter.
4. Division of Drinking Water California Notification Level. Banned chemical and unlawful per Senate Bill SB317.
https://leginfo.ca.gov/faces/billTextClient.xhtml?bill_id=201920200SB317

5. GROUNDWATER LIMITS

⁵ General Permit section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Permit, effluent limits in the General Permit, and compliance with site-specific limits set forth in this notice of applicability.

As stated in the General Permit, Section C, the discharge (effluent) must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. The facility does not discharge into a designated groundwater basin, so there are no groundwater basin-specific objectives. Santa Barbara County must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the Basin Plan. These objectives include:

- 5.1. General objectives for taste and odors and radioactivity for all groundwaters.
- 5.2. Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15.

The Central Coast Water Board does not require first-encountered groundwater monitoring wells at this time. If effluent water quality indicates exceedances of the Basin Plan groundwater objectives, the Central Coast Water Board may require installation of groundwater monitoring wells in the future.

6. SETBACK REQUIREMENTS

General Permit Section B.1.I Table 3 includes setback requirements that are not met at the site. The General Permit states, "Noncomplying facilities may be permitted, if nuisance conditions do not result from the noncompliance. Expansion of a noncomplying wastewater system shall trigger further evaluation of the setbacks." Therefore, Santa Barbara County must not expand (or add additional connections) without notifying the Central Coast Water Board and receiving Central Coast Water Board approval considering an evaluation of the setbacks.

7. RECREATIONAL VEHICLE SIGNAGE REQUIREMENTS

To comply with Senate Bill 317, Section 25210.2 d, Santa Barbara County, as an owner or operator of a recreational vehicle park or campground that utilizes a septic system, onsite wastewater treatment system, or subsurface disposal system to dispose of recreational vehicle wastewater must post in a conspicuous location a notice stating the following:

"The State of California prohibits the use of products in RV holding tanks, including deodorizers, that contain bronopol, dowicil, formalin, formaldehyde, glutaraldehyde, paraformaldehyde, para-dichlorobenzene, benzene, toluene, xylene, ethylene glycol, 1,1,1-trichloroethane, trichloroethylene, and or perchloroethylene. These chemicals can inhibit biological activity in onsite wastewater treatment systems and threaten groundwater and drinking water wells and are strictly forbidden. Please use bacteria- or enzyme-based products."

ATTACHMENT 2 FIGURES

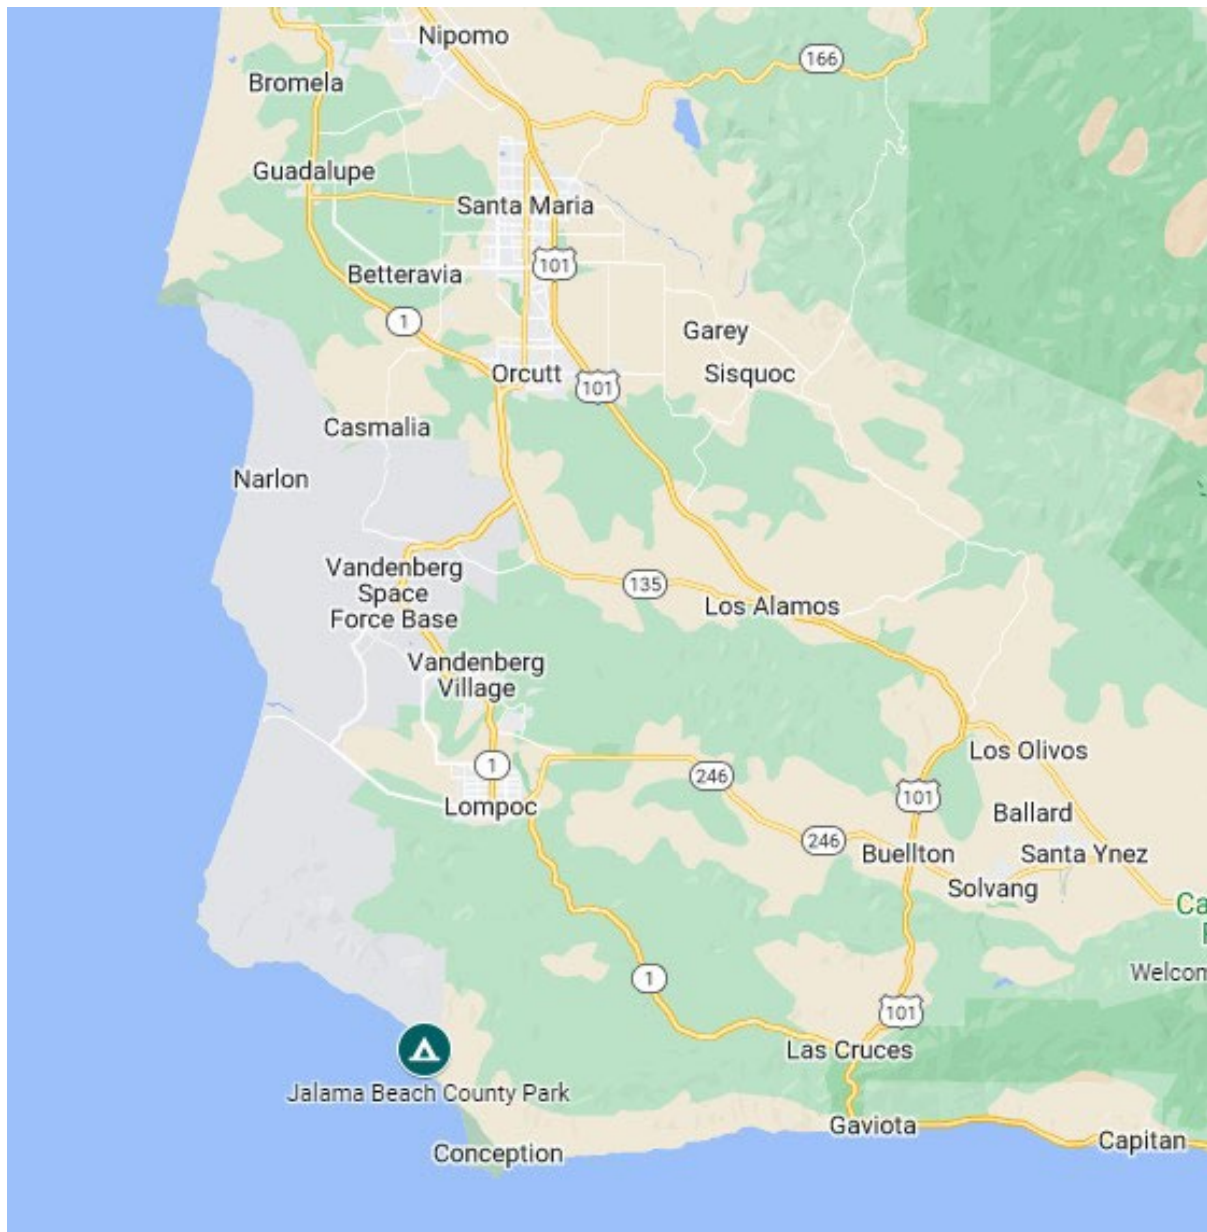


Figure 1. Site Location Map

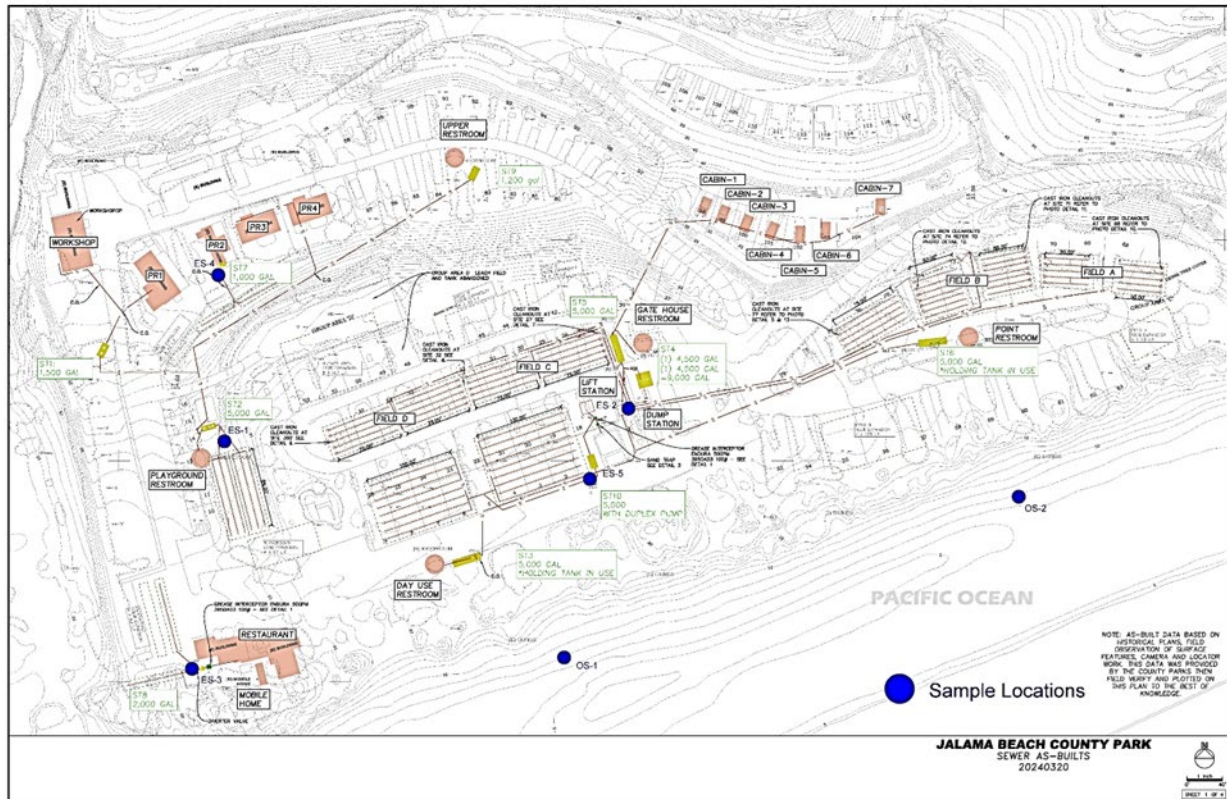


Figure Note: Use of the leachfield 100% replacement areas depicted in Figure 2 must be reviewed and approved by the Central Coast Water Board as they may not meet required setbacks and other design standards and may require the installation of supplemental treatment prior to use of those areas for disposal.

Figure 2. Site Map with Sample Locations

ATTACHMENT 3
MONITORING AND REPORTING PROGRAM R3-2024-0007
JUNE 3, 2024
FOR
JALAMA BEACH COUNTY PARK
LOMPOC, SANTA BARBARA COUNTY

This monitoring and reporting program describes requirements for monitoring a wastewater system for Santa Barbara County's Jalama Beach County Park located at 9999 Jalama Road in Lompoc, California.

Santa Barbara County owns and operates the wastewater system that is subject to the notice of applicability dated June 3, 2024, issued by the Central Coast Regional Water Quality Control Board (Central Coast Water Board) for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

- 1.1. All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be approved by the Central Coast Water Board. Unless otherwise specified below, sampling must be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

- 1.2. Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

- 1.2.1. The user is trained in proper use and maintenance of the instruments;

1.2.2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;

1.2.3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and

1.2.4. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

2.1. Representative samples of the water supply must be collected and analyzed as shown in Table 2 from the production wells Well 1 (CA4200846-001) and Well 2 (CA4200846-002) prior to any disinfection.

2.2. In lieu of the required water supply sampling, Santa Barbara County may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Santa Barbara County must report the results of any constituent monitored more frequently than is required by this monitoring and reporting program. Santa Barbara County must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units ^[1]	Type of Sample	Sampling Frequency	Reporting Frequency
TDS	mg/L	Grab	Annually	Annually
Nitrate and Nitrite (as N)	mg/L	Grab	Annually	Annually
Chloride	mg/L	Grab	Annually	Annually
Sodium	mg/L	Grab	Annually	Annually
Sulfate	mg/L	Grab	Annually	Annually
Boron	mg/L	Grab	Annually	Annually

Table Note:

1. mg/L denotes milligrams per liter

3. MONITORING LOCATIONS

Monitoring location information, including nomenclature that must be used when reporting data to the GeoTracker database and in reports (described below), is shown in Table 3. The field point code and latitude and longitude of all monitoring locations,

except supply wells, must be loaded to GeoTracker once. (See Section 10, Electronic Submittal, below.)

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code (Sample ID)	Sample Description
Effluent Sample – 1	ES-1	PLAYGROUND LEACHFIELD – Total daily flow and representative grab sample from final septic tank baffled zone, before disposal to leach field.
Effluent Sample – 2	ES-2	LIFT STATION - Total daily flow and representative grab sample from pump station tank, before disposal to leach field.
Effluent Sample – 3	ES-3	RESTAURANT - Total daily flow and representative grab sample from final septic tank baffled zone, before disposal to leach field.
Effluent Sample – 4	ES-4	PARK RANGER 2 - Total daily flow from final septic tank baffled zone, before disposal to leach field.
Effluent Sample – 5	ES-5	SHOWERS – Total daily flow monitoring from final septic tank baffled zone and before disposal to leach field.
Water Supply Well -1	WSW-1 ^[1]	CA4200846-001 Representative sample from potable well serving the development
Water Supply Well -2	WSW-2 ^[1]	CA4200846-002 Representative sample from potable well serving the development
Ocean Sample	OS-1	Pacific Ocean sample collected in minimum 3-foot surf, at mid tide, in the area perpendicular to leach fields C and D.
Ocean Sample	OS-2	Pacific Ocean sample collected in minimum 3-foot surf, at mid tide, in the area perpendicular to leach fields A and B.

Table Note:

1. Water supply sample data should be included in the semiannual report but does not need to be uploaded to GeoTracker if the Central Coast Water Board approves submittal of a Well Identification Number pursuant to the Water Supply Monitoring section above.

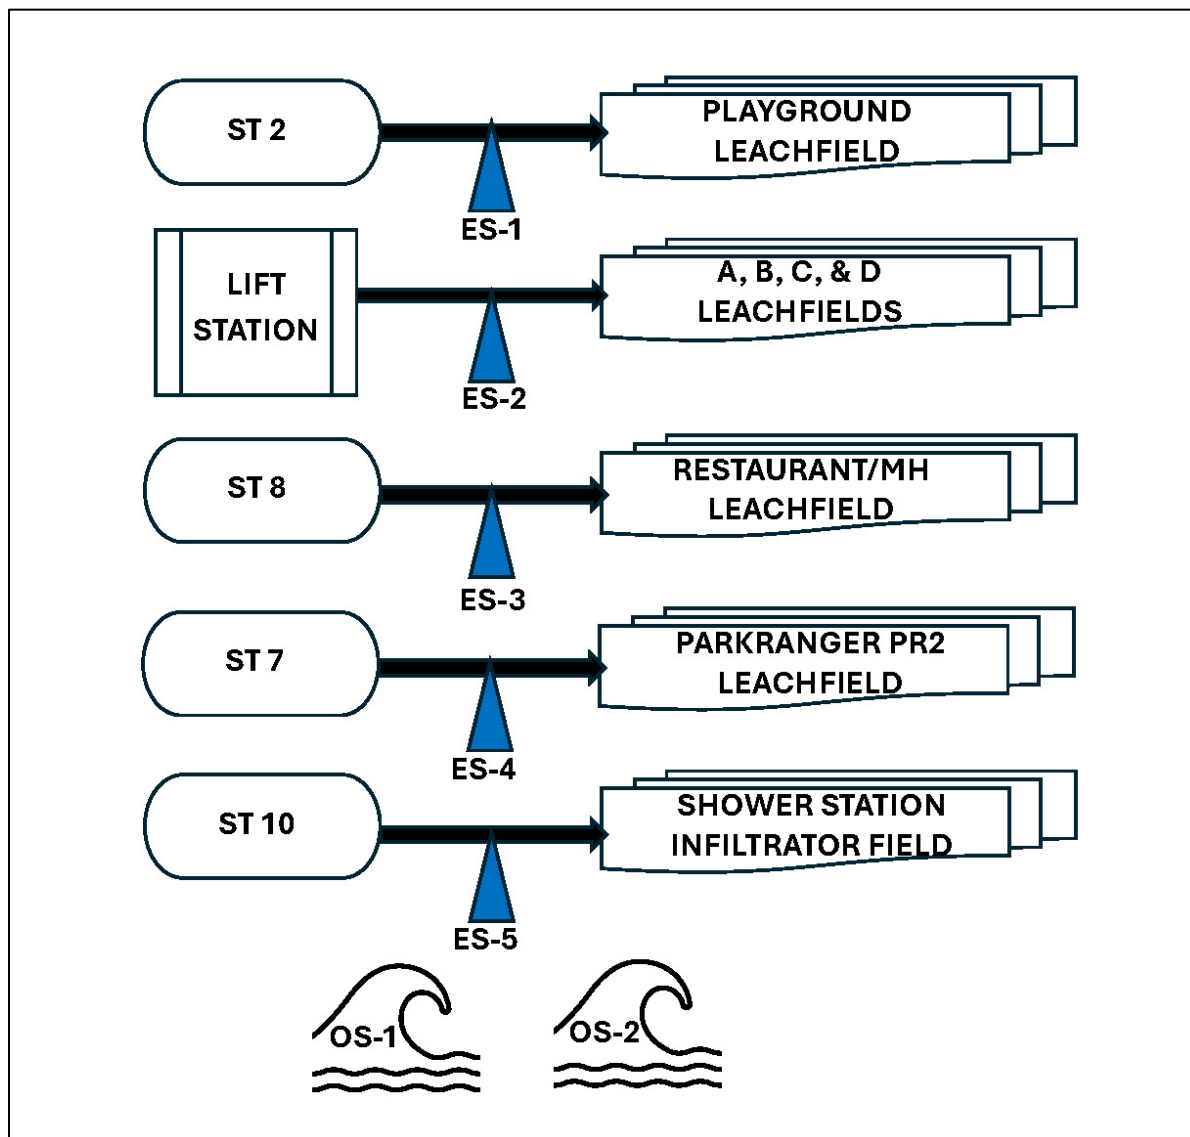


Figure 1. Monitoring Location Diagram

4. WASTEWATER SYSTEM MONITORING

4.1. Flow Monitoring

4.1.1. Santa Barbara County must monitor and report flow, as described in Table 4, with each monitoring report. Flow is monitored at monitoring locations ES-1, ES-2, ES-3, ES-4 and ES-5 after septic tank screening.

Table 4. Flow Monitoring at ES-1, ES-2, ES-3, ES-4, and ES-5

Parameter	Units	Sample Type	Sampling Frequency
Daily Flow	Gallons per day	ES-1 Calculated ES-2 Metered ES-3 Metered ES-4 Metered ES-5 Metered	Daily
Maximum Daily Flow	Gallons per day	Metered	Monthly
Average Daily Flow ^[1]	Gallons per day	Calculated	Monthly
Operating Capacity ^[2] (Percent of Monthly permitted flows)	%	Calculated	Monthly

Table Notes:

1. Average flow is based on the sum of the daily flow that occurs each day in a calendar month, divided by the number of days in the month.
2. The General Permit notice of applicability specifies each disposal field's maximum monthly average permitted flows in Table 2. In the monitoring reports, Santa Barbara County must evaluate and provide a comparison of monitored flows to the permitted flows.

4.2. Ocean and Effluent Constituent Monitoring

Representative samples of Jalama Beach County Park's effluent (treated wastewater) discharged to leachfields must be collected and analyzed as described in Table 5. All samples must be a single grab collection of the wastewater or ocean water.

Table 5. Effluent and Pacific Ocean Monitoring

Constituent	Units	EFFLUENT (ES-1, ES-2 AND ES-3) Sampling Frequency ^[3]	PACIFIC OCEAN (OS-1 AND OS-2) Sampling Frequency ^[3]
pH	pH units	Monthly	Not Required
Total Nitrogen	mg/L	Monthly	Monthly
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	Monthly	Monthly
Total Kjeldahl Nitrogen (as N)	mg/L	Monthly	Monthly
Zinc	mg/L	Monthly	Not Required
Ammonia (as N)	mg/L	Monthly	Monthly
Phenolic Compounds (non-chlorinated)	µg/L ^[1]	Monthly	Monthly
Formaldehyde	µg/L	Monthly	Monthly

Constituent	Units	EFFLUENT (ES-1, ES-2 AND ES-3) Sampling Frequency ^[3]	PACIFIC OCEAN (OS-1 AND OS-2) Sampling Frequency ^[3]
Sulfate	mg/L	Semiannually	Not Required
Total Coliform Organisms	MPN/ 100ml ^[2]	Not Required	Monthly
Fecal Coliform	MPN/ 100ml	Not Required	Monthly

Table Notes:

1. µg/L denotes micrograms per liter
2. MPN/100 mL denotes most probable number per 100 mL sample.
3. Monthly sampling must take place for a minimum of one year to ascertain potential wastewater impacts to ocean waters. Santa Barbara County may request a reduction in monitoring frequency after 12 months of data have been submitted.

5. SEPTIC TANK AND GREASE TRAP SLUDGE MONITORING

- 5.1. Septic tanks (ST1 through ST10) must be inspected at least as frequently as described in Table 6.

Table 6. Septic and Grease Sludge Measurements ^[1]

Parameter	Units	Measurement Type	Inspection/Reporting Frequency ^[2]
Sludge depth and scum thickness in each compartment of the tank	Feet	Gauge	Annual
Distance between bottom of scum layer and bottom of outlet device	Inches	Gauge	Annual
Distance between top of sludge layer and bottom of outlet device	Inches	Gauge	Annual
Effluent filter condition (if equipped, clean as needed)	NA	NA	Annual

Table Notes:

1. Septic tanks must be pumped when any one of the following conditions exists:
 - a. The combined thickness of sludge and scum exceeds one-third of the tank depth of the first compartment.
 - b. The scum layer is within 3 inches of the outlet device.
 - c. The sludge layer is within 8 inches of the outlet device.
2. Inspections of sludge and scum depth are not required if the tanks are pumped at least annually.

- 5.2. If a septic tank is pumped during the year, the pumping report must be submitted with the February semiannual report. Santa Barbara County must maintain a record of all septic tank service activities for a minimum of five years. At a minimum, the record must include the date, nature of service, service company name and license number.

6. SUBSURFACE DISPOSAL AREA INSPECTIONS

6.1. Santa Barbara County must walk the disposal areas to inspect all items in Table 7 at least weekly and after rain events. All pump controllers and automatic distribution valves must be inspected for proper operation as recommended by the manufacturer. Shallow-rooted plants are generally desirable, deep-rooted plants such as trees must be removed as necessary. Evidence of animals burrowing must be immediately investigated, and burrowing animal populations controlled as necessary. Disposal areas must be inspected to ensure they are allowing wastewater to infiltrate as designed, there is no surfacing, and soils are not saturated.

Table 7. Subsurface Disposal Area Monitoring

Parameter	Inspection Frequency
Pump controllers, automatic valves, etc.	Weekly
Nuisance Odor Condition	Weekly
Saturated Soil Condition	Weekly
Plant Growth	Weekly
Vectors or Animals Burrowing	Weekly
Disposal Area Condition	Weekly

6.2. A log of these inspections must be maintained onsite in a bound logbook and made available to the Central Coast Water Board upon inspection. Any problems must be promptly corrected and recorded. Santa Barbara County must submit a summary of violations found during the inspections with each subsequent monitoring report, or a note that there were no violations.

7. SOLIDS DISPOSAL MONITORING

7.1. Santa Barbara County must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

7.2. If solids are not removed during the year, Santa Barbara County must explain the absence of this monitoring in the report.

8. COLLECTION SYSTEM MAINTENANCE

8.1. Santa Barbara County must submit records of any maintenance performed on the sewer collection system within the past year.

9. REPORTING

9.1. The semiannual monitoring reports must be submitted in accordance with Table 8.

Table 8. Semiannual Monitoring Reports

Report	Monitoring Period	Report Due Date
First Semiannual Report	January 1 to June 30	August 1
Second Semiannual Report	July 1 to December 31	February 1

9.2. Semiannual Reports

9.2.1. Facility Information and Description

Briefly describe your facility, treatment process, and disposal process with references to figures.

9.2.2. Data Tables

Tabular summaries of all monitoring data (water supply, influent, effluent, and groundwater) compared to effluent limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program.

9.2.3. Compliance and Performance Discussion

9.2.3.1. Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Permit requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.

9.2.3.2. An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (Total Nitrogen, Formaldehyde, Total Coliform) between disposal fields and ocean water monitoring points, over time, nuisance conditions, wastewater system problems, etc.

9.2.3.3. A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.

9.2.4. Recreational Vehicle Signage Requirements

Certify compliance with the Senate Bill 317 directive in the first semiannual report (e.g. photographs of posted signage and their respective on-site locations)

9.2.5. Septic Tank and Grease Trap Pumping

Annually, in the second semiannual report, note if the septic tank was pumped or inspected and provide the results as described in Section 5.

9.2.6. Disposal Area Inspection

Report the results of the disposal area inspections, as described in Section 6.

9.2.7. Solids Disposal

If solids are disposed of offsite, comply with the reporting in Section 7.

9.2.8. Operator Information

9.2.8.1. The name, grade, and license number for the wastewater operator responsible for operation, maintenance, and wastewater system monitoring, and all operator personnel.

9.2.8.2. A copy of the current Office of Operator Certification Wastewater Treatment Plant Classification Form.

9.2.8.3. A copy of the current Office of Operator Certification Chief Plant Operator Acknowledgement Form.

9.2.8.4. If a contract operator is used, a copy of the contract operator certificate from the Office of Operator Certification.

9.2.9. Flow Evaluation

A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.

9.2.10. Figures

A wastewater system process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).

9.2.11. Laboratory Sheets

Copies of laboratory analytical report(s) and chain of custody form(s).

9.2.12. Collection System Maintenance

Records of any collection system maintenance performed on the sewer collection system during the reporting period.

10. ELECTRONIC SUBMITTAL

10.1. All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

10.2. The transmittal sheet describes who can sign reports. To authorize someone to sign and submit reports on your behalf, you must submit the "designation of duly authorized representatives form" found at the link below to the Central Coast Water Board.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/

10.3. Santa Barbara County must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{1,2} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number WDR1000035713 at:

<https://geotracker.waterboards.ca.gov/esi/login>

10.4. Table 9 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk:

Geotracker@waterboards.ca.gov.

Table 9. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

² Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Electronic Submittal	Description of Action	Action	Frequency
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water quality samples from the laboratory, field monitoring not required.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points (excluding supply wells). Effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.”	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

11. TECHNICAL REPORTS

11.1. Spill Prevention & Emergency Response Plan, Sampling and Analysis Plan, and Sludge Management Plan

Santa Barbara County must submit to GeoTracker the reports described in General Permit Section E.1. Technical Report Preparation Requirements by the dates included in Table 10. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

11.2. Time Schedule Compliance Plan

11.2.1. Santa Barbara County must provide a report that evaluates the data collected in the monitoring events that occurred between June 2024 and June 2025 and compare it with the General Permit limits described in the notice of applicability Table 2 Treatment Tank and Disposal Area Maximum Design Limits and Table 3 Wastewater System Effluent Limits. If monitored data is not meeting the General Permit limitations, Santa Barbara County must prepare and submit for Central Coast Water Board review and approval, a time schedule compliance plan. At a minimum, the time schedule compliance plan must address the following:

11.2.2. Comparison of the current flow and effluent quality to the flow and effluent limits shown in notice of applicability Tables 2 and 3.

11.2.3. A detailed description and chronology of efforts, since issuance of the notice of applicability, to reduce flow and wastes.

11.2.3.1. Justification of the need for additional time to achieve the flow and effluent limitations in notice of applicability Tables 2 and 3.

11.2.3.2. A detailed time schedule of specific actions Santa Barbara County will take to achieve the flow and effluent limitations.

11.2.3.3. A demonstration that the time schedule requested is as short as possible, considering the technological, operation, and economic factors that affect the design, development, and implementation of the measures that are necessary to comply with the effluent limitation(s).

11.2.3.4. If the requested time schedule exceeds one year, the proposed schedule shall include interim requirements and the date(s) for their achievement. The interim requirements shall include both of the following:

11.2.3.5. Flow limitation(s) and effluent limitation(s) for the pollutant(s) of concern.

11.2.3.6. Actions, measurable milestones, and tangible products leading to compliance with the flow and effluent limitation(s).

Table 10. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	September 3, 2024
Sampling and Analysis Plan	September 3, 2024
Time Schedule Compliance Plan	October 3, 2025

12. LEGAL REQUIREMENTS

12.1. The Central Coast Water Board's requirements that Santa Barbara County submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Santa Barbara County to enforcement action pursuant to [section 13268 of the California Water Code](#).

12.2. The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Santa Barbara County is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

- 12.3. The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.
- 12.4. Santa Barbara County must implement the above monitoring program on July 1, 2024. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Santa Barbara County must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered by:

Jennifer Epp
Digitally signed by Jennifer Epp
Date: 2024.05.31 17:11:40
Water Boards

for Ryan E. Lodge
Executive Officer