



Central Coast Regional Water Quality Control Board

October 4, 2024

Sent Via Electronic Mail

Paul Wood
City Manager
Greenfield
599 El Camino Real
Greenfield, CA 93927
e-mail: pwood@ci.greenfield.ca.us

Dear Paul Wood:

**GREENFIELD WASTEWATER TREATMENT PLANT, 41901 WALNUT AVENUE,
GREENFIELD, CA 93927, MONTEREY COUNTY:**

- **REVISED NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY;**
- **TRANSMITTAL OF REVISED MONITORING AND REPORTING PROGRAM NO. R3-2024-0067**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the September 26, 2024 Addendum to Report of Waste Discharge R3-2020-0020 and documents associated with the City of Greenfield's (Greenfield) domestic wastewater treatment facility (Wastewater System) located 41901 Walnut Avenue in Greenfield, California. The Wastewater System, owned by Greenfield, is currently regulated pursuant to *General Waste Discharge Requirements Order R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

This letter serves as a **revised** notice of applicability for Greenfield's enrollment in the General Permit. This letter includes: wastewater system operation summary, specific requirements and limitations (Attachment 1); figures (Attachment 2); and Greenfield's **revised** monitoring and reporting program (Attachment 3).

JANE GRAY, CHAIR | RYAN E. LODGE, EXECUTIVE OFFICER

895 Aerovista Place, Suite 101, San Luis Obispo, CA 93401 | www.waterboards.ca.gov/centralcoast

The original notice of applicability was issued on April 21, 2022. This revised notice of applicability and revised monitoring and reporting program includes the following key revisions and other minor revisions:

- Reduction in permitted monthly average influent flow from 1,500,000 gallons per day (gpd) to 1,200,000 gpd.
- Updates to the permitted treatment and disposal technologies and capacity described in notice of applicability Table 2.
- Addition of emergency disposal sprayfields, and requirements associated with the operation of the sprayfields.
- Monitoring and reporting requirements for the sprayfields.
- Update to the Water Quality Control Plan for the Central Coastal Basin (Basin Plan) Groundwater Objective for total nitrogen to 8 milligrams per liter (mg/L).

The revised notice of applicability and revised monitoring and reporting program are effective immediately and supersede and replace the April 21, 2022 notice of applicability and monitoring and reporting program.

Greenfield must comply with the following:

1. **General Permit** – Greenfield must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf

2. **Monitoring and Reporting Program** – Greenfield must comply with the requirements of Monitoring and Reporting Program No. R3-2024-0067 (Attachment 3).

Greenfield is required to submit quarterly monitoring reports and annual reports to the Central Coast Water Board and comply with annual volumetric reporting requirements¹ established by the State Water Resources Control Board (State Water Board). The next quarterly monitoring report is due **November 1, 2024**, the next annual report is due **March 1, 2025**, and the next annual volumetric data submission must be uploaded to the State Water Board GeoTracker database by **April 30, 2025**.

Quarterly monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

¹ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

All annual reports must be formatted and completed as specified in the annual report template found at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

As described in the attached monitoring plan, Greenfield must submit all reports/documents and laboratory data to the publicly accessible State Water Board's GeoTracker^{2,3} database with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System – specific global identification number **WDR100031387** at:

<https://geotracker.waterboards.ca.gov/esi/login>

3. **Fees** – Greenfield must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board's fee program and cover the state fiscal year of July 1 through June 30. Your current annual fee is \$28,205. Greenfield's Wastewater System is currently assigned a threat and complexity rating of 2B. A copy of the current state fee schedule is available electronically at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board was notified of Greenfield's initial enrollment at a regularly scheduled public meeting on June 16, 2022. Details about that meeting are available on our website at:

https://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to California Water Code section 13260, Greenfield must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, Greenfield must notify the Central Coast Water Board immediately of such changes.

² Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

³ Additional information available at: https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

Attachment 1 contains the Central Coast Water Board's understanding of the Wastewater System located at northeast end of Walnut Ave in Greenfield, California 93927. Please review Attachment 1 to determine if the description is representative of your current system. Pursuant to California Water Code section 13267, Greenfield must notify the Central Coast Water Board if this information is out of date or incorrect. You are required to provide the Central Coast Water Board with any needed updated information within **30 days** of issuance of this letter.

- 6. Responsible Party** – Greenfield is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code, and subjects Greenfield to enforcement action, and termination of enrollment under this General Permit.
- 7. Change in Ownership** - In the event of any change in control or ownership of the property, Greenfield must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board so that the new owner or operator can be enrolled in the General Permit and Greenfield's enrollment in the General Permit can be terminated.
- 8. Certified Operator** – Greenfield is required to comply with the operator certification requirements⁴ administered by the State Water Board's Office of Operator Certification, which currently requires a Class II certified operator onsite to maintain and operate the Wastewater System.
- 9. Compliance Schedule** – Greenfield submitted a time schedule compliance plan to request additional time to comply with the General Permit effluent limits for BOD, TSS and nitrate. Greenfield included a preliminary design plan to upgrade the wastewater system, which includes construction of a membrane bioreactor. The Central Coast Water Board generally concurs with the time schedule compliance plan and are preparing a time schedule order. We appreciate the significant efforts made by Greenfield to develop a plan for upgrading the wastewater system.

If you have any questions, please contact **Kristina Olmos at (805) 549-3121 or by email at Kristina.Olmos@waterboards.ca.gov** or Jennifer Epp at (805) 594-6181 or by email at Jennifer.Epp@waterboards.ca.gov.

⁴ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.
https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

Sincerely,

for Ryan E. Lodge
Executive Officer

Attachments:

Attachment 1. Wastewater System Operation Summary, Specific Requirements and Limitations

Attachment 2. Figures

Attachment 3. Monitoring and Reporting Program No. R3-2024-0067

cc:

Jamie Trugel, Public Works Director, Greenfield, jtugel@ci.greenfield.ca.us

Tino Gamboa, Greenfield, tgamboa@ci.greenfield.ca.us

Cara Aguiar, FRM, caguiar@frm-ops.com

Compliance FRM, compliance@frm-ops.com

Doug Pike, MNS Engineers, dpike@mnsengineers.com

Curtis Weeks, Arroyo Seco GSA, cweeks@arroyosecogsa.org

Jesse Woodard, Central Coast Water Board jesse.woodard@Waterboards.ca.gov

Jennifer Epp, Central Coast Water Board, jennifer.epp@Waterboards.ca.gov

Kristina Olmos, Central Coast Water Board, kristina.olmos@Waterboards.ca.gov

WDR Program, GeoTracker RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-227893

GeoTracker No. = GT-WDR100031387

Rev 4/05/2021

ECM Subject Name = Greenfield Wastewater Treatment Plant Revised NOA for R3-2020-2020

\\ca.epa.local\R:\RB3\Shared\WDR\WDR Facilities\Monterey Co\Greenfield, City Of WWTP\1_Permits\Generalorder 2024\Oct2024_Greenfieldnoa_0020_Final.Docx

**ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY, SPECIFIC REQUIREMENTS
AND LIMITATIONS**

1. OWNERSHIP AND WASTEWATER SYSTEM INFORMATION

Ownership and facility information submitted by Greenfield to the Central Coast Water Board is shown in Table 1.

Table 1. Ownership and Wastewater System Information

Name	Greenfield Wastewater Treatment Plant
Physical Address	41901 Walnut Ave Greenfield, CA 93927
Latitude	36° 20' 40.86"
Longitude	-121° 13' 3.42"
Mailing Address	P.O. Box 127 Greenfield, CA 93927
Owner	City of Greenfield
Operator (Contracted)	Fluid Resource Management (FRM) Jason Molinari phone: 805-597-7100 email: jasonm@frm-ops.com
Legally Responsible Official	Paul Wood phone: 831-674-5591 email: pwood@ci.greenfield.ca.us
Raw Wastewater Characteristics	Sewer Connections: 3386 Population: 18,000 Domestic (%): 95% Industrial (%): 5%
Permitted Design Flow, Average Monthly (gallons per day, gpd)	1,200,000
Baseline Flow (average flow) in gpd from 2023	970,000
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58
Place Type	Wastewater Treatment Facility
Place Subtype	n/a
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Waste Discharge Requirements
Reclamation Included	No

2. WASTEWATER SYSTEM OPERATION AND TREATMENT SUMMARY

Greenfield Wastewater Treatment Plant (Wastewater System) is a Class II wastewater treatment facility. Greenfield must staff a Grade II chief plant operator for proper operation of the Wastewater System. The current chief plant operator is Jason Molinari, Grade 4, License Number 28290.

The Wastewater System was originally designed to treat a peak flow of 2,000,000 gallons per day to a secondary treatment level and had an estimated average disposal capacity of 1,500,000 gpd. Currently, the Wastewater System is not consistently achieving secondary treatment level standards, and the disposal capacity has decreased. Therefore, the current permitted monthly average flow is 1,200,000 gpd. Greenfield may propose to increase permitted flow once it demonstrates that disposal capacity at the ponds and RIBs is sufficient to discharge all wastewater entering the system without pond freeboard violations.

The Wastewater System consists of the treatment technologies and treatment capabilities shown in Table 2. The Central Coast Water Board is permitting the operation and disposal of the system as described below, Greenfield must not change operation or disposal without Central Coast Water Board approval. Per General Permit Section III.7., discharge to areas other than the designated percolation ponds and rapid infiltration beds shown in Figures 2 and 3, and described in Table 2, is prohibited.

Table 2. Permitted Treatment & Disposal Technologies and Capacity

Headworks/Preliminary Treatment	Mechanical screening device with compactor/washer, Parshall Flume/ultrasonic level read for influent flow measurement, flow splitter box to split flows to Clarifiers 1, 2 and 3. Headworks capacity: 5,000,000 gpd (peak flow)
Primary Treatment	Three circular clarifiers operated in parallel. Two with 0.5 mgd capacity and another with 1.0 mgd capacity Primary treatment capacity 2,000,000 gpd based on original design and loading.
Secondary Treatment	Three aerated lagoons: Pond 1, Pond 2, and Pond 3, equipped with total of 90 HP floating aerators (18-5HP Aerators). Pond 1 and 2 operated in parallel and Pond 3 in series. Secondary treatment capacity: 2,000,000 gpd based on original design and loading.

Wastewater Disposal (Two Methods)	Two percolation ponds: Pond 4 and Pond 5 (4.2 acres total surface area). Operated in parallel to allow emptying and sludge removal when needed. Land Application by Controlled Flood: 18-acres total area by controlled flood methods in currently 11 bermed rapid infiltration basins (RIBs, also called percolation fields). Effluent is thinly spread, beds are rotated, dried and disked between applications. Effluent is designed to percolate within about 24 hours after application. Disposal capacity was originally 1,800,000 gpd, with a capacity in the RIBs of 1,500,000 gpd and a capacity in the ponds of 300,000 gpd; but has significantly decreased over the past years.
Emergency Wastewater Disposal Sprayfields (Temporary)	Greenfield may dispose to emergency wastewater sprayfields only with Central Coast Water Board staff approval for specific calendar dates. There are three spray disposal zones for a total of 16.5 acres, east of the ponds. The average percolation rate is 29 inches per hour based on percolations tests conducted in September 2024. See section 3.E. below for use requirements.
Biosolids/Sludge Production and Handling	Sludge from the clarifiers is pumped to the aerobic digester (30' diameter, 13.5' deep). In 2023, to increase solids removal, Greenfield rented a belt press, which dries biosolids from the digester. The ultimate destination of biosolids produced is Johnson Canyon Landfill located at 31400 Johnson Canyon Road, Gonzales. Annual production of biosolids is 100 dry tons.

A summary of historic and recent average effluent concentrations is included in Table 3, which were reported in Greenfield's quarterly monitoring reports. The Central Coast Water Board used reported effluent water quality data to establish the effluent and groundwater limitations in section 3.

Table 3. Effluent Water Quality for Select Constituents

Constituents	Units	Historical Average	Annual Average for 2021
Biochemical Oxygen Demand, 5-Day	mg/L	125 ^[1]	57
Total Suspended Solids	mg/L	82 ^[1]	66
Total Dissolved Solids	mg/L	840 ^[2]	1056
Chloride	mg/L	129 ^[2]	167
Sodium	mg/L	140 ^[2]	167
Sulfate	mg/L	70 ^[2]	158
Boron	mg/L	0.45 ^[2]	0.50
Total Nitrogen	mg/L	53 ^[2]	64
Nitrate as Nitrogen	mg/L	0.2 ^[2]	0

[1] Based on water quality data reported by Greenfield in their 2013 to 2020 monitoring reports.

[2] Based on water quality data reported by Greenfield in their 2004 to 2020 monitoring reports.

3. WASTEWATER SYSTEM SPECIFIC REQUIREMENTS AND LIMITATIONS

Greenfield must operate the Wastewater System in accordance with the General Permit and this Notice of Applicability. Greenfield must comply with the wastewater specific limitations specified in Table 4 through Table 8 and requirements below.

A. Flow Limitations:

Table 4. Flow Limitations

Flow	Units	Limit	Point of Compliance
Maximum Daily	Gallons per day	1,800,000	Influent
Maximum Monthly Average	Gallons per day	1,200,000	Influent

B. Effluent Limitations:

Since April 2024, the treatment pond effluent limitations shown in Table 5 apply.⁵

Table 5. Effluent Limitations: Treatment Ponds

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Biochemical Oxygen Demand, 5-Day	mg/L ^[1]	45	65	Not Applicable
Total Suspended Solids	mg/L	45	65	Not Applicable
Settleable Solids	mL/L ^[2]	0.3	Not Applicable	0.5
pH	pH units	Between 6.5 and 8.4	Not Applicable	Not Applicable

[1] mg/L denotes milligram per liter

[2] mL/L denotes milliliter per liter

⁵ Greenfield submitted a time schedule compliance plan to achieve compliance with effluent limitations and requested a time schedule order pursuant to Water Code section 13300 for consideration by the Central Coast Water Board.

**Table 6. Effluent Limitations
Based on - Salinas Valley Lower Forebay Objectives**

Constituents	Units	25-Month Rolling Median
Total Dissolved Solids	mg/L ^[1]	1,500
Chloride	mg/L	250
Sodium	mg/L	Not Applicable ²
Sulfate	mg/L	850
Boron	mg/L	Not Applicable ²
Total Nitrogen	mg/L	Not Applicable ²

[1] mg/L denotes milligrams per liter

[2] Groundwater monitoring is required for these constituents to demonstrate compliance with groundwater limitations.

C. Groundwater Limitations:

Based on review of historical effluent water quality (see Table 3), Greenfield is unable to consistently comply with the General Permit effluent limitations for sodium, boron, and total nitrogen, thus the point of compliance for these constituents is underlying groundwater. Through groundwater monitoring, Greenfield must demonstrate that the discharge does not cause groundwater to exceed the water quality objectives set forth in the Basin Plan including the limitations listed in Table 7.

**Table 7. Groundwater Limitations
Based on the Designated Groundwater Basin - Salinas Valley Lower Forebay**

Constituents	Units	25-Month Rolling Median
Sodium	mg/L ^[1]	150
Boron	mg/L	0.5
Total Nitrogen	mg/L	8

[1] mg/L denotes milligrams per liter

D. Organic Loading Limitations:

The effluent that is disposed to the bermed rapid infiltration basins via controlled flood irrigation and the emergency sprayfields are considered land application and thus organic loading limitations in Table 8 apply.

Table 8. Organic Loading Limitations

Constituents	Units	30-Day Average	Maximum
Biochemical Oxygen Demand, 5-Day	Pounds/acre/day	100	300

E. Requirements for Emergency Disposal to Sprayfields

Emergency disposal at the sprayfields is only permitted temporarily while percolation in the ponds and RIBs is not operating as designed, and influent flows exceed disposal capacity. Emergency disposal sprayfields will not be permitted after Greenfield upgrades the wastewater system and/or improves disposal capacity in the ponds and RIBs. The Central Coast Water Board may revise this notice of applicability at any time to remove the use of emergency disposal sprayfields.

Disposal to the sprayfields is only permitted under the following conditions.

1. Greenfield must first obtain Central Coast Water Board staff approval for discharge during specific calendar dates. Central Coast Water Board staff may revoke this approval if necessary.
2. Greenfield must provide a final field design drawing, the current approved conceptual plan is included in Figure 5, attached.
3. Greenfield must maximize effluent flow to the ponds and RIBs prior to requesting discharge to sprayfields.
4. Greenfield must comply with the requirements in General Permit section IV.C Land Application by Spray or Drip Methods.
5. Greenfield can only discharge to the area shown in red on Figure 4 and Figure 5, attached.
6. Greenfield must operate and maintain the sprayfields as proposed in the Addendum to Report of Waste Discharge R3-2020-0020 dated September 26, 2024, which includes
 - a. Spraying (discharge) of effluent between 8:00 AM and 5:00 PM.
 - b. The three sprayfields must be rotated daily to ensure soil drying.
 - c. Daily visual inspections for leaks, erosion, ponding and inspection of properly functioning berms/levees, pumps, piping and sprinkler heads.
7. Wastewater must not leave (runoff) the identified disposal area.
8. Greenfield must continue to progress towards improving disposal capacity in the ponds and RIBs.

ATTACHMENT 2 FIGURES

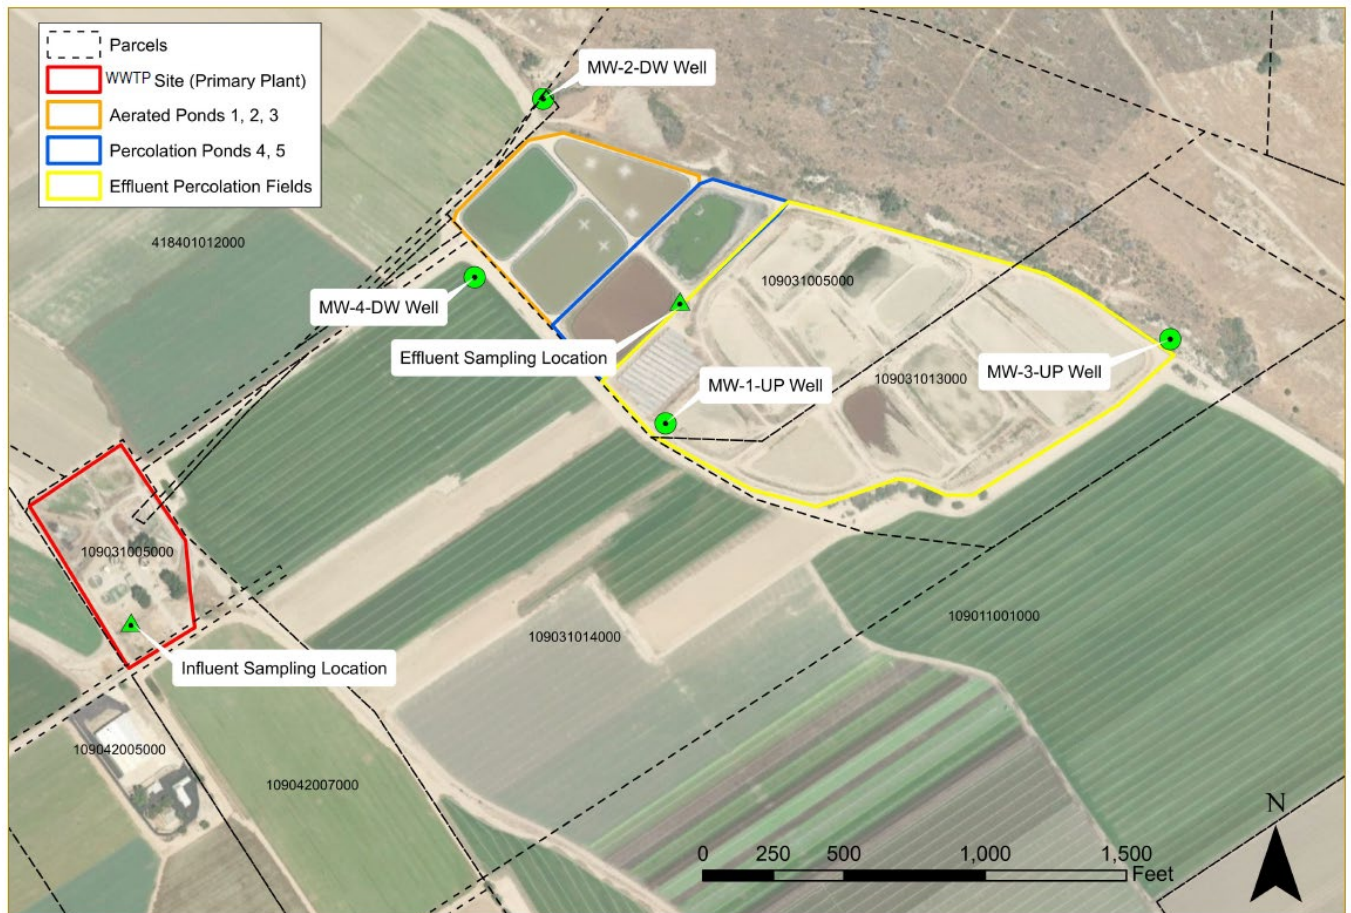


Figure 1. Site Map including Permitted Disposal Areas (Percolation Ponds and Effluent Percolation Fields/Rapid Infiltration Basins) and Groundwater Monitoring Wells

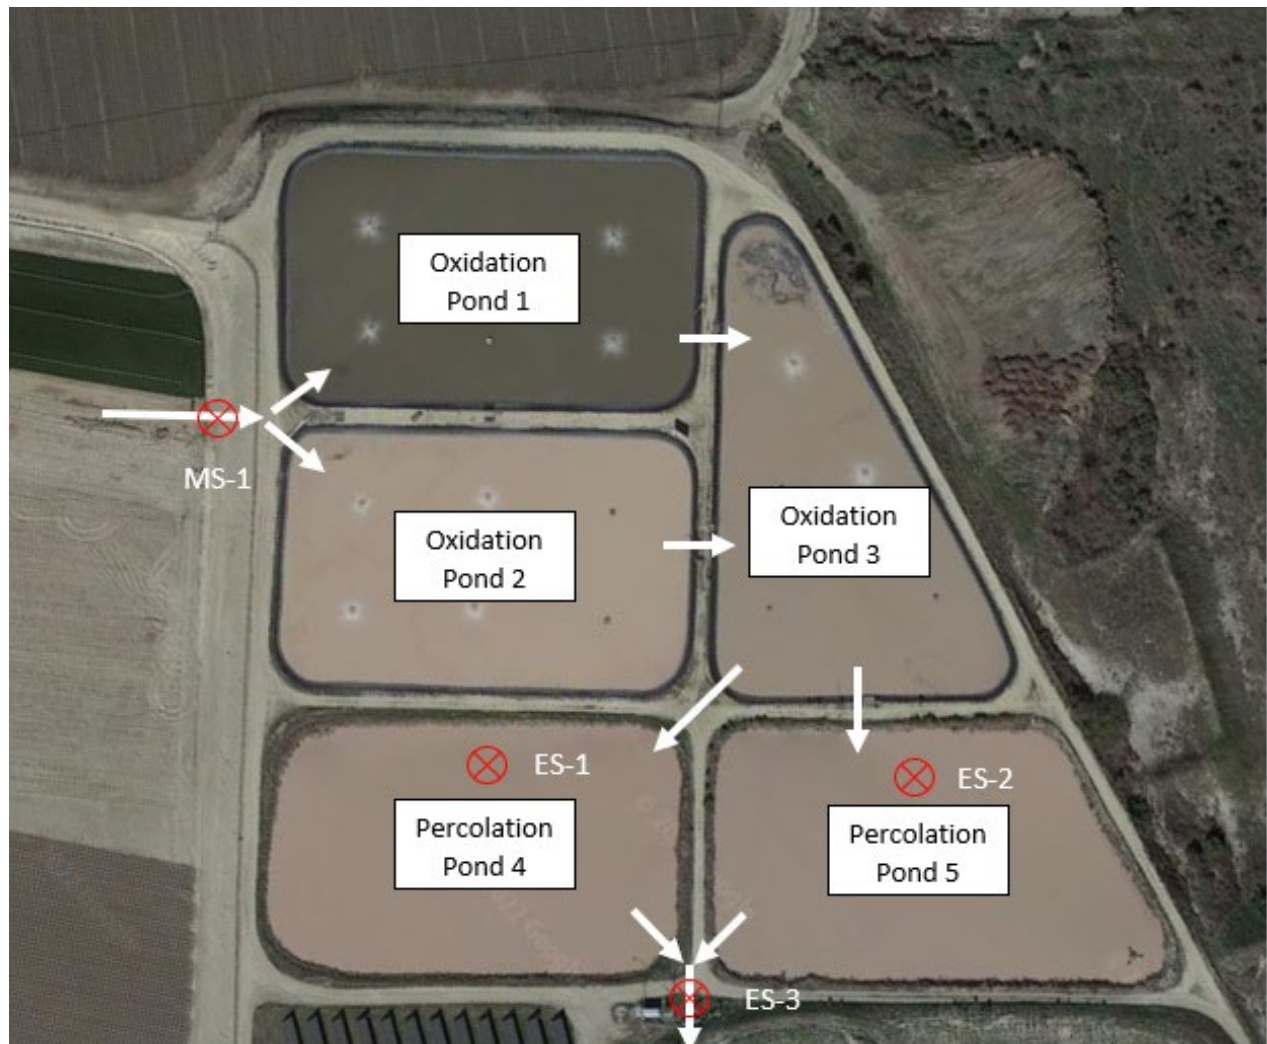


Figure 2. Ariel View of Ponds
with Midpoint Sample (MS) and Effluent Sample (ES) Locations



Figure 3. Aerial View of bermed Rapid Infiltration Basins, permitted disposal area



Figure 4. Aerial View of permitted Emergency Spray Disposal Area (red line)
Source: Adapted from Addendum to Report of Waste Discharge

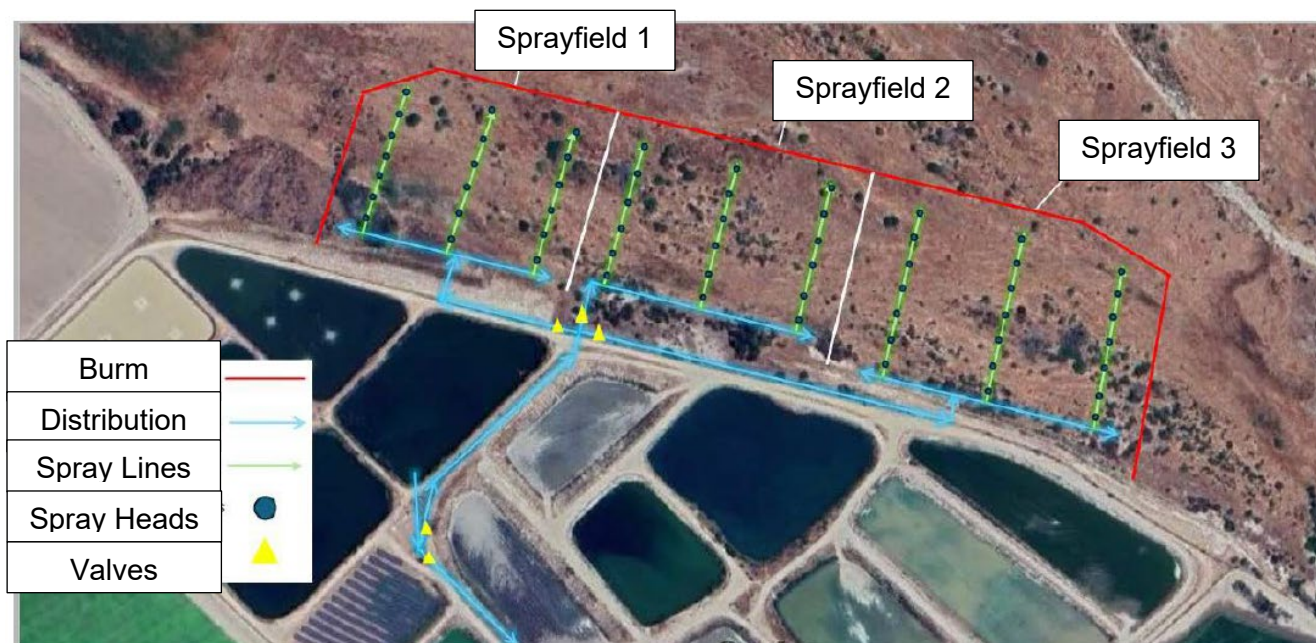


Figure 5. Proposed Emergency Sprayfield Disposal Area Layout
Source: Adapted from Greenfield Addendum to Report of Waste Discharge


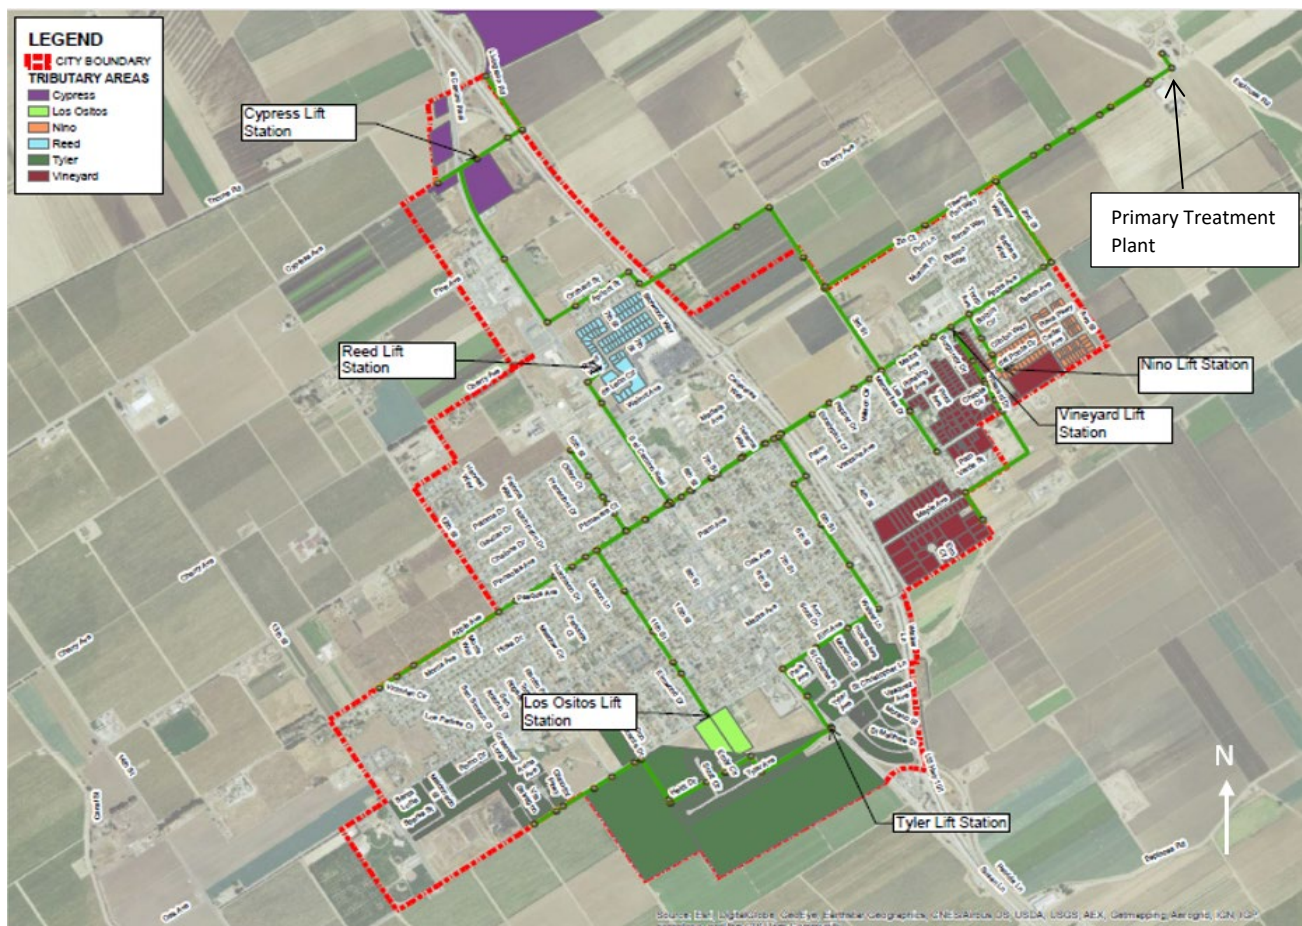


Figure 6. City Boundary with Lift Stations and Primary Treatment Plant

Source: Greenfield's Notice of Intent

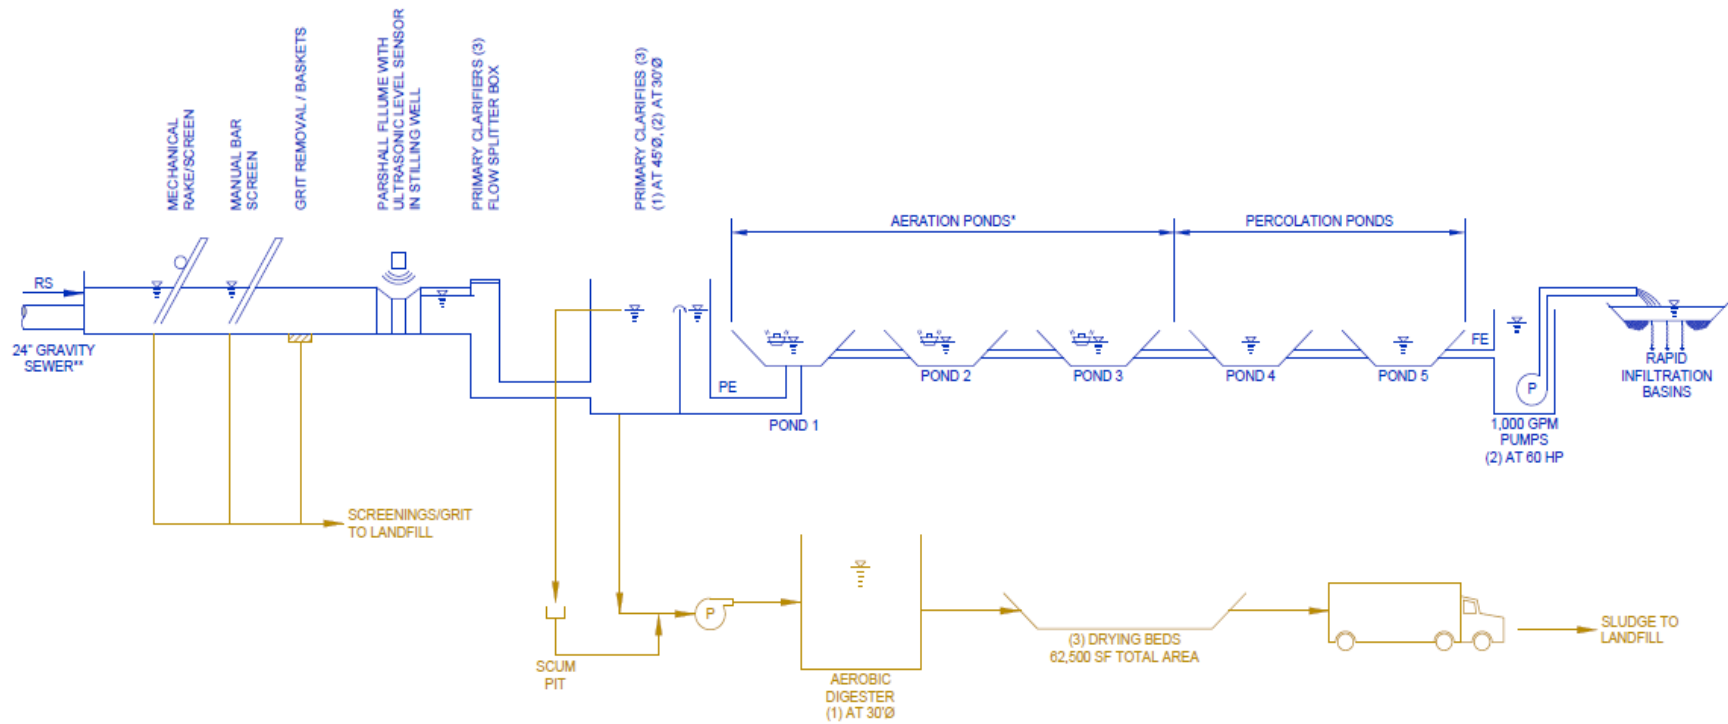

RS = RAW SEWAGE
PE = PRIMARY EFFLUENT
FE = FINAL EFFLUENT
* EACH POND EQUIPPED WITH SIX 5-HP AERATORS
**EXISTING INFLUENT SEWER IS 14" DIAMETER, TO BE UPSIZED TO 24" DIAMETER IN NEAR FUTURE

FIGURE 5. PROCESS FLOW DIAGRAM

SOURCE: JULY 2021 ENGINEERING REPORT FOR WASTEWATER TREATMENT PLANT, WALLACE GROUP

Figure 7. Process Flow Diagram
(Source: Adapted from Greenfield's Notice of Intent)

ATTACHMENT 3

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

MONITORING AND REPORTING PROGRAM R3-2024-0067

OCTOBER 4, 2024

MODIFICATION OF MONITORING AND REPORTING PROGRAM R3-2020-0020 FOR CITY OF GREENFIELD WASTEWATER SYSTEM GREENFIELD, MONTEREY COUNTY

This Monitoring and Reporting Program applies to the monitoring and reporting requirements for the City of Greenfield (Greenfield) Wastewater Treatment Plant (Wastewater System) enrolled in *General Waste Discharge Requirements Order R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

Greenfield owns and operates the Wastewater System that is subject to the General Permit and notice of applicability.

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The monitoring and reporting program directs Greenfield to submit reports (both technical and monitoring reports) and analytical data electronically via email and to the State Water Board's GeoTracker database (see Section VIII.C).

I. SAMPLING AND ANALYSIS

Greenfield must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Water Board. All samples (e.g., wastewater, groundwater, soil, sludge, etc.) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the Operations and Maintenance Manual for Central Coast Water Board review and approval.

A. Sampling Schedule – Unless otherwise specified below, sampling must be performed in accordance with Table 1.

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Quarterly	January, April, July, and October
Semiannual	April and October
Annual	October

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity, etc.) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

B. Monitoring Location Descriptions – All influent samples (IS), midpoint samples (MS), effluent samples (ES), and groundwater monitoring wells (MW) must be collected at the locations described in Table 2 and Figure 1. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. **Greenfield must upload the GeoTracker field point information for each sampling location in the GeoTracker database once, prior to uploading laboratory data** (see Table 10).

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	Field Point Description
Influent Sample	IS-1	Prior to clarifiers
Midpoint Sample	MS-1	After clarifiers, prior to ponds
Effluent Sample	ES-1	Grab Sample from Pond 4
Effluent Sample	ES-2	Grab Sample from Pond 5
Effluent Sample	ES-3	Grab Sample after/leaving Pond 5 (main effluent compliance point)
Monitoring Well	MW-1	South side of disposal area, within the RIBs; screen internal unknown
Monitoring Well	MW-1S	South side of disposal area, within the RIBs; screened 20 to 40 foot bgs

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	Field Point Description
Monitoring Well	MW-1D	South side of disposal area, within the RIBs; screened 50 to 70 feet bgs
Monitoring Well	MW-2	Northwest of treatment ponds; screen unknown
Monitoring Well	MW-2S	Northwest of treatment ponds; screened 20 to 40 feet bgs
Monitoring Well	MW-2D	Northwest of treatment ponds; screened 50 to 70 feet bgs
Monitoring Well	MW-3S	Southeast of RIBs; screened 20 to 40 feet bgs
Monitoring Well	MW-3D	Southeast of RIBs; screened 50 to 70 feet bgs
Monitoring Well	MW-4S	Adjacent to Aerated Pond 1; screened 20 to 40 feet bgs

bgs = below ground surface

II. WATER SUPPLY MONITORING

Representative samples of Greenfield's raw water supply (sampled before use or treatment) must be collected and analyzed, at a minimum, for constituents specified in Table 3.

In lieu of the required water supply sampling, Greenfield may request Central Coast Water Board approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county, provided, at a minimum, all of the required constituents are sampled at the frequency specified in Table 3. Greenfield must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 3. Greenfield must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Greenfield must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring

Constituent	Units ^[1]	Sample Type	Sampling Frequency
Nitrate (as N)	mg/L	Grab	Annually
Total Dissolved Solids	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually

Constituent	Units ^[1]	Sample Type	Sampling Frequency
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

[1] mg/L denotes milligrams per liter

III. INFLUENT AND EFFLUENT MONITORING

A. Influent and Effluent Flow Monitoring – Greenfield must monitor and report flow in gallons per day, as described in Table 4, with each monitoring report. See Section VIII.A.3 for supplemental volumetric annual reporting requirements established by the State Water Board.

Table 4. Influent and Effluent Flow Monitoring

	INFLUENT	INFLUENT	EFFLUENT	EFFLUENT
Parameter	Sample Type	Reporting Frequency	Sample Type	Reporting Frequency
Daily Flow ^[1]	Metered	Daily	Metered/Estimated ^[2]	Daily
Maximum Daily Flow	Metered	Monthly	Metered/Estimated ^[2]	Monthly
Mean Daily Flow	Calculated	Monthly	Calculated	Monthly

[1] The General Permit notice of applicability specifies the Wastewater System's maximum permitted flow. In the monitoring reports, Greenfield must evaluate and provide a comparison of monitored flow to the permitted flow.

[2] Greenfield is required to provide an explanation of how flow is estimated with each monitoring report.

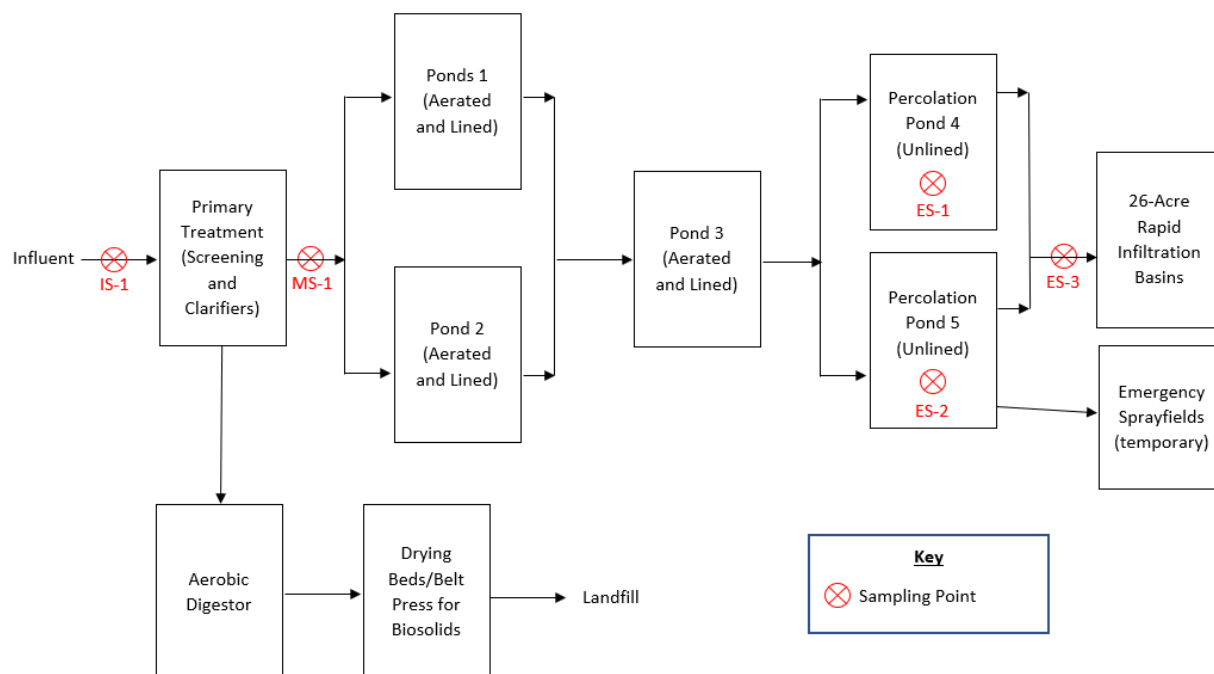


Figure 1. Process Flow Diagram and Sample Locations

B. Influent, Midpoint and Effluent Monitoring – At a minimum, influent, midpoint, and effluent constituent monitoring for the pond treatment system must be monitored as specified in Table 5 at the locations shown in Figure 1. Influent must be a composite sample¹, while all others are grab samples. All samples must be reported in milligrams per liter (mg/L), except for settleable solids which must be reported in milliliters per liter (mL/L). **Greenfield must report any effluent violations using one of the following approaches: 1) by comparing effluent limits to samples collected at ES-3, or 2) by comparing effluent limits to a flow-weighted average of ES-1, ES-2, and ES-3.**

Table 5. Influent, Midpoint and Effluent Monitoring

	INFLUENT (IS-1)	MIDPOINT (MS-1)	EFFLUENT (ES-1)	EFFLUENT (ES-2)	EFFLUENT (ES-3) ²
Parameter/ Constituent	Sampling Frequency	Sampling Frequency	Sampling Frequency	Sampling Frequency	Sampling Frequency
Biochemical Oxygen Demand, 5-Day	Monthly	Monthly	Monthly	Monthly	Monthly

¹ All samples are composite except for pH, which should be a grab sample for influent and effluent.

	INFLUENT (IS-1)	MIDPOINT (MS-1)	EFFLUENT (ES-1)	EFFLUENT (ES-2)	EFFLUENT (ES-3)²
Parameter/ Constituent	Sampling Frequency	Sampling Frequency	Sampling Frequency	Sampling Frequency	Sampling Frequency
Total Suspended Solids	Monthly	Monthly	Monthly	Monthly	Monthly
Settleable Solids	Not Required	Not Required	Not Required	Not Required	Monthly
Total Nitrogen ^[1]	Quarterly	Quarterly	Quarterly	Quarterly	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species	Quarterly	Quarterly	Quarterly	Quarterly	Quarterly
Total Kjeldahl Nitrogen (as N)	Quarterly	Quarterly	Quarterly	Quarterly	Quarterly
Ammonia (as N)	Quarterly	Quarterly	Quarterly	Quarterly	Quarterly
Alkalinity	Quarterly	Quarterly	Not Required	Not Required	Not Required
Total Dissolved Solids	Quarterly	Not Required	Not Required	Not Required	Quarterly
Chloride	Quarterly	Not Required	Not Required	Not Required	Quarterly
Sodium	Quarterly	Not Required	Not Required	Not Required	Quarterly
Sulfate	Quarterly	Not Required	Not Required	Not Required	Quarterly
Boron	Not Required	Not Required	Not Required	Not Required	Quarterly
Carbonate	Not Required	Not Required	Not Required	Not Required	Semiannually
Bicarbonate	Not Required	Not Required	Not Required	Not Required	Semiannually
Calcium	Not Required	Not Required	Not Required	Not Required	Semiannually
Potassium	Not Required	Not Required	Not Required	Not Required	Semiannually
Magnesium	Not Required	Not Required	Not Required	Not Required	Semiannually

[1] Total nitrogen is calculated and is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

[2] Permit compliance effluent sample. Other two effluent samples (ES-1 and ES-2) are for performance evaluation, as a majority of the effluent disposed is representative of the ES-3 location.

IV. DISPOSAL AREA OBSERVATION MONITORING

All wastewater treatment and disposal ponds (Ponds 1 to Pond 5) and the RIBs must be monitored as described in Table 6. Greenfield must inspect the ponds and RIBs at least weekly during operation, and after rain events. Sampling must be a grab sample taken from 1 foot below pond surface, or measured, as indicated in Table 6 and results must be reported in the subsequent monitoring report. When the emergency disposal sprayfields are in use, Greenfield must visually inspect the sprayfields to monitor for leaks, erosion and ponding, and inspect the condition of the levee/berms to confirm there is no erosion or damage at least twice per day.

Observations do not need to be reported in the monitoring reports unless a violation of permit conditions is observed. If violations are observed, planned and implemented mitigation measures to address the violations must be reported. Observations must be noted in a bound logbook and maintained onsite and made available to the Central Coast Water Board upon inspection. Any problems must be promptly corrected and recorded.

Table 6. Wastewater Pond Monitoring

Parameter/ Constituent	Units^[1]	Sample Type	Pond 1 to Pond 5	RIBs
Freeboard	0.1 feet	Measured	Weekly	Weekly ²
pH	pH Units	Grab	Weekly	Not required
Dissolved Oxygen	mg/L	Grab	Monthly	Not required
Sludge Depth	0.1 feet	Measured	Annually	Not required
Nuisance Odors/vectors	Not Applicable	Observation	Weekly	Weekly
Berm condition	Not Applicable	Observation	Weekly	Weekly
Vegetation in and surrounding berms	Not Applicable	Observation	Weekly	Weekly
Excessive Ponding	Not Applicable	Observation	Not required	Weekly

[1] mg/L denotes milligrams per liter

[2] monitor and report freeboard only if the RIB does not percolate the wastewater within 48 hours of application. If all RIBs percolate as designed, Greenfield can report RIBs are dry and not provide a reading in feet.

V. RAPID INFILTRATION BASIN (RIB) AND EMERGENCY SPRAYFIELD APPLICATION MONITORING AND REPORTING

Greenfield must evaluate and summarize wastewater disposal application rates, loading rates (pounds/acre/day) consistent with Table 7. Emergency sprayfields can only be used when approved by the Central Coast Water Board, and must be monitored and reported only when in use.

Table 7. Wastewater Disposal Monitoring and Reporting at RIBs and Sprayfields

Constituent/Monitoring	Units	Sample Type	Monitoring and Reporting Frequency
Local Precipitation	Inches/day	Weather Station ^[1]	Each precipitation event
Acreage Applied ^[2]	Acres	Measured	Daily
Application Rate	Gallons per day	Estimated ^[3]	Daily
Average Monthly Biochemical Oxygen Demand, 5-Day (BOD ₅) Applied ^[4]	lbs/acre/day	Calculated	Monthly
Maximum Daily BOD ₅ Applied ^[5]	lbs/acre/day	Calculated	Daily
Average Quarterly Total Nitrogen Applied ^[4]	lbs/acre/day	Calculated	Quarterly
Average Quarterly TDS Applied ^[4]	lbs/acre/day	Calculated	Quarterly

[1] Greenfield must have a rain gauge or use a NOAA or USGS rain station, such as <http://scacis.rcc-acis.org/>.

[2] Acreage applied denotes the acreage to which wastewater is applied.

[3] If the flow is estimated, Greenfield is required to provide an explanation (e.g., no meter- estimated using pump operations including rate and time) with each monitoring report.

[4] The loading rates must be calculated from average wastewater flow volumes, average applied acreage, and concentrations reported in effluent (ES-3) analytical testing as follows:

Average Total Nitrogen/Salts/BOD Applied (pounds/acre/day) =

$$\frac{X \text{ [mg/L]} \times Q \text{ [average million gallons per day]} \times 8.34 \text{ [(conversion from mg/L to pounds/million gallons per day)]}}{\text{Average Acreage Applied [acres]}}$$

Where X = Total nitrogen, salts, or BOD₅ concentration at ES-3 (average or 1-time result for the reporting period)

Where Q = Average Daily Application Rate

[5] Maximum daily must be calculated using the actual daily acres applied and flow to that acreage, not averages. Only need to report the maximum daily for the quarter, and every day the value is above the maximum BOD₅ loading daily limit.

VI. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

Greenfield must report the handling and disposal of all sludge/biosolids generated at the Wastewater System. Records must include the date removed from the Wastewater System, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

Greenfield must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

If sludge/biosolids are not removed during the year, Greenfield must explain the absence of this monitoring in the annual report.

VII. GROUNDWATER MONITORING

The discharge from the Wastewater System often exceeds, or is close to exceeding, effluent limitations specified in Table 6 of the General Permit for **sodium, boron and total nitrogen**. Therefore, instead of establishing an effluent limit, Greenfield is required to implement a groundwater monitoring program to demonstrate compliance with the groundwater basin water quality objectives. Greenfield must, at a minimum, sample and analyze all groundwater monitoring wells (MW-1, MW-1S, MW-1D, MW-2, MW-2S, MW2-D, MW-3S, MW-3D, and MW-4) as specified in Table 8.

Prior to sampling, depth to groundwater must be measured and groundwater elevations² must be calculated. The monitoring wells must be purged of at least three well volumes and until measurements of the following parameters have stabilized (i.e., are reproducible within 10 percent): pH, temperature, dissolved oxygen, electrical conductivity, and turbidity. No-purge, low-flow, or other sampling techniques are acceptable only if they are approved in advance by the Central Coast Water Board and described in an approved sampling and analysis plan. Once the groundwater level in each of the wells has recovered sufficiently to ensure the collection of representative groundwater samples, a qualified individual (e.g., consultant, technician, etc.) trained in using proper sampling methods must recover samples using approved USEPA methods. All data must be recorded in monitoring well field sheets.

Greenfield must provide monitoring well field sheets and report monitoring data, as described in Table 8, with each monitoring report.

Table 8. Groundwater Monitoring

Constituent	Units^[1]	Sample Type	Sampling Frequency
Groundwater Elevation ^[2]	0.01 feet	Calculated	Quarterly
Depth to Groundwater	0.01 feet	Measurement	Quarterly
Gradient	feet/feet	Calculated	Quarterly

² The locations and top-of-casing elevations for the existing groundwater monitoring wells must be surveyed by a licensed land surveyor if not already completed at the time of installation.

Constituent	Units ^[1]	Sample Type	Sampling Frequency
Groundwater Flow Direction ^[3]	degrees	Calculated	Quarterly
Total Nitrogen ^{[4][5]}	mg/L	Calculated	Quarterly
Nitrate (as N) + nitrite (as N)	mg/L	Grab	Quarterly
Total Kjeldahl Nitrogen (as N) ^[5]	mg/L	Grab	Quarterly
Sodium	mg/L	Grab	Quarterly
Boron	mg/L	Grab	Quarterly
Carbonate	mg/L	Grab	Semiannually
Bicarbonate	mg/L	Grab	Semiannually
Calcium	mg/L	Grab	Semiannually
Potassium	mg/L	Grab	Semiannually
Magnesium	mg/L	Grab	Semiannually

[1] mg/L denotes milligrams per liter

[2] Groundwater elevation must be based on depth to water using a surveyed measuring point elevation on the well and a surveyed reference elevation.

[3] Calculations must be prepared by, or under the responsible charge of, a California licensed professional.

[4] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

[5] If after four quarters of data nitrate is the only nitrogen species present, total nitrogen and ammonia are not required.

VIII. REPORTING REQUIREMENTS

A. QUARTERLY AND ANNUAL MONITORING REPORTS

Quarterly and annual monitoring reports are due as described in Table 9.

Table 9. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	May 1
Second Quarter Monitoring Report	April 1 to June 30	August 1
Third Quarter Monitoring Report	July 1 to September 30	November 1
Fourth Quarter Monitoring Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1

Report	Monitoring Period	Report Due Date
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

1. **Quarterly Monitoring Reporting** – At a minimum, the quarterly reports must include:
 - i. Results of all required monitoring in tabular format.
 - ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
 - iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. **Greenfield must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.
 - iv. Copies of laboratory analytical report(s) and chain of custody form(s).
 - v. An updated hydrogeologic conceptual site model with the groundwater monitoring reporting requirements based on new information generated from the monitoring well boring logs, groundwater elevation data, water quality data, etc.
 - vi. Copies of groundwater monitoring well field sheets with purge methods and logs.
2. **Annual Reporting** – Greenfield must submit annual reports by March 1 in compliance with Standard Provisions 2013³, (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by the Central Coast Water Board. All annual reports must be formatted and completed as specified in the current annual report template found at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

³ See Attachment E, Standard Provisions, 2013:
https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

3. **State Water Board Volumetric Annual Reporting** – Greenfield must electronically certify and submit a summary of the monthly influent and effluent flow volume by April 30th of each calendar year via the State Water Board's Internet GeoTracker database.

The following information is required:

- i. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e. total monthly influent volume).
- ii. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.
- iii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website⁴.

B. VERBAL NON-COMPLIANCE REPORTING

Greenfield must verbally notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, and wastewater containment failure, pursuant to General Permit section VI.C.2.

C. ELECTRONIC GEOTRACKER SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permiitting/docs/transmittal_sheet.pdf

Greenfield must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker^{5,6} database consistent with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System-specific global identification number **WDR100031387** at:

<https://geotracker.waterboards.ca.gov/esi/login>

⁴ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

⁵ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

⁶ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

For general questions, please contact the GeoTracker Help Desk at:

Geotracker@waterboards.ca.gov.

Table 10 summarizes all the GeoTracker electronic reporting requirements. The Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

Table 10 GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when requested by Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your California ELAP-accredited laboratory staff to upload all EDF laboratory data directly to GeoTracker	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.

Electronic Submittal	Description of Action	Action	Frequency
Field Points, Location Data (Geo XY) ^[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.” These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.
Elevation Data (Geo Z) ^[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Wastewater System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. Greenfield must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

IX. TECHNICAL REPORTS

Greenfield must submit a **Climate Change Adaptation Plan by September 1, 2025**.⁷ The Climate Change Adaptation Plan must, at a minimum, include the following components:

1. Hazards and Vulnerabilities – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using current tools, data, and guidance from the State of California (e.g., Cal-

⁷ Pursuant to the April 21, 2022 Notice of Applicability, Greenfield was required to submit the plan by April 21, 2024, but requested an extension as Greenfield is currently updating their General Plan, which will assess climate change vulnerabilities throughout the city.

Adapt⁸, Sea-Level Rise Guidance from Ocean Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California Climate Assessment Regional Reports), assess the Wastewater System's vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities.

- i. Sea Level Rise – Saltwater intrusion, flooding and inundation, and increased coastal erosion.
 - ii. Precipitation Pattern Changes.
 - a. Drought – Decreased influent quantity and quality.
 - b. Peak Events – Flooding and increased influent quantity.
 - iii. Temperature fluctuations and extremes.
 - iv. Increased wildfires.
 - v. Increased power outages.
2. Resiliency Actions – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.
3. Adaptation Strategy – For Wastewater Systems with design flows over 1,000,000 gallons per day, develop and implement a strategy to complete resiliency actions, at a minimum encompassing the following:
4. Recycled Water Feasibility Plan – Dischargers with Wastewater System design flows over 1,000,000 gallons per day must include a recycled water feasibility plan. The recycled water feasibility plan will assess the viability of using the Wastewater System's treated wastewater effluent for beneficial reuse including, but not limited to the following:
 - i. Beneficial Reuse Options – Identification of reuse opportunities for Greenfield's treated effluent that would achieve the highest beneficial impact and best uses possible of non-potable recycled water. Include assessment of the following non-potable recycled water benefits identified in the State Water Board Recycled Water Policy: providing safe alternatives to fresh water or potable water for approved uses; supporting

⁸ Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor's Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

sustainable groundwater and surface water uses with the intent of substituting use of treated effluent for use of fresh water or potable water; and diversifying community water supplies and mitigating for the impacts of climate change.⁹

- ii. Viable Users – Identification and viability evaluation of all potential users of the Wastewater System's treated effluent associated with identified beneficial reuse options. Greenfield must demonstrate it engaged potential water purveyors and customers about the viability of reusing the Wastewater System's treated effluent.
- iii. Infrastructure Upgrades – Assessment of infrastructure needs to produce non-potable recycled water for identified beneficial reuses and convey non-potable recycled water to beneficial reuse locations.
- iv. Fiscal Analysis – Cost estimates for identified reuse options, at a minimum including project development, construction, and long-term maintenance and lifecycle costs. This analysis shall also include identification and evaluation of the following: 1) funding options, including at a minimum, revenues from recycled water sales, grant and loan funding opportunities, and financing from other benefitting parties and 2) funding limitations.
- v. Schedule and Milestones for Next Steps – Timeframes to assess the feasibility of identified beneficial reuse options and to identify proposed beneficial reuse options based on prioritized water recycling and reuse opportunities, feasibility assessments, and other factors identified by Greenfield.
- vi. Identification of implementation schedule and adequate funding to implement the plan.

X. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Greenfield submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Greenfield to enforcement action pursuant to [section 13268 of the Water Code](#).

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit and to protect water quality. Greenfield is required to submit this information because it is subject to the General Permit and is responsible

⁹ [Water Quality Control Policy for Recycled Water](#), State Water Board, adopted December 11, 2018, page 1.

for the discharge.

Greenfield must implement the above revised monitoring program immediately. The Central Coast Water Board Executive Officer may rescind or modify this monitoring and reporting program at any time. Greenfield must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

ORDERED BY:

for Ryan E. Lodge
Executive Officer

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\Monterey Co\Greenfield, City of
WWTP\1_Permit\GeneralOrder 2024\Oct2024_GreenfieldMRP_Final.docx