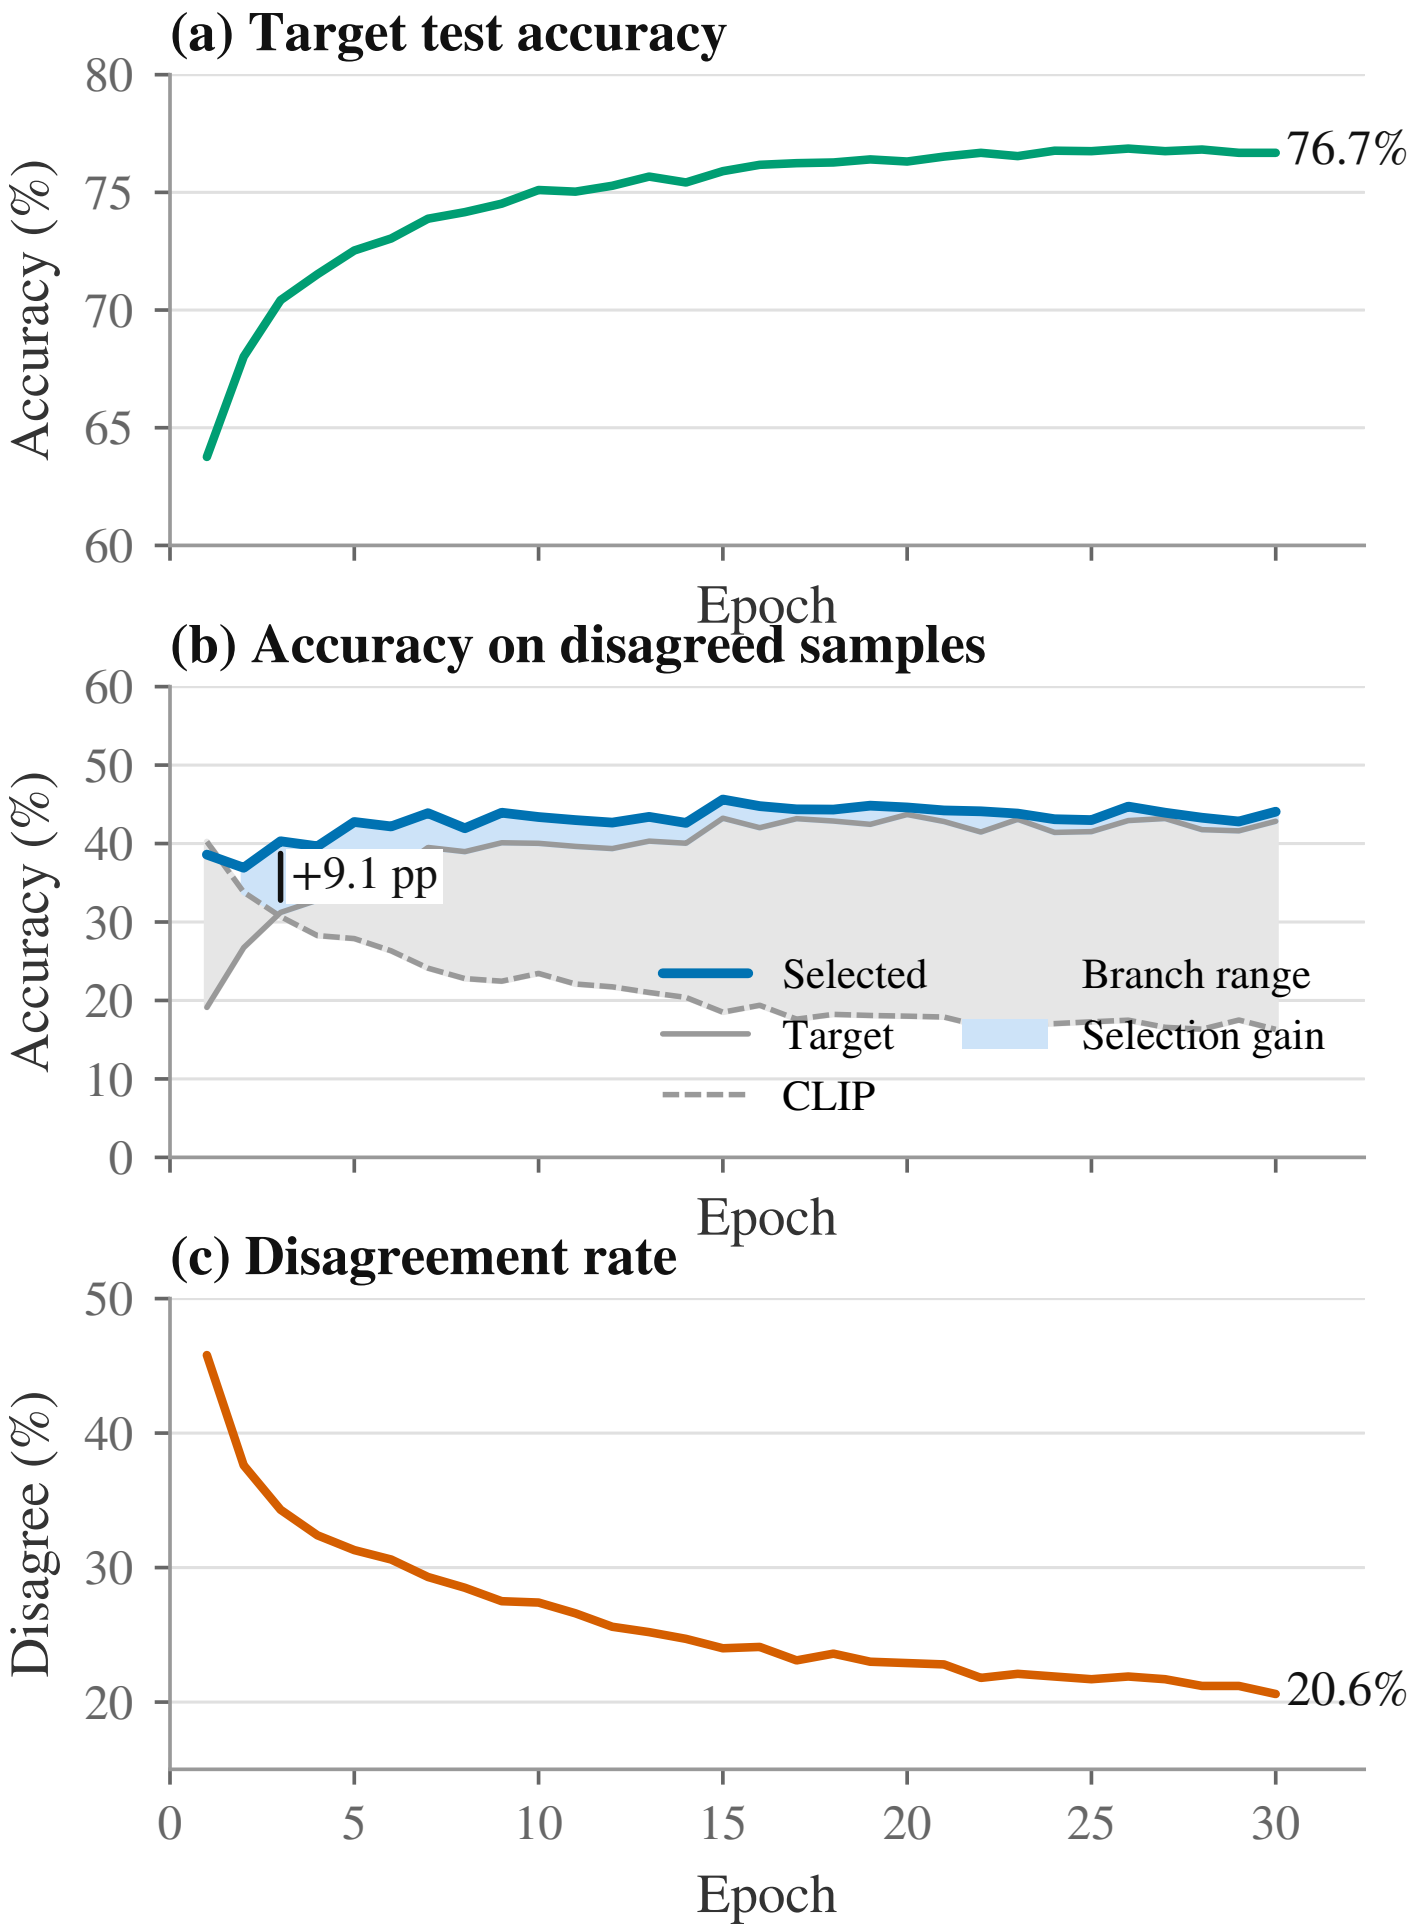
(a) Target test accuracy
Accuracy (%)
80
75
70
65
60
76.7%
Epoch
(b) Accuracy on disagreed samples
Accuracy (%)
60
50
40
30
20
10
0
+9.1 pp
Selected
Target
CLIP
Branch range
Selection gain
Epoch
(c) Disagreement rate
Disagree (%)
50
40
30
20
20.6%
0
5
10
15
20
25
30
Epoch