


Annual agreement can conceal seasonal errors

Exploratory H2 proxy: company offshore totals; fixed calibration from 2022 only

a Reported and modelled quarterly energy

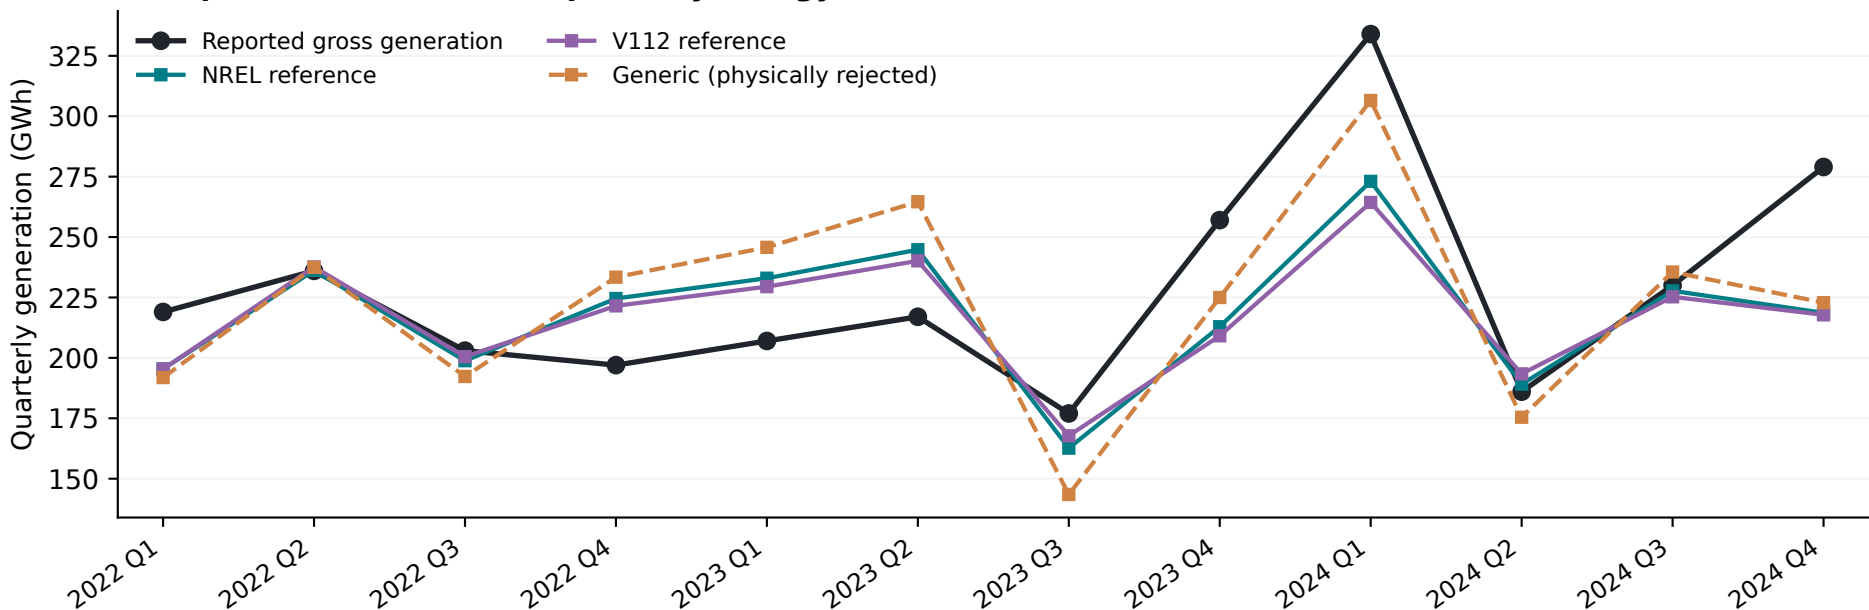

b Quarterly error (%) after annual calibration

	2022				2023				2024			
NREL reference	-10.8	+0.1	-2.1	+14.0	+12.5	+12.8	-8.1	-17.2	-18.2	+1.7	-1.0	-21.6
V112 reference	-10.8	+0.7	-1.2	+12.5	+10.9	+10.7	-5.2	-18.6	-20.9	+4.0	-2.1	-21.9
Generic (rejected)	-12.4	+0.6	-5.3	+18.5	+18.7	+21.9	-18.9	-12.5	-8.2	-5.7	+2.4	-20.1
	Q1	Q2	Q3	Q4	Q1	Q2	Q3	Q4	Q1	Q2	Q3	Q4

2023 NREL: annual bias -0.55%; sum of absolute quarterly errors / annual generation 13.08%.

Sources: issuer Q1/H1/9M and annual reports; ERA5 wind with reference curves. No quarterly refit.
Q2-Q4 derived from cumulative differences. Rounding is not a confidence interval. No hourly validation.