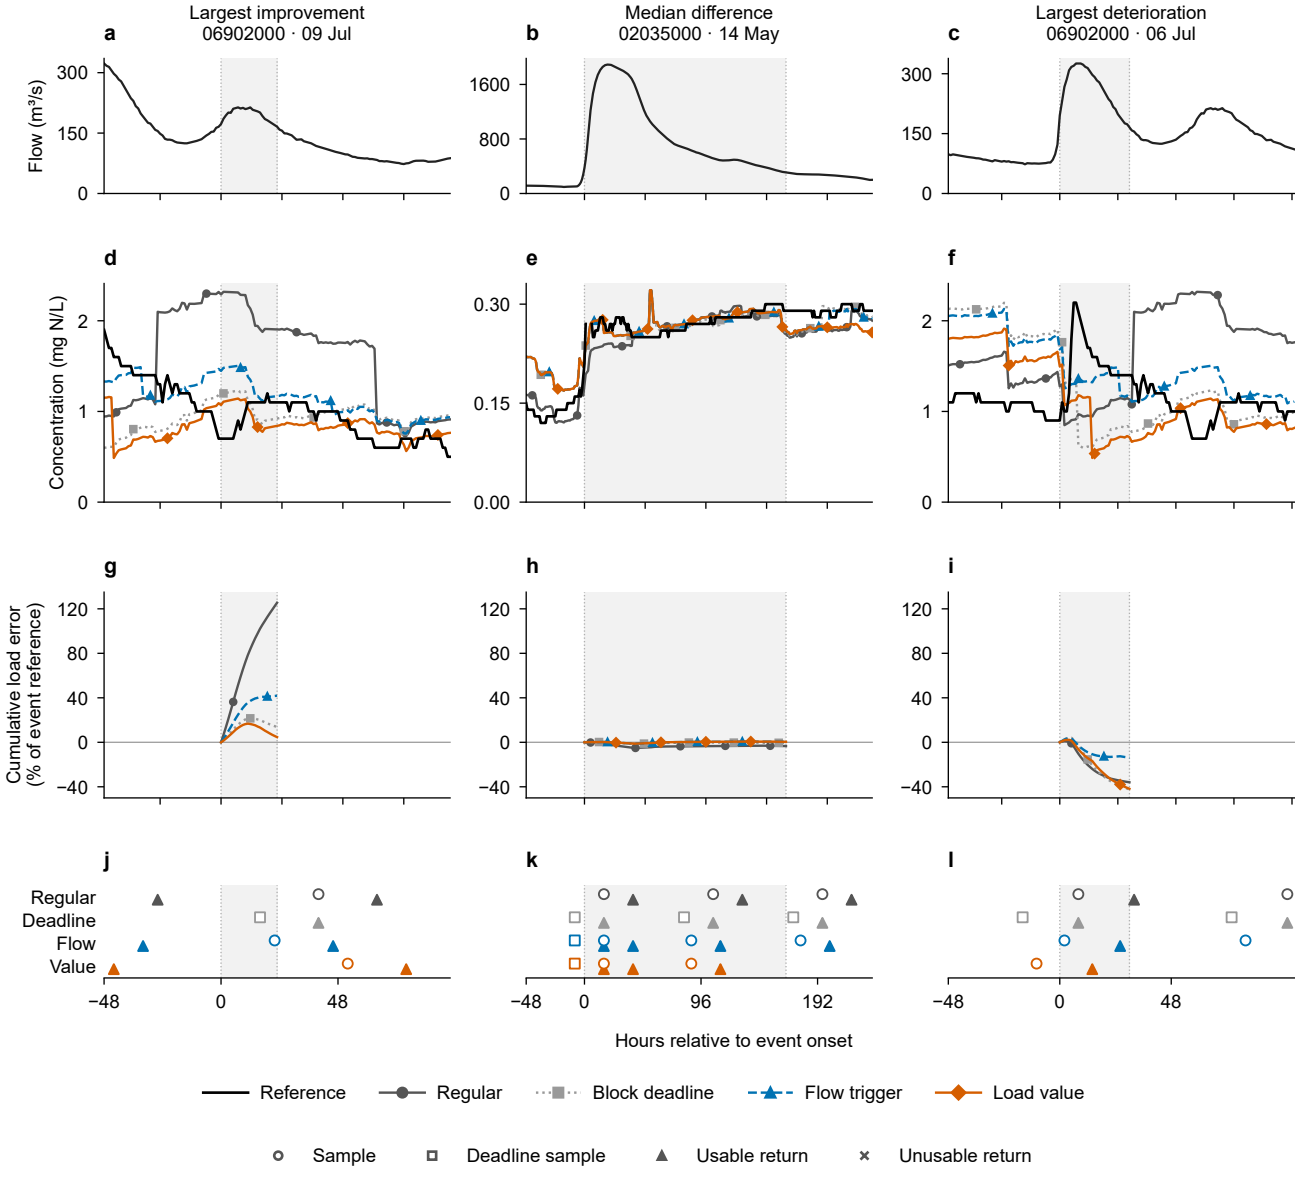

a
Largest improvement
06902000 · 09 Jul
b
Median difference
02035000 · 14 May
c
Largest deterioration
06902000 · 06 Jul
Flow (m³/s)
d
e
f
Concentration (mg N/L)
g
h
i
Cumulative load error
(% of event reference)
j
k
l
Regular
Deadline
Flow
Value
Hours relative to event onset
Reference
Regular
Block deadline
Flow trigger
Load value
Sample
Deadline sample
Usable return
Unusable return