



APPLICATION EXAMPLE

Integration and Usage of the Microsoft Teams with WinCC OA

SIMATIC WinCC Open Architecture

Legal information

Use of application examples

Application examples illustrate the solution of automation tasks through an interaction of several components in the form of text, graphics, and/or software modules. The application examples are a free service by Siemens AG and/or a subsidiary of Siemens AG ("Siemens"). They are non-binding and make no claim to completeness or functionality regarding configuration and equipment. The application examples merely offer help with typical tasks; they do not constitute customer-specific solutions. You yourself are responsible for the proper and safe operation of the products in accordance with applicable regulations and must also check the function of the respective application example and customize it for your system. Siemens grants you the non-exclusive, non-sublicensable and non-transferable right to have the application examples used by technically trained personnel. Any change to the application examples is your responsibility. Sharing the application examples with third parties or copying the application examples or excerpts thereof is permitted only in combination with your own products. The application examples are not required to undergo the customary tests and quality inspections of a chargeable product; they may have functional and performance defects as well as errors. It is your responsibility to use them in such a manner that any malfunctions that may occur do not result in property damage or injury to persons.

Disclaimer of liability

Siemens shall not assume any liability, for any legal reason whatsoever, including, without limitation, liability for the usability, availability, completeness, and freedom from defects of the application examples as well as for related information, configuration and performance data and any damage caused thereby. This shall not apply in cases of mandatory liability, for example under the German Product Liability Act, or in cases of intent, gross negligence, or culpable loss of life, bodily injury or damage to health, non-compliance with a guarantee, fraudulent non-disclosure of a defect, or culpable breach of material contractual obligations. Claims for damages arising from a breach of material contractual obligations shall however be limited to the foreseeable damage typical of the type of agreement, unless liability arises from intent or gross negligence or is based on loss of life, bodily injury, or damage to health. The foregoing provisions do not imply any change in the burden of proof to your detriment. You shall indemnify Siemens against existing or future claims of third parties in this connection except where Siemens is mandatorily liable. By using the application examples you acknowledge that Siemens cannot be held liable for any damage beyond the liability provisions described.

Other information

Siemens reserves the right to make changes to the application examples at any time without notice. In case of discrepancies between the suggestions in the application examples and other Siemens publications such as catalogs, the content of the other documentation shall have precedence.

The Siemens terms of use (<https://support.industry.siemens.com>) shall also apply.

Security information

Siemens provides products and solutions with industrial cybersecurity functions that support the secure operation of plants, systems, machines and networks.

In order to protect plants, systems, machines and networks against cyber threats, it is necessary to implement – and continuously maintain – a holistic, state-of-the-art industrial cybersecurity concept. Siemens' products and solutions constitute one element of such a concept.

Customers are responsible for preventing unauthorized access to their plants, systems, machines and networks. Such systems, machines and components should only be connected to an enterprise network or the internet if and to the extent such a connection is necessary and only when appropriate security measures (e.g. firewalls and/or network segmentation) are in place.

For additional information on industrial cybersecurity measures that may be implemented, please visit www.siemens.com/cybersecurity-industry.

Siemens' products and solutions undergo continuous development to make them more secure. Siemens strongly recommends that product updates are applied as soon as they are available and that the latest product versions are

used. Use of product versions that are no longer supported, and failure to apply the latest updates may increase customer's exposure to cyber threats.

To stay informed about product updates, subscribe to the Siemens Industrial Cybersecurity RSS Feed under <https://www.siemens.com/cert>.

Third-Party Software Information

Note to Resellers: Please pass on this document to your customer to avoid license infringements.

This product, solution or service ("Product") contains third-party software components listed in this document. These components are Open Source Software licensed under a license approved by the Open Source Initiative (www.opensource.org) or similar licenses as determined by SIEMENS ("OSS") and/or commercial or freeware software components. With respect to the OSS components, the applicable OSS license conditions prevail over any other terms and conditions covering the Product. The OSS portions of this Product are provided royalty-free and can be used at no charge.

If SIEMENS has combined or linked certain components of the Product with/to OSS components licensed under the GNU LGPL version 2 or later as per the definition of the applicable license, and if use of the corresponding object file is not unrestricted ("LGPL Licensed Module", whereas the LGPL Licensed Module and the components that the LGPL Licensed Module is combined with or linked to is the "Combined Product"), the following additional rights apply, if the relevant LGPL license criteria are met: (i) you are entitled to modify the Combined Product for your own use, including but not limited to the right to modify the Combined Product to relink modified versions of the LGPL Licensed Module, and (ii) you may reverse-engineer the Combined Product, but only to debug your modifications. The modification right does not include the right to distribute such modifications and you shall maintain in confidence any information resulting from such reverse-engineering of a Combined Product.

Certain OSS licenses require SIEMENS to make source code available, for example, the GNU General Public License, the GNU Lesser General Public License and the Mozilla Public License. If such licenses are applicable and this Product is not shipped with the required source code, a copy of this source code can be obtained by anyone in receipt of this information during the period required by the applicable OSS licenses by contacting the following address:

Siemens AG
LC TEC IT&SL
Werner-von-Siemens Str. 60
91052 Erlangen
Germany

Keyword: Open Source Request (please specify Product name and version, if applicable)

SIEMENS may charge a handling fee of up to 5 EUR to fulfil the request.

Warranty regarding further use of the Open Source Software

SIEMENS' warranty obligations are set forth in your agreement with SIEMENS. SIEMENS does not provide any warranty or technical support for this Product or any OSS components contained in it if they are modified or used in any manner not specified by SIEMENS. The license conditions listed below may contain disclaimers that apply between you and the respective licensor. For the avoidance of doubt, SIEMENS does not make any warranty commitment on behalf of or binding upon any third party licensor.

Open Source Software and/or other third-party software contained in this Product:

Please note the following license conditions and copyright notices applicable to Open Source Software and/or other components (or parts thereof):

Component	Open Source Software [Yes/No]	Acknowledgements/Comment	License conditions and copyright notices
Microsoft Teams (v26043.2016.4478.2773, Microsoft 365 – Desktop/Web, last checked 31/03/2026)	No	Microsoft Software License Terms	Microsoft Software License Terms - Microsoft Support
Workflows App in Teams	No	Microsoft Software License Terms	About the Microsoft Dataverse for Teams environment - Power Platform Microsoft Learn

Table 0-1 Third-Party Software Overview

Contents

Legal information	2
Third-Party Software Information	4
1. Introduction	6
1.1. Overview	6
1.2. Components used	6
2. Engineering	8
2.1. Project integration	8
2.2. Configuration	14
2.3. Testing with the WinCC OA Example Panel (teams.pnl)	19
1. Appendix	24
Important WinCC OA specific abbreviations	24
Service and support	26
Change documentation	27

1. Introduction

1.1. Overview

This solution enables WinCC OA to send notifications to Microsoft Teams channels or chats using incoming webhooks via Workflows app templates that process webhook alerts.

It allows alarms, events, and custom messages generated in WinCC OA to be delivered to Teams in real time.

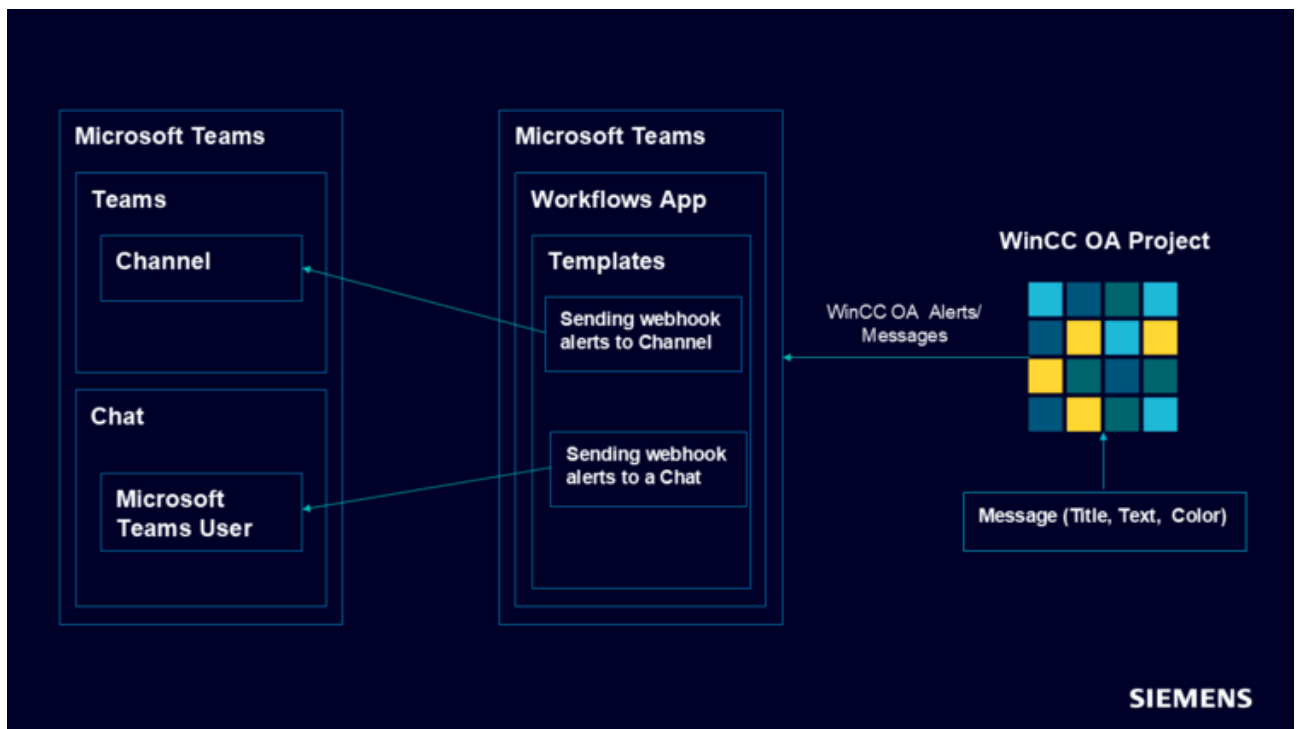


Figure 1: Architectural Overview

1.2. Components used

1.2.1. WinCC OA

This application example has been created with the following hard- and software components:

Component	Number	Article number
WinCC OA 3.20 Server Basis	1	6AV6355-1AA50-0BA0
WinCC OA V3.20, Para Standard	1	6AV6355-1AA50-0CH0

Table 1-1 WinCC OA licenses

You can purchase these components from the [Siemens Industry Mall](#).

This application example consists of the following components:

Component	File name	Note
Manual	WinCCOATeamsExample.pdf	This document
Subproject WinCC OA	WinCCOATeams.zip	Subproject for WinCC OA

Table 1-2 Application Example content

1.2.2. Microsoft Teams

The Workflows app in Microsoft Teams is based on Microsoft Power Automate, which is provided as a cloud service and continuously updated by Microsoft. As a result, no fixed user-visible version is specified for the Workflows app.

This integration was tested using Microsoft Teams version 26043.2016.4478.2773 (Microsoft 365 – Desktop/Web), last checked on 31/03/2026.

Security Notice

This application example integrates with Microsoft Teams, a third-party cloud service maintained by Microsoft. The following security considerations apply:

- Third-Party Responsibility:**
 Security vulnerabilities affecting Microsoft Teams are addressed by Microsoft. It is the responsibility of the user to ensure that the Microsoft Teams installation and related components are kept up to date by applying the latest supported security updates and software versions.
- Network Segmentation (OT/IT Separation):**
 When integrating Microsoft Teams with operational technology (OT) environments, proper network segmentation must be implemented in accordance with IEC 62443-3-3 (SR 3.1 - Communication Integrity, SR 5.1 - Network Segmentation). Microsoft Teams should only be deployed in IT zones or DMZ segments, never directly in OT control networks. Use unidirectional gateways or data diodes where applicable.
- Data Protection and Privacy:**
 Microsoft Teams processes data in Microsoft cloud infrastructure. Users must ensure compliance with applicable data protection regulations (GDPR/DSGVO) and verify that Microsoft's data processing agreements meet organizational requirements. Avoid transmitting sensitive operational data or personally identifiable information (PII) through Teams channels without proper encryption and access controls. More information regarding GDPR are available in [Whitepaper - EU-GDPR/EU-DSGVO and WinCC OA](#)
- Incident Response:**
 In case of security incidents affecting Microsoft Teams (e.g., service breaches, unauthorized access),

users should follow their organization's incident response procedures and consult Microsoft's Security Response Center (MSRC) for guidance: <https://msrc.microsoft.com>

2. Engineering

2.1. Project integration

2.1.1. System requirements

- WinCC OA Version 3.20 P0 or higher installed and valid license (incl. Para)
- Installed WinCC OA JavaScript Manager for Node.js WinCC OA JavaScript Manager for Node.js
- Minimal system requirements for WinCC OA (see WinCC OA Documentation)

2.1.2. Installation WinCC OA

To carry out the installation of WinCC OA, please follow the steps in the WinCC OA documentation. You can find the documentation under following link: [Installation](#)

Note:

Node.js is automatically installed with WinCC OA. No additional installation steps are required (see [Node.js Installation section in the documentation](#)).

On Linux systems, if a version of Node.js is already installed, it may not be updated automatically during the WinCC OA installation. In this case, ensure that Node.js is either updated to the latest version or uninstalled before installing WinCC OA with a JavaScript environment.

2.1.3. Subproject Integration

Unpack the supplied ZIP archive "WinCCOATeams.zip" and register as a subproject [Register project](#). and The ZIP-archive contains 4 folders:

- colorDB – a set of color definition files that customize the user interface by assigning RGB values to different colors
- dplist – Contains the data point (DP) list for the JavaScript Teams Integration Manager
- javascript - JavaScript source (index.js) and support files for the Teams Integration Manager.
- panels – Contains the test panel teams.pnl.
- config – contains stylesheet.css file.

2.1.4. Creating a WinCC OA Project

To use the Microsoft Teams application example, you need to first create a standard WinCC OA project. Steps from online documentation [Create project](#) can be followed. then include it in your project [Change project properties](#) (see “Include Subprojects” section).

2.1.5. Importing the Required Datapoint Type and Datapoint

Import the datapoint list TeamsIntegrationManager.dpl, ([Import From ASCII File \(Mass Engineering\)](#)) into your WinCC OA project. After a successful import, a new datapoint type “**Teams**” (see Figure 2) will be created in the project. This datapoint type includes a datapoint named “**Teams**”.

Teams Datapoint Type: It contains two structures (Config and Message)

- **Config:**
 - **WebhookUrl** (string): contains the Microsoft Power Automate webhook URL that allows external applications like WinCC OA to send messages to a Microsoft Teams channel or chat.
- **Message:** contains the following six datapoint elements:
 - **color** (string): contains one of the seven predefined color names described in section 2.8.1 to color the title.
 - **title** (string): contains the title of the message sent from WinCC OA to Microsoft Teams.
 - **text** (string): contains the desired text to be sent from WinCC OA to Microsoft Teams.
 - **summary** (string):
 - **send** (bool): triggers sending the message (colored title with text) to Microsoft Teams, when set to TRUE.

After a successful import:

- Open the **Para** panel  in WinCC OA.
- Check the created datapoints.
- Ensure that all datapoint elements listed above are available.

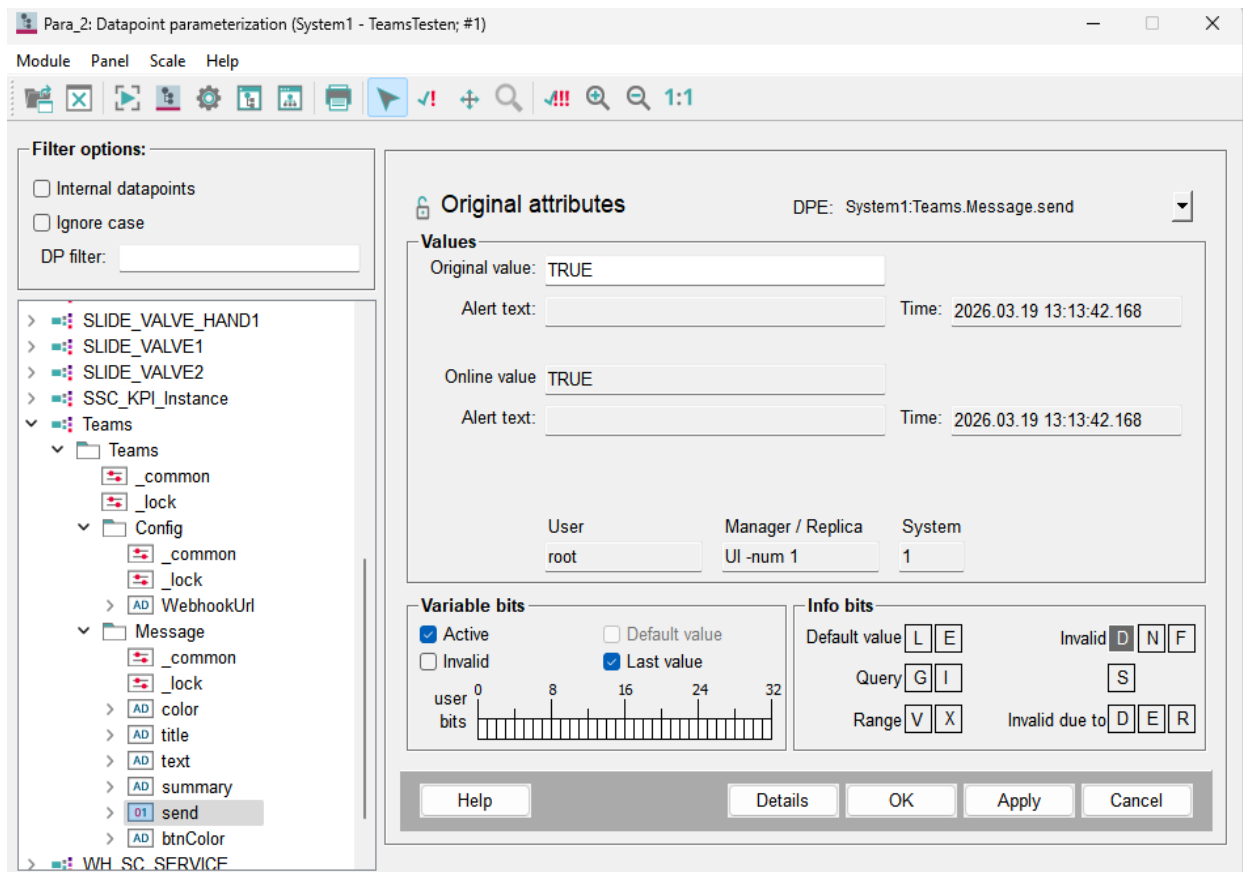


Figure 2: Open PARA module to check the imported DPs

2.1.6. Workflows App Installation

To use workflows in Microsoft Teams:

1. Click **View more apps (...)** on the left-hand rail.

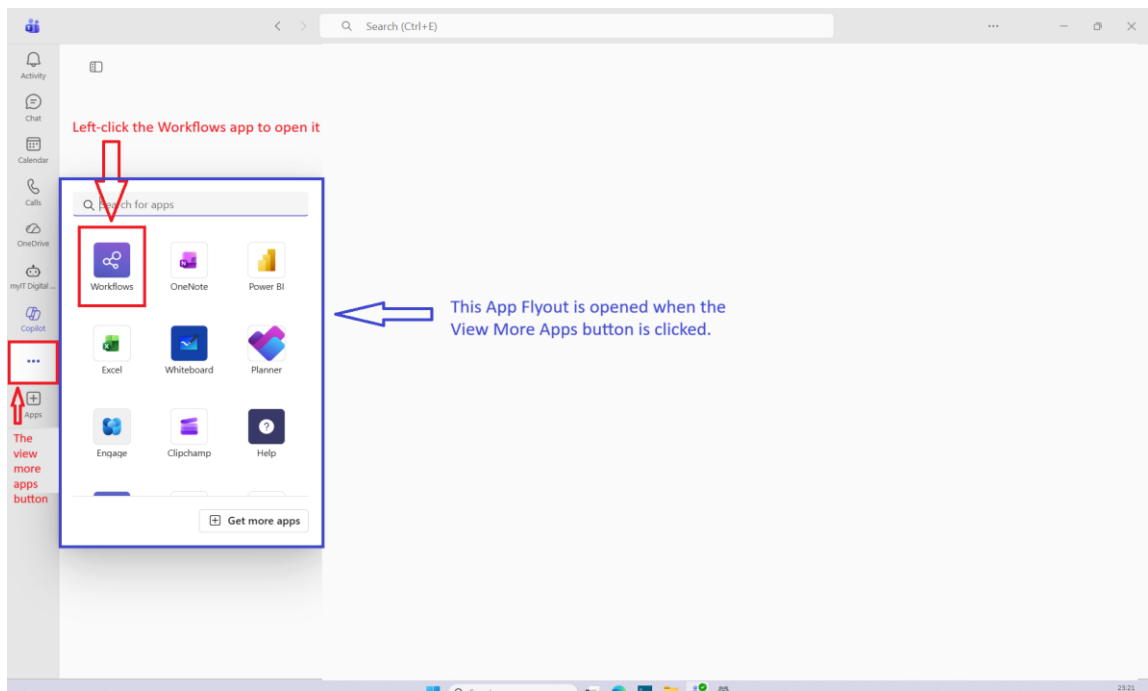


Figure 3: Use the Apps flyout and select 'Workflows' to open it

2. Locate the **Workflows** app:

- Click **Open** if the app is already installed.
- Click **Add** if the app is not installed.

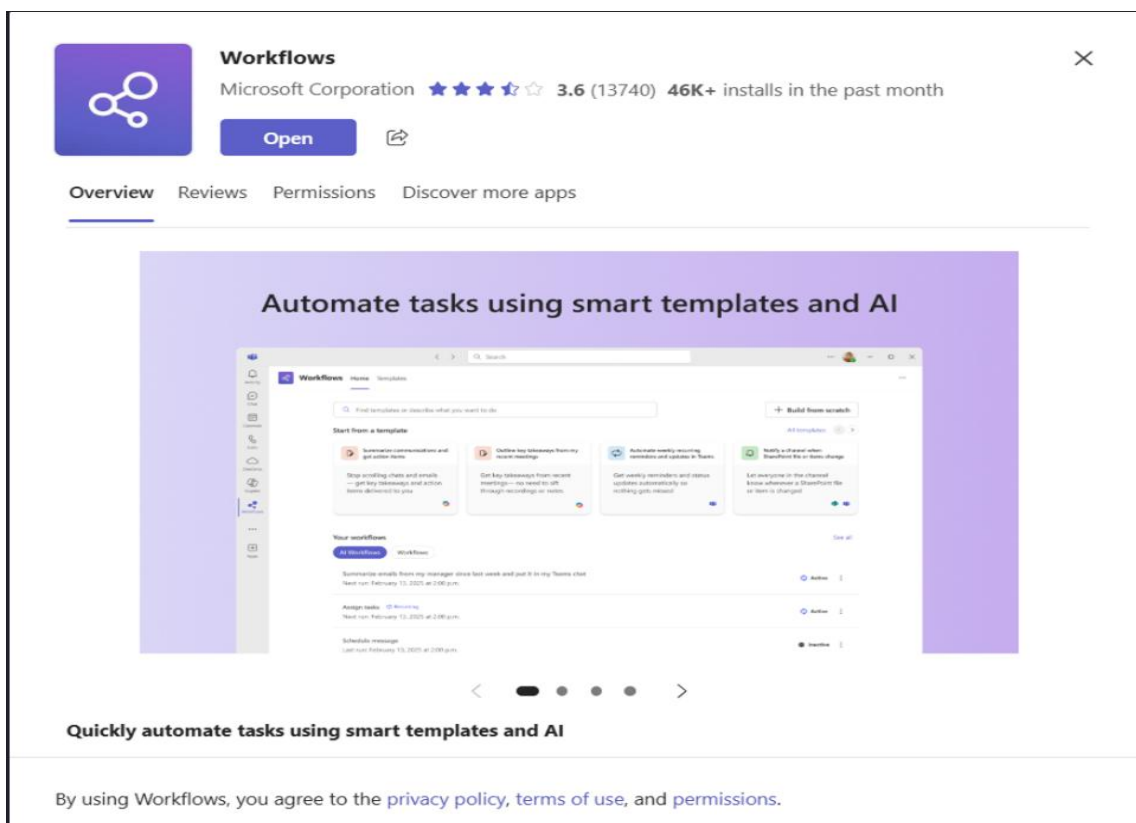


Figure 4: Open the Workflows app to automate tasks.

3. Open the Workflows app and select **Templates** at the top center.

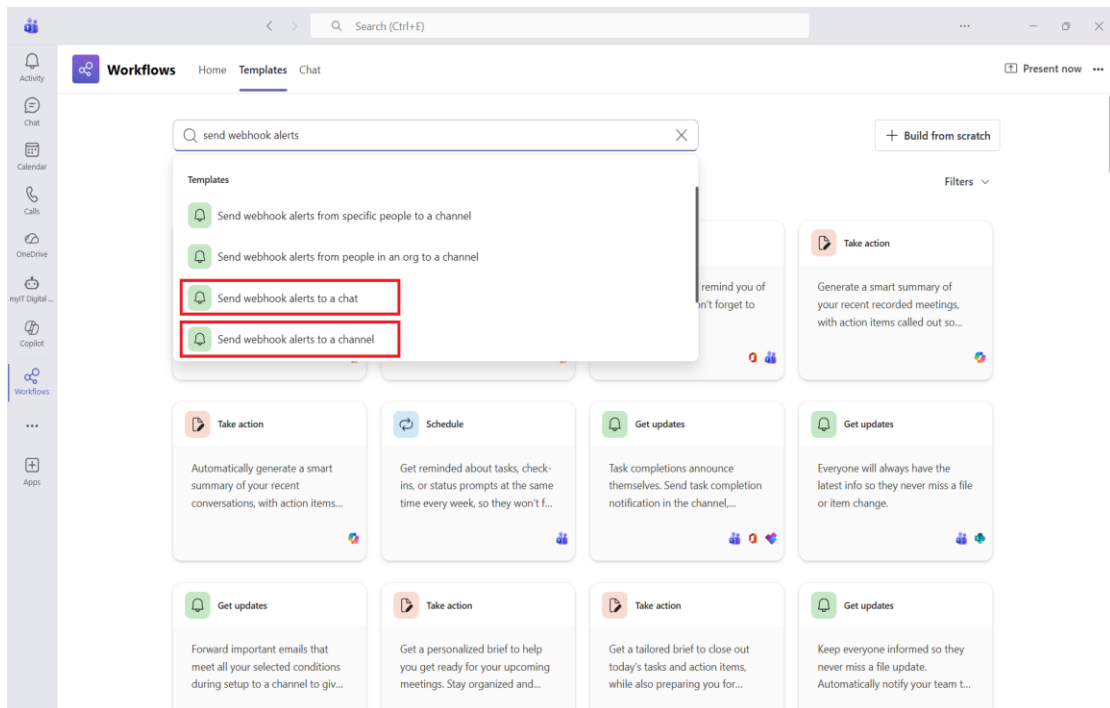


Figure 5: Search and select a webhook alert template.

4. Search for either:
- **Send webhook alerts to chat** – sends messages from WinCC OA to a group chat.
 - **Send webhook alerts to a channel** – sends messages to a specific channel.

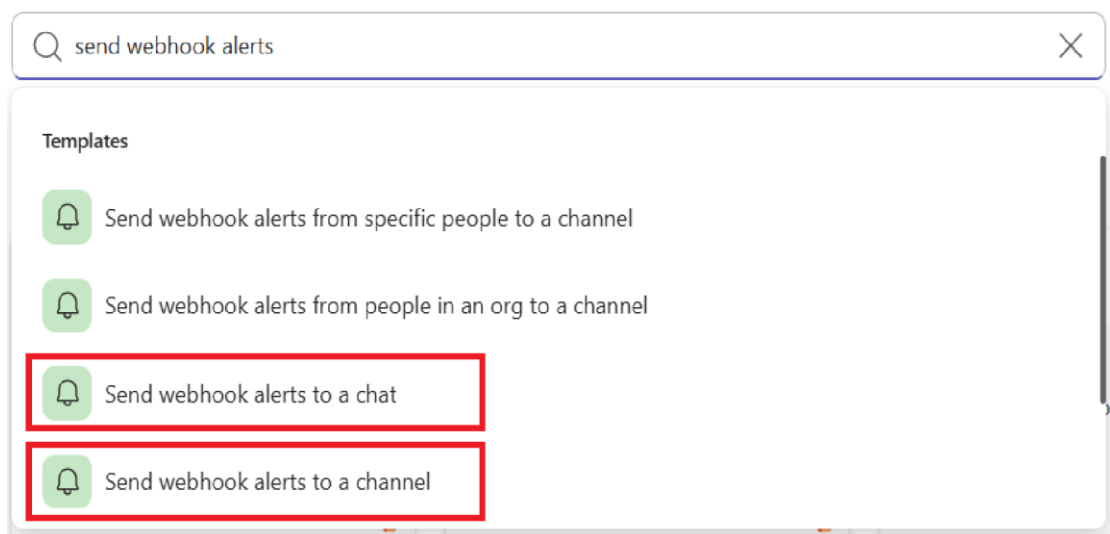


Figure 6: Select a webhook alert template.

2.1.7. Installation of Dependencies

To set up the Teams Integration subproject, all required dependencies must be installed using **npm**. The following steps to be followed:

- To install all dependencies, run the PowerShell command `npm install` in the following path: `<subproject_path>\javascript\TeamsIntegration.`, where `WinCCOATeams.zip` is unpacked and registered.
- Navigate to the `TeamsIntegration` folder using PowerShell:

```
PS C:\Users\user> cd C:\WinCC_OA_Proj\3.20\TeamsSubProject\javascript\TeamsIntegration
PS C:\WinCC_OA_Proj\3.20\TeamsSubProject\javascript\TeamsIntegration> dir

Directory: C:\WinCC_OA_Proj\3.20\TeamsSubProject\javascript\TeamsIntegration

Mode                LastWriteTime         Length Name
----                -
d-----          3/12/2026   10:20 AM             .vs
d-----          3/12/2026   10:20 AM             ReadMe
-a-----          2/26/2026    7:45 AM             167 .gitignore
-a-----          2/26/2026    7:45 AM          1619 .index_intern.js
-a-----          3/6/2026   10:22 AM          2857 index.js
-a-----          3/6/2026   10:14 AM           358 package.json
-a-----          2/26/2026    7:45 AM          2146 Readme.md

PS C:\WinCC_OA_Proj\3.20\TeamsSubProject\javascript\TeamsIntegration> |
```

Figure 7: TeamsIntegration directory before npm install.

- Initially, the `TeamsIntegration` folder contains only the following files:

```
PS C:\WinCC_OA_Proj\3.20\TeamsSubProject\javascript\TeamsIntegration> dir

Directory: C:\WinCC_OA_Proj\3.20\TeamsSubProject\javascript\TeamsIntegration

Mode                LastWriteTime         Length Name
----                -
d-----          3/12/2026   10:20 AM             .vs
d-----          3/12/2026   10:20 AM             ReadMe
-a-----          2/26/2026    7:45 AM             167 .gitignore
-a-----          2/26/2026    7:45 AM          1619 .index_intern.js
-a-----          3/6/2026   10:22 AM          2857 index.js
-a-----          3/6/2026   10:14 AM           358 package.json
-a-----          2/26/2026    7:45 AM          2146 Readme.md
```

Figure 8: TeamsIntegration folder contents before executing npm install

- Run the “`npm install`” command to install all required packages:

```
PS C:\WinCC_OA_Proj\3.20\TeamsSubProject\javascript\TeamsIntegration> npm install
added 1 package, and audited 3 packages in 10s
found 0 vulnerabilities
```

Figure 9: npm install completed with 0 vulnerabilities.

- This command reads the package.json file and installs all necessary Node.js dependencies for the project.
- After execution, the folder will include the following new items:
- node_modules – contains all installed npm packages.
- package-lock.json – locks the versions of installed packages.
- These indicate that the dependencies were successfully installed.

```
PS C:\WinCC_OA_Proj\3.20\TeamsSubProject\javascript\TeamsIntegration> dir

Directory: C:\WinCC_OA_Proj\3.20\TeamsSubProject\javascript\TeamsIntegration

Mode                LastWriteTime         Length Name
----                -
d-----          3/12/2026 10:20 AM                .vs
d-----          3/16/2026  3:29 PM            node_modules
d-----          3/12/2026 10:20 AM                ReadMe
-a-----          2/26/2026  7:45 AM             167 .gitignore
-a-----          2/26/2026  7:45 AM          1619 .index_intern.js
-a-----          3/6/2026 10:22 AM          2857 index.js
-a-----          3/16/2026  3:29 PM           752 package-lock.json
-a-----          3/6/2026 10:14 AM           358 package.json
-a-----          2/26/2026  7:45 AM         2146 Readme.md
```

Figure 10: TeamsIntegration directory after executing npm install

2.2. Configuration

2.2.1. Microsoft Teams channel configuration

Before configuring a workflow, a Microsoft Teams channel must be created. Channels can be created in the following ways:

1. **During the creation of a new team** – a default channel is automatically created as the first channel of the team.
2. **Within an existing team** – additional channels can be added later.

The following sections describe both methods.

- **Creating a New Team**

1. Launch Microsoft Teams.
2. Select Chat from the left sidebar and click Channels.

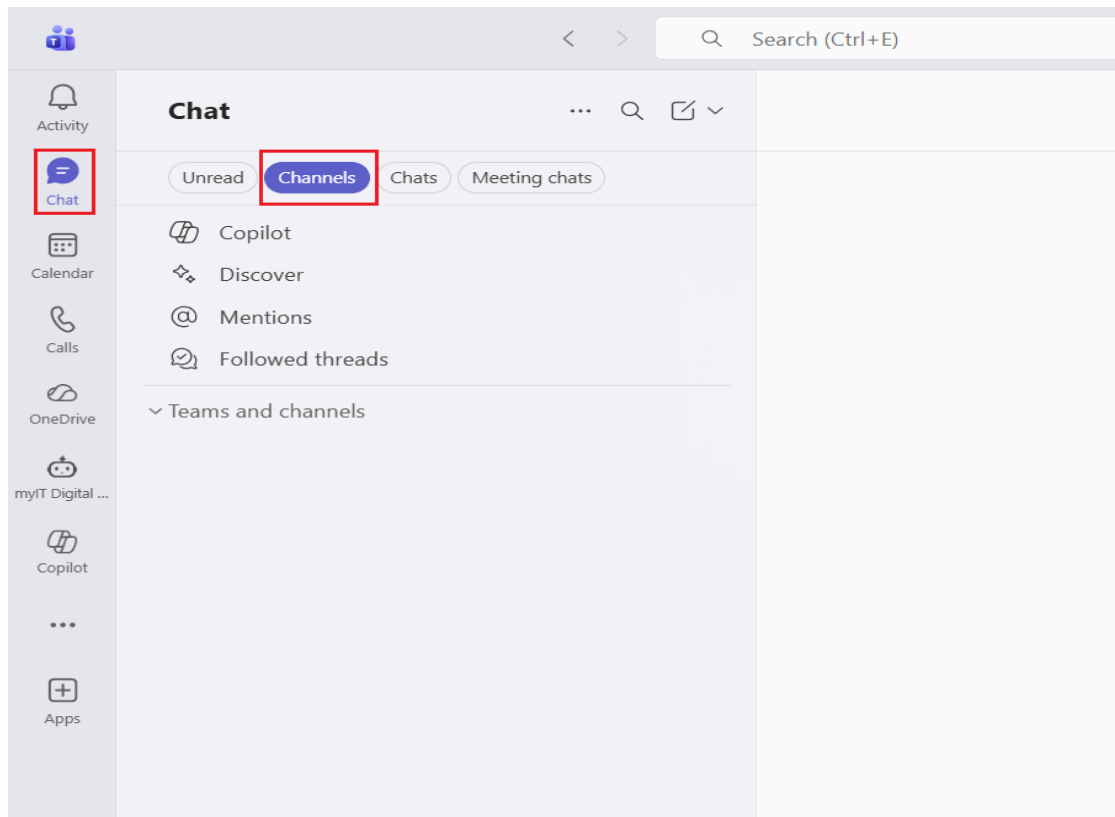


Figure 11: Accessing channel conversations via the 'Channels' tab in Microsoft Teams.

3. Select either Create a new team or Join an existing team.

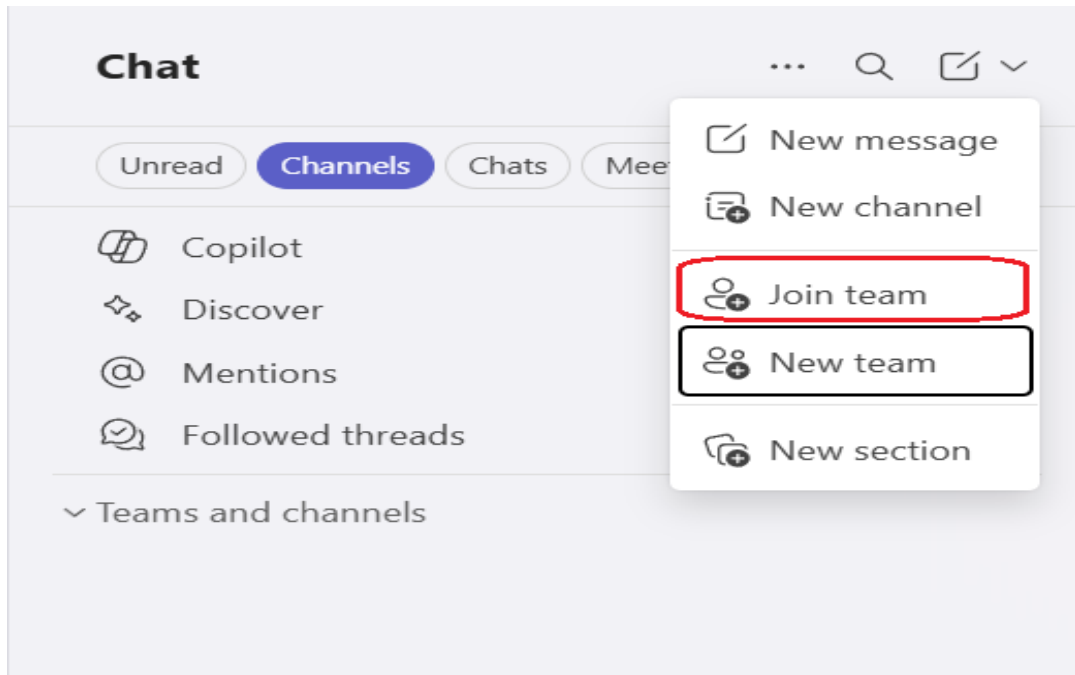


Figure 12: Create a new team or join an existing team.

4. Set the privacy (Private or Public), provide a team name, and optionally add a description.
5. Specify the first channel name, as each team starts with a default channel during creation.

Create a team

You're creating a team from scratch. [More create team options](#)

Team name *

WinCC OA Alert Team

Description

Let people know what this team is all about

Team type and sensitivity



Private

C1 - Restricted

First channel name * ⓘ

First WinCC OA Alert Channel

[What's a team?](#)

Cancel

Create

Figure 13: Enter team details and click Create to finish setup

6. Click Create to finalize the team and first channel setup.

• Creating a New Channel

1. Navigate to the desired team, click the More options (...) next to the team name, and select Add channel.

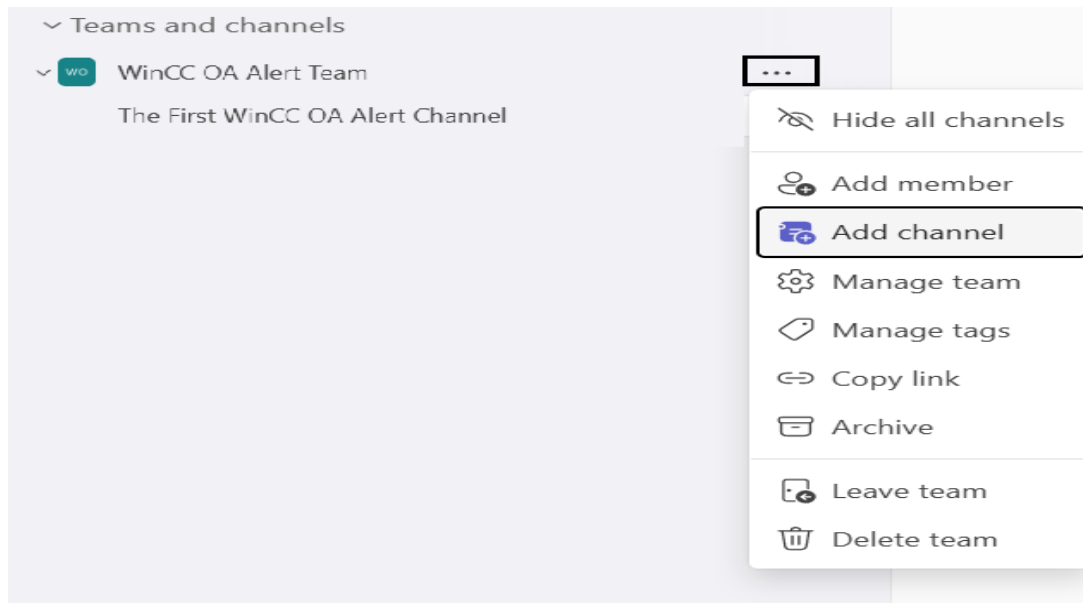


Figure 14: Select 'Add channel' from the team options to create another channel.

2. Enter a channel name and, optionally, a description.
3. Choose the channel type: Standard (accessible to all team members) or Private (restricted to selected members).
4. Click Add to create the channel.

2.2.2. Configuring Workflows App for Sending Alerts to a Chat

Open the Workflows app → Templates → Select or enter the group chat to which you want to send alerts.

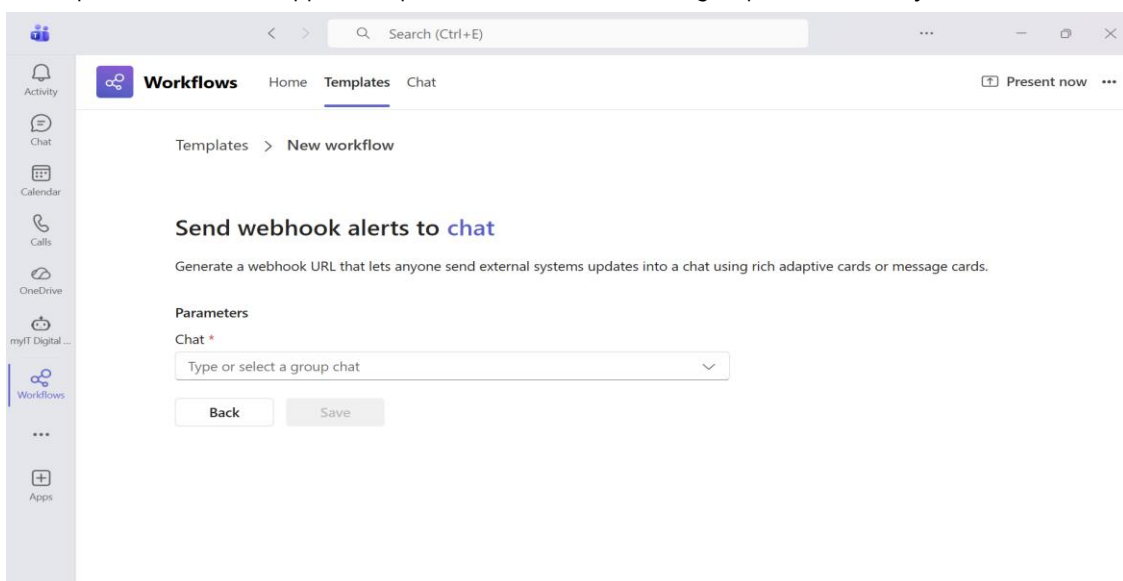


Figure 15: Select the chat for webhook alerts.

1. Click Save.
2. Copy the webhook link provided.

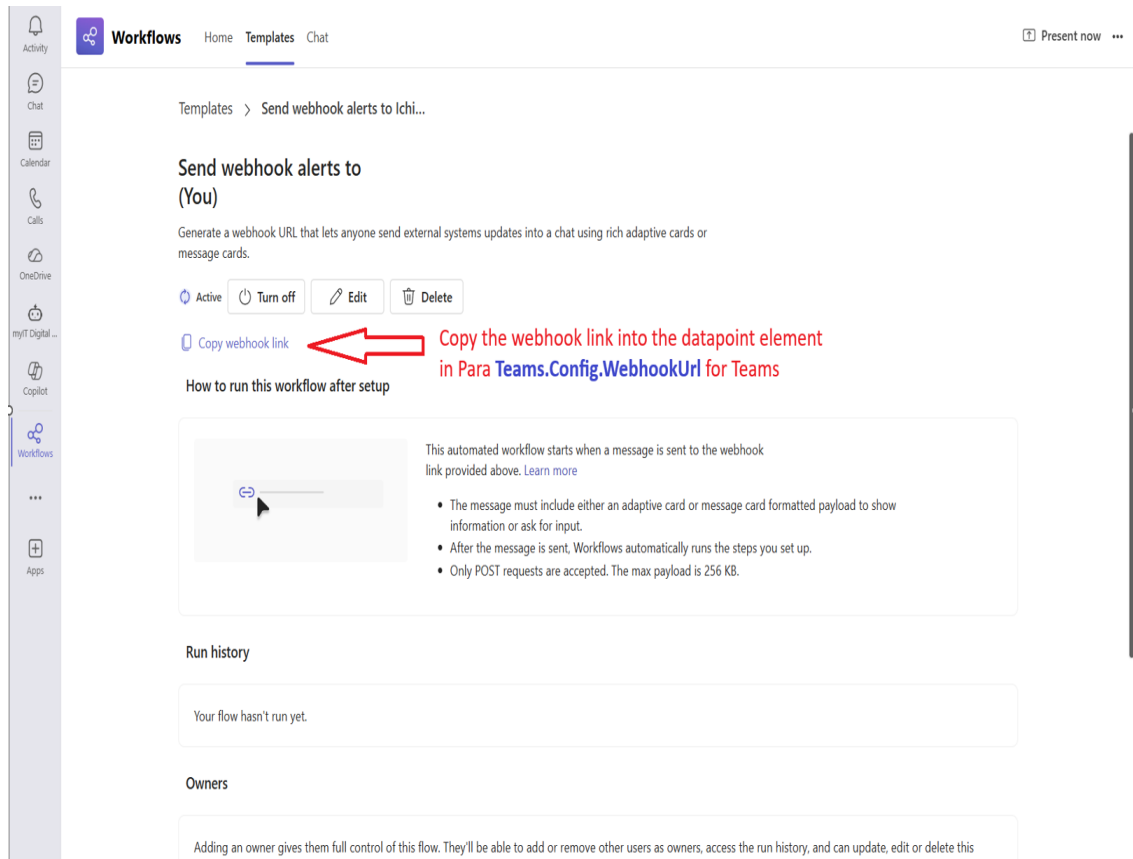


Figure 16: Copy the webhook URL.

3. In your WinCC OA project, paste the link into the Teams.config.WebhookUrl datapoint in the PARA module

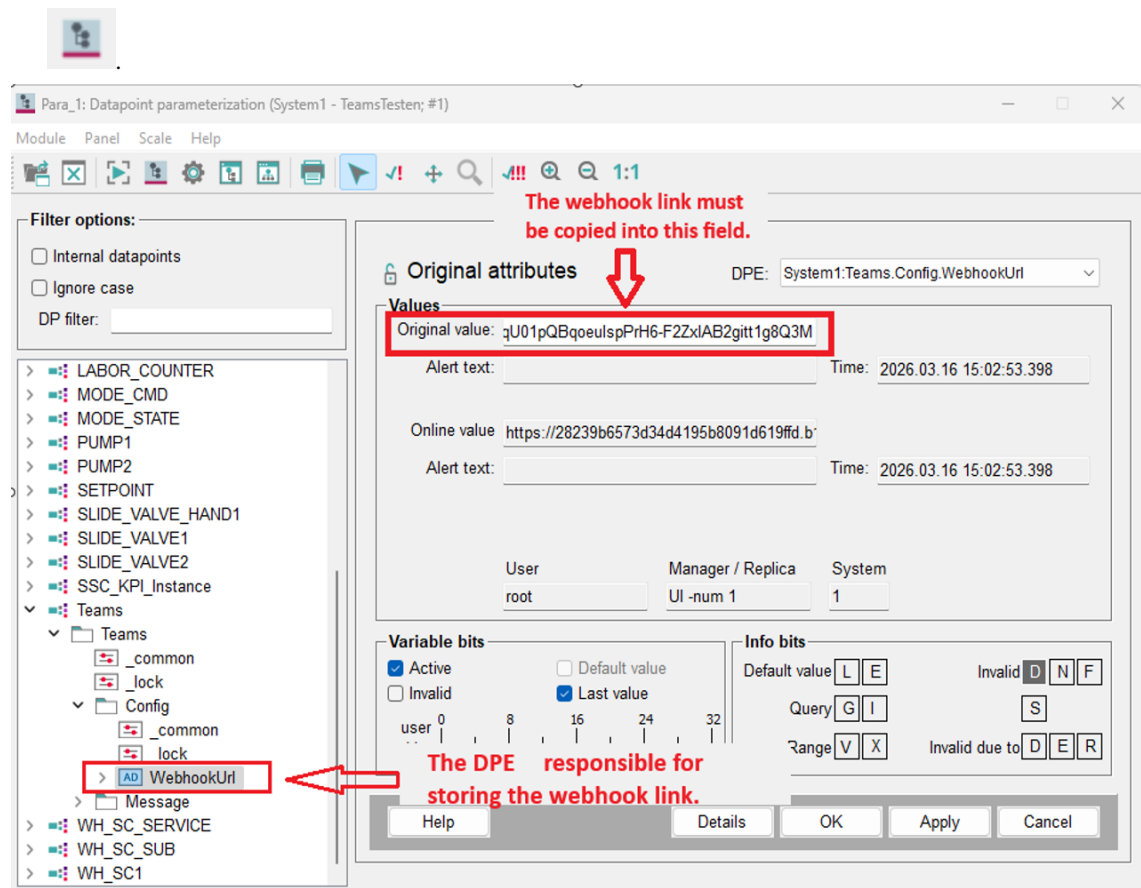


Figure 17: Paste the webhook URL into the WebhookUrl DPE.

2.2.3. Configuring Workflows App for Sending Webhook Alerts to a Channel

- 2) Select the desired channel in the workflow template and click Save.

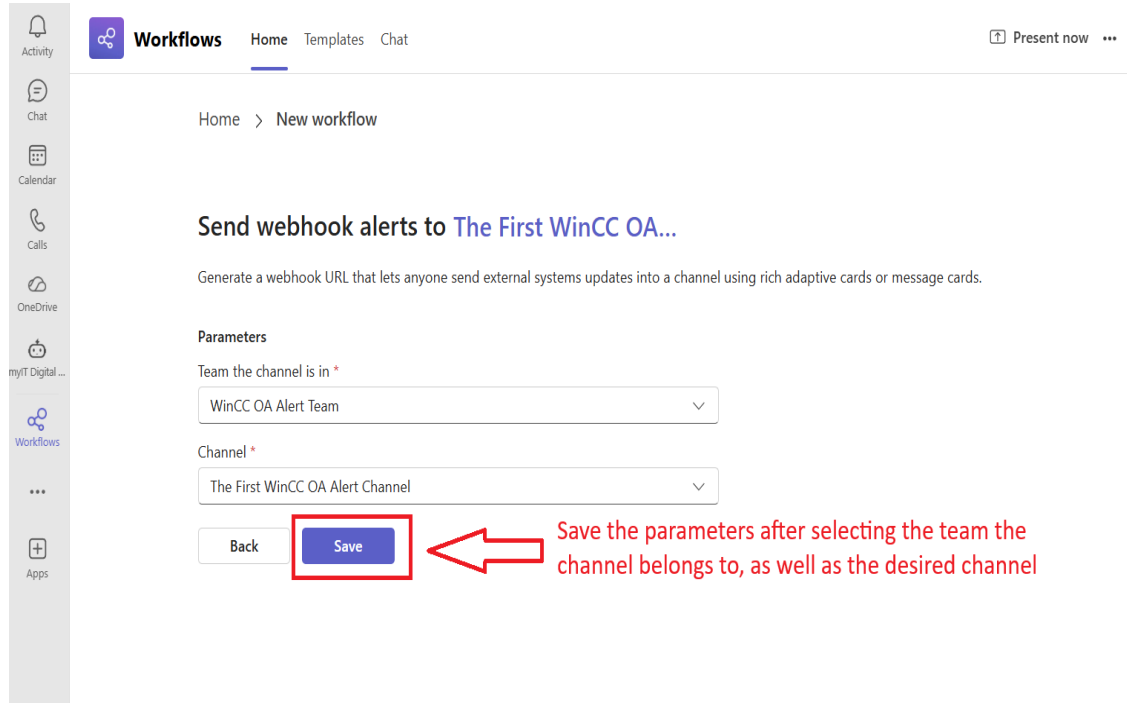


Figure 18: Select the team and channel, then click Save

1. Copy the webhook link provided.
2. Open the Para panel in WinCC OA. Paste the link into the Teams.config.WebhookUrl DP.
3. Click Apply to save the configuration in the PARA Module, as we did previously in 2.1.6.4

Once configured, WinCC OA can send messages directly to the selected Teams chat or channel via Power Automate Workflows App.

2.3. Testing with the WinCC OA Example Panel (teams.pnl)

This example shows how to send a message from **WinCC OA** to a **Microsoft Teams channel** using a panel interface and a JavaScript Manager. The user enters a title and message, selects a color, and sends it via a webhook, where it is displayed in Teams.

1. In the WinCC OA Console:
Add and start a new JavaScript Manager with the options: "TeamsIntegration/index.js".

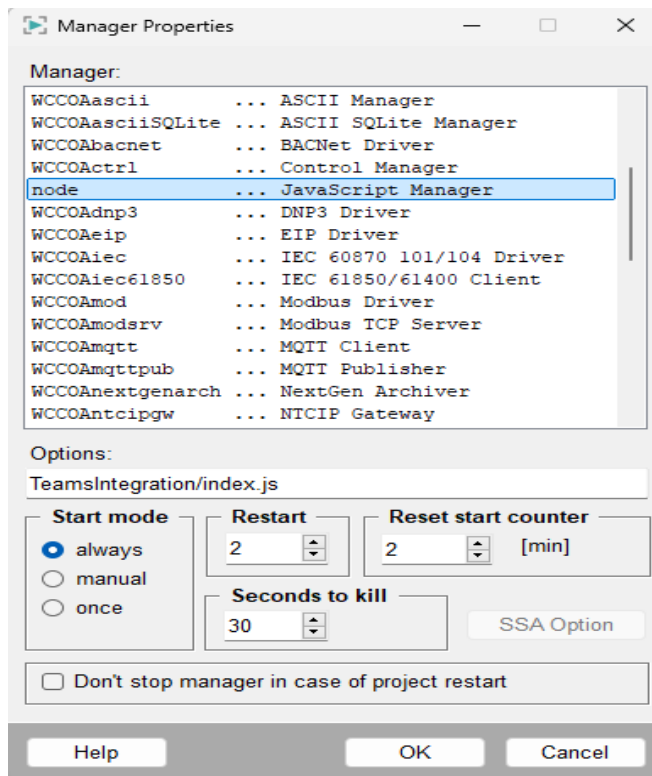


Figure 19: JavaScript Manager running TeamsIntegration/index.js

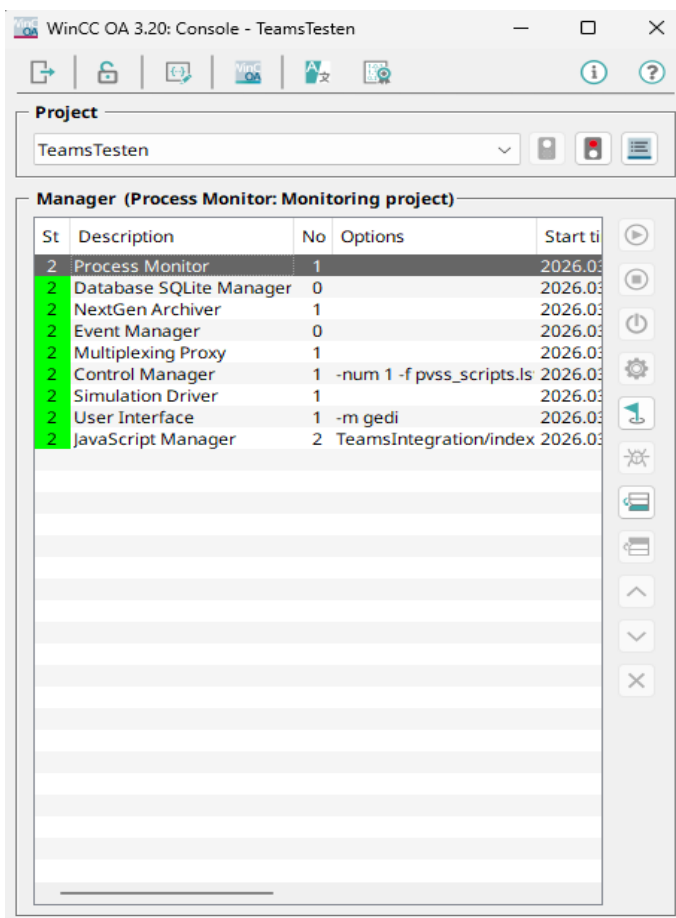


Figure 20: JavaScript Manager successfully started with TeamsIntegration/index.js.

2. Run the project using the start button in the Project Administrator  In the GEDI open the “teams.pnl” panel from the subproject.

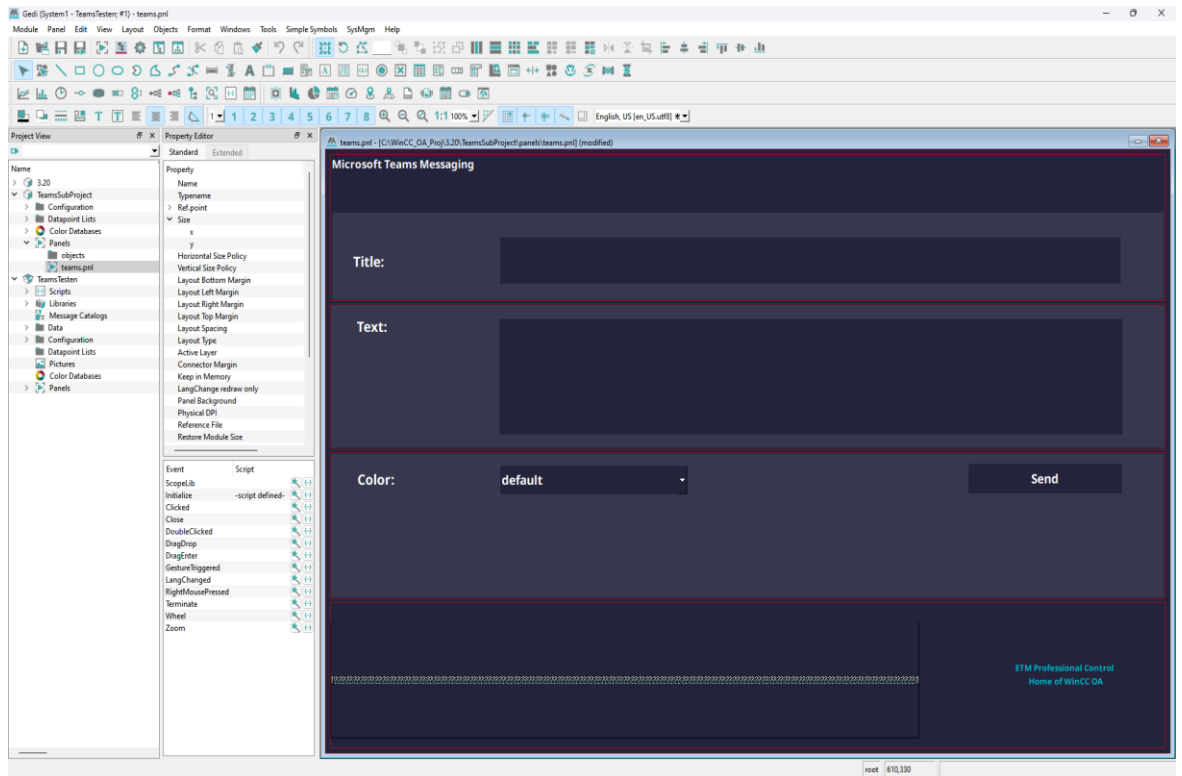


Figure 21: WinCC OA Teams messaging panel

3. After opening the “teams.pnl”, run it using the following icon in GEDI  (Save and run in QuickTest).

Note: No need to save the panel in the project when trying to run it.

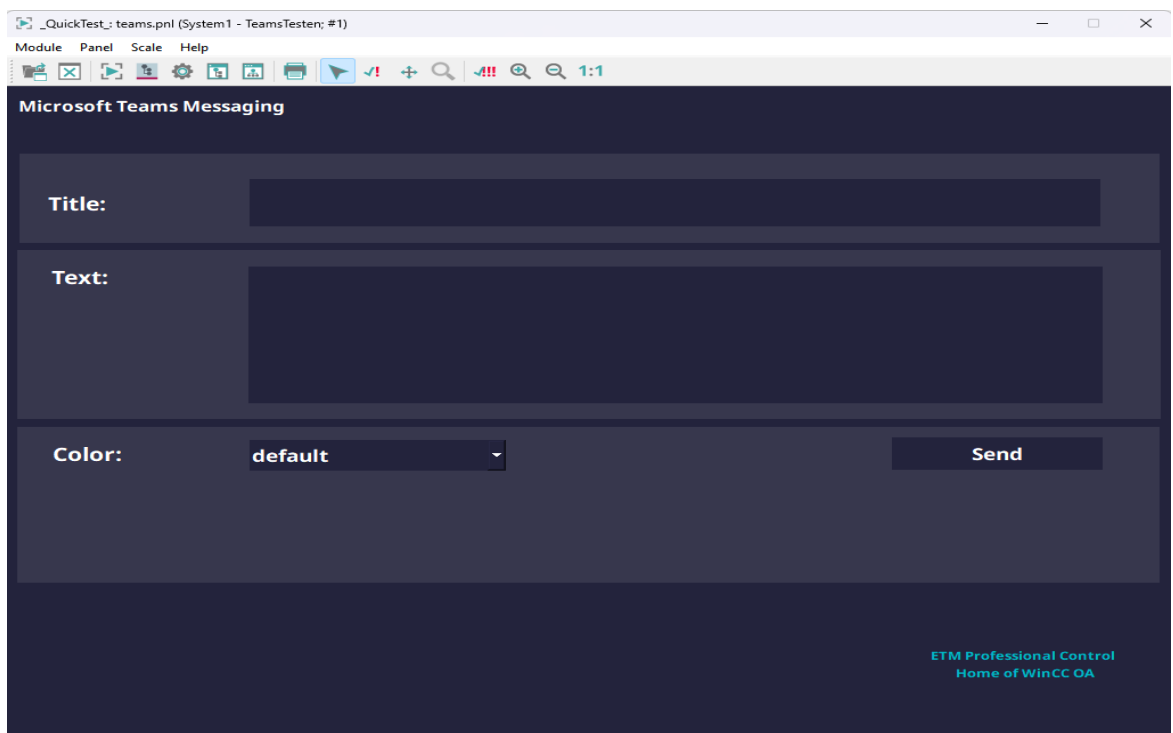


Figure 22: Starting “teams.pnl” Panel

- Write the title and the text in the appropriate fields and press the Enter key.
- Select the desired color for the title.

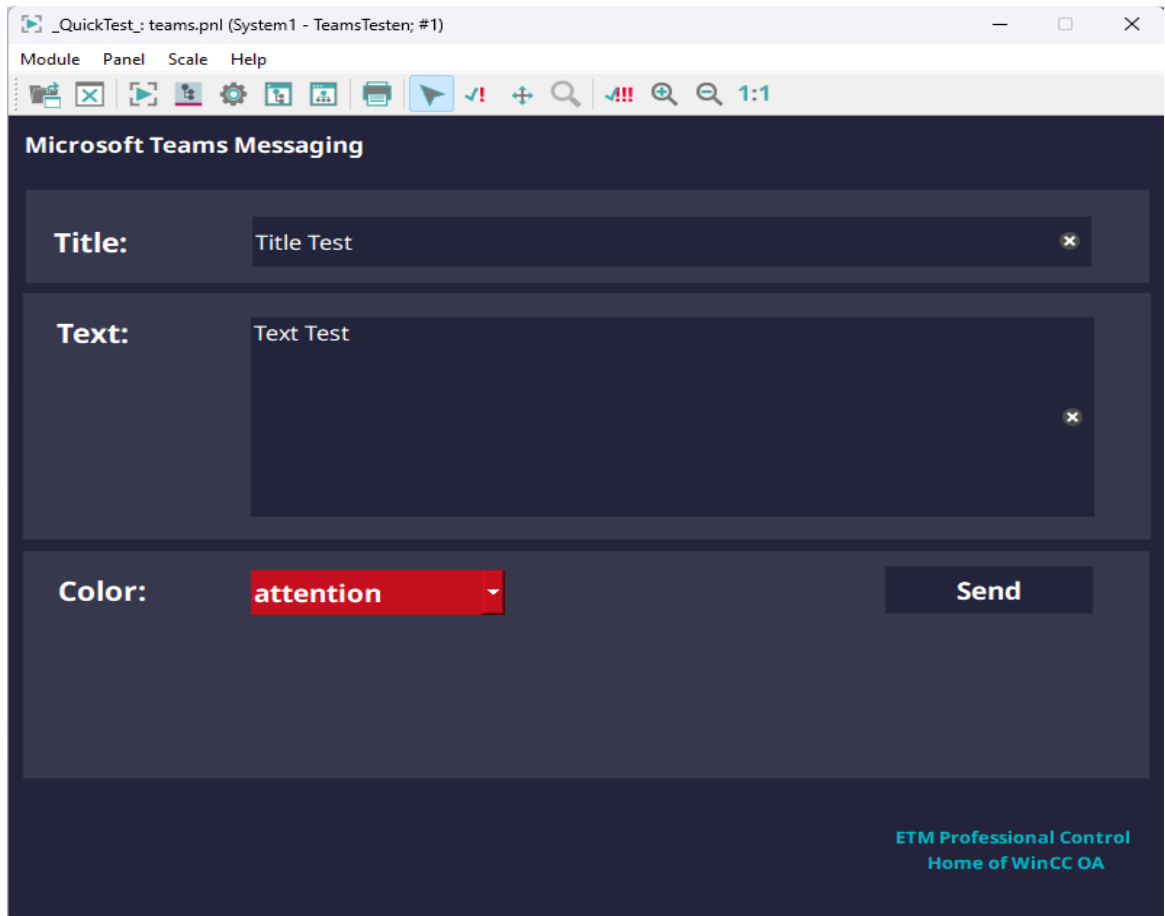


Figure 23: Example message.

- Click Send.

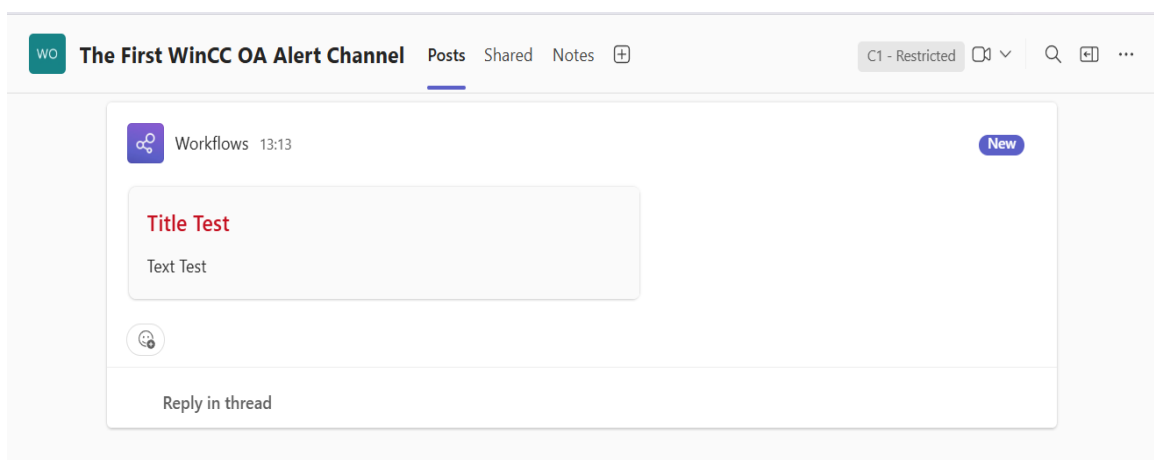


Figure 24: Teams channel showing the posted alert message.

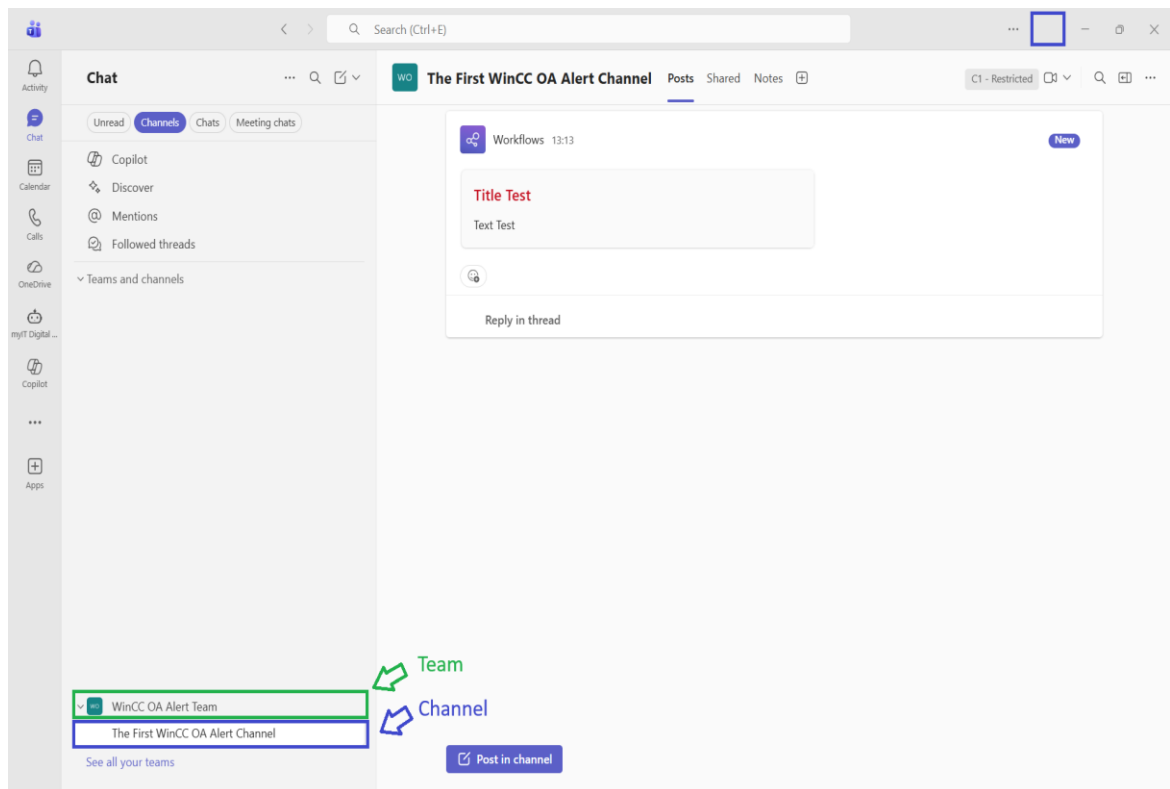


Figure 25: Message posted to the chosen Teams channel.

- If the title or text is missing, the send operation is skipped. The message is not sent—even if the send button is pressed—and a notification is logged in the Log Viewer (see figure below).

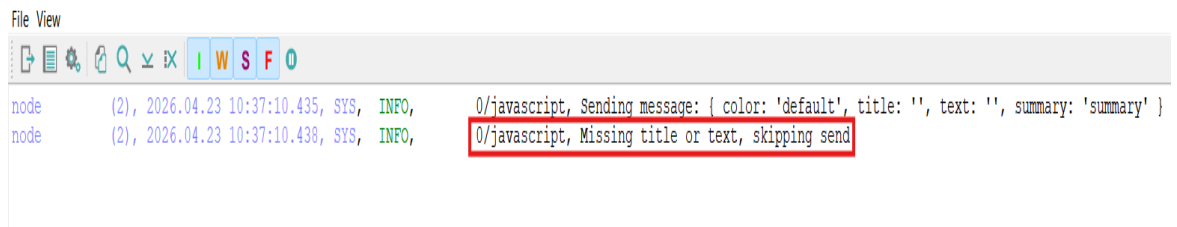


Figure 26: Log Viewer indicating skipped send due to missing title or text

- Five predefined message colors can be selected from the combobox, named as follows:
(default, accent, good, warning, attention)

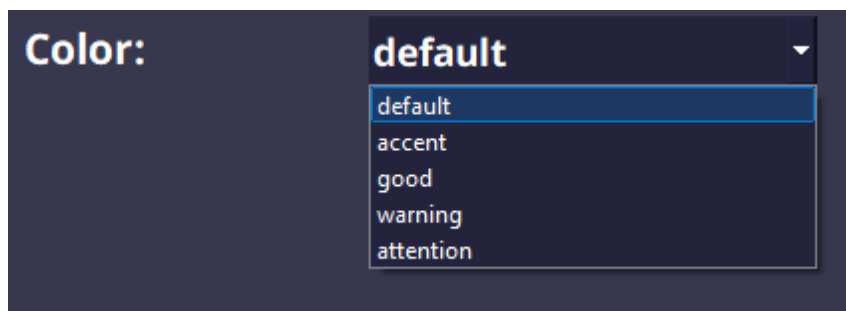


Figure 27: Message color selection options.

- Each of these names maps to a predefined color in the *TeamsColors* colorDB, as shown below.

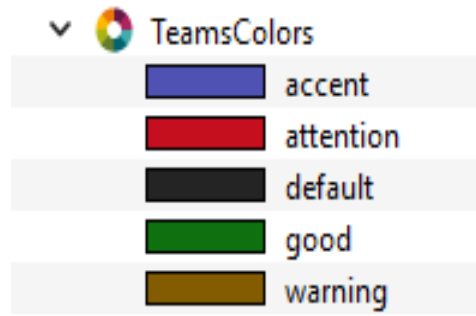


Figure 28: TeamsColors colorDB with predefined message styles

3. Appendix

Important WinCC OA specific abbreviations

Acronym	Long form	Meaning
WinCC OA	Simatic WinCC Open Architecture	A SCADA system for visualizing and operating of processes, production flows, machines and plants in all lines of business. Distributed systems enable any number of stand-alone systems, from 2 to 2048, to be linked via a network.

		Each subsystem can be configured either as a single-user or multi-user system, redundant or not, in each case.
DPT	Data point type	Object definition (class) of a structured data object as mapping of a real device. Single data points (instances) are derived from the DPT. Therefore, the data point type is a form of template.
DP	Data point	Structured, device-oriented data object as representation of a real device within the control system. A data point contains one or more data point elements (process variables).
DPE	Data point element	Single process information within a device-oriented data point. Each DPE corresponds to a value/state. In addition to the value, there are DPE attributes like time stamp, quality information or origin.
GEDI	Graphic Editor GEDI	Graphic Editor. It is used both for drawing of process images ("panels") as well as for designing of symbols, dialogs, and scripting.
PARA	Configuration Tool	Editor for the creation and configuration of data point types, data points, and data point elements as well as their configs.
ASCII	American Standard Code for Information Interchange	Standardized protocol for storage and transfer of characters/text. In WinCC OA, the acronym also refers to the database import/export manager. It is a module to export and import configurations as ASCII files. Mass configuration can therefore be carried out in a spread sheet program (for example MS Excel), file editor, or in an external database.
D	Driver Manager ("Driver")	Interface for connecting controllers (PLC, DDC, ...) fieldbuses and telecontrol systems. A driver handles the communication via an external protocol and enables the exchange of information with WinCC OA. The processing of data from the "field" to WinCC OA contains event orientation, old/new comparison, transformation, conversion, and smoothing. The protocol of the Driver must be the same as the protocol of the "field" device. Furthermore, the connection (how to reach the device) must be configured in WinCC OA. For exchanging data, a periphery address must be configured on a corresponding DPE.
UNS	Unified Name Space	UNS (Unified Namespace) is a central, real-time data architecture that serves as a single source of truth for all data in an industrial or enterprise environment. It organizes and exposes data from various systems (e.g., PLCs, SCADA, MES, ERP) in a standardized, hierarchical structure, often using MQTT and Sparkplug B.
CNS	Common Name Service CNS	The plantmodel editor can be used for building and modifying data structures such as views and trees based on CNS and use them within projects easily.
CTRL	Control Manager ("Scripting")	Processing unit that allows to process user specific logic / business logic (control scripts). Control possesses an easy to learn syntax (similar to ANSI-C) and is processed by an interpreter (CTRL Manager).

Table 3-1 WinCC OA specific abbreviations

Service and support

WinCC OA Extended Services

Do you have questions about WinCC OA projects, need additional features, or require technical assistance? ETM provides 24/7 access to our complete service and support expertise for WinCC OA.

Our range of services includes the following:

- Extended Services provide tailored support for your evolving needs
- All kind of analysis/troubleshooting for older WinCC OA versions than our current mainline
- Project startup workshop
- Architecture definition
- Project engineering assistance with dedicated contact person
- Special project developments (special requirements, web widgets, gateways, etc.)
- WinCC OA library development assistance
- Project or architecture reviews with report
- Project-specific problem or performance analysis
- Project upgrade (analysis with report, assistance during upgrade, etc.)
- Assistance for complex error reproduction scenarios
- On-site assistance for any tasks related to WinCC OA and their components
- 24/7 on-duty assistance or priority callback for certain time range
- Database support Oracle®, InfluxDB®, PostgreSQL® and MS SQL®
- Raima/HDB to SQLite/NGA migration
- Setup and consulting for WinCC OA Add-ons e.g., APM, AMS, DRS, ...
- WinCC OA Security services (as per the WinCC OA Security Guideline, NIS2)
- Tests on unsupported platforms (e.g., unsupported OS)
- Individual Workshops (driver workshop, UI workshop, business logic, etc.)
- Factory Acceptance Test (FAT)/Site Acceptance Test (SAT) assistance
- Creating of prototypes, proof of concepts, demos, etc.
- Project tender analysis and evaluation of projects

You can find detailed information on our range of services in the service catalog web page:

www.winccoa.com/documentation/WinCCOA/latest/en_US/Support/topics/support_extendedServices.html

SiePortal

The integrated platform for product selection, purchasing and support - and connection of Industry Mall and Online support. The SiePortal home page replaces the previous home pages of the Industry Mall and the Online Support Portal and combines them.

- **Products & Services**
In Products & Services, you can find all our offerings as previously available in Mall Catalog.
- **Support**
In Support, you can find all information helpful for resolving technical issues with our products.
- **mySieportal**
mySiePortal collects all your personal data and processes, from your account to current orders, service requests and more. You can only see the full range of functions here after you have logged in.

You can access SiePortal via this address:

sieportal.siemens.com

Technical Support

The Technical Support of Siemens Industry provides you fast and competent support regarding all technical queries with numerous tailor-made offers.

– ranging from basic support to individual support contracts. Please send queries to Technical Support via Web form:

siemens.com/SupportRequest

WinCC OA – Training and Certification

To fully leverage the flexibility and openness of WinCC OA, we offer a wide range of training courses, from beginner to expert levels. Our modules cover various topics, with options for individual training. For WinCC OA partners, completing specific courses is required to obtain or maintain partner status, ensuring the highest level of expertise and support.

For more information on our offered trainings and courses, as well as their locations and dates, refer to our web page:

www.winccoa.com/support/training.html

Change documentation

Version	Date	Modifications
V1.0	4/2026	First version

Table 3-2 Change Documentation

Published by
Siemens AG
DI FA HMI ISW ETM

Marktstrasse 3
7000 Eisenstadt
Austria

E-mail: wincc_oa.at@siemens.com

Web: www.siemens.com/wincc-open-architecure

For the U.S. published by
Siemens Industry Inc

100 Technology Drive
Alpharetta, GA 30005
United States

Subject to changes and errors. The information given in this document only contains general descriptions and/or performance features which may not always specifically reflect those described, or which may undergo modification in the course of further development of the products. The requested performance features are binding only when they are expressly agreed upon in the concluded contract.