



APPLICATION EXAMPLE

Integration and Usage of the WinCC OA Telegram Bot Library

SIMATIC WinCC Open Architecture

Legal information

Use of application examples

Application examples illustrate the solution of automation tasks through an interaction of several components in the form of text, graphics, and/or software modules. The application examples are a free service by Siemens AG and/or a subsidiary of Siemens AG ("Siemens"). They are non-binding and make no claim to completeness or functionality regarding configuration and equipment. The application examples merely offer help with typical tasks; they do not constitute customer-specific solutions. You yourself are responsible for the proper and safe operation of the products in accordance with applicable regulations and must also check the function of the respective application example and customize it for your system. Siemens grants you the non-exclusive, non-sublicensable and non-transferable right to have the application examples used by technically trained personnel. Any change to the application examples is your responsibility. Sharing the application examples with third parties or copying the application examples or excerpts thereof is permitted only in combination with your own products. The application examples are not required to undergo the customary tests and quality inspections of a chargeable product; they may have functional and performance defects as well as errors. It is your responsibility to use them in such a manner that any malfunctions that may occur do not result in property damage or injury to persons.

Disclaimer of liability

Siemens shall not assume any liability, for any legal reason whatsoever, including, without limitation, liability for the usability, availability, completeness, and freedom from defects of the application examples as well as for related information, configuration and performance data and any damage caused thereby. This shall not apply in cases of mandatory liability, for example under the German Product Liability Act, or in cases of intent, gross negligence, or culpable loss of life, bodily injury or damage to health, non-compliance with a guarantee, fraudulent non-disclosure of a defect, or culpable breach of material contractual obligations. Claims for damages arising from a breach of material contractual obligations shall however be limited to the foreseeable damage typical of the type of agreement, unless liability arises from intent or gross negligence or is based on loss of life, bodily injury, or damage to health. The foregoing provisions do not imply any change in the burden of proof to your detriment. You shall indemnify Siemens against existing or future claims of third parties in this connection except where Siemens is mandatorily liable.

By using the application examples you acknowledge that Siemens cannot be held liable for any damage beyond the liability provisions described.

Other information

Siemens reserves the right to make changes to the application examples at any time without notice. In case of discrepancies between the suggestions in the application examples and other Siemens publications such as catalogs, the content of the other documentation shall have precedence. The Siemens terms of use (<https://support.industry.siemens.com>) shall also apply.

Security information

Siemens provides products and solutions with industrial cybersecurity functions that support the secure operation of plants, systems, machines and networks.

In order to protect plants, systems, machines and networks against cyber threats, it is necessary to implement – and continuously maintain – a holistic, state-of-the-art industrial cybersecurity concept. Siemens' products and solutions constitute one element of such a concept.

Customers are responsible for preventing unauthorized access to their plants, systems, machines and networks. Such systems, machines and components should only be connected to an enterprise network or the internet if and to the extent such a connection is necessary and only when appropriate security measures (e.g. firewalls and/or network segmentation) are in place.

For additional information on industrial cybersecurity measures that may be implemented, please visit www.siemens.com/cybersecurity-industry.

Siemens' products and solutions undergo continuous development to make them more secure. Siemens strongly recommends that product updates are applied as soon as they are available and that the latest product versions are used. Use of product versions that are no longer supported, and failure to apply the latest updates may increase customer's exposure to cyber threats.

To stay informed about product updates, subscribe to the Siemens Industrial Cybersecurity RSS Feed under <https://www.siemens.com/cert>.

Telegram data transfer and data protection

Important: This application example transfers configured WinCC OA data to Telegram, a third-party cloud service outside the Siemens-controlled infrastructure. Telegram is responsible for the transport, processing, storage and deletion of data within the Telegram service. Siemens does not control Telegram's infrastructure, data processing locations or retention policies.

Communication between this library and the Telegram Bot API uses HTTPS/TLS. Therefore, the transport is encrypted and is not clear-text communication. However, Telegram Bot API communication is not end-to-end encrypted. Telegram can process the transmitted message content on its servers.

Do not transmit personal data, credentials, confidential information, sensitive process data, safety-related information or other protected information through this application example. Only explicitly approved, non-sensitive data point elements and alarms may be configured for Telegram transmission.

Before using this application example, the operator must perform a security and data protection assessment, establish an appropriate legal basis, apply data minimization, define retention and deletion procedures, and ensure that requests for access or erasure can be fulfilled. Particular attention must be paid to the principles of Privacy by Default and the Right to Erasure.

For additional information, refer to the current EU_GDPR_WinCC_OA.pdf, the Telegram Privacy Policy at <https://telegram.org/privacy> and the Telegram Bot API documentation at <https://core.telegram.org/bots/api>.

This application example is not intended for direct use in a production environment without an individual security and data protection assessment.

Third-Party Software Information

Note to Resellers: Please pass on this document to your customer to avoid license infringements.

This product, solution or service ("Product") contains third-party software components listed in this document. These components are Open Source Software licensed under a license approved by the Open Source Initiative (www.opensource.org) or similar licenses as determined by SIEMENS ("OSS") and/or commercial or freeware software components. With respect to the OSS components, the applicable OSS license conditions prevail over any other terms and conditions covering the Product. The OSS portions of this Product are provided royalty-free and can be used at no charge.

If SIEMENS has combined or linked certain components of the Product with/to OSS components licensed under the GNU LGPL version 2 or later as per the definition of the applicable license, and if use of the corresponding object file is not unrestricted ("LGPL Licensed Module", whereas the LGPL Licensed Module and the components that the LGPL Licensed Module is combined with or linked to is the "Combined Product"), the following additional rights apply, if the relevant LGPL license criteria are met: (i) you are entitled to modify the Combined Product for your own use, including but not limited to the right to modify the Combined Product to relink modified versions of the LGPL Licensed Module, and (ii) you may reverse-engineer the Combined Product, but only to debug your modifications. The modification right does not include the right to distribute such modifications and you shall maintain in confidence any information resulting from such reverse-engineering of a Combined Product.

Certain OSS licenses require SIEMENS to make source code available, for example, the GNU General Public License, the GNU Lesser General Public License and the Mozilla Public License. If such licenses are applicable and this Product is not shipped with the required source code, a copy of this source code can be obtained by anyone in receipt of this information during the period required by the applicable OSS licenses by contacting the following address:

Siemens AG
LC TEC IT&SL
Werner-von-Siemens Str. 60
91052 Erlangen
Germany

Keyword: Open Source Request (please specify Product name and version, if applicable)

SIEMENS may charge a handling fee of up to 5 EUR to fulfil the request.

Warranty regarding further use of the Open Source Software

SIEMENS' warranty obligations are set forth in your agreement with SIEMENS. SIEMENS does not provide any warranty or technical support for this Product or any OSS components contained in it if they are modified or used in any manner not specified by SIEMENS. The license conditions listed below may contain disclaimers that apply between you and the respective licensor. For the avoidance of doubt, SIEMENS does not make any warranty commitment on behalf of or binding upon any third party licensor.

Open Source Software and/or other third-party software contained in this Product:

Please note the following license conditions and copyright notices applicable to Open Source Software and/or other components (or parts thereof):

Component	Open Source Software [Yes/No]	Acknowledgements/Comment	License conditions and copyright notices
node-telegram-bot-api 2.1.0	Yes	MIT	node-telegram-bot-api/LICENSE.md at master · yagop/node-telegram-bot-api · GitHub
puppeteer 25.11.0	Yes	Apache	puppeteer/LICENSE at main · puppeteer/puppeteer · GitHub

Chart.js v4.5.1	Yes	MIT	Chart.js/LICENSE.md at master · chartjs/Chart.js · GitHub
--------------------	-----	-----	---

Table 0-1 OSS Packages

Contents

Legal information	2
Third-Party Software Information	4
1. Introduction	6
1.1. Overview	6
1.2. Components used	6
1.3. Requirements	6
2. Engineering	7
2.1. Project integration	7
2.2. Operation	15
3. Usage example	23
4. Appendix	24
Important WinCC OA specific abbreviations	24
Service and support	26
Change documentation	27

1. Introduction

1.1. Overview

This document describes the integration of the WinCC OA Telegram Bot Library within WinCC OA projects. The library enables real-time communication, allowing users to receive alerts, monitor trends, access current values, and manipulate predefined variable tags directly through Telegram mobile application.

The integration sends configured WinCC OA data to an external Telegram service. Before continuing, read the “Telegram data transfer and data protection” section in the Legal information chapter.

1.2. Components used

This application example has been created with the following hard- and software components:

Component	Number	Article number
WinCC OA 3.20 Server Basis	1	6AV6355-1AA50-0BA0
WinCC OA V3.20, Para Standard	1	6AV6355-1AA50-0CH0

Table 1-1 WinCC OA Licenses

You can purchase these components from the [Siemens Industry Mall](#).

1.3. Requirements

- Installed WinCC OA version 3.20
- Installed WinCC OA JavaScript Manager for Node.js [WinCC OA JavaScript Manager for Node.js](#)
- Node.js 26.9.0
- npm 12.0.2

This application example consists of the following components:

Component	File name	Note
Manual	WinCCOATelegramBotAppExample.pdf	This document
Example Project WinCC OA	WinCCOATgBotExample.zip	Pre-configured project for testing the example in WinCC OA
Subproject WinCC OA (the bot library)	tgbotlib.zip	Subproject for WinCC OA

Table 1-2 Application Example Parts

2. Engineering

2.1. Project integration

2.1.1. System requirements

- WinCC OA Version 3.20 P1 or higher installation and license (incl. Para)
- Minimal system requirements for WinCC OA (see [WinCC OA Documentation](#))

2.1.2. Installation WinCC OA

To carry out the installation of WinCC OA, please follow the steps in the WinCC OA documentation. You can find the documentation under following link: [Installation of WinCC OA](#)

2.1.3. Preparation

Unpack the supplied ZIP archive "tgbotlib.zip" into the folder where the project is to be created. The ZIP-archive contains the folder: tgbotlib: The Telegram Bot subproject

2.1.4. Creating a WinCC OA Project

To use the telegram bot application example, you need to first create a standard WinCC OA project. Steps from online documentation [Create project](#) can be followed. then include it in your project [Change project properties](#) (see "Include Subprojects" section).

2.1.5. Registration and integration of the Telegram Bot library as a WinCC OA subproject

1. In the WinCC OA Project Administrator click on  (see Figure 2-6) to register a new project. From the previously created folder in the section [2.1.3](#), select the folder "tgbotlib", deselect the checkbox "Runnable", and click on OK.

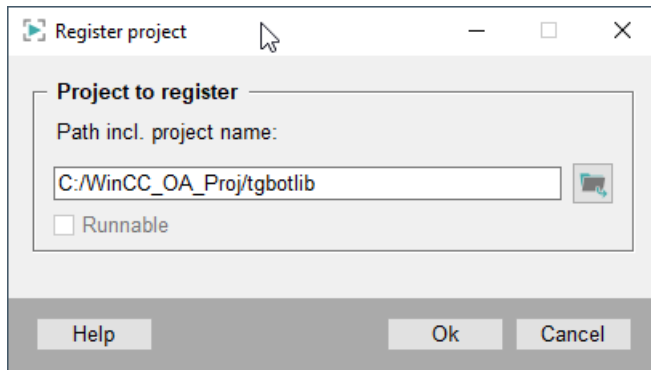


Figure 2-7 Project registration dialog

The subproject is now registered.

Attention: Subprojects (not runnable projects) do not appear in the WinCC OA Project Administrator!

2. To assign the registered subproject to your project, first select your project in the "Project

Administrator" panel, then click in the WinCC OA project administrator on  to open the project properties.

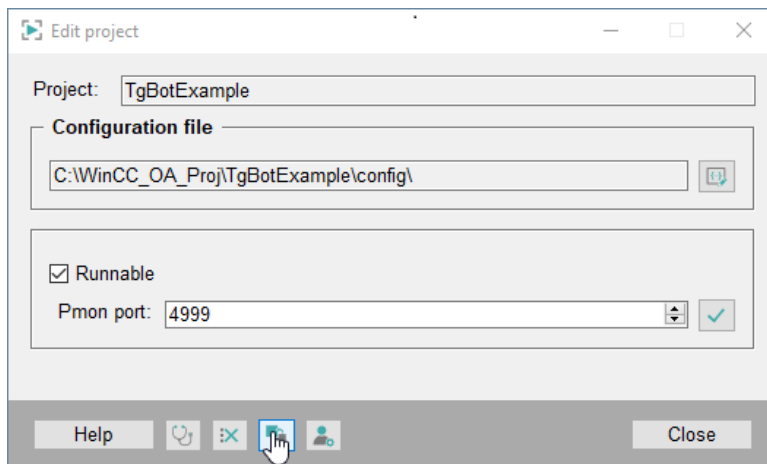


Figure 2-8 Project editing dialog

Now click on  to display the available subprojects.

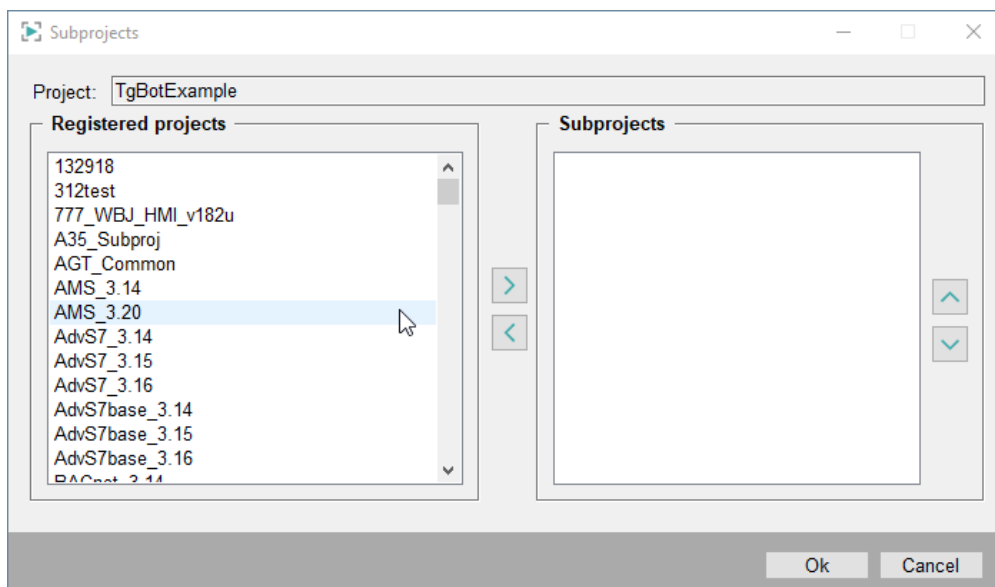


Figure 2-9 Manage subprojects

Select the subproject "tgbotlib" then move it by means of  to the right list

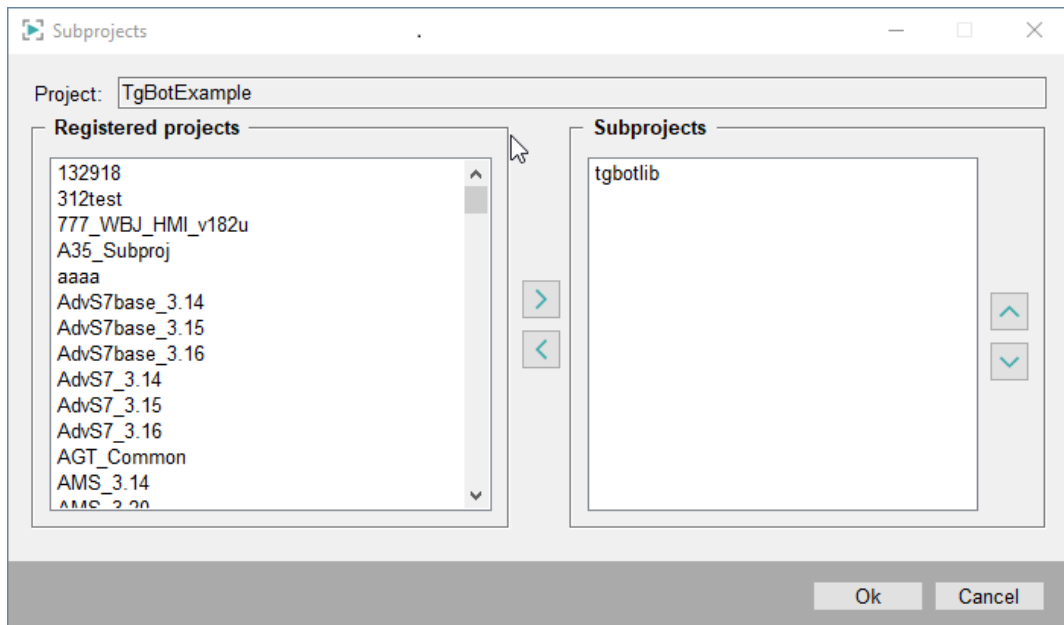


Figure 2-10 Include the subproject into your project

Click "OK" and "Close".

3. Be sure that this is the correct order of the project and subprojects in the config file of your project.

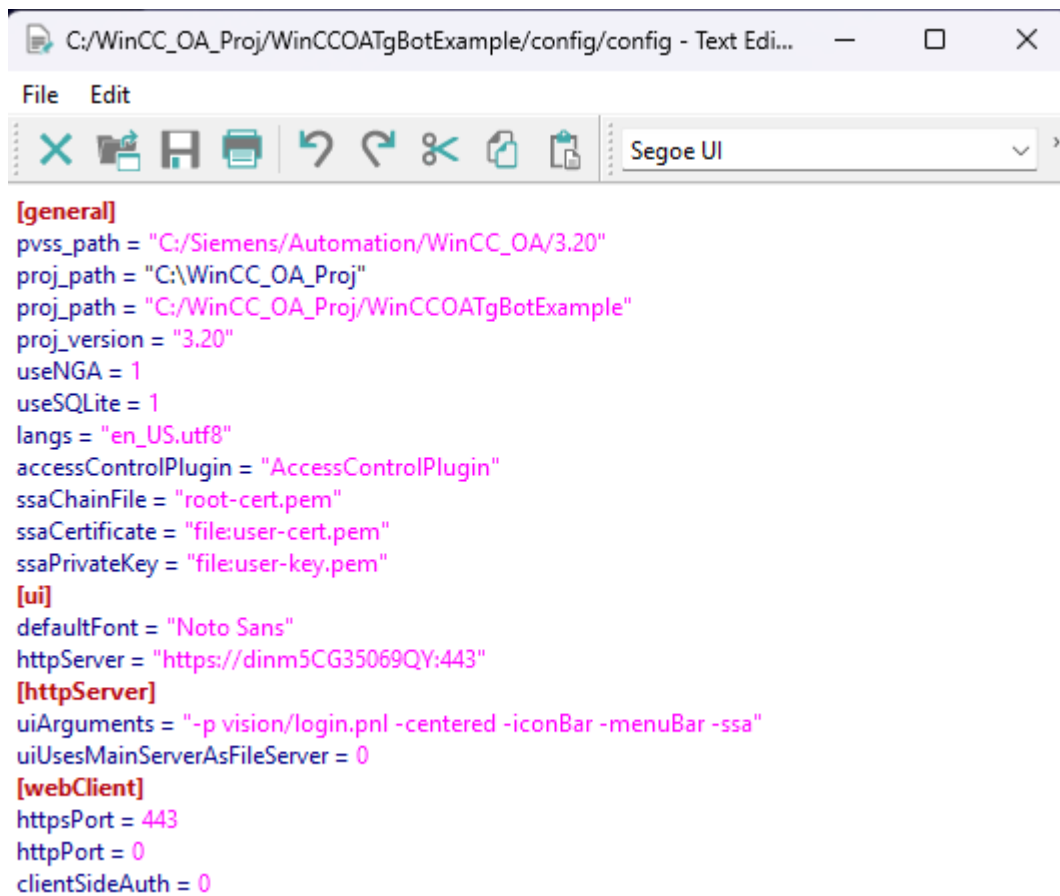


Figure 2-11 Project config file – Order of projects / subprojects

2.1.6. Setting up the Telegram Bot.

2.1.6.1. Telegram Bot Registration

Register and configure a new Telegram Bot for use with WinCC OA:

1. Open Telegram and Access the @BotFather bot:
 - Start a chat with the @BotFather bot, the official bot management interface in Telegram.
2. Create a New Bot:
 - Use the command `/newbot`.
 - Follow the instructions to assign a name and username to your bot.
 - Upon successful creation, you will receive a unique API Key. Copy (and save) this key, as it will be required for integration.
3. Adjust Privacy Settings:
 - Use the command `/setprivacy` in @BotFather.

- Set privacy to "Disable" to allow the bot to receive messages from both private and group chats.

2.1.6.2. Installation Dependencies

To install all dependencies powershell command "npm install" should be executed in the following subfolder path "tgbotlib\javascript" from the previously created folder in the section 2.1.3.

2.1.6.3. WinCC OA Configuration

1. Run the project using the start button in the Project Administrator 

In the GEDI open the ASCII manager.

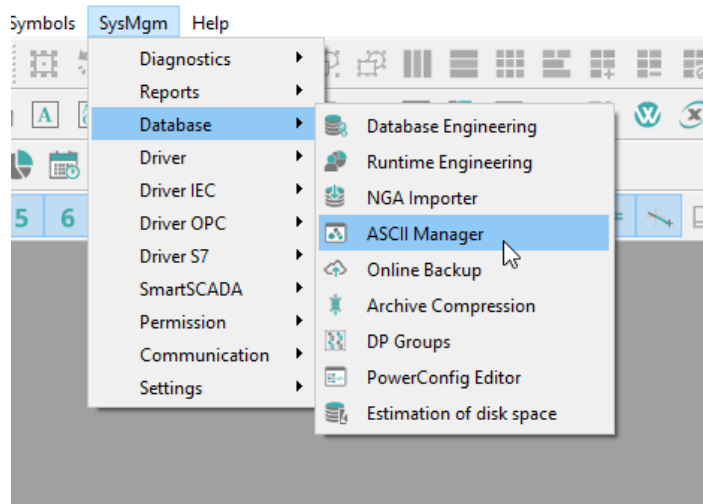


Figure 2-12 GEDI – ASCII Manager

2. Within the ASCII Manager Panel import "tgbot.dpl"

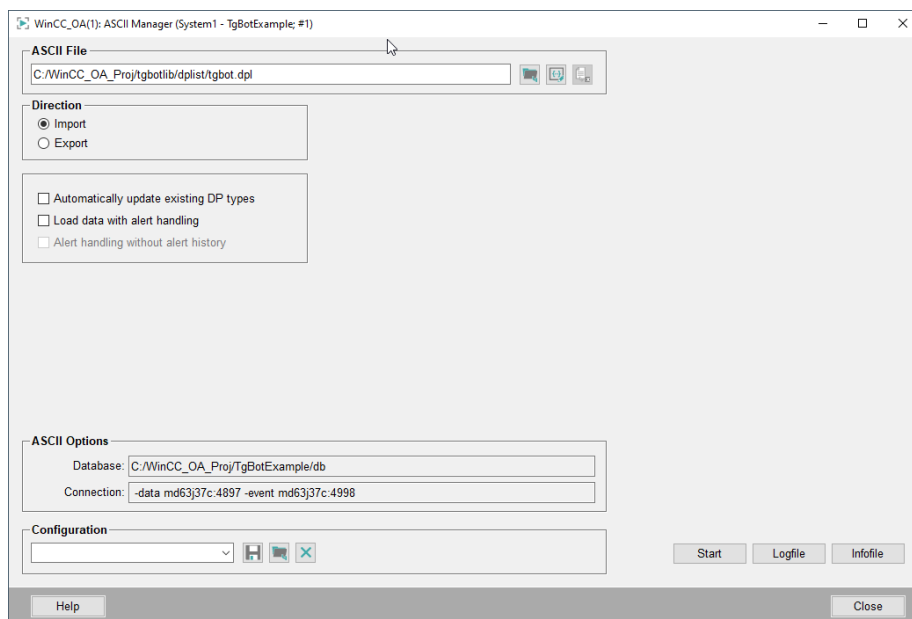


Figure 2-13 ASCII Manager Panel import

3. Open the panel "TgBotPanel.pnl" from "tgbotlib/Panels/" and run it using the following icon in GEDI



(Save and run in QuickTest).

Put the API key from [2.1.6.1](#) into the relevant field and press "Set API key"

Note: After restarting the panel the API key will not be shown, that it is not available for other users running the same panel (for security reasons). There is no need to enter it every time you open the panel, even if the field is empty.

Figure 2-14 TgBot Configuration

4. In the WinCC OA Console, add and start a new JavaScript Manager with the options: "tgbot/index.js".

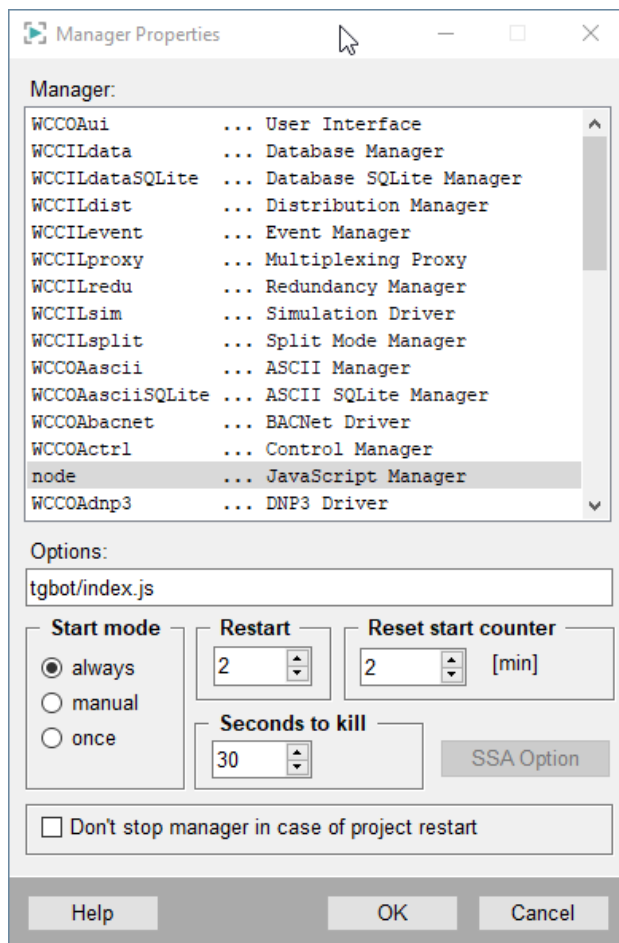


Figure 2-15 Add a new js Manager

2.2. Operation

1. Initiate Communication

- Start a chat with your bot in Telegram. Alternatively, create a new group and add the bot as a member.
- Note:
 - If the bot is added to a group, the corresponding Chat ID will be a negative value.
 - If the bot menu is not appearing and need to show it, send a message to the chat with `"/start"`

2. Link Users/Groups to Chat IDs:

- In the `"TgBotPanel.pnl"`, assign a user or user group to the Chat ID obtained from Telegram by clicking on `"Assign users/groups"` button.

This links the bot to the user or group in WinCC OA.

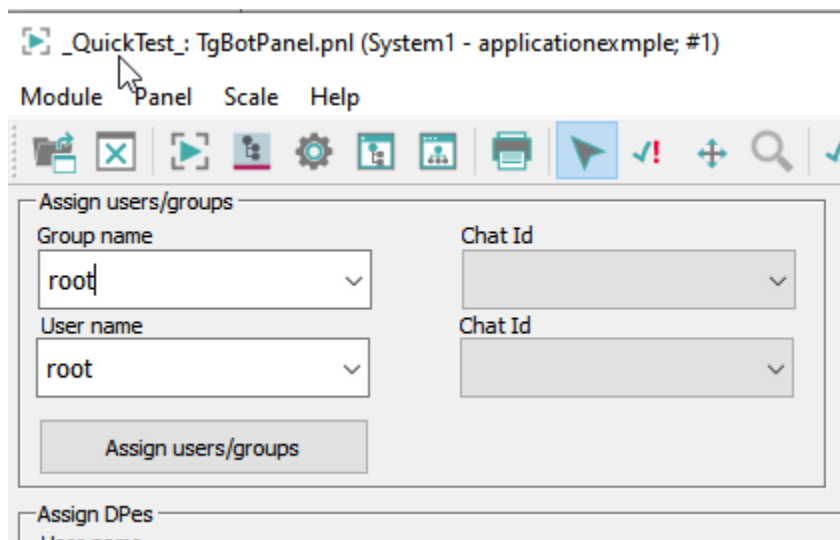


Figure 2-16 Binding users and groups names to chats ids

Notes:

- Only existing WinCC OA users and groups can be assigned to a chat ID.
- It is not allowed to use the same name for WinCC OA users and WinCC OA groups. E.g.: The `"User"` should not be `"root"` user and at the same time the `"Group"` should not be `"root"` group
- Each Telegram user or group interacting with the WinCC OA Telegram Bot is identified by a `"Chat ID"`. This ID is required to link the Telegram chats with specific users or groups in WinCC OA.

Through the `"TgBotPanel.pnl"` panel, administrators can assign Chat IDs to users or groups, enabling personalized access to system data and alarms. Once assigned, users can receive alarms, monitor trends, set data point values, and acknowledge alerts directly via Telegram.

That is why it is essential to avoid using identical names for users and groups to prevent conflicts.

2.2.1. Configuring Data Points and Alerts

Data selection restriction: Configure only data point elements, alarm queries and acknowledgement functions that have been explicitly approved for transmission to and processing by Telegram. Do not configure personal, confidential, sensitive, safety-related or security-relevant data. Apply the principle of least privilege, especially for remote writes and alarm acknowledgements.

The "TgBotPanel.pnl" panel provides several configuration fields for mapping data points and alerts. Use a semicolon (;) as delimiter when entering multiple values.

- Choose the username or groupname (representing the Telegram chat ID, only bound usernames are available) you need to assign the datapoints to.

The image shows two configuration panels. The top panel, titled 'Assign DPs', has a 'User name' dropdown menu with 'root' selected. Below it is a text input field for 'DPes for set' containing the string 'System1:AAA.value;System1:AAA.value2;System1:AAA.value3;'. A button labeled 'Assign data points' is positioned below this field. Further down, there is a text input field for 'DPes for trends' containing 'System1:AAA.value;System1:AAA.value2;', followed by another 'Assign data points' button. The bottom panel, titled 'Assign Alerts Subscription', also has a 'User name' dropdown menu with 'root' selected. Below it is a text input field for 'Query' containing the SQL query 'SELECT ALERT '_alert_hdl.._value', '_alert_hdl.._text', '_alert_hdl.._act_state' FROM 'AAA.qqqq''. An 'Assign query' button is below this field. At the bottom of the panel is a text input field for 'DPes for Ack' containing 'System1:AAA.value;System1:AAA.value2;', with an 'Assign dpes for Ack' button below it.

Figure 2-17 Selecting a user/group and assigning datapoints to a user/group

Remote writes and alarm acknowledgements can affect the operation of the WinCC OA system. Enable these functions only after an explicit risk assessment and restrict them to dedicated non-administrative users and approved data point elements.

1. DPEs for set (Writing Values from Telegram)

Define list of data points elements (DPEs) that users can set via telegram chat values for. E.g.:
 "System1:AAA.value;System1:AAA.value2;System1:AAA.value3;"

2. DPEs for trends (Usable in Telegram Trends)

Define list of data points elements which are available for trends in a telegram chat. E.g.:
 "System1:AAA.value;System1:AAA.value2;"

3. Query (Usable for Alert Monitoring in Telegram)

Define SQL-style queries for alert subscription for specific chat. E.g.:

"SELECT ALERT '_alert_hdl.._value', '_alert_hdl.._text', '_alert_hdl.._act_state' FROM 'AAA.qqqq'"

4. DPEs for Ack (Acknowledgment of Alarms in Telegram)

List alerts data points elements that users can acknowledge via Telegram. E.g.:

"System1:AAA.value;System1:AAA.value2;"

2.2.2. Telegram Menu Structure and Button Functionality

Note: Please use datapoints and queries that exists in your project and if you are using the application example refer to section [3.](#) for data point and query details.

1. Navigate to the "Configs" submenu

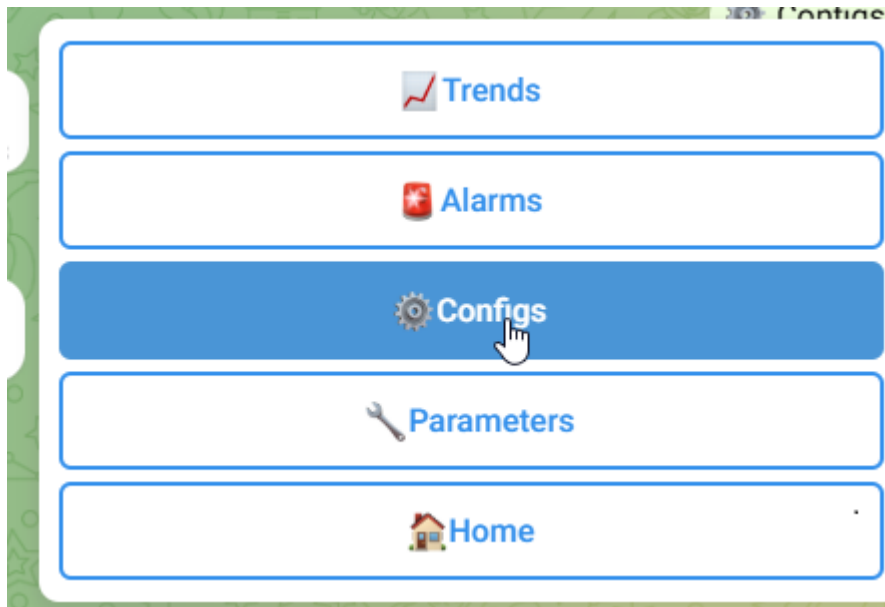


Figure 2-18 Main menu overview

2. Chose the menu option "Trends conf"

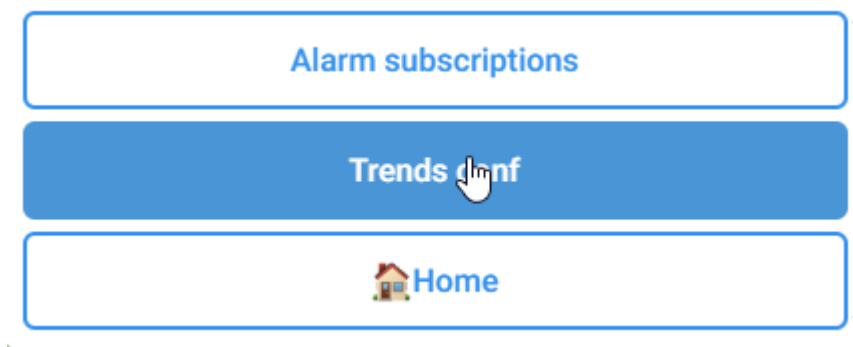


Figure 2-19 Config menu overview

3. Chose the menu option "Add trend"

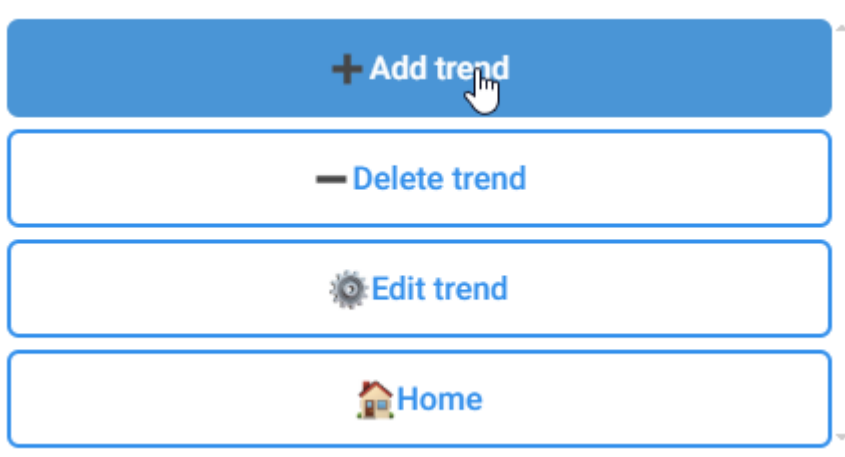


Figure 2-20 Trend's config menu overview

4. Type a name for the new trend

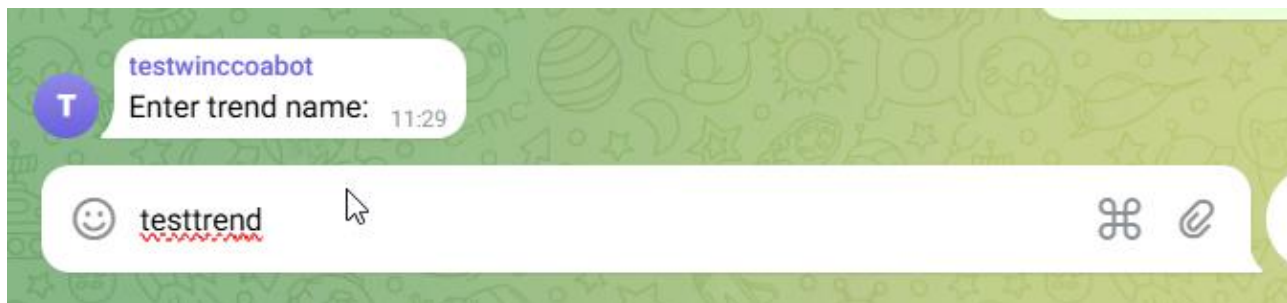


Figure 2-21 Example of creating new trend

5. Add desired data point

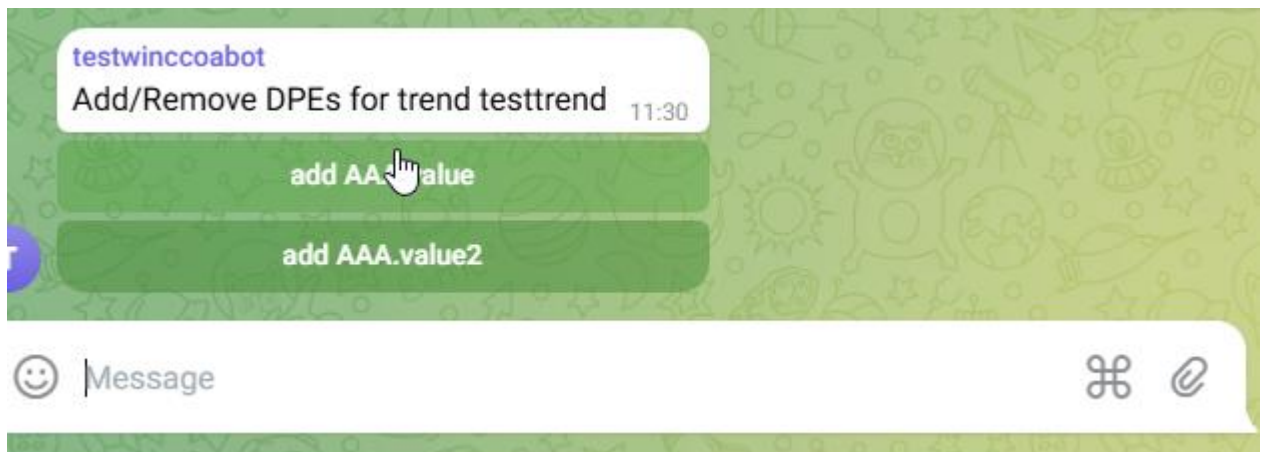


Figure 2-22 Adding datapoints to a trend

6. The trend is now available from the Trend menu

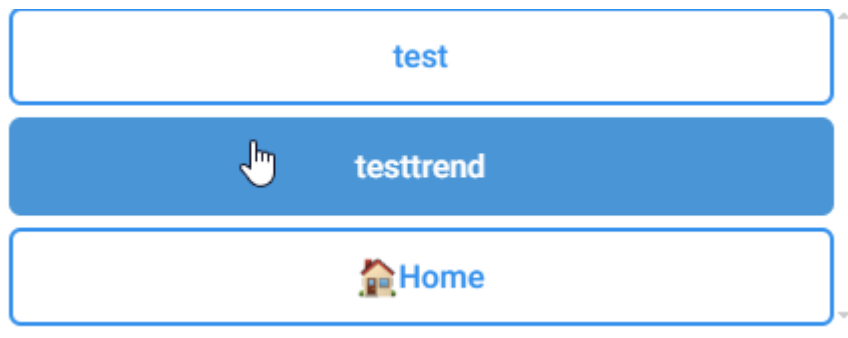


Figure 2-23 List of available trends

7. Choose a time range

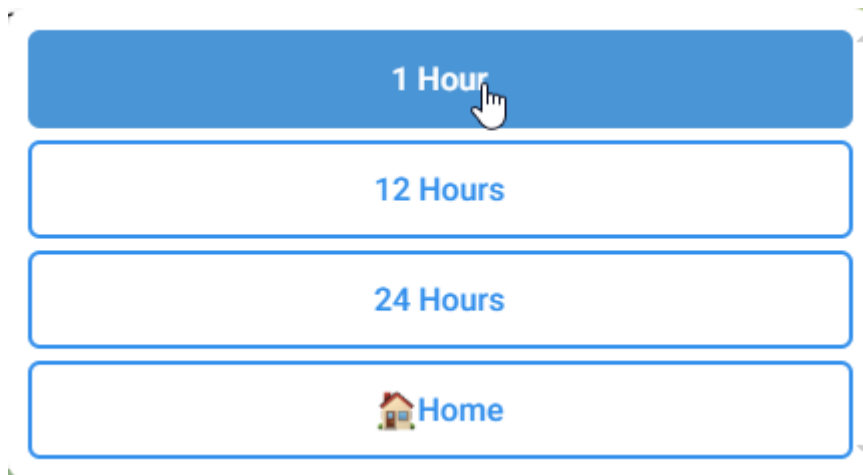


Figure 2-24 List of available predefined time ranges

8. Changes within the time range will be shown, if there were no changes on the datapoints in specified time interval message "There is no data for this period" will appear.

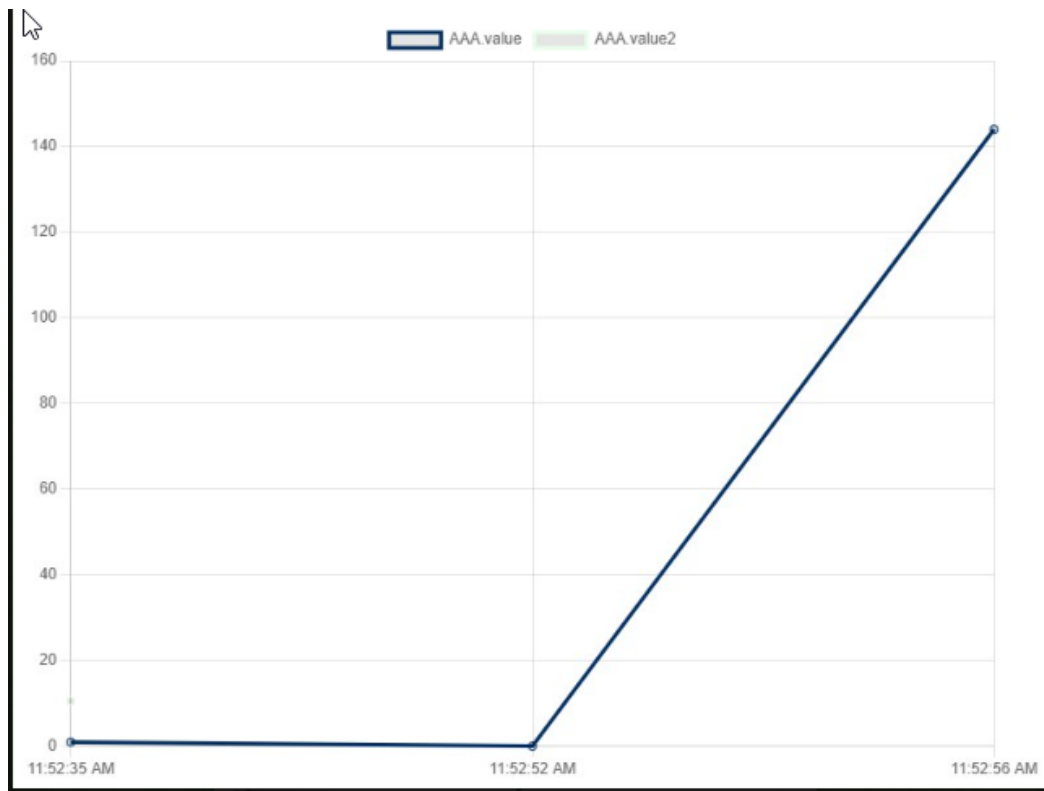


Figure 2-25 Example of a trend

Similarly, users can configure alarms or set values of data points.
Please see next section for a detailed menu overview

2.2.3. Menu Overview

Main Menu

-  Trends: Opens the trends menu, allowing users to analyze data trends.
-  Alarms: Provides alarm-related features.
-  Configs: Opens a submenu with configuration options.
-  Parameters: Enables interaction with system parameters.
-  Home: Returns to the main menu.

Submenus

Configs Menu

- Alarm subscriptions: Manages alarm subscriptions.
- Trends conf: Configures trend analysis.
-  Home: Returns to the main menu.

Trends Time Ranges Menu:

- 1 Hour: Displays trends for the past hour.
- 12 Hours: Displays trends for the past 12 hours.
- 24 Hours: Displays trends for the past 24 hours.
- 🏠 Home: Returns to the main menu.

Trends Conf Menu:

- ➕ Add trend: Adds a new trend.
- — Delete trend: Deletes an existing trend.
- ⚙ Edit trend: Edits trend configuration.
- 🏠 Home: Returns to the main menu.

2.2.4. Functional Descriptions

Trends

- **Purpose:** Displays trends for specified time ranges.
- **User Interaction:** User selects a preconfigured trend and a time range, and the bot retrieves trend data.

Alarms

- **Purpose:** Displays current alarms list.
- **User Interaction:** Users interact with alarms, acknowledgement as needed.

Configs

- **Purpose:** Provides configuration options for alarms and trends.
- **Note:**
 - For trends: “_archive” config needs to be set on the data points to be able to use trends.
 - For alarms: By default, all the alarms are unmuted, and we can mute them using the bot config menu
- **User Interaction:** User navigates through options to create, delete, edit trends or to mute/unmute alarms.

Parameters

- **Purpose:** Allows users to set values for datapoint elements.
- **User Interaction:** User uses inline buttons for setting new values.

Note If an interaction involves modifying a previous message from the bot (e.g., updating a button state after user action), avoid performing the interaction twice to prevent conflicts. If the same interaction is executed twice, it may attempt to modify the already updated message, leading to errors. In such cases, restart the manager to reset the state and ensure consistent behavior.

3. Usage example

The attached example project provides preconfigured a WinCC OA dashboard and a simulation of several values.

For demonstration purposes of this functionality next steps should be done:

1. Run the attached project: "applicationexample"
2. Navigate to the folder "<PROJ_PATH>/javascript/tgBot" and execute powershell command "npm install"
3. Run the GEDI and start the panel "TgBotPanel.pnl" from "applicationexample/panels"
4. Set the API key and follow the steps in section [2.1.6.](#)
5. Start the "JavaScript Manager" through console

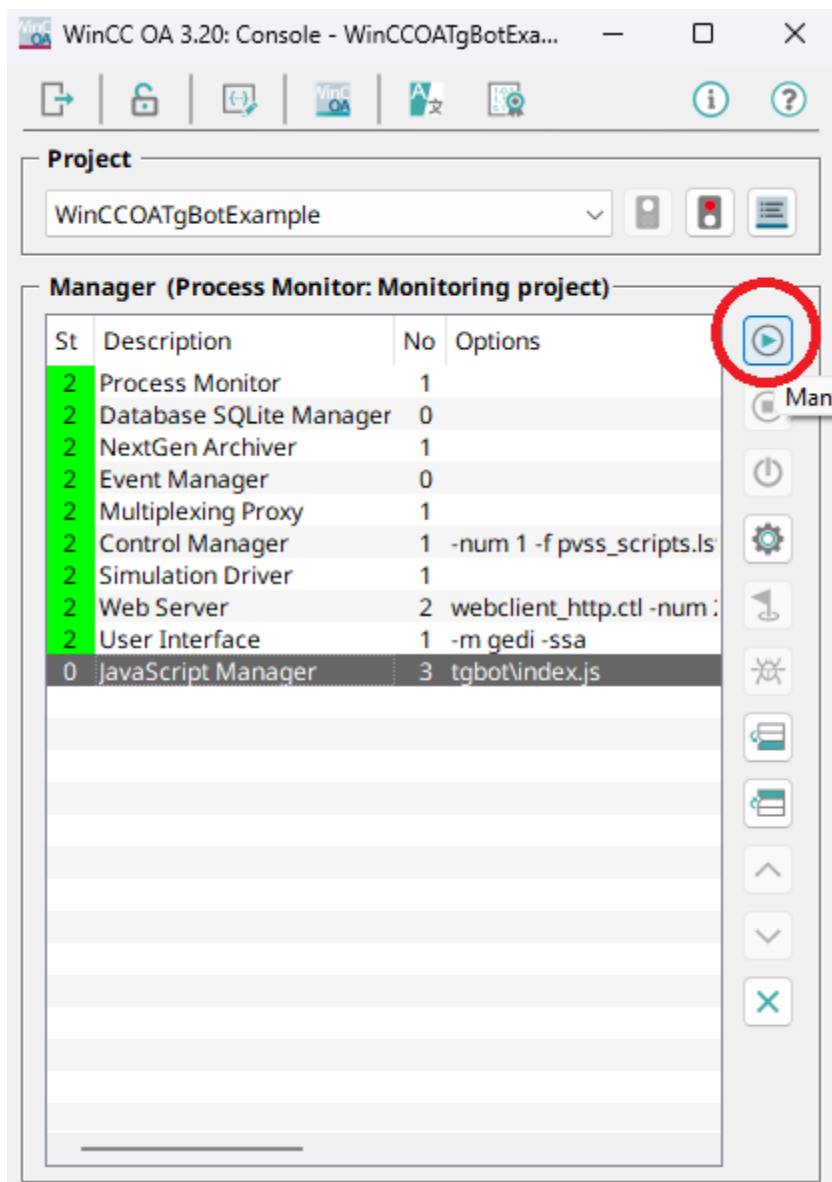


Figure 3-1 Managers overview

4. Appendix

Important WinCC OA specific abbreviations

Acronym	Long form	Meaning
WinCC OA	Simatic WinCC Open Architecture	A SCADA system for visualizing and operating of processes, production flows, machines and plants in all lines of business. Distributed systems enable any number of stand-alone systems, from 2 to 2048, to be linked via a network. Each subsystem can be configured either as a single-user or multi-user system, redundant or not, in each case.
DPT	Data point type	Object definition (class) of a structured data object as mapping of a real device. Single data points (instances) are derived from the DPT. Therefore, the data point type is a form of template.
DP	Data point	Structured, device-oriented data object as representation of a real device within the control system. A data point contains one or more data point elements (process variables).
DPE	Data point element	Single process information within a device-oriented data point. Each DPE corresponds to a value/state. In addition to the value, there are DPE attributes like time stamp, quality information or origin.
GEDI	Graphic Editor GEDI	Graphic Editor. It is used both for drawing of process images ("panels") as well as for designing of symbols, dialogs, and scripting.
PARA	Configuration Tool	Editor for the creation and configuration of data point types, data points, and data point elements as well as their configs.
ASCII	American Standard Code for Information Interchange	Standardized protocol for storage and transfer of characters/text. In WinCC OA, the acronym also refers to the database import/export manager. It is a module to export and import configurations as ASCII files. Mass configuration can therefore be carried out in a spread sheet program (for example MS Excel), file editor, or in an external database.
D	Driver Manager ("Driver")	Interface for connecting controllers (PLC, DDC, ...) fieldbuses and telecontrol systems. A driver handles the communication via an external protocol and enables the exchange of information with WinCC OA. The processing of data from the "field" to WinCC OA contains event orientation, old/new comparison, transformation, conversion, and smoothing. The protocol of the Driver must be the same as the protocol of the "field" device. Furthermore, the connection (how to reach the device) must be configured in WinCC OA. For exchanging data, a periphery address

must be configured on a corresponding DPE.

CTRL	Control Manager ("Scripting")	Processing unit that allows to process user specific logic / business logic (control scripts). Control possesses an easy to learn syntax (similar to ANSI-C) and is processed by an interpreter (CTRL Manager).
------	-------------------------------	---

Table 4-1 WinCC OA specific abbreviations

Service and support

WinCC OA Extended Services

Do you have questions about WinCC OA projects, need additional features, or require technical assistance? ETM provides 24/7 access to our complete service and support expertise for WinCC OA.

Our range of services includes the following:

- Extended Services provide tailored support for your evolving needs
- All kind of analysis/troubleshooting for older WinCC OA versions than our current mainline
- Project startup workshop
- Architecture definition
- Project engineering assistance with dedicated contact person
- Special project developments (special requirements, web widgets, gateways, etc.)
- WinCC OA library development assistance
- Project or architecture reviews with report
- Project-specific problem or performance analysis
- Project upgrade (analysis with report, assistance during upgrade, etc.)
- Assistance for complex error reproduction scenarios
- On-site assistance for any tasks related to WinCC OA and their components
- 24/7 on-duty assistance or priority callback for certain time range
- Database support Oracle®, InfluxDB®, PostgreSQL® and MS SQL®
- Raima/HDB to SQLite/NGA migration
- Setup and consulting for WinCC OA Add-ons e.g., APM, AMS, DRS, ...
- WinCC OA Security services (as per the WinCC OA Security Guideline, NIS2)
- Tests on unsupported platforms (e.g., unsupported OS)
- Individual Workshops (driver workshop, UI workshop, business logic, etc.)
- Factory Acceptance Test (FAT)/Site Acceptance Test (SAT) assistance
- Creating of prototypes, proof of concepts, demos, etc.
- Project tender analysis and evaluation of projects

You can find detailed information on our range of services in the service catalog web page:

www.winccoa.com/documentation/WinCCOA/latest/en_US/Support/topics/support_extendedServices.html

SiePortal

The integrated platform for product selection, purchasing and support - and connection of Industry Mall and Online support. The SiePortal home page replaces the previous home pages of the Industry Mall and the Online Support Portal and combines them.

- **Products & Services**
In Products & Services, you can find all our offerings as previously available in Mall Catalog.
- **Support**
In Support, you can find all information helpful for resolving technical issues with our products.
- **mySieportal**
mySiePortal collects all your personal data and processes, from your account to current orders, service requests and more. You can only see the full range of functions here after you have logged in.

You can access SiePortal via this address:

sieportal.siemens.com

Technical Support

The Technical Support of Siemens Industry provides you fast and competent support regarding all technical queries with numerous tailor-made offers.

– ranging from basic support to individual support contracts. Please send queries to Technical Support via Web form:

siemens.com/SupportRequest

WinCC OA – Training and Certification

To fully leverage the flexibility and openness of WinCC OA, we offer a wide range of training courses, from beginner to expert levels. Our modules cover various topics, with options for individual training. For WinCC OA partners, completing specific courses is required to obtain or maintain partner status, ensuring the highest level of expertise and support.

For more information on our offered trainings and courses, as well as their locations and dates, refer to our web page:

www.winccoa.com/support/training.html

Change documentation

Version	Date	Modifications
V1.0	4/2025	First version
V1.1	9/2026	Updated dependencies, security and data-protection information, and installation instructions

Table 4-2 Change Documentation

Published by
Siemens AG
DI FA HMI ISW ETM

Marktstrasse 3
7000 Eisenstadt
Austria

E-mail: wincc_oa.at@siemens.com

Web: www.siemens.com/wincc-open-architecure

For the U.S. published by
Siemens Industry Inc

100 Technology Drive
Alpharetta, GA 30005
United States

Subject to changes and errors. The information given in this document only contains general descriptions and/or performance features which may not always specifically reflect those described, or which may undergo modification in the course of further development of the products. The requested performance features are binding only when they are expressly agreed upon in the concluded contract.